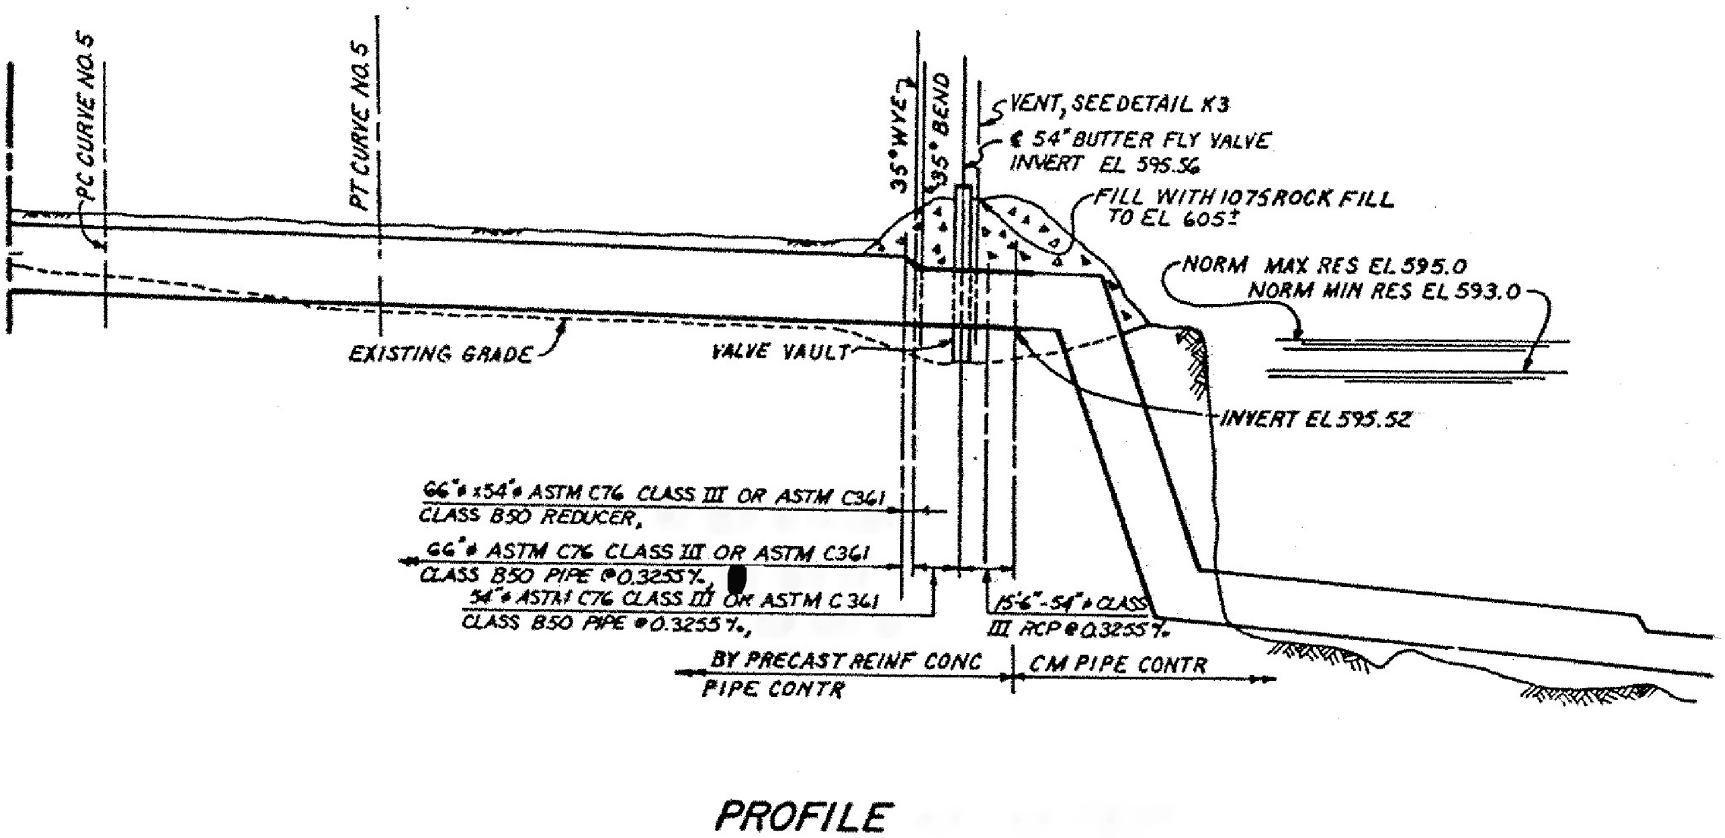

FIGURE 3.4-3
Cooling Tower Blowdown Pipe Profile at Discharge