

Bellefonte Nuclear Plant, Units 3 & 4
COL Application
Part 3, Environmental Report

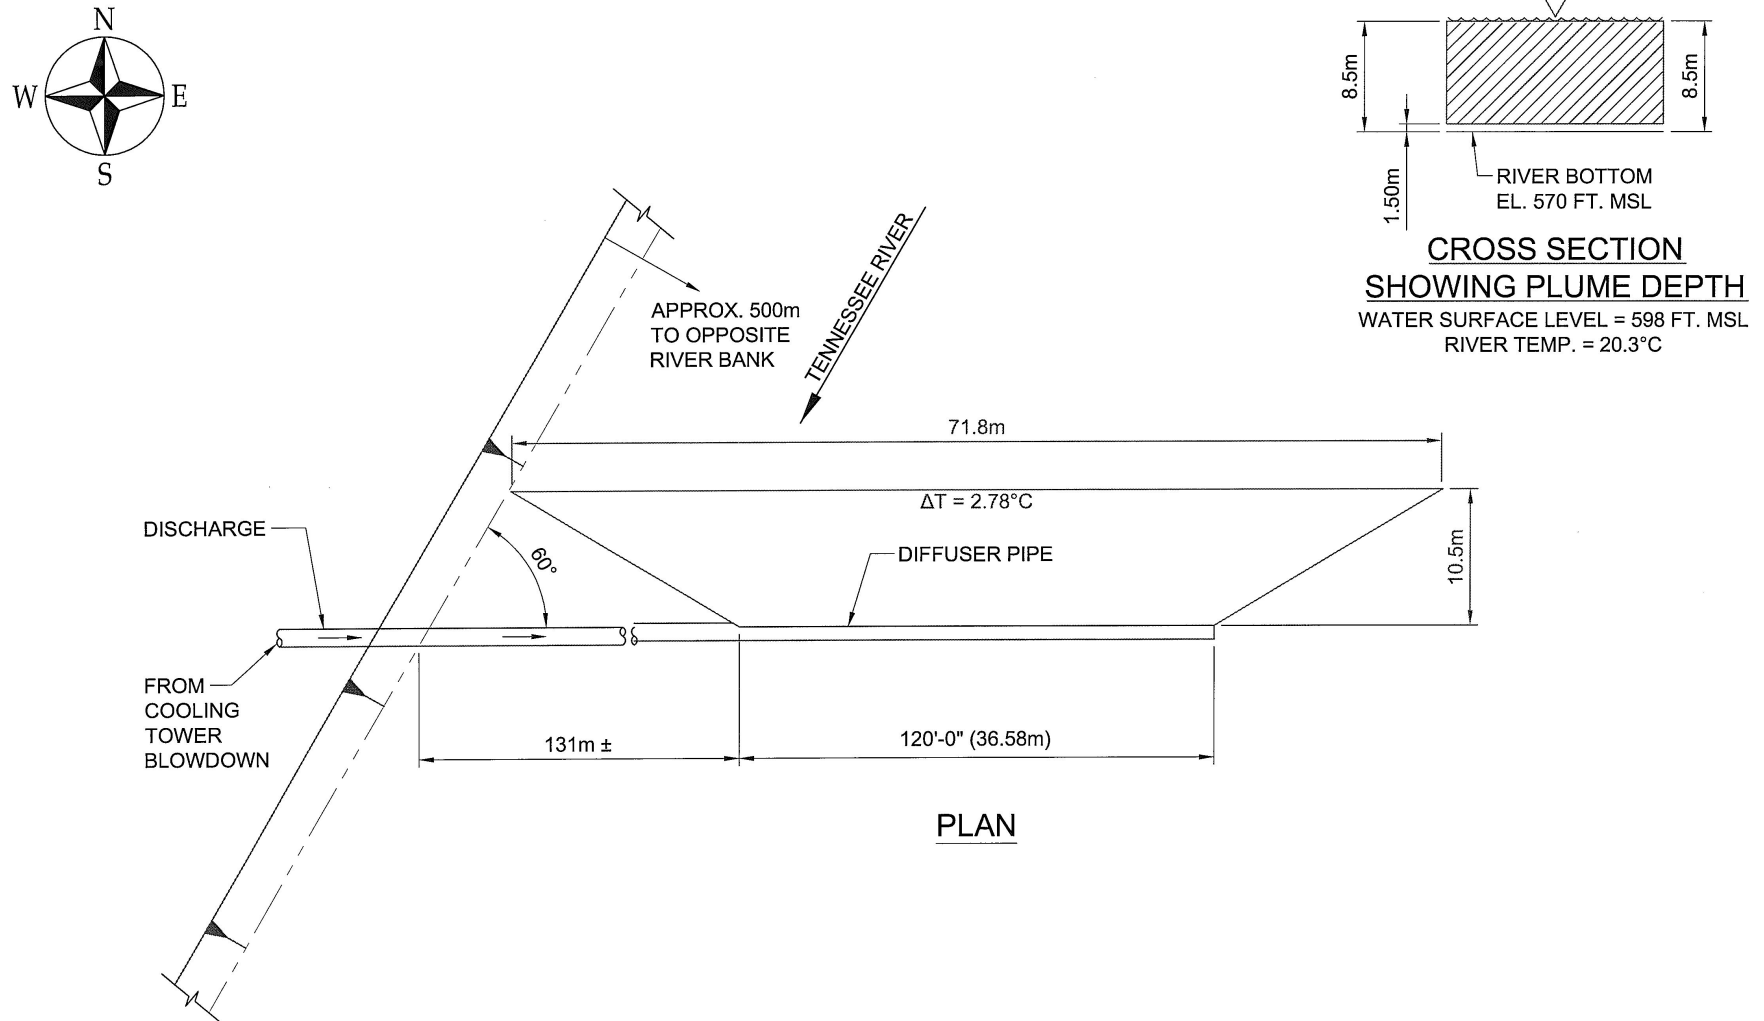


FIGURE 5.3-10
Mean River Temperature, Maximum Reverse River Flow