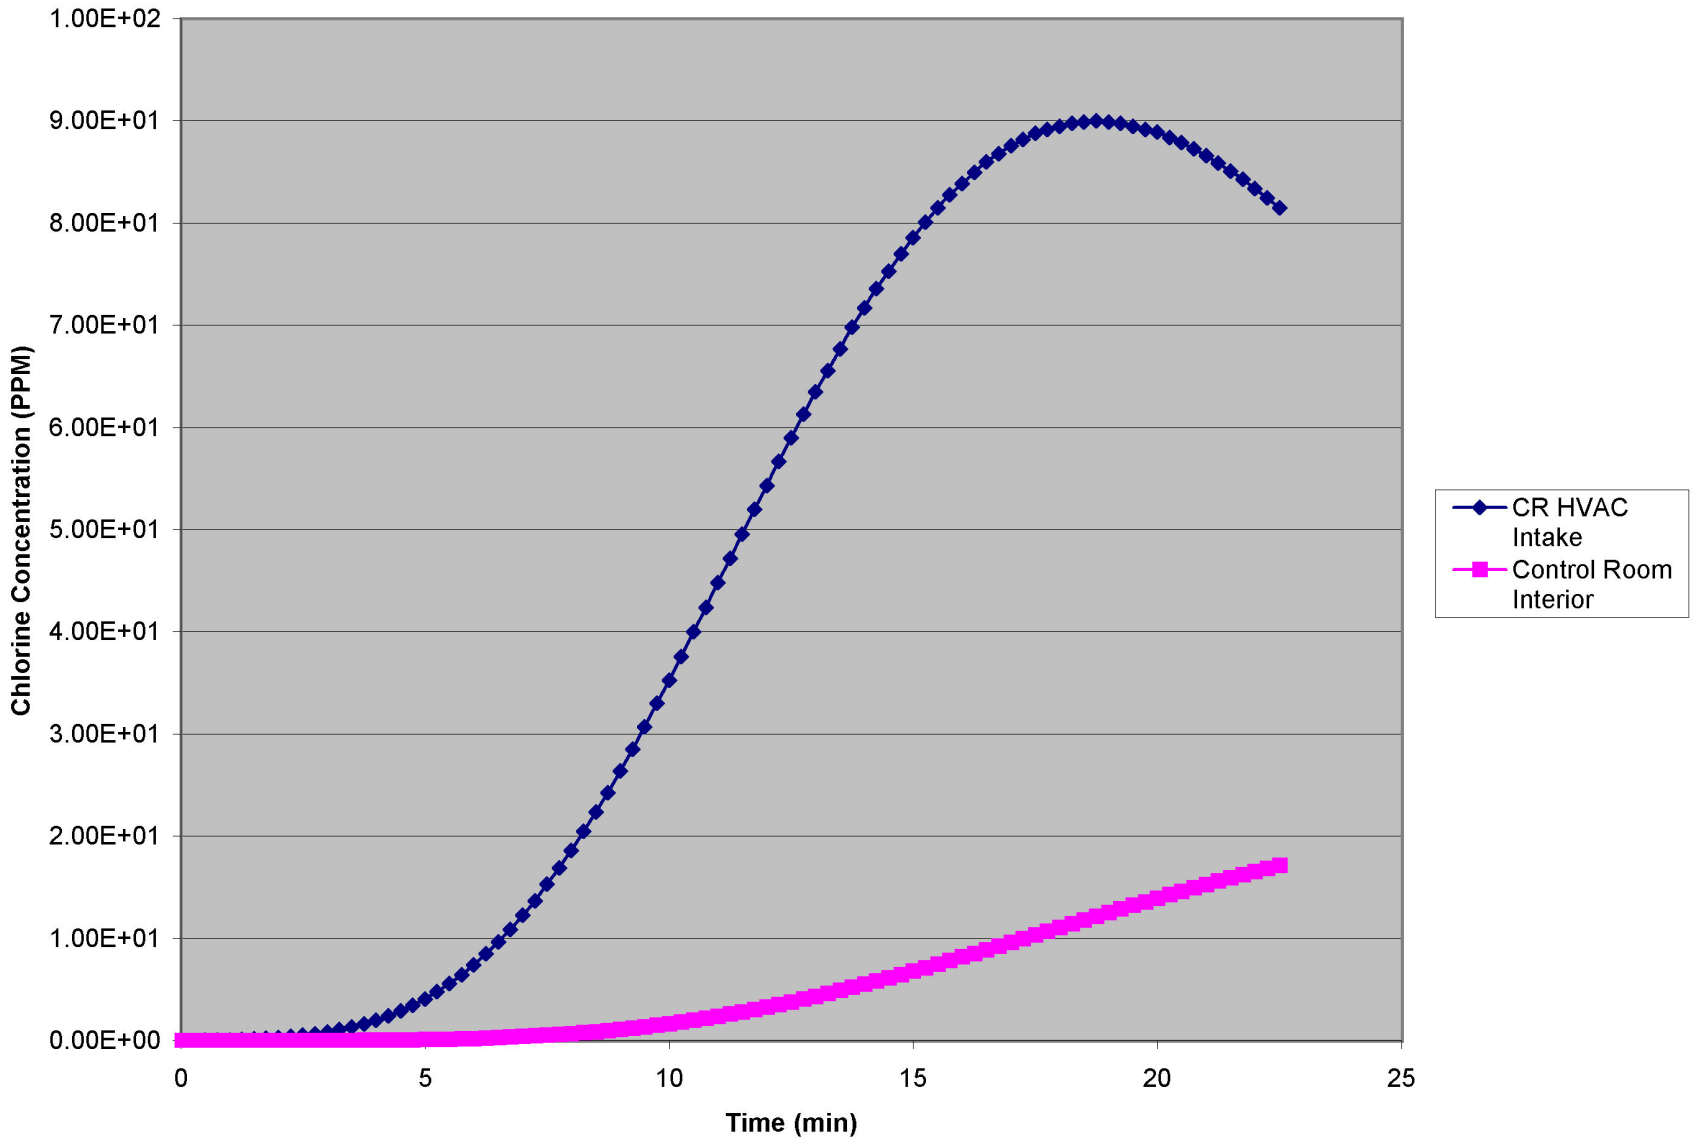

FIGURE 6.4-201
Control Room Chlorine Concentration (No Mitigating Actions)