



NOTES

- 1. SEE SHEET 2 FOR TRASH RAKE, TRAVELING SCREEN AND SCREEN WASH PUMP.
- 2. ALTERNATE GRAVITY FLOW MAKE UP TO SWS COOLING TOWER BASIN PER AP1000 DCD 9.2.1.2.2.

ABBREVIATIONS

- DTS DEMINERALIZED WATER TREATMENT SYSTEM
- FPS FIRE PROTECTION SYSTEM
- RWS RAW WATER SYSTEM
- SWS SERVICE WATER SYSTEM

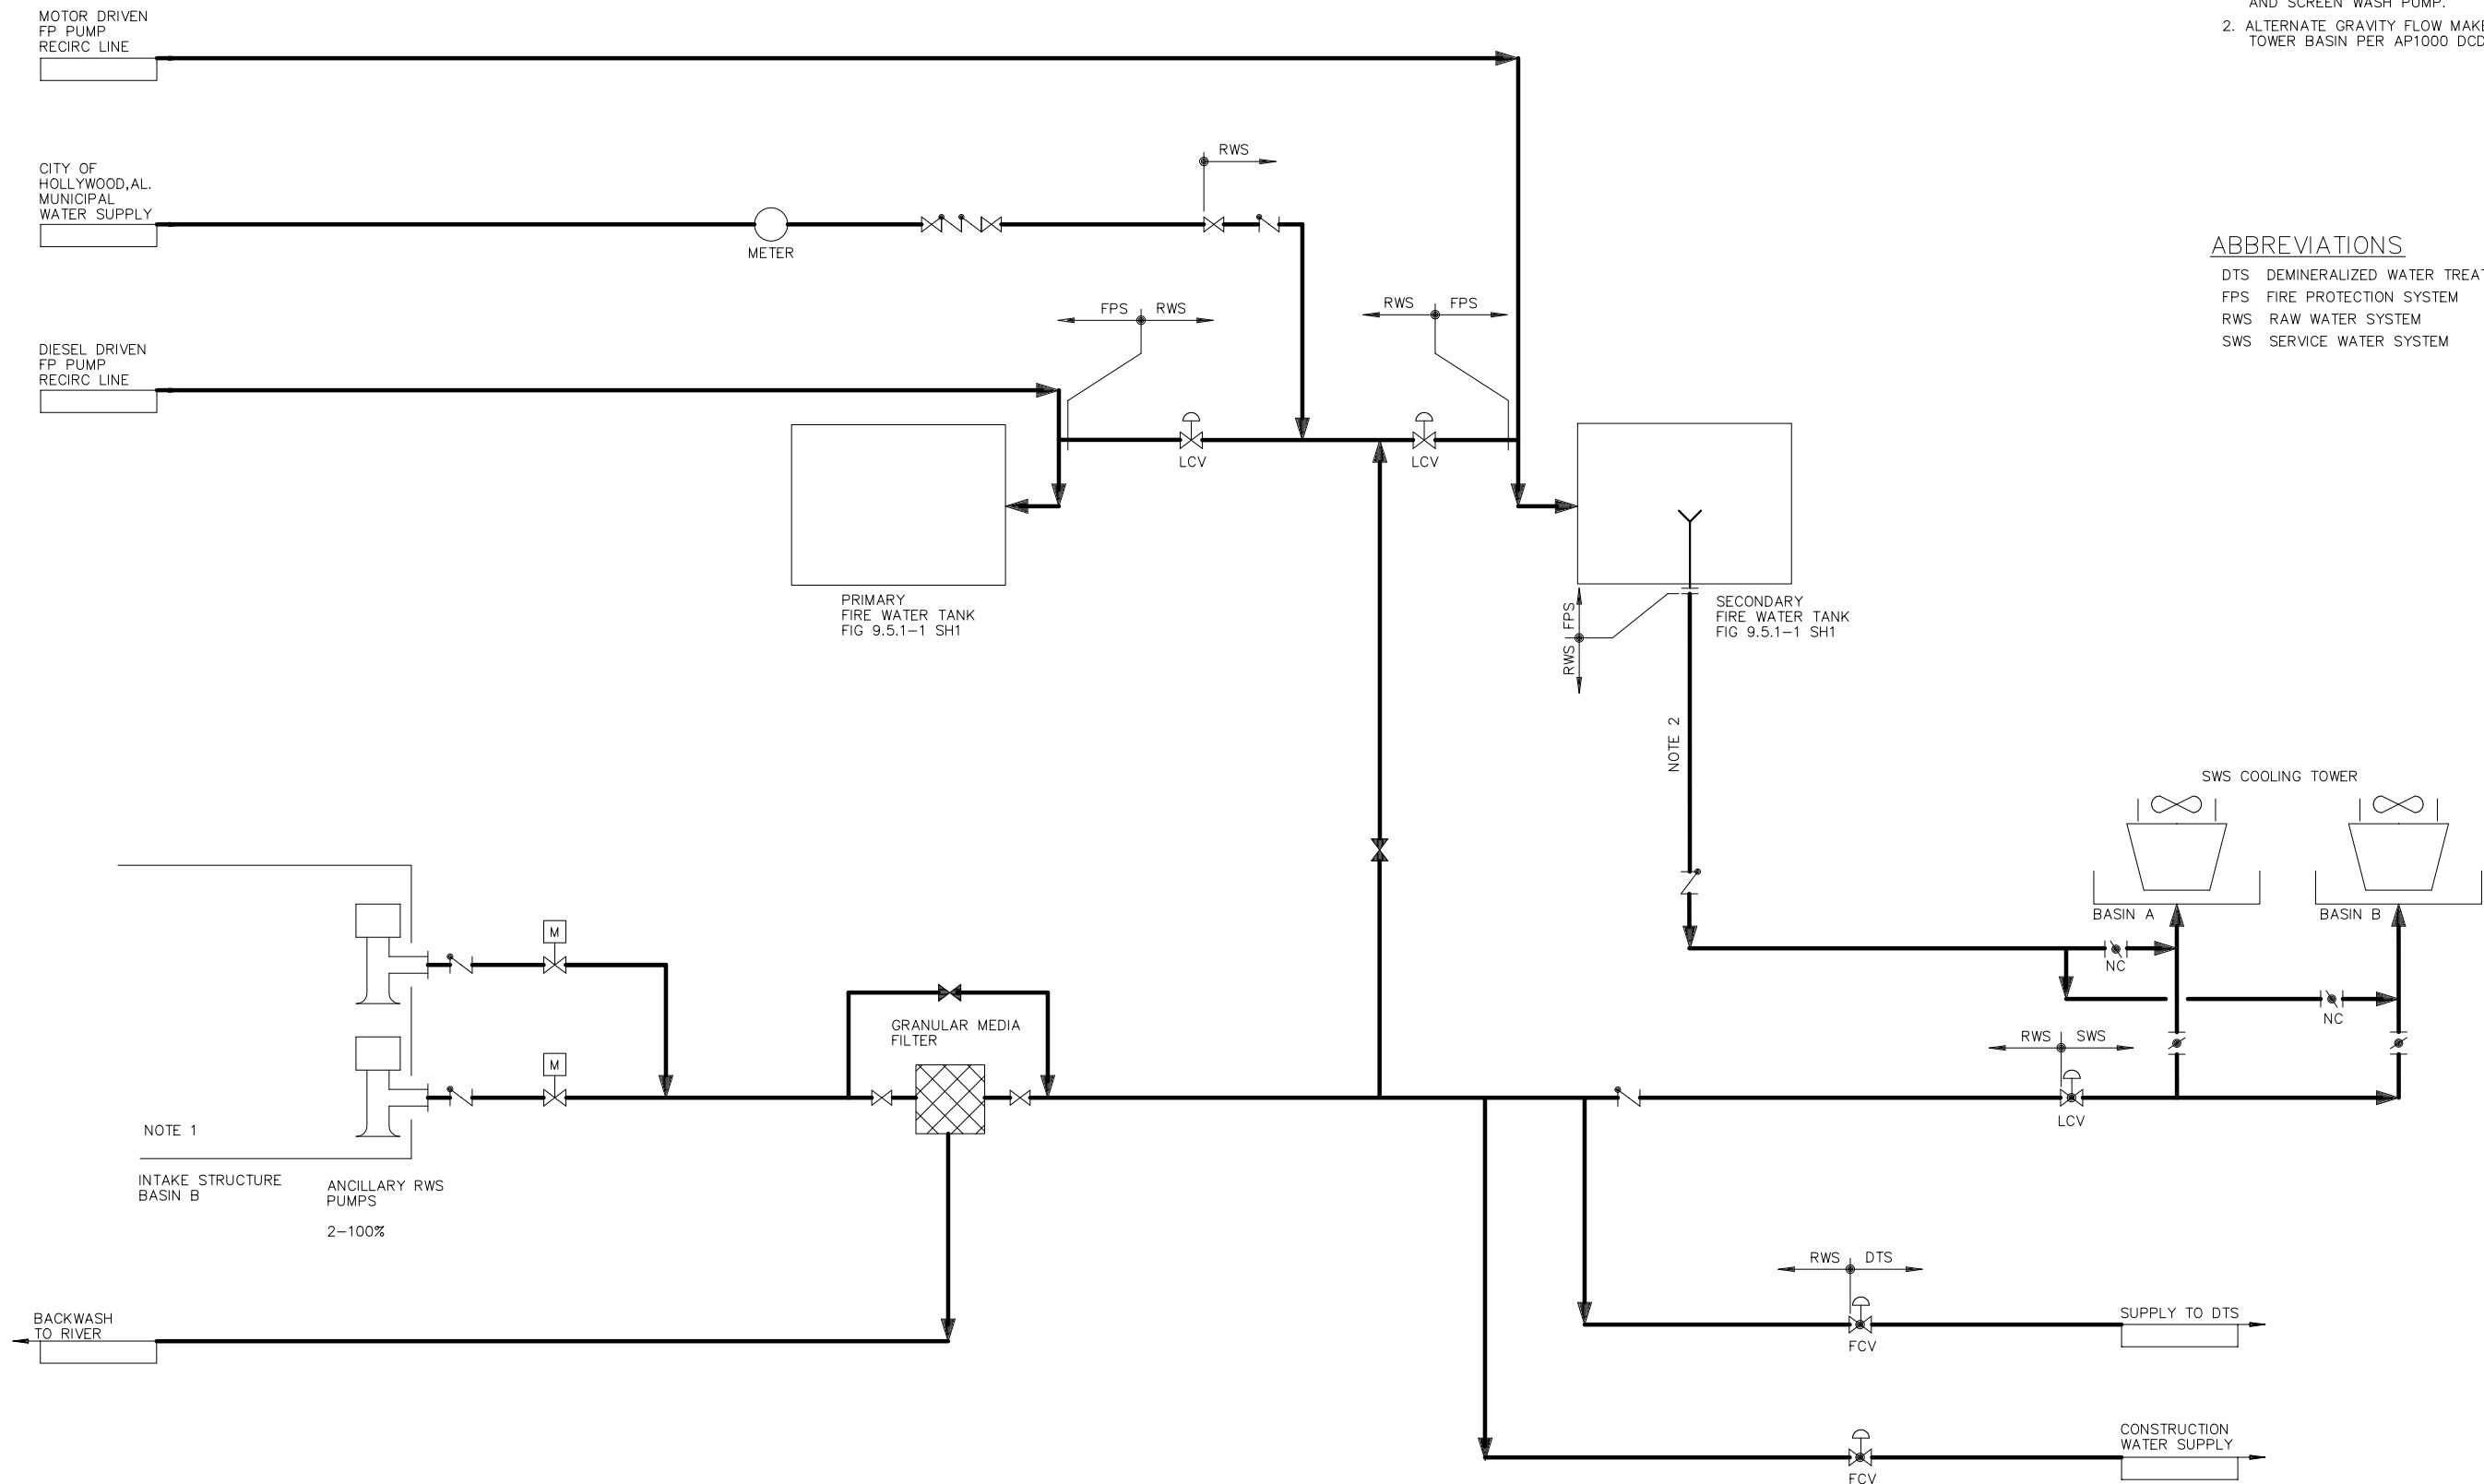

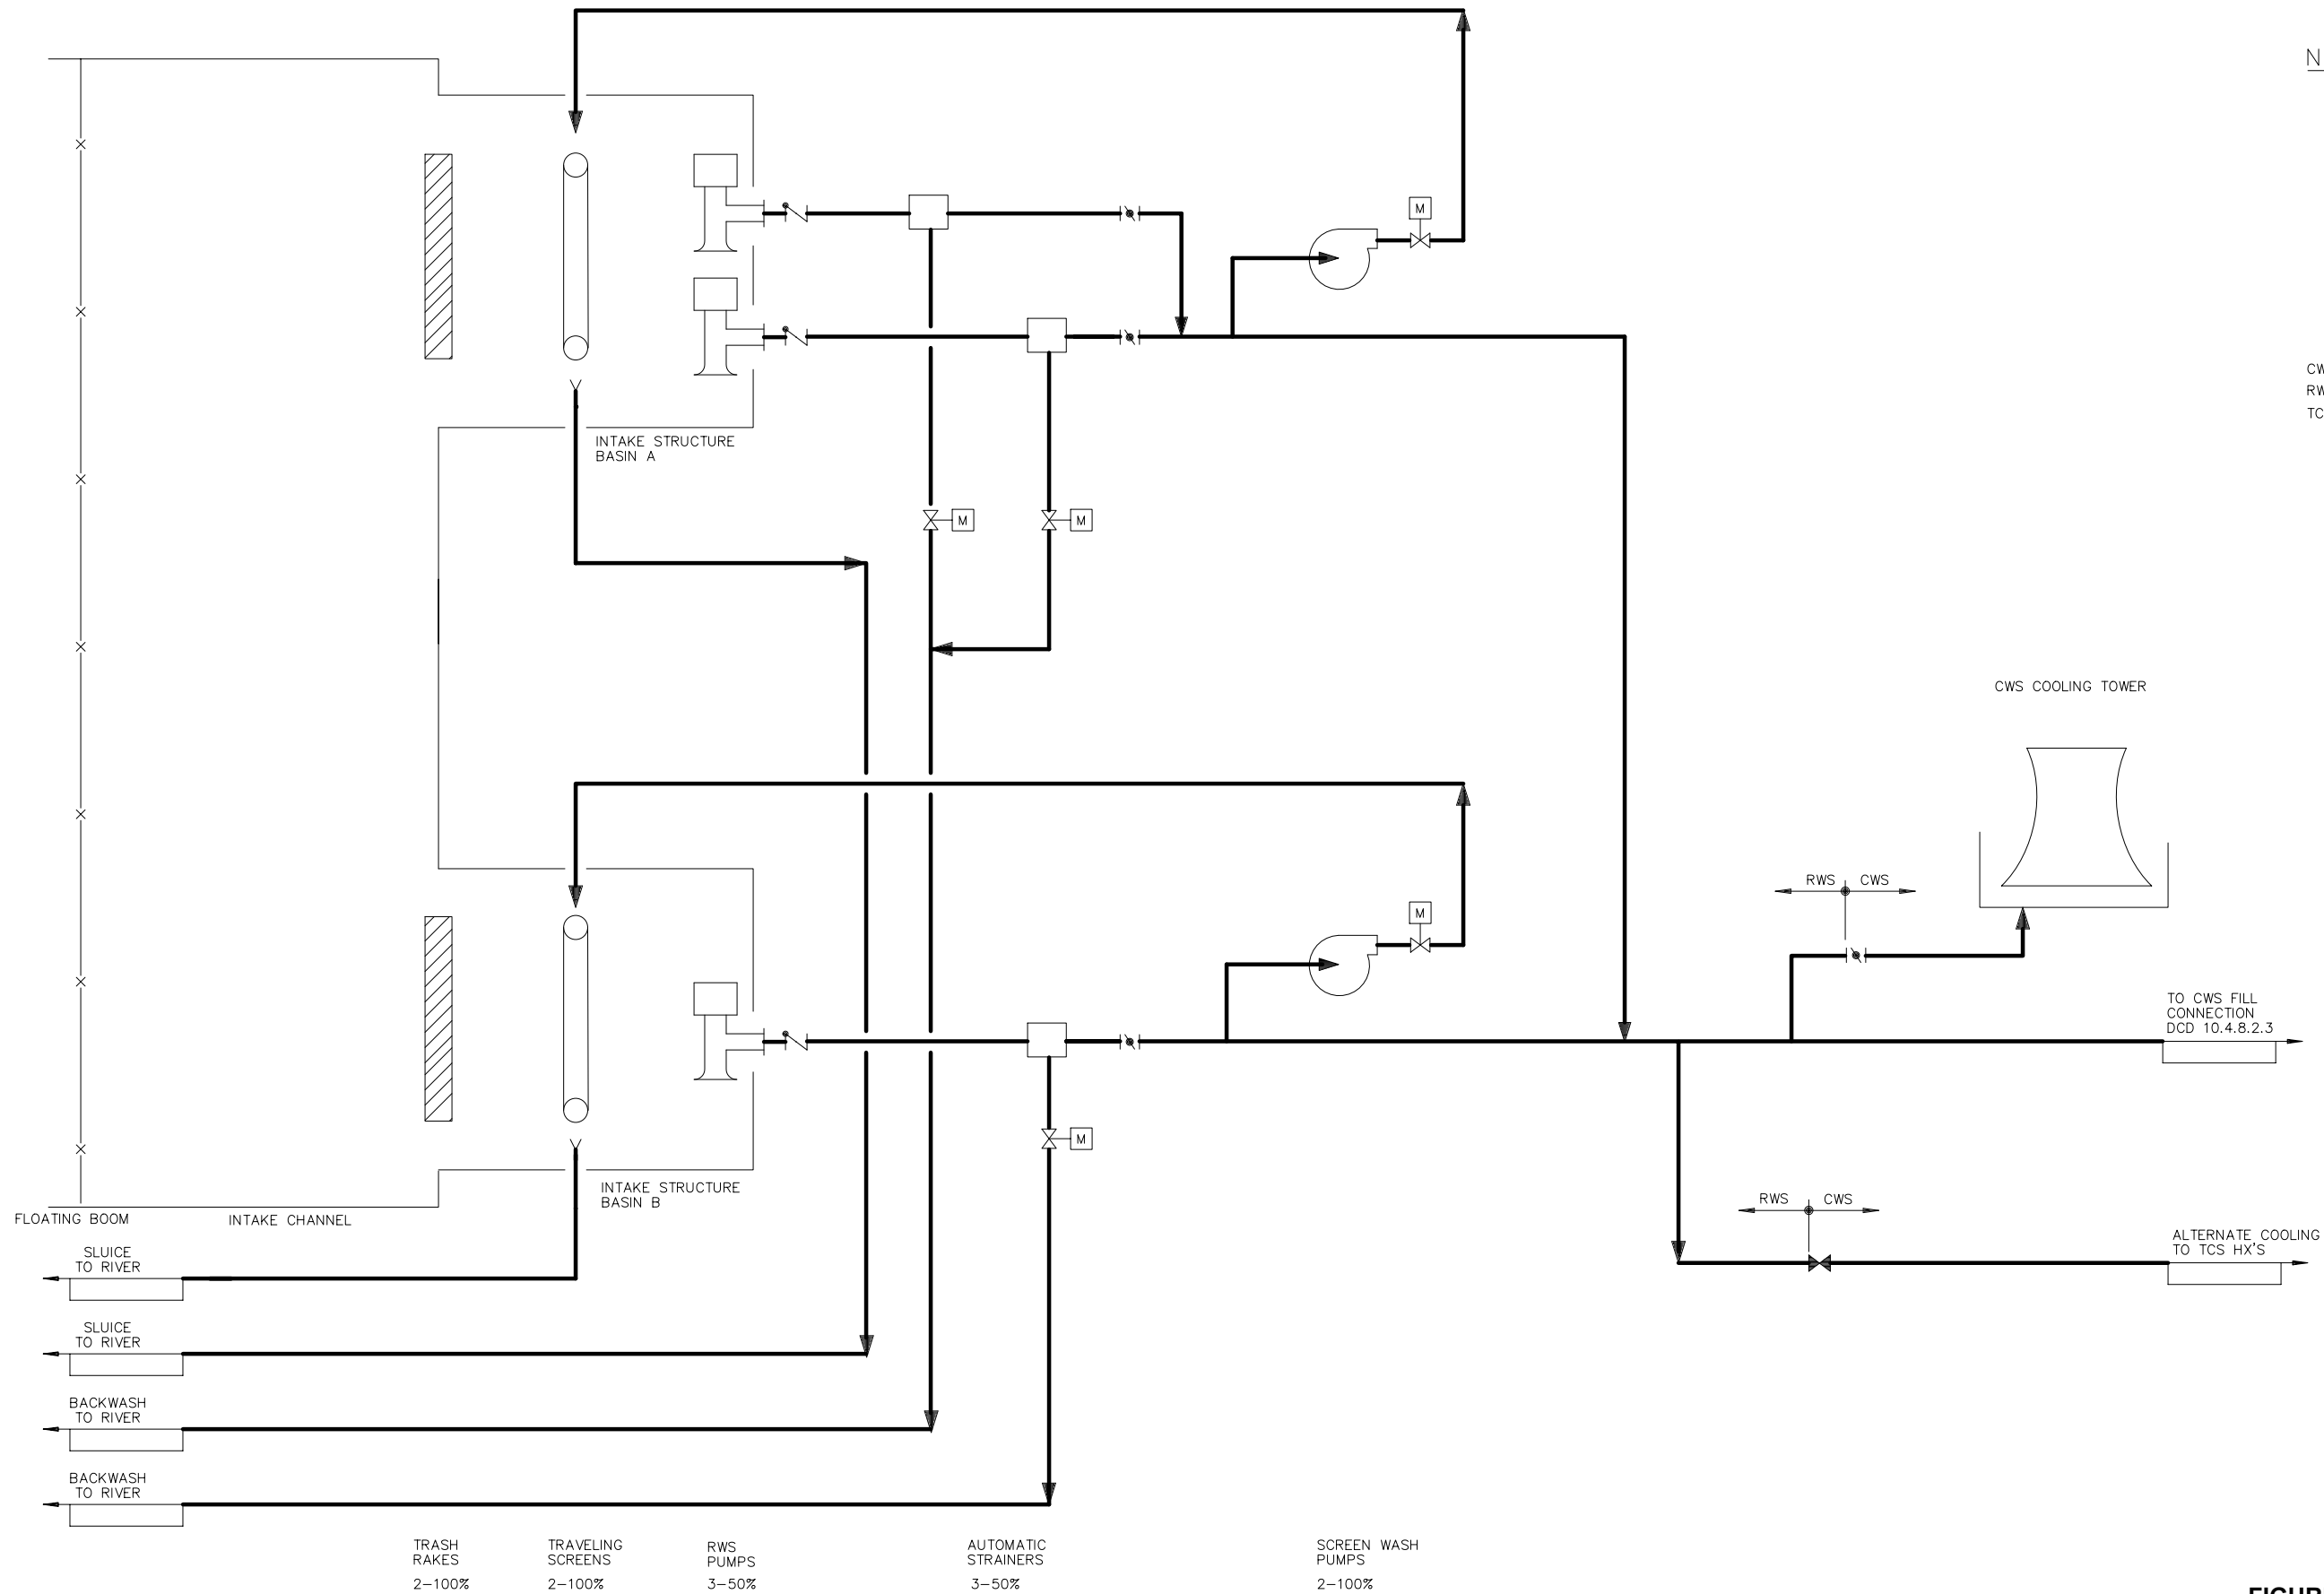

NOTES

ABBREVIATIONS

- CWS CIRCULATING WATER SYSTEM
- RWS RAW WATER SYSTEM
- TCS TURBINE BUILDING CLOSED COOLING WATER SYSTEM