


Rancho Seco

Final Status Survey Summary Report


November 5, 2007

Waste Gas Valve Gallery Floor and Lower Walls (Room 059)

Survey Unit F8130231

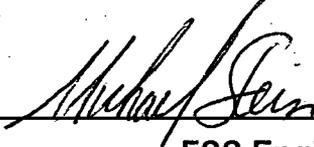Prepared By:  Date: 11/5/2007
FSS Engineer

Reviewed By:  Date: 11/5/07
Lead FSS Engineer

Approved By:  Date: 11-14-07
Dismantlement Superintendent, Radiological

FINAL STATUS SURVEY SUMMARY REPORT

Survey Unit:

F8130231, Waste Gas Valve Gallery Floor and Lower Walls (Room 059)

Survey Unit Description:

Operating History: The Waste Gas Valve Gallery is located on the -20' elevation of the Auxiliary Building. The Auxiliary Building is a reinforced concrete structure that, during power operations, contained the Radwaste processing and supporting systems. The building has six main elevations. Residual levels of surface radioactivity were detected on all interior elevations of the building. Operating records and the HSA document several events with the potential for a release of radioactivity inside this structure.

Site Characterization: Direct measurements were taken on each interior elevation of the Auxiliary Building. These measurements confirmed the presence of plant-derived radionuclides. Direct measurements taken on the -20' elevation, showed a mean gross activity level of 247,831 dpm/100 cm² and a maximum value of 10,080,000 dpm/100 cm². Based on the classification procedure (DSIP-0020) and levels of gross activity reported, the interior surfaces of the Auxiliary Building were determined primarily to be a Class 1 for the floors and lower walls (bottom 2 meters of the walls), and Class 2 for the upper walls and ceiling. Inside the Waste Gas Valve Gallery there were a number of areas on the floor where the gross surface activity levels were higher than the DCGL prior to remediation. Therefore, a Class 1 final status survey was performed on the floor and lower wall surfaces of the room.

HSA Events: HSA Report pg. 63.

Survey Unit Design Information:

The Survey Unit Design Parameters are presented in Table 1 below. The survey unit and measurement locations are depicted on the maps in Attachment 1. Direct measurement locations were determined using a random-start, fixed grid pattern and 43 m² were scanned for approximately 100% coverage. Samples of removable contamination were collected at each direct measurement location. The instrumentation used for the survey along with the MDC values are listed in Tables 2-1 and 2-2 in Attachment 2.

Table 1. Survey Unit Design Parameters

| Survey Design Parameter | Value | Comment |
|--|---------------|---------------------------------------|
| Survey Area: | F813 | Waste Gas Valve Gallery (Room 059) |
| Survey Unit: | 0231 | Structure Surface |
| Class: | 1 | LTP Table 5-4 |
| SU Area (m²): | 43 | |
| Evaluator: | Michael Stein | |
| DCGL (dpm/100 cm²): | 43000 | Gross Activity DCGL |
| Area Factor: | 6.3 | Class 1 |
| Design DCGL_{emc} (dpm/100 cm²): | 270900 | Class 1 |
| LBGR (dpm/100 cm²): | 21500 | Default = 50% DCGL |
| Design Sigma (dpm/100 cm²): | 12035 | |
| Type I Error: | 0.05 | |
| Type II Error: | 0.05 | |
| Predominant Nuclide: | Cs-137 | |
| Sample Area (m²): | 2.5 | Class 1 |
| Scan Area (m²): | 43 | |
| Scan Coverage (%): | 100% | Class 1 |
| Z_{1-α}: | 1.645 | |
| Z_{1-β}: | 1.645 | |
| Sign P: | 0.96407 | |
| Calculated Relative Shift: | 1.7 | |
| Relative Shift Used: | 1.7 | Uses 3.0 if Relative Shift is >3 |
| N-Value: | 14 | |
| Design N-Value + 20%: | 17 | NUREG-1575 Table 5-5 |
| Design Min Samples N: | 17 | Class 1 |
| Grid Spacing L: | 1.6 | Class 1 |

Survey Results:

A total of 24 direct measurements were made in F8130231. The results including mean, median, standard deviation and range are shown in Table 2. All direct measurements were less than the DCGL. None of the scan measurements indicated areas of elevated activity. Scan activity ranged from 3,110 to 34,237 dpm/100 cm², based on a surveyor efficiency of 0.5 and no background subtracted. Samples for removable surface activity were all less than 10% of the DCGL as shown in Table 3. Removable surface activity samples were counted for alpha activity and none was detected at the MDC shown in Table 2-1 of Attachment 2.

Table 2. Direct Measurement Results

| Measurement ID | Gross Activity (dpm/100 cm ²) |
|---------------------|---|
| F8130231-C0001BD | 1463 |
| F8130231-C0002BD | 1603 |
| F8130231-C0003BD | 1468 |
| F8130231-C0004BD | 1110 |
| F8130231-C0005BD | 1660 |
| F8130231-C0006BD | 1774 |
| F8130231-C0007BD | 1406 |
| F8130231-C0008BD | 1982 |
| F8130231-C0009BD | 1390 |
| F8130231-C0010BD | 1499 |
| F8130231-C0011BD | 1380 |
| F8130231-C0012BD | 1452 |
| F8130231-C0013BD | 1463 |
| F8130231-C0014BD | 1364 |
| F8130231-C0015BD | 1546 |
| F8130231-C0016BD | 1333 |
| F8130231-C0017BD | 1567 |
| F8130231-C0018BD | 2018 |
| F8130231-C0019BD | 1608 |
| F8130231-C0020BD | 1499 |
| F8130231-C0021BD | 2101 |
| F8130231-C0022BD | 2972 |
| F8130231-C0023BD | 8626 |
| F8130231-C0024BD | 2433 |
| Mean: | 1947 |
| Median: | 1522 |
| Standard Deviation: | 1478 |
| Range: | 1110 - 8626 |

Table 3. Removable Surface Activity Results

| Measurement ID | Surface Beta Activity (dpm/100 cm²) |
|-----------------------|---|
| F8130231C0001SM | 4.86 |
| F8130231C0002SM | 6.14 |
| F8130231C0003SM | 2.29 |
| F8130231C0004SM | 6.14 |
| F8130231C0005SM | 9.98 |
| F8130231C0006SM | 11.27 |
| F8130231C0007SM | 6.14 |
| F8130231C0008SM | 7.42 |
| F8130231C0009SM | 12.55 |
| F8130231C0010SM | 7.42 |
| F8130231C0011SM | 1.01 |
| F8130231C0012SM | -0.27 |
| F8130231C0013SM | 2.29 |
| F8130231C0014SM | 3.58 |
| F8130231C0015SM | 7.42 |
| F8130231C0016SM | 7.42 |
| F8130231C0017SM | 2.29 |
| F8130231C0018SM | 15.11 |
| F8130231C0019SM | 8.7 |
| F8130231C0020SM | 6.14 |
| F8130231C0022SM | 11.27 |
| F8130231C0023SM | 20.24 |
| F8130231C0024SM | 15.11 |
| Mean: | 7.59 |
| Median: | 7.42 |
| Standard Deviation: | 5.01 |
| Range: | -0.27 to 20.24 |

Survey Unit Data Assessment:

The survey design required 17 direct measurements for the Sign Test. In actuality 24 direct measurements were obtained. The critical value and the results of the Sign Test are presented in Table 4. The sample mean and median values were less than the DCGL. The sample standard deviation was less than the design standard deviation so no additional samples were required.

Table 4. Data Assessment Results

| Survey Results Parameter | Value | Comment | |
|---|--------------|-------------------------|-----------------------------------|
| Material Background Used (dpm/100 cm ²): | N/A | Average Ambient BKG = 0 | |
| Ambient Background Used (dpm/100 cm ²): | N/A | | |
| Actual Direct Measurements (N): | 24 | | |
| Median (dpm/100 cm ²): | 1522 | | |
| Mean (dpm/100 cm ²): | 1947 | | |
| Direct Measurement Standard Deviation (dpm/100 cm ²): | 1478 | | |
| Total Standard Deviation (dpm/100 cm ²): | 1478 | | Based on samples and backgrounds. |
| Maximum (dpm/100 cm ²): | 8626 | | Background Subtract Not Applied |
| Material Type: | N/A | | |
| Sign Test Final N Value: | 24 | | Class 1 |
| S+ Value: | 24 | | |
| Critical Value: | 16 | | |
| Sufficient Samples Collected: | Yes | | |
| Maximum Value < DCGL: | Yes | | |
| Median Value < DCGL: | Yes | | |
| Mean Value < DCGL: | Yes | | |
| Maximum Value < DCGL_{mc}: | Yes | | |
| Total Standard Deviation <= Sigma: | Yes | | |
| Pass the Sign Test? | Yes | | |
| Reject the Null Hypothesis? | Yes | | |
| Does the Survey Unit Pass All Criteria? | Yes | | |

Survey Unit Investigations and Results:

No investigations were required for either direct or scan measurements and no investigation results are reported.

ALARA Statement:

As stated in Chapter 4 of the LTP, as long as the residual activity within the survey unit is less than the DCGL (i.e. the survey unit average activity is less than the DCGL and the EMC criterion has been met), the ALARA criterion has been met.

Changes in Initial Survey Unit Assumptions:

The survey unit was designed as a Class 1 structure survey and the sample results are consistent with that classification. The variability of the survey results was less than the characterization data used for survey design. No potential areas of elevated activity were detected. Therefore, the EMC criterion was met.

Conclusion:

The FSS of this survey unit was properly designed as a Class 1 survey based on Table 5-4 of the LTP. The required number of direct measurements was made and the scan coverage met the requirement of Table 5-6 of the LTP. No direct measurements exceeded the DCGL of 43000 dpm/100 cm² and none of the removable surface activity measurements exceeded 10% of the DCGL. No investigations were required.

The direct measurement data support rejection of the null hypothesis, providing high confidence that the survey unit satisfied the release criteria and that the data quality objectives were met.


It is concluded that survey unit F8130231 meets the release criteria of 10CFR20.1402.


Attachment 1

Maps

November 5, 2007

Survey Unit F813023

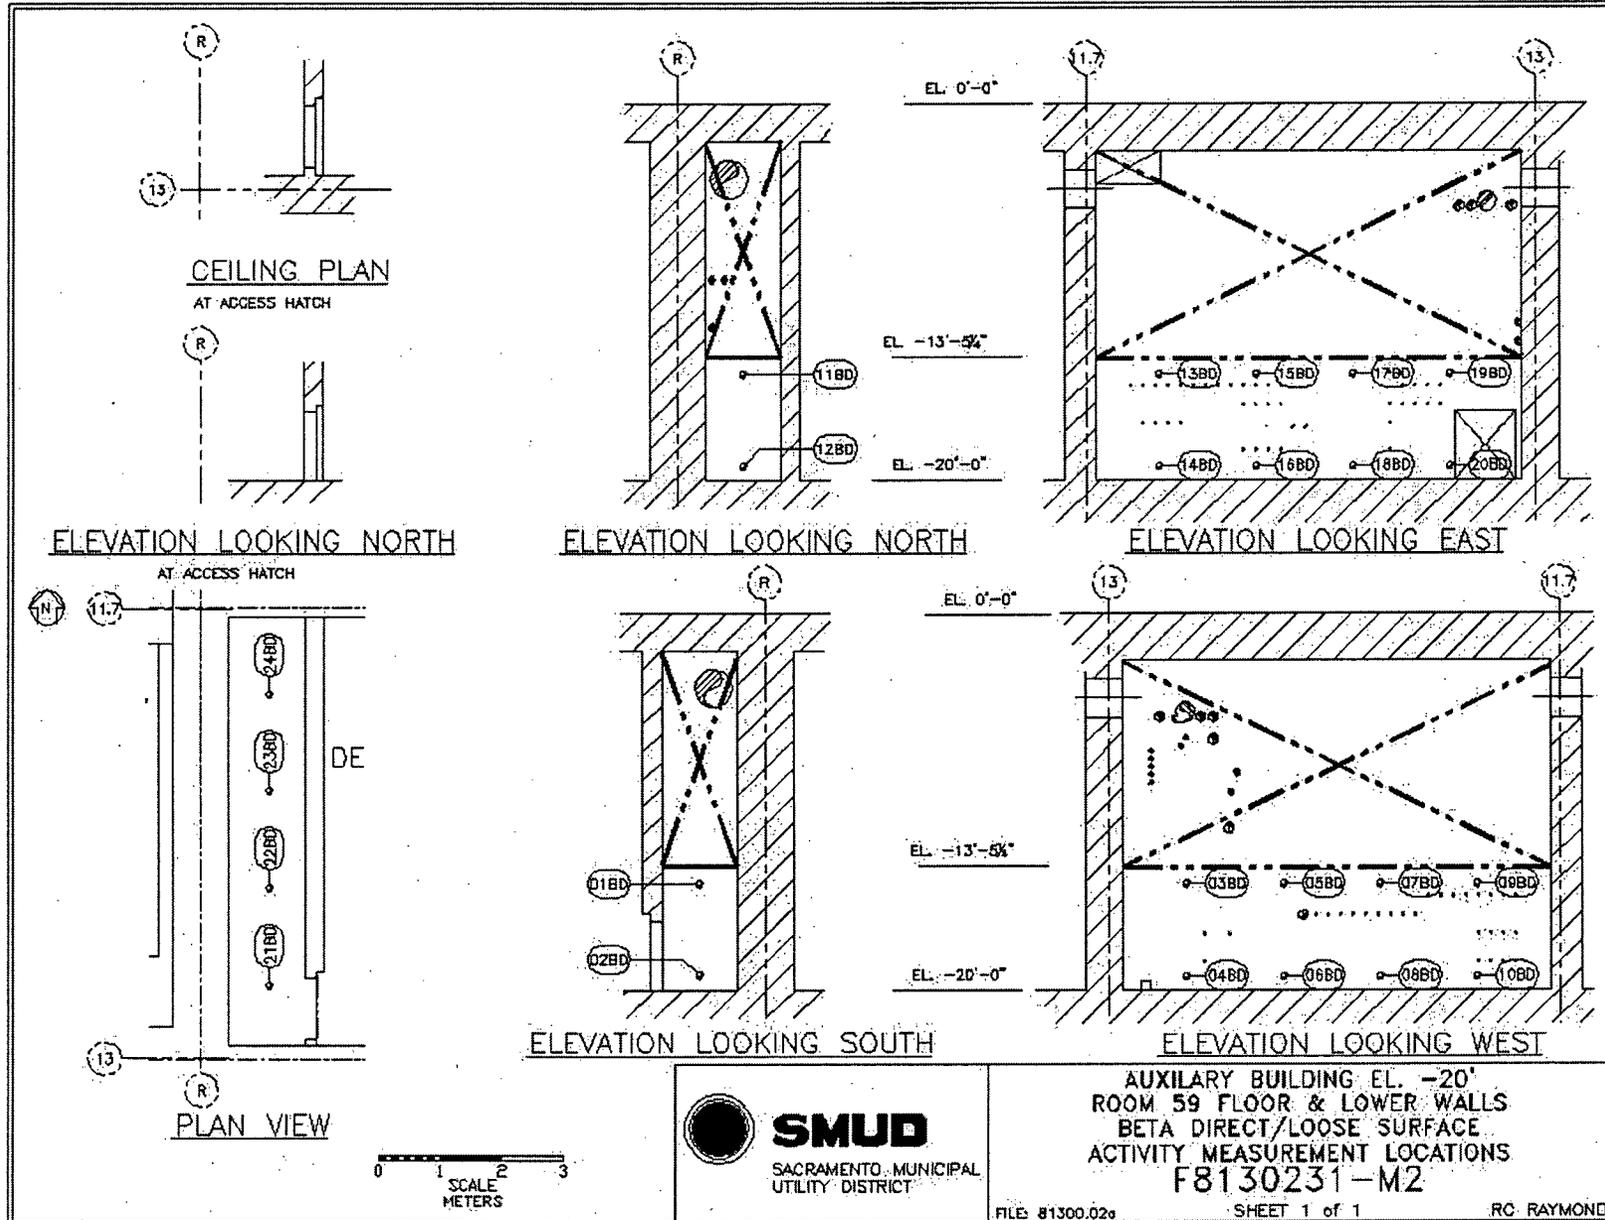

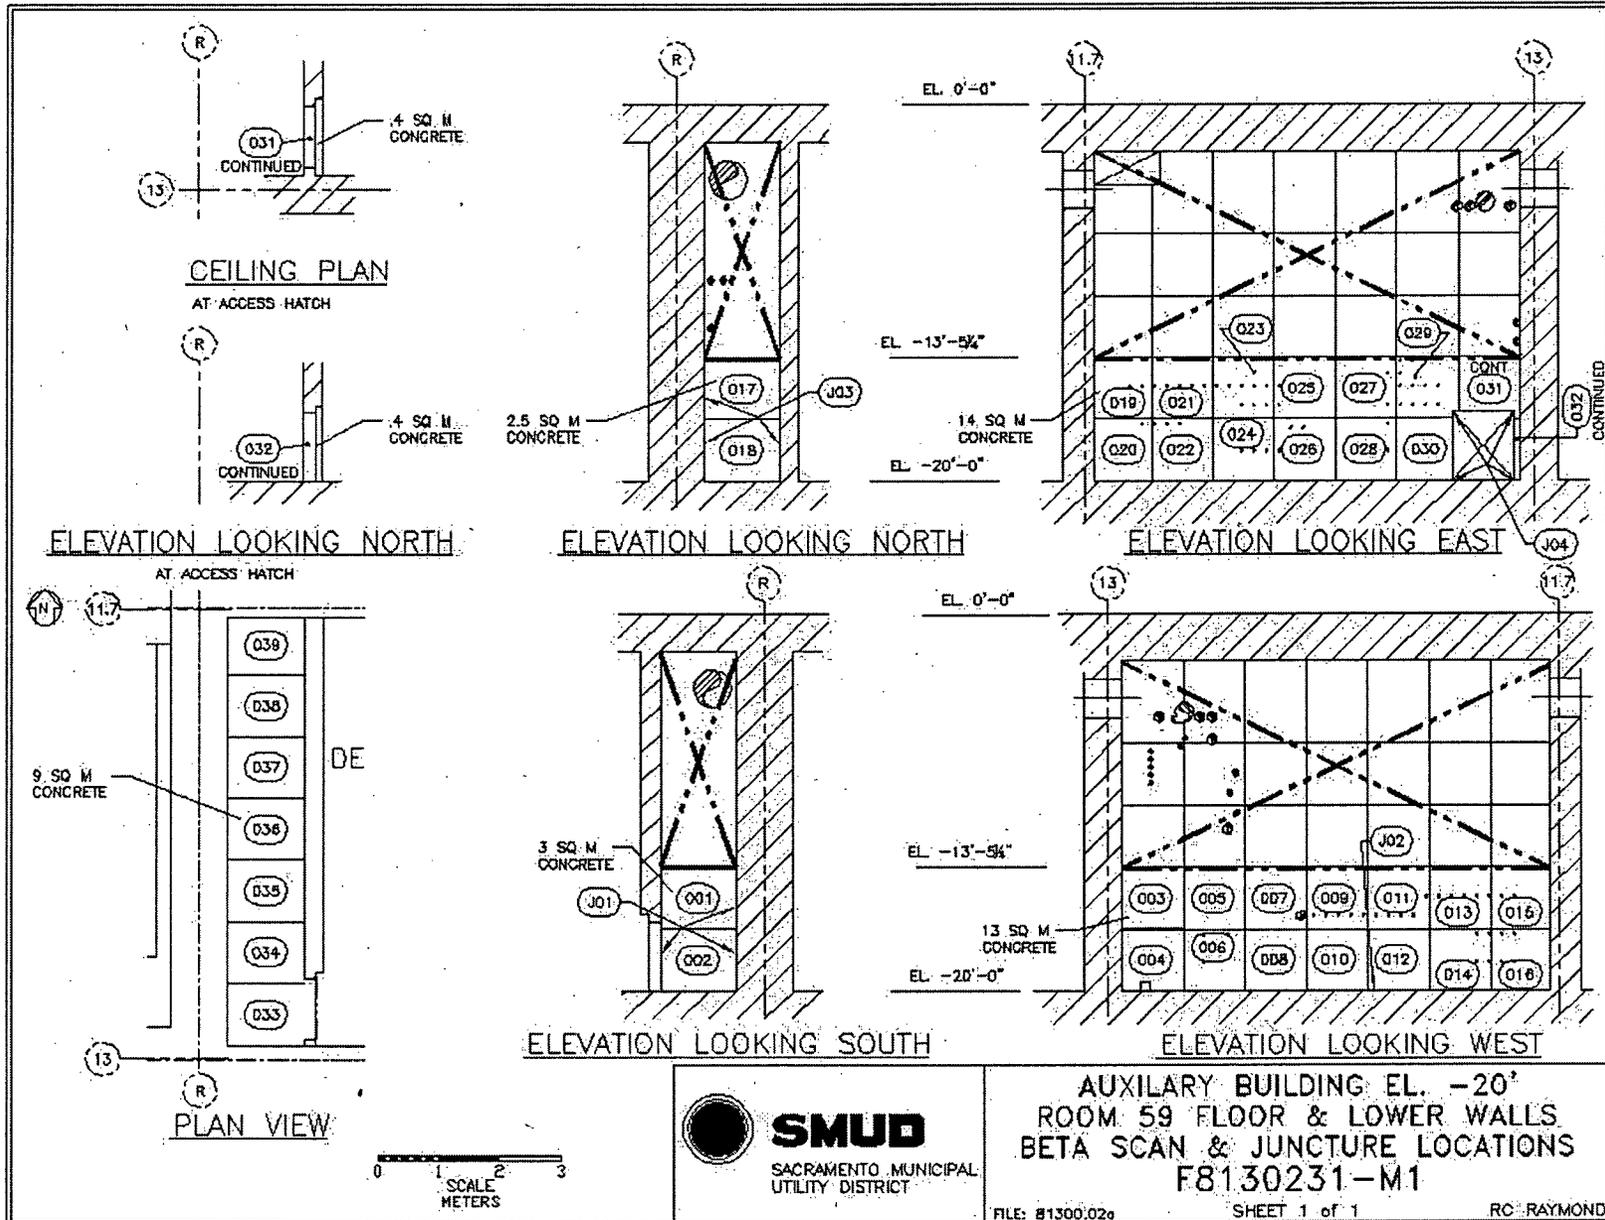

Attachment 2

Instrumentation

November 5, 2007

Survey Unit F8130231

Table 2-1. Survey Unit Instrumentation

| Instrument Model; Serial No. | Detector Model; Serial No.. | MDC Static (dpm/100 cm²) | MDC Scan (dpm/100 cm²) |
|-------------------------------------|------------------------------------|--|--|
| M2350; 203486 | 43-68B; 161400 | 433 | 1033 |
| M2350; 203465 | 43-68/5B; 148942 | 433 | 1033 |
| M2350; 203465 | 43-116-1B; 190173 | 491 (β juncture) | 739 (β juncture) |
| Tennelec; 0401171 | N/A | 5 dpm α , 11 dpm β | N/A |

Table 2-2. Investigation Criteria and DCGL

| Parameter | Value (dpm/100 cm²) |
|---------------------------------|---------------------------------------|
| Investigation Criteria - Direct | 270900 |
| Investigation Criteria – Scan | 270900 |
| DCGL _w | 43000 |
| DCGL _{EMC} | 270900 |

Attachment 3

Investigation

November 5, 2007

Survey Unit F8130231

(none required)

Attachment 4

Data Assessment

November 5, 2007

Survey Unit F8130231

