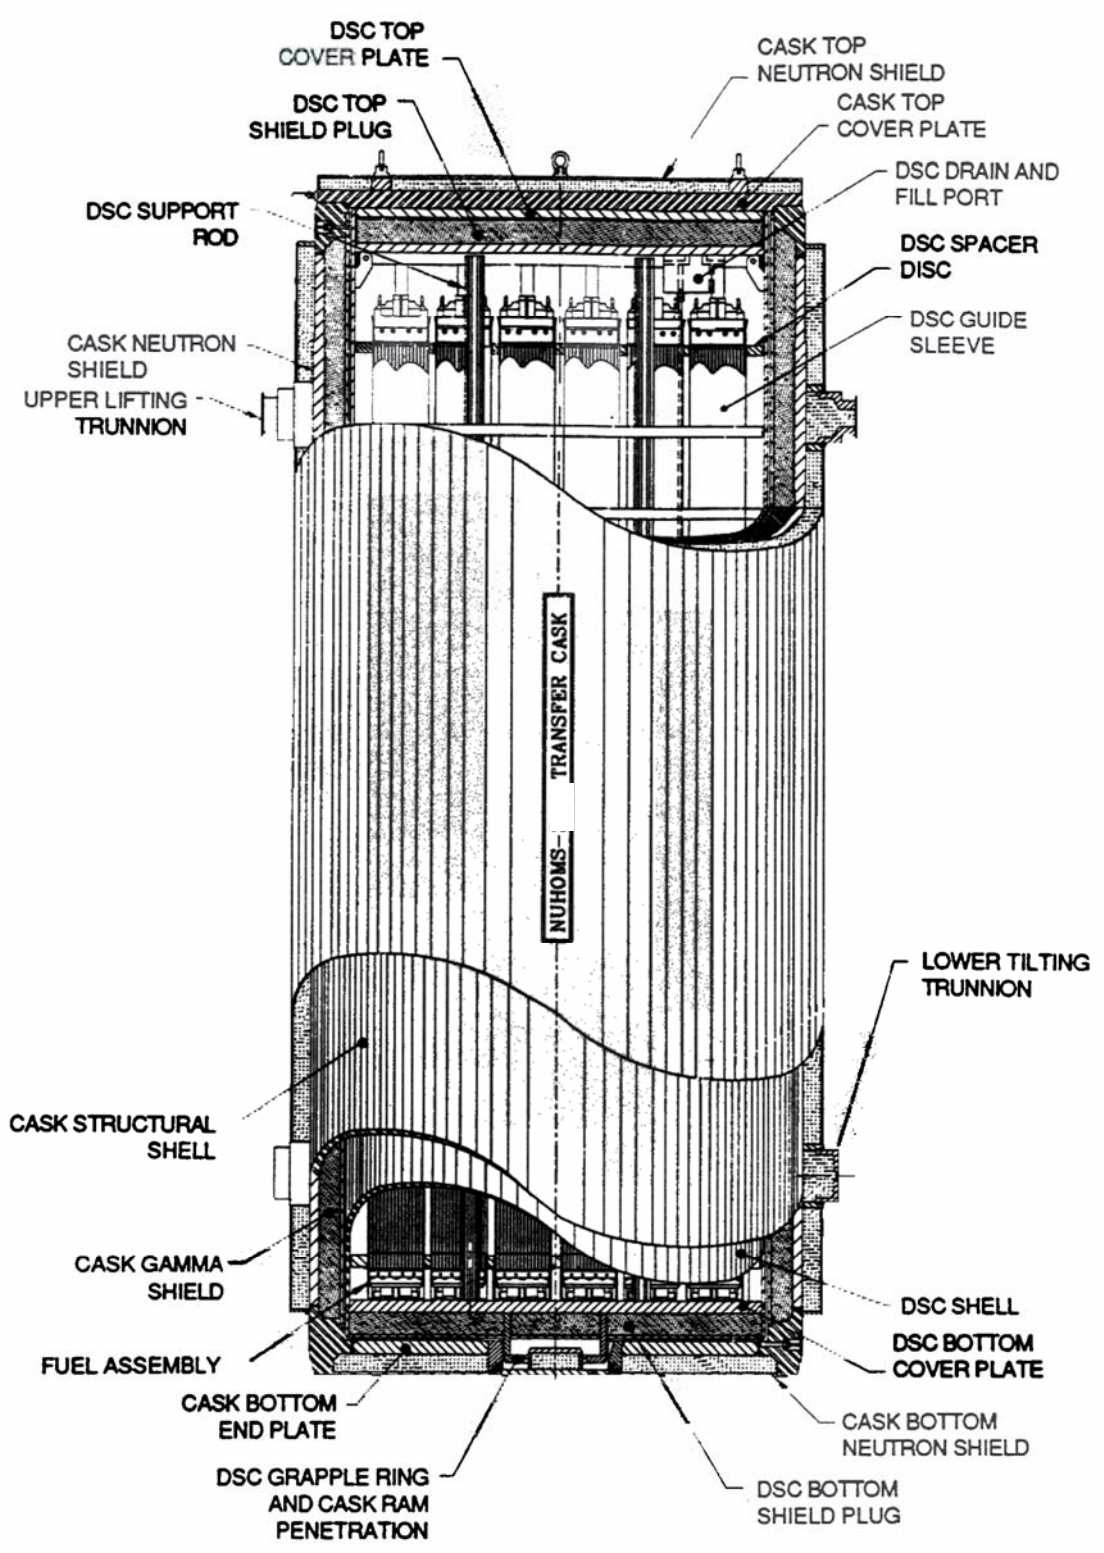

Calvert Cliffs Nuclear Power Plant, Independent Spent Fuel Storage Installation	NUHOMS TRANSFER CASK (Shown with a NUHOMS-24P DSC)	USAR Figure 4.7-1 Revision 15