
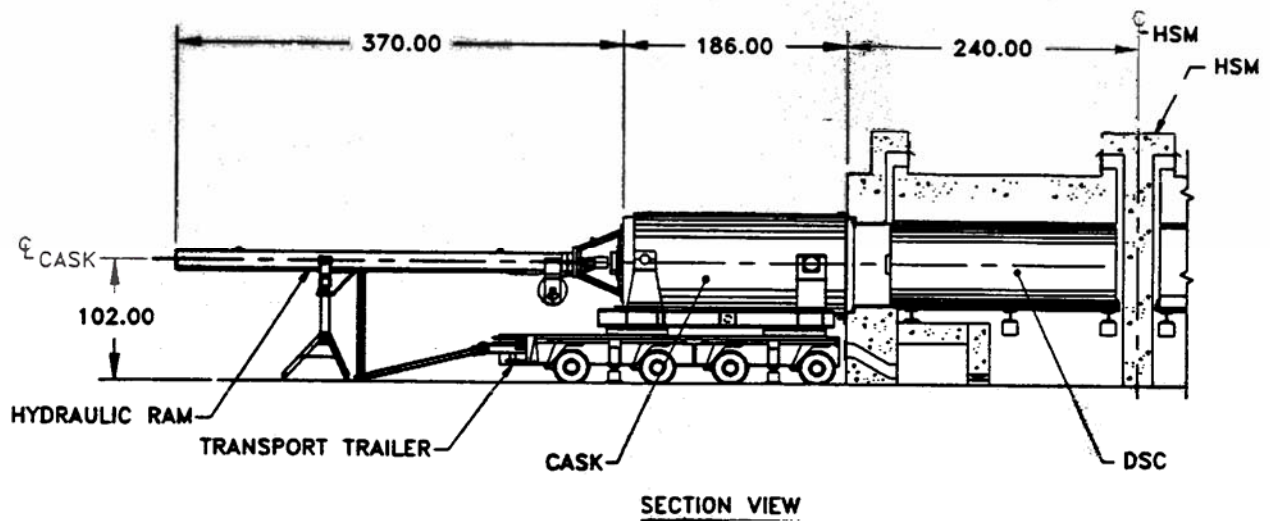


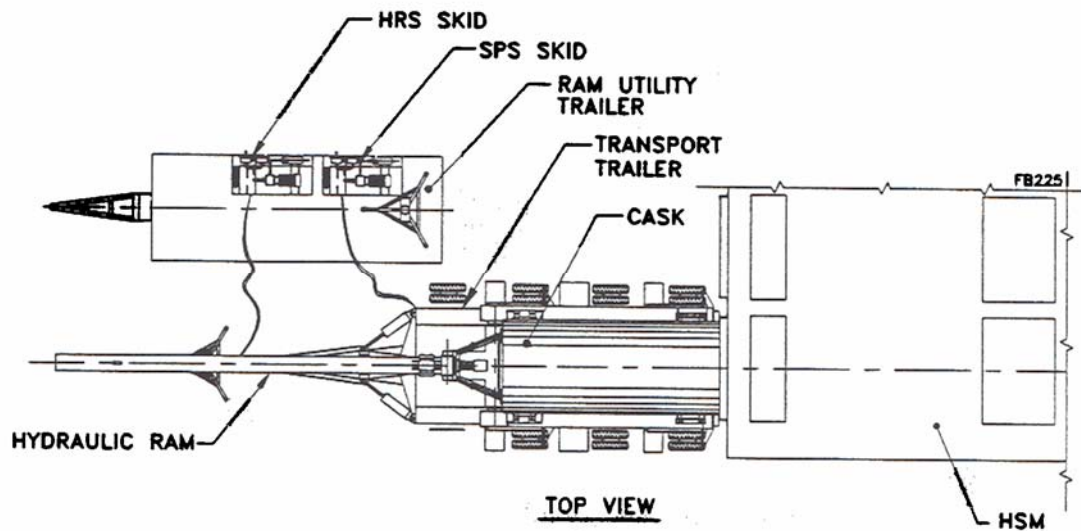

Calvert Cliffs Nuclear
Power Plant, Independent
Spent Fuel Storage
Installation

NUHOMS TRANSFER SYSTEM CONFIGURATION [See Reference 4.5]

USAR
Figure 4.7-5
Revision 15