

ATTACHMENT 5

CALCULATION EPM-PJA-063092

TITLE: DOCUMENTATION OF DESIGN BASIS REVIEW, REQUIRED THRUST/TORQUE CALCULATIONS, AND VALVE AND ACTUATOR CAPABILITY ASSESSMENT FOR VALVE 1-FCV-68-332				PLANT/UNIT WATTS BAR NUCLEAR PLANT/#1	
PREPARING ORGANIZATION DNE, ABB IMPELL, EBASCO, MECHANICAL		KEY NOUNS (Consult RIMS DESCRIPTORS LIST) MOV, VALVE OPER, VALVE ACTUATORS			
BRANCH/PROJECT IDENTIFIERS MEB-WBN-68 WBN-68-D053 EPM-PJA-063092		Each time these calculations are issued, preparer must ensure that the original (RO) RIMS accession number is filled in. Rev. (for RIMS' use) RIMS accession number			
		RO	B18 921113 285		
APPLICABLE DESIGN DOCUMENT(S) N/A		R 4	(64) B 26	'95 08 31 3	
		R			
SAR SECTION(S) 3.9.3.2	UNID SYSTEM(S) 68	R			
REVISION 0		R4	R	R	Safety-related? YES [X] NO []
ECN No. (or Indicate Not Applicable) N/A		S-39937-A			Statement of Problem: NRC Generic Letter 89-10 requires that each licensee develop, implement, and document a program which ensures that specified safety-related motor-operated valves (MOVs) will perform their safety function for the life of the plant. Part of this program involves the documentation of MOV design basis review, determination of required thrust/torque, and assessment of valve and actuator capability.
Prepared: P. J. Antonvich		D.C. BUCHE			
Checked/Verified: T. S. Snead		TV LEASE			
Reviewed: T. J. Miller		TJ MILLER			
Approved: T. J. Miller		TJ MILLER			
Date: 11/12/92		8-31-95			
USE FORM TVA 10534 IF MORE SPACE REQUIRED	List all pages added by this revision	SEE REV. LOG			
	List all pages deleted by this revision	SEE REV. LOG			
	List all pages changed by this revision	SEE REV. LOG			
Abstract: These calculations contain an unverified assumption(s) that must be verified later. Yes [] No [X]					
<p style="text-align: right;">REV-68-332</p> <p>This calculation documents the design basis review and required thrust/torque for MOV 1-FCV-68-332. The design basis review has been performed and the required thrust/torque has been determined per the methodology specified in Mechanical Design Standards DS-M18.2.21 and DS-M18.2.22. This methodology addressed the new requirements specified in NRC Generic Letter 89-10. As summarized in Section 8.0 this calculation shows that the valve and valve actuator are capable of meeting the new thrust/torque requirements. Therefore, based on the results of this calculation MOV 1-FCV-68-332 is able to perform its design basis function.</p> <p>This calculation contains special requirements: Yes [] No [X]</p>					
[] Microfilm and store calculations in RIMS Service Center [X] Microfilm and return calculations to: Calculation Library				Microfilm and destroy. [] Address: IOB-1E	

ORIGINAL

cc:

MEB

THIS PAGE ADDED BY REVISION 4
DDB
6/30/95

REVISION LOG

MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

SHEET 2 OF 39

TITLE: DOCUMENTATION OF MOV DESIGN BASIS REVIEW FOR 1-FCV-68-332		
REVISION NUMBER	DESCRIPTION OF REVISION	DATE APPROVED
0	<p>ORIGINAL ISSUE</p> <p>Prepared by: P. J. Antonvich <i>PJA 11/11/92</i></p> <p>Checked by: T. Snead <i>TSS 11/12/92</i></p>	<p>11/12/92</p>
1	<p>This revision incorporates Design Change Notice W-12962-A for the spring pack replacement (0301-112) for 1-FCV-68-332</p> <p>Pages Added: 3A</p> <p>Pages Revised: 4, 9, 20, 21, 37, 1, 2</p> <p>Pages deleted: 0</p> <p>Total Pages: 41</p> <p>Prepared: M. R. Johnson <i>mrf 4/6/93</i></p> <p>Checked: <i>J. Beltz</i></p>	<p>5/25/93</p>
2	<p>This revision incorporates Design Change Notice <u>F-22416-A</u> for increased Actuator thrust rating of 140% above the nominal thrust rating of 14,000 lbs. (SB-00).</p> <p>Pages Added: 3B, 3C, 3D</p> <p>Pages Revised: 1, 2, 4, 12, 35, 37, 38</p> <p>Pages Deleted: 0</p> <p>Total Pages: 44</p> <p>Prepared BY: M. R. Johnson <i>mrf 1/4/94</i></p> <p>Checked BY:</p>	<p><i>Rev'd for FAK 1/6/94</i></p>

TITLE: DOCUMENTATION OF MOV DESIGN BASIS REVIEW FOR 1-FCV-68-332		
REVISION NUMBER	DESCRIPTION OF REVISION	DATE APPROVED
3	<p>This revision incorporates the following MOV issues: elevated temperature effects, seismic evaluation, EOI evaluation, reconciled DP test data</p> <p>Pages Revised: 1, 4, 5, 7, 9-18, 22-28, 30, 32-34, 37, 38, 3C, 21</p> <p>Pages Added: 2A, 3E, 3F, 3G^{11/11/94}, 24A, Att. 2 (4 pgs), Att 3 (11 pgs)</p> <p>Pages Deleted: none</p> <p>Total pages: 64 ^{12/14/94} 11/14/94</p> <p>DCCM and CCRIS search was performed on 11/10/94 and no changes were found which affect this calculation. ^{11/12/94}</p> <p>Prepared: <i>[Signature]</i> 11/11/94, <i>[Signature]</i> 12/14/94</p> <p>Checked: <i>[Signature]</i> 12/16/94</p>	12/21/94
4	<p>This revision incorporates the following MOV issues: revised reconciled DP test data and mispositioning evaluation.</p> <p>Pages Revised: ^{7/12/95} 1, 2A, 4, 5, 7, 9-11, 17, 21, 24, 27, 3C, 12, 14, 20, 22</p> <p>Pages Added: 1A, 3F, ATT. 2 (4 pgs)</p> <p>Pages Deleted: ATT. 2 (4 pgs)</p> <p>DCCM and CCRIS search was performed on 6/29/95 and no changes were found which affect this calculation.</p> <p>Prepared: D.C. Busche 6/30/95</p> <p>checked: <i>[Signature]</i> 7/12/95</p>	8-31-95

CLIENT: TENNESSEE VALLEY AUTHORITY PROJECT: WATTS BAR NUCLEAR PLANT UNIT 1
 SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW FOR 1-FCV-68-332

CALCULATION DESIGN VERIFICATION (INDEPENDENT REVIEW) FORM

MEB-WBN-68, WBN-68-D053, EPM-PJA-063092 0
 Calculation No. Revision

Method of design verification (independent review) used
 (Check method used):

- | | |
|--------------------------|-----------|
| 1. Design Review | <u>X</u> |
| 2. Alternate Calculation | <u>NR</u> |
| 3. Qualification Test | <u>NR</u> |

Justification (explain below):

Method 1: In the design review method, justify the technical adequacy of the calculation and explain how the adequacy was verified.
 (Calculation is similar to another, based on accepted handbook methods, appropriate sensitivity studies included for confidence, etc.)

Method 2: In the alternate calculation method, identify the pages where the alternate calculation has been included in the calculation package and explain why this method is adequate.

Method 3: In the qualification test method, identify the QA documented source(s) where testing adequately demonstrates the adequacy of this calculation and explain.

This design review was conducted in accordance with TVA Design Standards DS-M18.2.21 and DS-M18.2.22. Calculation methodology and results were compared to these standards and were found to meet the technical requirements contained therein. The design input and assumptions were verified and found to be reasonable. The calculation results are adequately conservative. The computations were checked, and the evaluation of the differential and line pressure scenarios was confirmed using the references in Section 5.0.

J. H. ...
 Design Verifier
 (Independent Reviewer)

11/12/92
 Date

EBASCO SERVICES INCORPORATED

SHEET 3A OF 39

CLIENT: TENNESSEE VALLEY AUTHORITY PROJECT: WATTS BAR NUCLEAR PLANT UNIT 1

SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW FOR 1-FCV-68-332

CALCULATION DESIGN VERIFICATION (INDEPENDENT REVIEW) FORM

MEB-WBN-68, WBN-68-D053, EPM-PJA-063092 1
Calculation No. Revision

Method of design verification (independent review) used
(Check method used):

- | | |
|--------------------------|-----------|
| 1. Design Review | <u>X</u> |
| 2. Alternate Calculation | <u>NR</u> |
| 3. Qualification Test | <u>NR</u> |

Justification (explain below):

Method 1: In the design review method, justify the technical adequacy of the calculation and explain how the adequacy was verified. (Calculation is similar to another, based on accepted handbook methods, appropriate sensitivity studies included for confidence, etc.)

Method 2: In the alternate calculation method, identify the pages where the alternate calculation has been included in the calculation package and explain why this method is adequate.

Method 3: In the qualification test method, identify the QA documented source(s) where testing adequately demonstrates the adequacy of this calculation and explain.

This design review was conducted in accordance with TVA Design Standards DS-M18.2.21 and DS-M18.2.22. Calculation methodology and results were compared to these standards and were found to meet the technical requirements contained therein. The design input and assumptions were verified and found to be reasonable. The calculation results are adequately conservative. The computations were checked, and the evaluation of the differential and line pressure scenarios was confirmed using the references in Section 5.0.

L. Belt

Design Verifier
(Independent Reviewer)

5/25/97

Date

CLIENT: TENNESSEE VALLEY AUTHORITY PROJECT: WATTS BAR NUCLEAR PLANT
UNIT - 1

SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW AND THRUST/TORQUE
CALCULATIONS FOR 1-FCV-68-332

CALCULATION DESIGN VERIFICATION (INDEPENDENT REVIEW) FORM

MEB-WBN-68, WBN-68-D053, EPM-PLA-063092
Calculation No.

2
Revision

Method of design verification (independent review) used
(Check method used):

- | | |
|--------------------------|-----------|
| 1. Design Review | <u>X</u> |
| 2. Alternate Calculation | <u>NR</u> |
| 3. Qualification Test | <u>NR</u> |

Justification (explain below):

Method 1: In the design review method, justify the technical adequacy of the calculation and explain how the adequacy was verified. (Calculation is similar to another, based on accepted handbook methods, appropriate sensitivity studies included for confidence, etc.)

Method 2: In the alternate calculation method, identify the pages where the alternate calculation has been included in the calculation package and explain why this method is adequate.

Method 3: In the qualification test method, identify the QA documented source(s) where testing adequately demonstrates the adequacy of this calculation and explain.

This design review was conducted in accordance with TVA Design Standards DS-M18.2.21 and DS-M18.2.22. Calculation Methodology and results were compared to these standards and were found to meet the technical requirements contained therein. The design input and assumptions were verified and found to be reasonable. The calculation results are adequately conservative. The computations were checked, and the evaluation of the differential and line pressure scenarios was confirmed using the references in Section 5.0

John F. Lund
Design Verifier
(Independent Reviewer)

06 JAN 94
Date

EBASCO SERVICES INCORPORATED

CLASSIFICATION, CATEGORIZATION AND MAINTENANCE OF DESIGN CALCULATIONS

SHEET 3C OF 39

CALCULATION CLASSIFICATION & CATEGORIZATION

CALCULATION INFORMATION: MEB-WBN-68 WBN-68-D053 IDENTIFIER EPM-PJA-063092 REV. 2/3/4 RIMS NO. NR ISSUE DATE NR

R3 11/12/14/94 2/3 7/12/95

TITLE DOCUMENTATION OF MOV DESIGN BASIS REVIEW AND THRUST/TORQUE REQUIREMENTS AND VALVE AND ACTUATOR CAPABILITY ASSESSMENT FOR 1-FCV-68-332

SYSTEM(S), COMPONENT, FEATURE OR SUBJECT OF CALCULATION

SYSTEM/DESCRIPTION

- (X) SAFETY SYSTEM SYSTEM NO. 68 (X) SAFETY RELATED FEATURE RCS Relief Flow Control Valve () NON-SAFETY SYSTEM SYSTEM NO. () NON-SAFETY RELATED FEATURE () PLANT ENVIRONMENT (EQ, ETC.) () APPENDIX R () CIVIL STRUCTURES () INSTRUMENTATION (PAM, ETC.) () LICENSING () OTHER

R3 11/12/14/94

CALCULATION CATEGORY E06

FINAL CLASSIFICATION

- (X) ESSENTIAL () FILE ONLY () DESIRABLE () SUPERSEDED

SUBMITTED [Signature] DATE 1/4/94 REVIEWED [Signature] DATE 06 JAN 94 APPROVED [Signature] DATE 1/6/94

Rev. 3 11/12/14/94 RMC 2/10/94 MTC 12/21/94 11/14/94 2/3 7/12/95

THIS PAGE ADDED BY REVISION 2

REV. 4 7/12/95 MTC 8/31/95

EBASCO SERVICES INCORPORATED

CLASSIFICATION, CATEGORIZATION AND MAINTENANCE
OF DESIGN CALCULATIONS

SHEET 3D OF 39

Attachment 1
CALCULATION CLASSIFICATION & CATEGORIZATION

IDENTIFIER: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PRELIMINARY CLASSIFICATION

- | | |
|---|-------------------------------------|
| <input checked="" type="checkbox"/> ESSENTIAL | <input type="checkbox"/> FILE ONLY |
| <input type="checkbox"/> DESIRABLE | <input type="checkbox"/> SUPERSEDED |

CALCULATION CLASSIFICATION JUSTIFICATION:

SUBMITTER This calculation documents the design basis review and required thrust/torque for MOV 1-FCV-68-332. The calculation addresses the requirements specified in NRC Generic Letter 89-10.

REVIEWER

- | | |
|---|---|
| <input checked="" type="checkbox"/> AGREE WITH CLASSIFICATION | <input type="checkbox"/> DISAGREE - COMMENTS REQUIRED |
|---|---|

APPROVER

- | | |
|---|---|
| <input checked="" type="checkbox"/> AGREE WITH CLASSIFICATION | <input type="checkbox"/> DISAGREE - COMMENTS REQUIRED |
|---|---|

WATTS BAR NUCLEAR PLANT UNIT 1

SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW FOR 1-FCV-68-332

CALCULATION DESIGN VERIFICATION (INDEPENDENT REVIEW) FORM

MEB-WBN-68, WBN-68-DO53, EPM-PJA-063092
Calculation No.3
RevisionMethod of design verification (independent review) used
(Check method used):

- | | |
|--------------------------|-----------|
| 1. Design Review | <u>X</u> |
| 2. Alternate Calculation | <u>NR</u> |
| 3. Qualification Test | <u>NR</u> |

Justification (explain below):

Method 1: In the design review method, justify the technical adequacy of the calculation and explain how the adequacy was verified. (Calculation is similar to another, based on accepted handbook methods, appropriate sensitivity studies included for confidence, etc.)

Method 2: In the alternate calculation method, identify the pages where the alternate calculation has been included in the calculation package and explain why this method is adequate.

Method 3: In the qualification test method, identify the QA documented source(s) where testing adequately demonstrates the adequacy of this calculation and explain.

This design review was conducted in accordance with TVA Design Standards DS-M18.2.21 and DS-M18.2.22. Calculation methodology and results were compared to these standards and were found to meet the technical requirements contained therein. The design input and assumptions were verified and found to be reasonable. The calculation results are adequately conservative. The computations were checked, and the evaluation of the differential and line pressure scenarios was confirmed using the references in Section 5.0. This revision incorporates elevated temperature effects, EOI evaluation, seismic evaluation, and reconciliation of DP test data.

Roy Coll
Design Verifier
(Independent Reviewer)

12/16/94
Date

THIS PAGE ADDED BY REV 3

JA
11/11/94

CLIENT: TENNESSEE VALLEY AUTHORITY PROJECT: WATTS BAR NUCLEAR PLANT
UNIT - 1

SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW AND THRUST/TORQUE
CALCULATIONS FOR 1-FCV-68-332

CALCULATION DESIGN VERIFICATION (INDEPENDENT REVIEW) FORM

MEB-WBN-68, WBN-68-D053, EPM-PLA-063092
Calculation No.

4
Revision

Method of design verification (independent review) used
(Check method used):

1. Design Review X
2. Alternate Calculation NR
3. Qualification Test NR

Justification (explain below):

Method 1: In the design review method, justify the technical adequacy of the calculation and explain how the adequacy was verified. (Calculation is similar to another, based on accepted handbook methods, appropriate sensitivity studies included for confidence, etc.)

Method 2: In the alternate calculation method, identify the pages where the alternate calculation has been included in the calculation package and explain why this method is adequate.

Method 3: In the qualification test method, identify the QA documented source(s) where testing adequately demonstrates the adequacy of this calculation and explain.

This design review was conducted in accordance with TVA Design Standards DS-M18.2.21 and DS-M18.2.22. Calculation Methodology and results were compared to these standards and were found to meet the technical requirements contained therein. The design input and assumptions were verified and found to be reasonable. The calculation results are adequately conservative. The computations were checked, and the evaluation of the differential and line pressure scenarios was confirmed using the references in Section 5.0. This revision incorporates revised test data reconciliation and mispositioning evaluation.

D. Masov
Design Verifier
(Independent Reviewer)

7/12/95
Date

THIS PAGE ADDED BY REVISION 4

DB
6/30/95

EBASCO SERVICES INCORPORATED

CLIENT: TENNESSEE VALLEY AUTHORITY
PROJECT: WATTS BAR NUCLEAR PLANT UNIT - 1
SUBJECT: DOCUMENTATION OF MOV DESIGN BASIS REVIEW AND THRUST/TORQUE REQUIREMENTS FOR 1-FCV-68-332

SHEET 4 OF 39

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA* DATE: 11/11/92
CHECKER: T. Sneed *TSH* DATE: 11/12/92

TABLE OF CONTENTS


<u>TITLE</u>	<u>SHEET NOS.</u>
Calculation Cover Sheet	1
Revision Log	2
Calculation Design Verification (Independent Review) Form	3
Table of Contents	4
 <u>SUMMARY OF ANALYSIS</u>	
1.0 Purpose and Scope	5
2.0 Criteria	6
3.0 Applicable Codes and Standards	7
4.0 Assumptions	8
5.0 References	9
6.0 Design Input Data	12
7.0 Calculations	13
8.0 Summary of Calculation Results	37
9.0 Conclusions	39

ATTACHMENTS

1. Simplified Sketch ----- (page 1 of 1) *11/12/94* *62* *64*

THIS CALCULATION PACKAGE CONTAINS 40 TOTAL SHEETS

Attachment 2 : Reconciliation Process (4 pgs)
Attachment 3 : Test data (11 pgs)

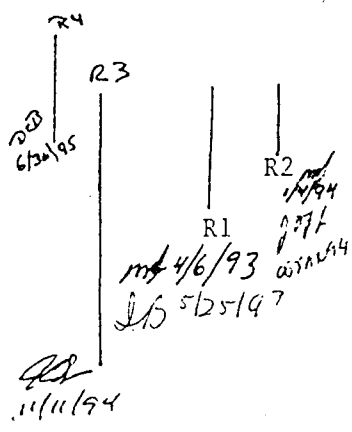

EBASCO SERVICES INCORPORATED

SHEET 5 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TS

DATE: 11/12/92

1.0 PURPOSE AND SCOPE

1.1 Purpose

This calculation documents the design basis review, performs the required thrust/torque calculation, and assesses the valve and actuator capabilities. The results of this calculation are the total valve package which contains the comprehensive Generic Letter 89-10 engineering analysis for the Reactor Coolant System Relief Flow Control Valve (Train B), 1-FCV-68-332, including elevated temperature effects, seismic evaluation, and reconciled test data, mispositioning evaluation and evaluation

1.2 Scope of Emergency Operating Instructions (EOIs).

The design basis review will be performed in accordance with TVA Mechanical Design Standard DS-M18.2.22 (Sect. 3.2). Its purpose is to identify the functional, seismic, and electrical considerations which will influence the valve's, 1-FCV-68-332, ability to perform its design function and also to document specific design information on both the valve and operator (Sections 7.1 through 7.5). The calculated maximum thrust/torque capability will be compared to the thrust/torque requirements, also calculated herein using TVA Mechanical Design Standard DS-M18.2.21 (Sect 3.1), in order to ensure sufficient thrust/torque is available to operate the valve.

The valve and operator thrust/torque capabilities and requirements are based on the worst case line/differential pressures and electrical conditions, as identified in the design basis review.

R3 R4
11/11/92
6/30/92

EBASCO SERVICES INCORPORATED

SHEET 6 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: *11/11/92*

CHECKER : T. Snead

TJ

DATE: *11/12/92*

1.3 CORRELATION

This calculation is presented in Ebasco Project Procedure E-30-TVA format. To identify the location of data required by TVA Design Standard DS-M18.2.22 the following correlation is provided.

<u>DS-M18.2.22 DATA Section</u>		<u>E-30-TVA FORMAT</u>
Purpose	1.0	1.0
Assumptions	2.0	4.0
References	3.0	5.0
Design Basis Review	4.0 - 4.4	7.0 - 7.44
Calculations	4.5	7.5
Walkdown	5.0	7.6
Conclusion	6.0	8.0 & 9.0

2.0 CRITERIA

The motor-operated valve, 1-FCV-68-332, shall be evaluated using TVA Nuclear Design Standards DS-M18.2.21 and DS-M18.2.22.

EBASCO SERVICES INCORPORATED

SHEET 7 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TS

DATE: 11/12/92

3.0 APPLICABLE CODES AND STANDARDS

- 3.1 TVA Nuclear Power Mechanical Design Standard DS-M18.2.21,
"Motor-Operated Valve Thrust and Torque Calculations", Rev. ^{R3}
⑦ ~~5~~, dated ~~07/29/91~~ _{11/11/94}
- 3.2 TVA Nuclear Power Mechanical Design Standard DS-M18.2.22,
"MOV Design Basis Review Methodology", Rev. 1, dated ^{11/11/94}
~~07/29/91~~.
- 3.3 NRC Generic Letter 89-10, "Safety-Related Motor-Operated
Valve Testing and Surveillance", dated June 28, 1989, and Supplements.
Not Used.
- 3.4 ~~Supplement 1 to NRC Generic Letter 89-10, "Results of Public
Workshops", dated June 13, 1990.~~
- 3.5 "Application Guide for Motor-Operated Valves in Nuclear
Power Plants", EPRI Report NP-6660-D, Final Report dated
March 1990. <sub>23
6/30/95</sub>

EBASCO SERVICES INCORPORATED

SHEET 8 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER : T. Snead

TS

DATE: 11/12/92

4.0 ASSUMPTIONS

- 4.1 Valves are assumed to be in and remain in their normal position during normal operation or accident condition such that the effects of mispositioning can be determined. The technical justification for this assumption is to assure that the valves are evaluated at the maximum line and differential pressures.
- 4.2 The pressure drop for piping losses is neglected in the calculation. The technical justification for this assumption is that it allows for a conservative determination of line and differential pressure.

EBASCO SERVICES INCORPORATED

SHEET 9 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

5.0 REFERENCES

5.1 TVA WBN Calculation EPM-TSS-110791, Rev. ⁴ 1, "Generic Letter
89-10 MOV Population at Watts Bar (Unit 1)"

5.2 TVA Design Basis Document, System Description N3-68-4001,
Revision ² thru DCN ~~S-17564-A~~, "Reactor Coolant System"
₃

5.3 TVA Mechanical Piping Drawing ⁴ 47W465-7, Rev. ⁶ 1, "Reactor
Coolant Auxiliary and Miscellaneous Piping"

5.4 TVA WBN WBPEVAR8909010, Rev. ²⁸ 26, "Cable Ampacity - NV4 & NV5
Cables in Class 1E Raceways"

5.5 TVA WBN DCN ^W ~~M-12962-A~~, "MOV Uniqueness and Thrust
Requirements", (RIMS # ~~B26 901004 827~~) T56 930323 840

5.6 TVA WBN Flow Diagram 1-47W813-1, Rev. ¹⁵ 1, "Reactor Coolant
System"
_{11/12/94}

5.7 TVA Mechanical Piping Drawing 47W465-2, Rev. ^R 1, "Reactor
Coolant Auxiliary & Miscellaneous Piping"

5.8 TVA Site Instruction ^{1-52-68-901-B} ~~SI-4.0.5.68.A~~, Rev. ¹ 1, "Valve Full
Stroke Exercising During Plant Operation - Reactor Coolant",
Watts Bar Nuclear Plant

5.9 TVA WBN Schematic Diagram, 1-45W760-68-5, CCD, Rev. ¹³ 1, "Reactor Coolant System Schematic Diagram"

5.10 ~~TVA WBN Letter, dated June 26, 1992, "Evaluation of Cable
Sizing for the Generic Letter 89-10 Motor Operated Valve
(MOV) Program" (RIMS # T41 920626 868)~~
_{Not Used.}

5.11 ~~Westinghouse Electric Corporation Letter WAT-D-8939, dated
July 30, 1992, "Seismic Qualification of Westinghouse Gate
Valves for Watts Bar" (RIMS # T33 920730 983)~~
_{Not Used.}

R3
R4
6/30/95
R2
6/30/95
R1
11/11/94
R4
6/30/95
R4
6/30/95

EBASCO SERVICES INCORPORATED

SHEET 10 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/14/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

5.0 REFERENCES (Continued)

- 5.12 Westinghouse Letter WAT-D-6874, dated 02/24/86, to E. R. Ennis (TVA), "Data Base for Motor Operated Valves"
- 5.13 Westinghouse Drawing 115E010, Rev. 902, "Motor Op. Gate Valve - Mod. 03000GM88FNH008, 3-1500 ASME Class 1 GPO ASSY", Contract No. 71C62-54114-2
- 5.14 Marks Standard Handbook for Mechanical Engineers, Eighth Edition
- 5.15 Westinghouse Electric Corporation Letter WAT-D-8584, dated 6/25/91, Contract # 71C62-54114-1 "Maximum Allowable Thrusts" (RIMS #B26 91 0805 300)
- 5.16 ~~TVA QIR MNMWB 92022, Rev. 0, Limitorque Actuator Torque Switch Setting Chart for New Replacement Spring Packs~~
(RIMS # T81 920804 937) TVA WBN Vendor Technical Manual WBN-VTM-L200-0010, Rev. 10, Section 0240, "Technical Details for Limitorque SMB Motor Operators."
E
- 5.17 TVA WBN Environmental Drawing 47W235-42, Rev. ~~E~~, *E*, "Environment Data - Harsh Lower Compartment" ⑦
- 5.18 Limitorque Selection Guides:
- 5.18.1 Application Factors, SEL-4, Revised 07/01/77.
- 5.18.2 Gate & Globe Valve Efficiency Chart, SEL-7, 11/89.
- 5.18.3 Stem Factors, SEL-10, dated 05/21/79.
- 5.18.4 Rating Sheets, SEL-9, Rev. 2, Dated 6/2/75.
- 5.19 TVA WBN SOER 84-07, dated 6/7/91, "Identification of Gate Valves Subject to Thermal Binding and Bonnet Overpressurization"
- 5.20 Westinghouse Letter WAT-D-8830, "EMD Gate Valve Wedge Angle Information", dated 4/23/92 (Rims #T33 920423 954)

RM
R4
6/3/94
RR
11/11/94

EBASCO SERVICES INCORPORATED

SHEET 11 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

5.0 REFERENCES (Continued)

5.21 TVA WBN Calculation ^{WBN-}EEB-MS-TI06-0010, Rev. ³⁹8, "Auxiliary Power System Analysis on 1E Buses Via CSST C and CSST D with Auto Load Tap Changers" ⁽⁴⁷⁾

5.22 Westinghouse Equipment Specification G-678852, Rev. 2, "Motor Operated Gate Valves ASME Boiler and Pressure Vessel Code Section III Class 1, 2, & 3," Contract No. 71C62-54114-1.

5.23 TVA EQ Binder WBNEQ-MOV-001, Rev. ⁽¹²⁾8, "Environmental Qualification Documentation Package" ⁽⁷⁵⁾

5.24 TVA WBN Calculation WBN-EEB-MS-TI08-0008, Rev. ²⁸28, "480V 1E Coordination/Protection"

5.25 Westinghouse Field Change Notice FCN No. WATM-10640 (RIMS # NEB 830223 358)

5.26 TVA WBN Valve Index by ID, WAT-ID, Rev. 10, dated 9/30/86 Contract No. 71C62-54114-1 (RIMS # B26 861230 900)

5.27 ~~TVA WBN Site Instruction 4.0.5.68.B, Rev. 1, "Valve Full Stroke Exercising During Cold Shutdown Reactor Coolant"~~

5.28 ^{Not Used.} ~~TVA WBN Letter, dated 11/11/92, "Watts Bar Nuclear Plant (WBN) Evaluation of Cable Sizing for the Generic Letter 89-10 Motor Operated Valve (MOV) Program" (T44 921111 033)~~

5.29 TVA Electrical Design Standard DS-E12.6.3, Rev. ⁴2 through EX-DS-12.6.3, "Cable Ampacity Tables for Auxiliary and Control Power Cables (0-15000 Volts)" ^{"Auxiliary and Control Power Cable Sizing up to 15000 Volts (RIMS # B44 940215001)"}

5.30 TVA WBN-OSG4-095, Rev. ⁽¹³⁾7, "Selection Criteria for MOVs Requiring Thermal Overload Bypass"

5.31 ~~TVA Procedure Method PM87-26 (EEB), Rev. 2, "Cable Length/ Impedance to be Used in Electrical Calculations" (RIMS # B43 890822 908)~~ Westinghouse Letter WAT-D-9838, 11/10/94, "MOV seismic Analysis" (RIMS # T33 941110 803)

R3
R4
DEB 6/30/95
R4
DEB 6/30/95
R4
DEB 6/30/95
R4
DEB 7/12/95
R4
DEB 7/12/95
R4
DEB 11/11/94

EBASCO SERVICES INCORPORATED

SHEET 12 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

5.0 REFERENCES (Continued)

5.32 Operability Test Report of Westinghouse Nuclear Gate Valves,
Dated 1/28/77, Engineering Memorandum No. 4995

5.33 ~~TVA QIR MNN WBN 89006, Rev. 0, "Motor Operator Valves
Stroke Times" TVA WBN Vendor Technical Manual WBN-VTM-L200-0010,
Rev. 10, Section 0380, "Limitorque Technical Update 93-03,(13) "Elevated Temperature Effects"~~

A review of DCCM was performed and no outstanding changes affect
this calculation.

23
R4
11/11/94

6.0 DESIGN INPUT DATA

6.1 The design input for determining the Motor Operated Valve
Design Basis and the motor operated valve thrust/ torque
requirements, operation and capability was obtained from
References listed in Section 5.0.

5.34 TVA WBN Letter between Limitorque (Pat McQuillian) and TVA WBN Engineering
Manager (Bob Johnson), dated ~~1/4/94~~, ~~T28 940104 800~~, Subject: Increased
Actuator Thrust Rating. *P/31/94 724 940912 433*

5.35 TVA WBN Vendor Technical Manual WBN-VTM-W120-0800
Rev. 8, Section 2958, "Westinghouse EMB Valves"
(6)

R2
11/14/94
R4
11/12/95
11/11/94

EBASCO SERVICES INCORPORATED

SHEET 13 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

CHECKER: T. Snead *TS*

DATE: 11/11/92

DATE: 11/12/92

7.0 CALCULATIONS

7.1 SYSTEM DESIGN BASIS DATA

DATA SOURCE

1. VALVE NO: 1-FCV-68-332 Ref. 5.1
2. MARK NO : 8000B Ref. 5.25;
Ref. 5.12, ~~p 2~~
Ref. 5.23, ~~p F116~~
3. DESCRIPTION: RCS Pressure Relief Flow Control Valve (Train B) Ref. 5.9
4. SAFETY FUNCTION: Remains open and must be able to be opened to align the PORV's, providing a depressurization path. The valve is closed to isolate the PORV in the event it fails to close. Ref. 5.2, ~~pp 54 & 55~~
5. SEISMIC CLASS: Category I (Active) See Comment 7.1.5
Ref. 5.2, ~~pg 164~~
6. SYS DESIGN PRESS: 2510 psia Ref. 5.2, ~~pg 166~~
SYS DESIGN TEMP : 680° F Ref. 5.2, ~~pg 166~~
7. NORMAL POSITION: Open See Comment 7.1.7
SAFETY POSITION: Close See Comment 7.1.7
8. FLOW RATE: 210,000 lb/hr @ 2265 psia Ref. 5.2, ~~pg 166~~
9. MAX LINE/DIFFERENTIAL PRESS: Comment 7.1.9
- | | <u>Line P/Diff. P</u> | <u>Line P/Diff. P</u> |
|-------------------------|-----------------------|------------------------|
| Normal Plant Operation: | OPEN <u>2235/2235</u> | CLOSE <u>2235/0</u> |
| Testing: | OPEN <u>2235/0</u> | CLOSE <u>2235/0</u> |
| Accident: | OPEN <u>NR</u> | CLOSE <u>2335/2335</u> |
| Misposition: | OPEN <u>2510/2510</u> | CLOSE <u>2335/2335</u> |
| | <u>2734 2734</u> | |
10. FLUID TYPE: Liquid & Saturated Steam - Reactor Coolant Ref. 5.2, ~~pg 54 & 55~~
- FLUID TEMP: 680 ° F Ref. 5.2, ~~pg 159~~

P3

PTS
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 14 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.1 SYSTEM DESIGN BASIS DATA (Continued)

DATA SOURCE

11. REQUIRED STROKE TIME: ~~10.0 seconds (design)~~

Ref. 5.2, ~~5.33~~, pg 5

APPLICABLE SI: ~~SI 4.0.5.68.B~~
1-SI-68-901-B

12. LEAK TIGHTNESS REQUIREMENT: 9 cc/hr

See Comment 7.1.12

13. MOV CAN BE FULL FLOW TESTED? N (YES/NO)

See Comment 7.1.13

14. BONNET OVERPRESSURIZATION/THERMAL BINDING/
PRESSURE LOCKING N (Y/N)

See Comment 7.1.14

15. ORIENTATION OF VALVE:

Ref. 5.3

Ref. 5.7

Ref. 5.23, ~~pg F117~~

Line: Horiz X Vert Degrees from vertical

Stem: Horiz Vert X Degrees from vertical

16. BUTTERFLY VALVE CHARACTERISTICS: Not Required For a Gate Valve

Flow velocities: Not Required For a Gate Valve

Piping arrangements: Not Required For a Gate Valve

17. AMBIENT TEMPERATURE: 60° to 120°F (Normal)

Ref. 5.17

327°F Maximum Accident

R4
7/13/95

R7
11/11/92

R4
7/12/95

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.1 SYSTEM DESIGN BASIS DATA (Continued)

Comments:

7.1.5 Seismic Class - Reference 5.32 provides test data for seismic qualification of Westinghouse Gate Valve of size 4" and 12". Reference 5.11 categorizes various sizes of Westinghouse gate valves into two different groups using the 4" valve as the representative for one group and the 12" valve as the representative for the other group. 1-FCV-68-332 (a 3" gate valve) is represented by the 4" valve.

Based on Ref. 5.11 and the test results of the 4" gate valves in Ref. 5.32, pg 22, an operating thrust range of 5,500 lbs to 7,500 lbs in the opening direction, and a thrust range of 11,500 lbs to 13,600 lbs in the closing direction were noted during stroking at 2500 psid.

Although Section 7.5.1 of this design basis review calculates a required opening thrust of 11,898 lbs (which is greater than the Ref. 5.32 value). Since Reference 5.32 demonstrated operability of the valve under differential pressure conditions similar to Section 7.5.1 it may be concluded that this valve is seismically qualified for its application.

7.1.7 Valve Position - The PORV Block valve is required to be open (and is normally open) to allow venting of the pressurizer for plant depressurization following an accident or abnormal event, in the event the PORV does not close the PORV Block valve may be required to close to stop RCS depressurization (Ref. 5.2, pp. 54 & 55).

Reference 5.31 provides seismic qualification for ^{this} these ~~valves~~ for accelerations of 3.0 g's horizontal and 2.1 g's vertical and an operating thrust/torque of 20,000 lbf / 250 ft-lb. *11/11/92*

TS
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 16 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.1 SYSTEM DESIGN BASIS DATA (Continued)

7.1.9 Analysis of flow rate and maximum line/differential pressure for normal, testing, accident, and mispositioning scenarios:

Computation of maximum expected line pressures, differential pressures and flow velocity for RCS Pressure Relief Flow Control Valve (Train B), 1-FCV-68-332. Refer to Attachment 1, Simplified Sketch.

Opening (Accident/Abnormal Conditions) - The PORV Block valve is required to be open (and is normally open) to allow venting of the pressurizer for plant depressurization following an accident or abnormal event (Ref. 5.2, ~~pg. 54~~). Therefore, it is not required to open under accident conditions. R2

Closing (Accident/Abnormal Conditions) - The PORV Block valve may be required to close to stop RCS depressurization in the event the PORV does not close. (Ref. 5.2, ~~pp. 4, 55, 164~~). In this scenario, the PORV would be isolated when it was determined it would not close. This would be at some pressure below the PORV setpoint. The maximum differential pressure for this operation occurs at an upstream pressure of 2335 psig based on the PORV setpoint (Ref. 5.2, ~~pg. 179~~) and downstream pressure of 0 psig which results in a differential pressure of 2335 psid at a line pressure of 2335 psig. The downstream pressure in the pressurizer relief tank (PRT) is normally 3 psig (Ref. 5.2, ~~pg. 163~~) but is taken as zero for conservatism and simplicity.

Accumulation and setpoint drift are not applicable as the valve would not be shut until pressure dropped below the PORV setpoint regardless of lift pressure.

Opening and Closing (Normal/Test Operations) - The valve may be required to be closed for maintenance or PORV testing and would subsequently be opened to restore the PORV flow path. During normal power operation, the differential pressure is 2235 psid at a line pressure of 2235 psig for opening operations. This is based on an upstream pressure at maximum normal system pressure (Ref. 5.2, ~~pg. 130~~) and negligible pressure in the PRT (see: Closing Accident/Abnormal conditions). The valve is stroked for surveillance testing (Ref. 5.8 ~~& 5.27~~). The opening and closing operation would occur at 0 psid differential pressure, as the PORV is closed, at a line pressure of 2235 psig. Conditions at cold shutdown are bounded by the power operations scenario. R2
11/11/94

EBASCO SERVICES INCORPORATED

SHEET 17 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TJS

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.1 SYSTEM DESIGN BASIS DATA (Continued)

, including both closing following inadvertent opening and inadvertent closure,

Inadvertent Mispositioning - The valve may be mispositioned during normal or accident/abnormal conditions. The closing scenario is bounded by the closing operation at accident/abnormal conditions (2335 psig/ 2335 psid). The opening scenario would require opening of the valve following inadvertent closure to restore the depressurization path following an accident or abnormal event. Worst case upstream pressure is based on the ^{ASME} Pressurizer Code Safety Valve setpoint (RCS design pressure) of 2510 (2485 psig plus 1% setpoint error, Ref. 5.2, pp. 55) and a negligible downstream pressure (see Closing (Accident/Abnormal Conditions)). The consideration of safety valve accumulation pressure for reopening the valve is not credible as the safety valves, once open, provide complete overpressure protection. This results in valve operation at a differential pressure of ~~2510~~ ²⁷³⁴ psid and a line pressure of ~~2510~~ ²⁷³⁴ psig.

R4
6/30/95
R3
is also used
AA
11/11/92

COMMENTS

Requirement that safety valves be designed to limit system pressure to 110% of design or 2734 psig.

7.1.12 Leak Rate - Leak rate = 3 cc/hr * nominal valve size = 3 * 3 = 9 cc/hr max design leak rate. (Ref. 5.22, p. 25 & Ref. 5.13)

7.1.13 Full flow testing - The valve cannot be full flow tested in the open or closed directions since it would require an RCS pressure of 2510 psig which is above the PORV setpoint of 2335 psig (Ref. 5.8, Ref. 5.27, and Comment 7.1.9 above).

7.1.14 Bonnet overpressurization - All safety related active gate valves that may be susceptible to thermal binding or bonnet pressurization are evaluated in SOER 84-07 (Ref. 5.19, attachment 1, p. 12) and valve 1-FCV-68-332 is not susceptible to thermal binding or bonnet pressurization.

7.1.9 For EOI evaluation, the max DP reflected in this section is based on system design pressure and documented in engineering design output documents such as the system description and flow diagrams.

R3
AA
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 18 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.2 Valve Design Data

VALVE DESIGN DATA

DATA SOURCE

Valve Tag No.	<u>1-FCV-68-332</u>	
Valve Contract No.	<u>71C62-54114-1</u>	Ref ^{5.13} 5.2, p. 55; <u>Ref 5.22, p. 175</u>
Valve Drawing.	<u>115E010</u>	<u>Ref 5.26, p. 13</u>
1. Valve Serial No.	<u>03000GM88FNH00B- 00S710002</u>	<u>Ref 5.25, p. 2;</u> <u>Ref 5.23, p. F116</u>
2. Valve Model No.	<u>03000GM88FNH00B</u>	<u>Ref 5.13</u>
3. Valve Mfg.	<u>Westinghouse</u>	<u>Ref 5.13</u>
4. Valve Pressure Class.	<u>1500</u>	<u>Ref 5.13</u>
5. Valve Size/Type	<u>3" Gate</u>	<u>Ref 5.13</u> <u>Comment 7.2.6</u>
6. Seat Diameter Mid point of seat)	<u>2.87"</u>	<u>Ref 5.13</u>
7. Seat Angle	<u>7°</u>	<u>Ref 5.20</u>
8. Stem Diameter	<u>1.25"</u>	<u>Ref 5.13</u>
9. Stem Pitch	<u>0.333"</u>	<u>Ref 5.13</u>
10. Stem Lead	<u>0.333"</u>	<u>Ref 5.13</u>
11. Stem Travel	<u>4.31"</u>	<u>Ref 5.13</u>
12. Disc type	<u>Flexible Wedge Gate Valve</u>	<u>Ref 5.13</u>

27
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 19 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.2 Valve Design Data (Continued)

Comments:

7.2.6 Seat Diameter - The seat diameter (2.87) was determined by the measurement shown of the valve drawing plus 0.25" (0.25" + 2.62") (Ref. 5.13). 0.25" was derived using 4 times (for conservatism) the .0625" seat width used in DS-M18.2.21, pg 4.

EBASCO SERVICES INCORPORATED

SHEET 20 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.3 OPERATOR DESIGN DATA

DATA SOURCE

Valve Tag Number	<u>1-FCV-68-332</u>	
1. Operator Mfg.	<u>Limitorque</u>	<u>Ref 5.23, pg F116</u>
2. Operator Type/Size	<u>SB/00</u>	<u>Ref 5.23, pg F116</u>
3. Order No.	<u>378447B</u>	<u>Ref 5.23, pg F116</u>
4. Serial No.	<u>205839</u>	<u>Ref 5.23, pg F116</u>
5. Spring Pack No.	<u>0301-112</u> 0301-113	<u>See Comment 7.3.5</u>
6. Overall Gear Ratio (OAR)	<u>38.6</u>	<u>Ref 5.25, p. 2</u> <u>Ref 5.5, p. 4</u>
7. Pullout/Run Efficiency	<u>0.45 / 0.60</u>	<u>Ref 5.18.2</u>
8. Stem Factor (FS 0.15)	<u>0.0116</u>	<u>Ref 5.18.3, p. 6</u>
9. HBC Size	<u>Not Applicable</u>	<u>NO HBC UNIT INSTALLED</u>
10. HBC Serial No.	<u>Not Applicable</u>	<u>NO HBC UNIT INSTALLED</u>
11. HBC Order No.	<u>Not Applicable</u>	<u>NO HBC UNIT INSTALLED</u>
12. HBC Gear Ratio	<u>Not Applicable</u>	<u>NO HBC UNIT INSTALLED</u>
13. HBC Gear Eff.	<u>Not Applicable</u>	<u>NO HBC UNIT INSTALLED</u>

R4

DEC 21/12/95

R1
MAY 4/16/93
J.P. 5/25

EBASCO SERVICES INCORPORATED

SHEET 21 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA* DATE: 11/11/92
CHECKER: T. Snead *TS* DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.3 OPERATOR DESIGN DATA (Continued)

Comments:

7.3.5 Determination of Spring Pack Capability -

0301-112 TVA DCN ^WM-12962-A (Ref. 5.5, p. 4) lists the installed spring pack as ~~301-113~~. The torque switch setting chart shows torque switch setting 1 as ~~170~~ ft-lbs and 2 as ~~240~~ ft-lbs (Ref. 5.16, p. 5). The minimum ~~thrust~~ ^{torque} required to close the valve, (Section 7.5.1), is ~~11,798~~ lbf (equivalent torque is ~~137~~ ft-lbs), to open the valve is ~~13,316~~ lbf (equivalent torque is ~~154~~ ft-lbs). *12,291*

115

3 185

The spring pack is satisfactory for this application.
and to open the valve is in

RI
4/6/93
5/5/93
6/30/95

EBASCO SERVICES INCORPORATED

SHEET 22 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *YJK*

DATE: 11/11/92

CHECKER: T. Snead *TJS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA

DATA SOURCE

Valve Tag Number	<u>1-FCV-68-332</u>	
1. Motor Mfg.	<u>Reliance</u>	<u>Ref 5.23, pg F116</u>
2. ID No.	<u>713114-J2</u>	<u>Ref 5.23, pg F116</u>
3. Start Torque	<u>15 ft-lbs (Nameplate Data)</u>	<u>Ref 5.23, pg F116</u>
4. Running Torque	<u>3 ft-lbs</u>	<u>Ref 5.23, pg F116</u>
5. RPM	<u>3400</u>	<u>Ref 5.23, pg F116</u>
6. Horsepower	<u>1.9 HP</u>	<u>Ref 5.23, pg F116</u>
7. Volts	<u>460 V</u>	<u>Ref 5.21, pg 182</u>
8. Running Current	<u>3.5 A</u>	<u>Ref 5.23, pg F116</u>
9. L. R. Current	<u>26.0 A</u>	<u>Ref 5.21, pg 182</u>
10. Duty Cycle	<u>15 Min</u>	<u>Ref 5.23, pg F116</u>
11. Motor Code	<u>Not Listed</u>	<u>Not Listed</u>
12. Insulation Class	<u>RH</u>	<u>Ref 5.23, pg F116</u>
13. Frame Designation	<u>P56</u>	<u>Ref 5.23, pg F116</u>
14. Electrical Cable Sizing	<u>Satisfactory</u>	<u>Comment 7.4.14</u> <u>Ref 5.10, pgs 7 & 30</u>
15. Control Circuit Logic	<u>Satisfactory</u>	<u>Comment 7.4.15</u> <u>Ref 5.9</u>
16. Degraded Voltage Cond.	<u>Satisfactory</u>	<u>Comment 7.4.16</u> <u>Ref 5.21, pg 183</u>
17. Overload Sizing	<u>T29 Satisfactory</u>	<u>Comment 7.4.17</u> <u>Ref 5.21, pg 182</u>

AS
11/11/94

R3
AS
11/11/94

R7

R4

R4

R4

R4

EBASCO SERVICES INCORPORATED

SHEET 23 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA (Continued)

Comments:

7.4.14 Electrical cable sizing - For ~~MOV 1-FCV-68-332, reference 5.21, pg 182 shows the cable numbers as 1V2445B & 1V2446B, the cable size as # 12 wire, the full load (run) amperage as 3.5 amperes and the locked rotor current as 26 amperes. The cable ampacity calculation (Ref. 5.4; Use of this calculation approved by Ref. 5.10) shows the derated 71% (acceptable per Ref. 5.28) full load ampacity as 5.9 and the allowed cable ampacity as 9.4 amperes for 1V2445B (Ref. 5.4, Appendix H, p. 30); for 1V2446B the derated 200% full load ampacity as 7.7 amperes and the allowed cable ampacity as 26.6 amperes (Ref. 5.4, p. 527).~~

The cable sizing for this application including its ability to withstand locked rotor condition (Ref. 5.29) was evaluated is considered satisfactory ~~based on the following:~~
(Ref. 5.4).

~~The 71% full load current was evaluated in Ref. 5.28, and found acceptable for this application.~~

23

TS
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 24 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA Comments (Continued)

7.4.15 Control circuit logic - The valve is required to operate to isolate the RCPB anytime that a PORV may fail open; Ref. 5.30, ~~Attach. 1, p. 14a~~ requires the Thermal Overload (TO) Protection Device to be bypassed and the Torque Switch (TS) to be bypassed in the closing direction during a DBE.

The electrical schematic (Ref. 5.9) shows that the TO is bypassed by a safety signal; the valve travel is limited by a limit switch in the opening direction, and by torque switch with limit switch bypass in the closing direction. *Valve travel is limited by the limit switch in the closing direction (Ref. 5.35).*

The control circuit for this valve meets its design application.

7.4.16 Degraded voltage condition - Reference 5.17 shows that the valve is located in a harsh environment and a reduced voltage evaluation caused by elevated cable and motor temperature is applicable. The maximum accident environmental temperature is 327° F (Ref. 5.17) which equates to 164° C [$C=(T-32)/1.8$]. The minimum voltage indicated on page 182 of reference 5.21 is corrected to 90° C for cable and 40° C for motor. ~~Minimum motor terminal voltage (V_{min}) is determined using the following provided data and formulae.~~ See pg 24A for an evaluation of elevated temperature effects.

ELEVATED TEMPERATURE EVALUATION FOR:
 15.0 START TORQUE, Nameplate
 MAX ENVIRONMENTAL TEMPERATURE
 327 temperature (deg) 164.0 degrees C

1-FCU-68-332-B per (Ref. 5.33)

MOTOR INFORMATION
 3400 rpm

VALUE INFORMATION ACTUATOR INFORMATION
 0.333 load 38.6 DAR

MOTOR TOTAL TEMPERATURE
 168.5 total motor temperature

4.31 travel 29.33 high speed stem
 8.82 stroke time secs
 0.15 stroke time mins

EVALUATION OF LRA AND LRT
 19.2% max % LRA loss (Limitorque 93-03)
 15.91% actual % LRA loss based on temp
 21.9 adjusted LRA

EVALUATION OF MISPOSITIONING
 1.45 temp rise due to misposition (3 strokes)

21.4% max % TQ loss (Limitorque 93-03)
 17.73% actual % TQ loss based on temp
 12.34 adjusted TQ

EVALUATION OF UT (BLOCK vs. INDIVIDUAL) PER STROKE
 block start (y/n): n
 block start (open/close): N/A
 individual start (open/close): both

TERMINAL VOLTAGE EVALUATION

AS FOUND	1-FCU-68-332-B	load	FLI	LRA	LRPF	Zm	Rm	Jxm	Rtot	Rc	Jxc	Individual Motor Start	Block Motor Start
		1.90	3.50	26.0	0.90	10.2147	9.1932	4.4525	0.23700	1.3545	0.0482	376.8	
REVISED	1-FCU-68-332-B	1.90	3.50	21.9	0.90	12.1270	10.9143	5.2060	0.23700	1.3545	0.0482	305.6	
										0.2500	0.0092		
										0.2500	0.0092		

CORRECTION OF Rc, Rm, AND Xm FOR TEMPERATURE > 90 DEGREES CELSIUS FOR:

1-FCU-68-332-B per (Ref. 5.29)

Voltage Divider (Umin) = Udcc x Zmc / Ztotal
 Umin = 395.05

formulas:

	REVISED	ORIGINAL
0.003002 = Temperature Coefficient of Resistance		
= Temperature corrected MTR Impedance	15.9043	13.4637
= Temperature corrected MTR Resistor	15.0049	12.7062
1.6634 = Temperature corrected Cable Resistance (Rcc)		
= Total corrected Impedance (Ztc) =	17.8032	15.2042

where

$a1 = 1 / (234.5 + T1)$
 $Zmc = [(Rmc)^2 + (Xm)^2]^{0.5}$
 $Rmc = Rm (1 + (a1) (Tc - Tm))$
 $Rcc = Rc (1 + (a1) (Tc - T1))$
 $Ztc = [(Rmc + R12cc + Roh)^2 + (Xm + X12cc)^2]^{0.5}$

Provided Data:

	REVISED	ORIGINAL
440 = Motor Control Center Volt		
= Motor Resistance (Rm) =	10.9143	9.1932
= Motor Reactance (Xm) =	5.2060	4.4525
1.3545 = Cable Resistance		
0.0482 = Cable reactance		
0.23700 = Overload Heater Resistance		
164 = Accident Environment Temperature (degree celsius)		
90 = Initial Temperature (degree celsius)		
40 = Initial Motor Temperature (degree celsius)		

DETERMINATION OF MOTOR CAPABILITY FOR :

1-FCU-68-332-B

38.6 DAR
 0.6 run efficiency
 0.45 pull out efficiency

376.8 individual motor start as found in WBM-EEB-MS-T106-0010 (Ref. 5.21)

385.6 new individual motor start based on reduced LRA

395.0 new individual motor start voltage corrected for > 90 degree celsius (*)
 Open direction Close direction =

0.8508 0.8508 terminal voltage ratio
 determination of voltage factor (VF)
 0.7375 0.7375 VF = 1, if voltage ratio > .9 otherwise = (voltage ratio)^2
 determination of application factor (AF)
 1 1 AF=1, if terminal voltage ratio < .9 otherwise = .9 (Ref. 5.33)

OPENING MOTOR CAPABILITY

CLOSING MOTOR CAPABILITY =

1-FCU-68-332-B

150 ft.-lbs.

211 ft.-lbs. (see section 7.5.2 for formulae)

0.0116 stem factor

based on stem pitch, lead, diameter

13621 lbs.

18190 lbs.

This page added by Rev. 3 JAS
 11/11/94

EBASCO SERVICES INCORPORATED

SHEET 25 OF 39
REVISION 0

OBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TS

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA Comments (Continued)

7.4.16 Degraded Voltage Condition (Continued)

Provided data

$V_{mcc} = 440$ volts = Motor control center voltage (Ref. 5.21, pg 182)

$R_m = 6.1288$ ohms = Motor resistance (Ref. 5.21, pg 182)

$X_m = 8.1717$ Ohms = Motor reactance (Ref. 5.21, pg 182)

$R_{oc} = 1.3545$ ohms = Cable resistance outside containment wire
(Ref. 5.21, pg 182)

$X_{oc} = 0.0482$ ohms = Cable reactance outside containment wire
(Ref. 5.21, pg 182)

$R_{ic} = 0.2580$ ohms = Cable resistance inside containment wire
(Ref. 5.21, pg 182)

$X_{ic} = 0.0092$ ohms = Cable reactance inside containment wire
(Ref. 5.21, pg 182)

$R_{oh} = 0.237$ ohms = Overload heater resistance
(Ref. 5.21, pg 182)

$T_c = 164^\circ\text{C}$ = Accident environment temperature inside containment
(Ref. 5.17)

$T_{1c} = 90^\circ\text{C}$ = Initial cable temperature (Ref. 5.31, pg 2)

$T_{1m} = 40^\circ\text{C}$ = Initial motor temperature (Ref. 5.2, pg 182)

P-7

TS
11/11/92

OBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA Comments (Continued)

7.4.16 Degraded Voltage Condition (Continued)

Formulae

$$V_{min} = \frac{(V_{mcc}) * (Z_{mc})}{(Z_{total-corrected})} \quad \text{(Voltage Divider)}$$

$$a_1 = 1 / (234.5 + T_1) = \text{Temperature coefficient of resistance (Ref. 5.14, pg 15-5)}$$

$$Z_{mc} = [(R_{mc}^2) + (X_m^2)]^{1/2} = \text{Temperature corrected motor impedance}$$

$$R_{mc} = R_m * (1 + (a_1) * (T_c - T_{1m})) = \text{Temperature corrected motor resistance}$$

$$R_{cc} = R_c * (1 + (a_1) * (T_c - T_{1c})) = \text{Temperature corrected cable resistance}$$

$$Z_{total-corrected} = [(R_{mc} + R_{icc} + R_{occ} + R_{ohc})^2 + (X_m + X_{ic} + X_{oc})^2]^{1/2}$$

Calculations

$$a_1 = 1 / (234.5 + 90^\circ\text{C}) = 0.003082 / ^\circ\text{C}$$

$$R_{mc} = 6.1288 \text{ ohms} (1 + (0.003082 / ^\circ\text{C}) * (164^\circ\text{C} - 40^\circ\text{C})) = 8.471 \text{ ohms}$$

$$Z_{mc} = (8.471^2 \text{ ohms} + 8.1717^2 \text{ ohms})^{1/2} = 11.77 \text{ ohms}$$

$$R_{icc} = 0.258 \text{ ohms} (1 + (0.003082 / ^\circ\text{C}) * (164^\circ\text{C} - 90^\circ\text{C})) = 0.3168 \text{ ohms}$$

$$R_{oc} = 1.3545 \text{ ohms}$$

$$R_{oh} = 0.237 \text{ ohms}$$

$$(Z_{total-corrected}) = [(8.471 \text{ ohms} + 0.3168 \text{ ohms} + 1.3545 \text{ ohms} + 0.237 \text{ ohms})^2 + (8.1717 \text{ ohms} + 0.0482 \text{ ohms} + 0.0092 \text{ ohms})^2]^{1/2}$$

$$= 13.246 \text{ ohms}$$

TS
11/11/94

EBASCO SERVICES INCORPORATED

SHEET 27 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

CHECKER: T. Snead

DATE: 11/11/92

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.4 ELECTRICAL DATA Comments (Continued)

7.4.16 Degraded Voltage Condition (Continued)

$$V_{min} = \frac{(440 \text{ volts}) (11.77 \text{ ohms})}{13.246 \text{ ohms}} = \underline{391.0 \text{ volts}}$$

The valve operator will deliver sufficient thrust and torque to the valve during degraded voltage conditions to perform its safety function (see Section 7.5).

7.4.17 Overload sizing - References 5.22, p. 182 and 5.24 Attachment M12212A, p. 48 determined that an overload size of T29 is required and is installed. The correct heater is installed for this application.

R3

11/11/92

11/30/95

EBASCO SERVICES INCORPORATED

SHEET 28 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TSS

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations

7.5.1 Valve Requirements

Calculation of Piston Effect Load - F_p

$$F_p = P * \pi/4 * d^2 \text{ (Sect. 3.1, pg 2)}$$

Where:

P = 2335 psig = Closing maximum line pressure (Sect. 7.1.9)

P = ²⁷³⁴~~2510~~ psig = Opening maximum line pressure (Sect. 7.1.9)

d = 1.25" = stem diameter at packing (Ref. 5.13)

$$\pi/4 = 0.7854$$

$$F_p \text{ Closing} = 2335 * 0.7854 * 1.25^2 = \underline{2865} \text{ lbf}$$

$$F_p \text{ Opening} = \overset{3355}{\underset{2734}{\del{2510}}} * 0.7854 * 1.25^2 = \underline{3089} \text{ lbf}$$

Calculation of Packing Friction Load - F_{pack}

$$F_{pack} = 1000 \text{ lbf} * d \text{ (Sect. 3.1, pg 4)}$$

Where:

d = 1.25" = stem diameter at packing (Ref. 5.13)

$$F_{pack} = 1000 * 1.25 = \underline{1250} \text{ lbf}$$

R3

TSS
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 29 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE: 11/11/92

CHECKER: T. Snead

TS

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.1 Valve Requirements (Continued)

Calculation Closing Differential Pressure Load - F_{dp}

$$F_{dp} = dp * \pi/4 * D^2 * FV * \frac{\mu}{[\cos \phi - (\mu * \sin \phi)]}$$

(Sect. 3.1, pg 3)

Where:

$$\pi/4 = 0.7854$$

$dp = 2335$ psid = Closing differential pressure (Sect. 7.1.9)

$D = 2.87$ " = Seat diameter at midpoint. (Sect 7.2.6)

$FV = 1.2$ = Valve safety factor (Sect. 3.1, pg 3)

$\mu = 0.4$ = Valve friction factor (Sect. 3.1, pg 3)

$\phi = 7^\circ$ = Wedge angle (Ref. 5.20)

$$F_{dp} = 2335 * 0.7854 * (2.87)^2 * 1.2 * \frac{.4}{[\cos 7 - (.4 \sin 7)]}$$

$$F_{dp} = \underline{7,683} \text{ lbf}$$

EBASCO SERVICES INCORPORATED

SHEET 30 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.1 Valve Requirements (Continued)

Calculation of Opening Differential Pressure Load - F_{dp}
(Sect. 3.1, pg 3)

$$F_{dp} = dp * \pi/4 * D^2 * FV * \frac{\mu}{[\cos \phi + (\mu * \sin \phi)]}$$

Where:

$$\pi/4 = 0.7854$$

$$dp = \frac{2734}{2510} \text{ psid} = \text{Opening differential pressure (Sect. 7.1.9)}$$

$$D = 2.87" = \text{Contact seat diameter (Sect. 7.2.6)}$$

$$FV = 1.2 = \text{Valve safety factor (Sect. 3.1, pg 3)}$$

$$\mu = 0.4 = \text{Valve friction factor (Sect. 3.1, pg 3)}$$

$$\phi = 7^\circ = \text{Wedge angle (Ref. 5.20)}$$

$$F_{dp} = \frac{2734}{2510} * 0.7854 * 2.87^2 * 1.2 * \frac{.4}{[\cos 7 + (.4 \sin 7)]}$$

$$F_{dp} = \frac{8153}{7,485} \text{ lbf}$$

Calculation of Required Closing Thrust - F_r

$$F_r = F_p + F_{pack} + F_{dp} \text{ (Sect. 3.1, pg 2)}$$

Where:

$$F_{dp} = 7,683 \text{ lbf} = \text{Differential Pressure Load}$$

$$F_p = 2,865 \text{ lbf} = \text{Piston Effect Load}$$

$$F_{pack} = 1,250 \text{ lbf} = \text{Packing Friction Load}$$

$$F_r = 7,683 + 2,865 + 1,250 = \underline{11,798} \text{ lbf}$$

PM

11/11/92

EBASCO SERVICES INCORPORATED

SHEET 31 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.1 Valve Requirements (Continued)

Calculation of Wedging Load - F_w (Sect. 3.1, pg 5)

$$F_w = F_k * f_w * F_v * \frac{(1 - (\mu * \tan \phi))}{[\sin \phi + (\mu * \cos \phi)]} * \frac{\mu}{[\cos \phi + (\mu * \sin \phi)]}$$

Where:

$f_w = 0.6$ = Wedge factor (Sect. 3.1, pg 5 & Ref. 5.13)

$F_v = 1.2$ = Valve safety factor (Sect. 3.1, pg 3)

$\mu = 0.4$ = Valve friction factor (Sect. 3.1, pg 3)

$\phi = 7^\circ$ = Wedge angle (Ref. 5.20)

$F_{pack} = 1250$ lbf = Packing friction load

$F_p = 0$ lbf = Piston effect load (In order to account for a "hard-seated" valve closed with no line pressure a zero value is used.)

$F_{dp} = 0$ lbf = Differential pressure force (In order to account for a "hard-seated" valve closed with no differential pressure a zero value is used.)

$F_{rmax} = 1.15 * F_r = 13,568$ lbf = Maximum closing stem thrust
= 11,798 lbf * 1.15 (Sect. 3.1, pg 5)

F_k = Effective unseating force = $F_{rmax} - F_{pack} - F_p - F_{dp}$
(only closing values) [Sect 3.1, pg 5] = 13,568 - 1250 - 0
- 0 = 12,318 lbf

$$F_w = 12,318 * 0.6 * 1.2 * \frac{(1 - (0.4 * \tan 7))}{[\sin 7 + (0.4 * \cos 7)]} * \frac{0.4}{[\cos 7 + (0.4 * \sin 7)]} = \underline{6,243} \text{ lbf}$$

EBASCO SERVICES INCORPORATED

SHEET 32 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.1 Valve Requirements (Continued)

Calculation of Required Opening Thrust - F_r

$$F_r = F_{dp} + F_{pack} + F_w - F_p \text{ (Sect. 3.1, pg 1)}$$

Where:

$$F_{dp} = \overset{8153}{\cancel{7,485}} \text{ lbf} = \text{Differential Pressure Load (see page 30)}$$

$$F_{pack} = 1,250 \text{ lbf} = \text{Packing Friction Load (see page 28)}$$

$$F_w = 6,243 \text{ lbf} = \text{Wedging load (see page 31)}$$

$$F_p = \overset{3355}{\cancel{3,080}} \text{ lbf} = \text{Piston Effect Load (see page 28)}$$

$$F_r = \overset{8153}{\cancel{7,485}} + 1,250 + 6,243 - \overset{3355}{\cancel{3,080}} = \overset{12,291}{\cancel{11,898}} \text{ lbf}$$

Calculation of Required Operator Torque - A_{tor}

$$A_{tor} = F_r * SF \text{ (Sect. 3.1, pg 5)}$$

Where:

$$F_r = 11,798 \text{ lbf} = \text{Closing Required Thrust}$$

$$F_r = \overset{12,291}{\cancel{11,898}} \text{ lbf} = \text{Opening Required Thrust}$$

SF = 0.0116 = Stem Factor (Ref. 5.18.3). Where: Coef. of friction = 0.15 (Sect. 3.1, pg 5); Stem Pitch = 1/3 and Stem Lead = 1/3 (Ref. 5.13)

$$A_{tor} \text{ (Closing)} = 11,798 * 0.0116 = \underline{137} \text{ ft-lbs}$$

$$A_{tor} \text{ (Opening)} = \overset{12,291}{\cancel{11,898}} * 0.0116 = \overset{143}{\cancel{138}} \text{ ft-lbs}$$

27

PJA
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 33 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA

DATE:

11/11/92

CHECKER: T. Snead

TSS

DATE:

11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.2 Operator Capabilities

Closing Operator Torque Capability - A_{tor} & A_{thr}

Closing A_{tor} = $MT * OAR * AF * RE * VF$ (Sect. 3.1, pg 6)

Closing A_{thr} = A_{tor} / SF (Sect. 3.1, pg 6)

Where;

$MT = 15$ ft-lbs = Motor Starting Torque (Ref. 5.23, pg F129D)

$OAR = 36.2$ = Overall Gear Ratio (Ref. 5.25, p. 2)

$AF = 0.9$ = Application Factor (Ref. 5.18.1)

$RE = 0.60$ = Running Efficiency (Ref. 5.18.2)

$VF = 0.7561$ = Voltage Factor (87.0% (400.0/460) available voltage squared, see Comment 7.4.16)

$SF = 0.0116$ = Stem Factor (Sect. 7.5.1)

Closing A_{tor} = $15 * 36.2 * 0.9 * 0.60 * 0.7561 = 222$ ft-lbs

Closing A_{thr} = $222 / 0.0116 = 19,138$ lbf

(see pg 24A)

P3

PJA
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 34 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonovich *PJA*

CHECKER: T. Snead *TS*

DATE: 11/11/92

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.2 Operator Capabilities (Continued)

Opening Operator Torque Capability - A_{tor} & A_{thr}

Opening $A_{tor} = MT * OAR * AF * PE * VF$ (Sect. 3.1, pg 6)

Opening $A_{thr} = A_{tor} / SF$ (Sect. 3.1, pg 6)

Where;

$MT = 15$ ft-lbs = Motor Starting Torque (Ref. 5.23, page F129D)

$OAR = 36.2$ = Overall Gear Ratio (Ref. 5.25, p. 2)

$AF = 0.9$ = Application Factor (Ref. 5.18.1)

$PE = 0.45$ = Pullout Efficiency (Ref. 5.18.2)

$VF = 0.7561$ = Voltage Factor (87.0% {400.0/460} available voltage squared, see Comment 7.4.16)

$SF = 0.0116$ = Stem Factor (Sect. 7.5.1)

Opening $A_{tor} = 15 * 36.2 * 0.9 * 0.45 * 0.7561 = 166$ ft-lbs

Opening $A_{thr} = 166 / 0.0116 = 14,310$ lbf

(see pg 24A)

23

TS
11/11/92

EBASCO SERVICES INCORPORATED

SHEET 35 OF 39

REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TS*

DATE: 11/12/92

7.0 CALCULATIONS (Continued)

7.5 Thrust/Torque Calculations (Continued)

7.5.3 Weak Link Calculations

Valve Weak-Link

The valve manufacturer (Westinghouse) analyzed the weak link component in both the open and close directions, and calculated their maximum allowable thrusts (Ref 5.15). Although no detailed sub-component evaluation was provided, the conclusion is that the most limiting components are:

	WEAK LINK COMPONENT	MAXIMUM ALLOWABLE LOAD
OPEN DIRECTION	Disc	23995 lbf
CLOSE DIRECTION	Disc	36733 lbf

Operator Weak-Link (see Ref 5.18.4, p. 3)

Maximum Allowable Operator Output Torque (ft-lbs) - - - - - 250

Maximum Allowable Operator Output Thrust (lbf) - - - - - ~~14000~~
(Ref. 5.34) 19,600

R2
11/14/94
JFZ
05JAN94

EBASCO SERVICES INCORPORATED

SHEET 36 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER : T. Snead *TS*

DATE: 11/12/92

7.6 WALKDOWN DATA

Walkdown data has been previously performed and is documented in
TVA EQ Binder WBNEQ-MOV-001 (Ref. 5.23), "Environmental
Qualification Documentation Package."

EBASCO SERVICES INCORPORATED

SHEET 37 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich

PJA
TS

DATE: 11/11/92

CHECKER: T. Snead

DATE: 11/12/92

8.0 SUMMARY OF CALCULATION RESULTS

MOV Tag Number 1-FCV-68-332

Required Thrust/torque (Section 7.5.1 and DS-M18.2.21 Section 2.1)

Open: ^{12,291} ~~11,898~~ ¹⁴³ lbf/~~138~~ ft-lbs . Close: 11,798 lbf/137 ft-lbs

Open & shut = 29,000 lbf/250 ft-lbs

Seismic document which addresses maximum thrust/torque: (Ref. 5.31)

WAT D 8939 Seismic Qualification of Westinghouse Gate Valves
for Watts Bar (RIMS # T33 920730 983)

Motor Actuator Capability (Section 7.5.2 and DS-M18.2.21 Section 2.2)

Open Thrust/torque ¹³⁶²¹ ~~14,310~~ ¹⁵⁸ lbf/~~166~~ ft-lbs
Close Thrust/torque ¹⁸¹⁹⁰ ~~19,138~~ ²¹¹ lbf/~~222~~ ft-lbs

Valve Allowable (Section 7.5.3 and DS-M18.2.21 Section 2.3)

Limiting Component Open Disc
Thrust/Torque 23,995 lbf/278 ft-lbs

Limiting Component Close Disc
Thrust/Torque 36,733 lbf/426 ft-lbs

Actuator Allowable (Sect. 7.5.3)

Thrust/torque ^{19,600} ~~14,000~~ lbf/250 ft-lbs

Spring Pack Torque Band Capability -
Close Direction Only (Section 7.3.5)

Min. -170 115
Max. -240 185

8/87
08/21/94
11/11/94

R1
11/4/93
5/25/97

EBASCO SERVICES INCORPORATED

SHEET 38 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *TSS*

DATE: 11/12/92

8.0 SUMMARY OF CALCULATION RESULTS (CONTINUED)

27

		12,291	143
Thrust/torque Band Open	Min.	11,898	lbf/138 ft-lbs*
		(13621)	
	Max.	14,000	lbf/166 ft-lbs
Thrust/torque Band Close	Min.	(11,798)	(14,310) <i>11/13/94</i>
		11,798	lbf/137 ft-lbs*
		(158)	
	Max.	14,000	lbf/222 ft-lbs
		19,138	18,190
			211

IS MOV ACCEPTABLE FOR THE APPLICATION? Y (Y/N)

If "no", enter reference to design change document: NR

Comments:

PJA
11/14/94
ASJAN 94
11/14/94
R2

The torque values were obtained by multiplying the thrust and stem factor i.e. 23,995 * 0.0116 = 278 ft-lbs.

The minimum torques and thrusts in the open and close bands are based upon the calculated valve minimums.

The maximum thrusts in the open and close bands are based upon ~~actuator weak link thrust~~, the calculated operator capabilities.

The maximum torques in the open and close bands are based upon the calculated operator capabilities.

The torque switch band envelopes the minimum required operating torque in the close direction, and is, therefore, satisfactory with the installed spring pack.

The minimum required torques are for information only and actual operating torques may be less, depending upon lubrication and other factors.

R2
11/14/94
ASJAN 94

EBASCO SERVICES INCORPORATED

SHEET 39 OF 39
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68, WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonvich *PJA*

DATE: 11/11/92

CHECKER: T. Snead *T.S.*

DATE: 11/12/92

9.0 CONCLUSIONS

A design basis review has been performed and the required thrust/torque has been determined per the methodology specified in Mechanical Design Standards DS-M18.2.21 & DS-M18.2.22. This methodology determined that the motor operated valve 1-FCV-68-332 is acceptable from a design standpoint for its application as the Reactor Coolant System Pressure Relief Flow control Valve (Train B).

EBASCO SERVICES INCORPORATED

SHEET 1 OF 1
REVISION 0

SUBJECT: DESIGN BASIS REVIEW AND THRUST/TORQUE CALCULATION FOR
1-FCV-68-332

BRANCH/PROJECT IDENTIFIERS: MEB-WBN-68-WBN-68-D053, EPM-PJA-063092

PREPARER: P. J. Antonovich

PJA


Date: 11/11/92

CHECKER: T. Snead

T. Snead

Date: 11/12/92

Attachment 1

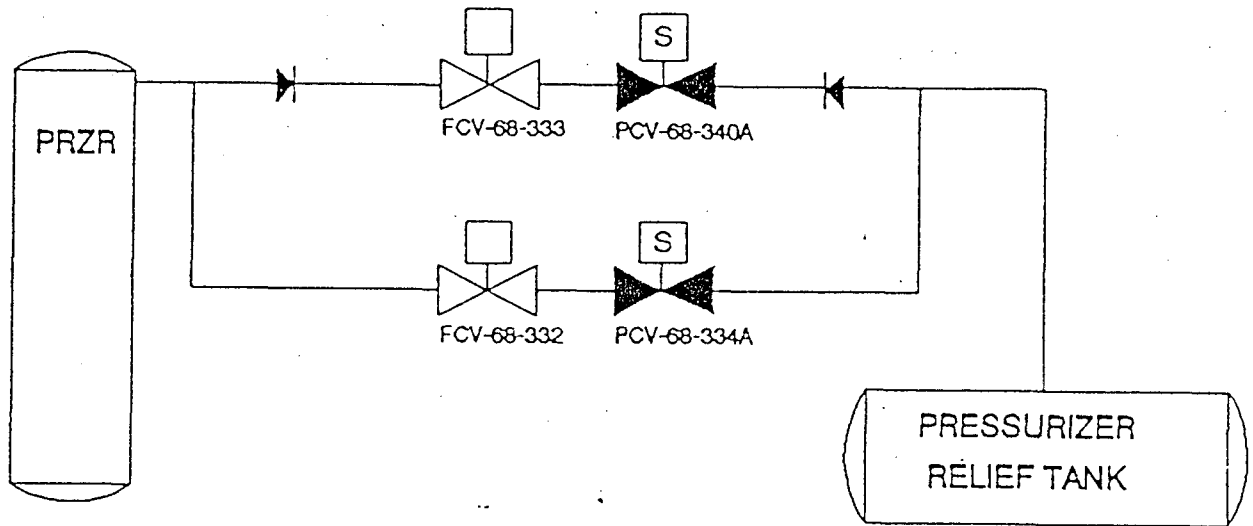

MOV RECONCILIATION
WATTS BAR NUCLEAR PLANT UNIT 1

non-shaded is calc input - other is tracking data

30-Jun-95

Page 1

1.0 INPUT: General Information

Valve Information		Closing T.S. wired in parallel to closing L.S. TSS = 1.0	
Manufacturer	WESTINGHOUSE	Valve UNID:	1-FCV-68-332-B
Size	3.00 inches	Closing control circuit:	LIMIT
Pressure Class	1500 psi	Stem Diameter	1.2500 inches
Disc Style	FWG	Mean Seat Diameter	2.87 inches
Stem Orientation	VERT	Seat Angle (theta)	7.0 degrees
Valve Stem Lead	0.3333 lead	cos(theta)	0.9925
		sin(theta)	0.1219
		Valve Stem Pitch	0.3333 pitch, in
Actuator Information		References (DP Test Data) (Rims Numbers)	
Manufacturer	Limatorque	T76 940614 847	
Type	SB	T76 940623 851	
Size:	00		

MOV Design Basis Review Calculation

Calculation Number	EPM-PJA-063092	REVISION 4	
Seat/Wdg Friction Factor (VF)	0.4000	Stem/Stem Nut Friction Factor (and) (SF)	0.0116
Closing Direction		Opening Direction	
Motor Capability	18190 lbs	Motor Capability	13621 lbs
Motor Capability	211.00 ft-lbs	Motor Capability	158.00 ft-lbs
Actuator Limit	19600 lbs	Actuator Capability	19600 lbs
Actuator Limit	250.00 ft-lbs	Actuator Capability	250.00 ft-lbs
Valve Weak Link	36733 lbs	Valve Capability	23995 lbs
Valve Weak Link	426.00 ft-lbs	Valve Capability	278.00 ft-lbs
Seismic Limit	20000 lbs	Seismic Limit	20000 lbs
Seismic Limit	250.00 ft-lbs	Seismic Limit	250.00 ft-lbs
Differential Pressure (DP)	2335 psid	Differential Pressure (DP)	2734 psid
Required Thrust	11798 lbs	Required Thrust	12291 lbs
Required Torque	137.00 ft-lbs	Required Torque	143.00 ft-lbs
Piston Effect	2865 lbs	Piston Effect	3335 lbs
Packing Load	1250 lbs	Packing Load	1250 lbs
DP Load	7683 lbs	Unseating Load	6243 lbs
		DP Load	8153 lbs

Static Test Information

Static Test Line Pressure	0 psig	(ASSUMED)	Stem Factor @ CST	0.0084
Closing Direction		Opening Direction		
Ave Running Load, [D]	1261 lbs	Ave Running Load, [L]	1226 lbs	
Thrust @ CST [G]	14008 lbs	Unseating Load, [J]	5638 lbs	
Torque @ CST [G]	118.17 ft-lbs	Unseating Load, [J]	23.72 ft-lbs	
Closing Direction		Closing Direction		
Total Peak, [H]	14988 lbs	Total Peak, [H]	135.05 ft-lbs	
Total Final, [I]	14813 lbs	Total Final, [I]	128.66 ft-lbs	

DP Test Information

Maximum DP test condition	2211 psid	Flow, Full Open	N/A gpm
Closing Direction		Line Pres., Full Open	2244 psig
Closing Direction		Opening Direction	
Req'd Closing Thrust [F]	12712 lbs	Measured DP Thrust, Opening [K]	4412 lbs
Req'd Closing Torque [F]	91.25 ft-lbs	Measured Unseating Thrust, Opening [J]	4412 lbs
Thrust @ CST Closing [G]	14393 lbs	Measured DP Torque, Opening [K]	40.15 ft-lbs
Torque @ CST Closing [G]	106.76 ft-lbs	Measured Unseating Torque, Opening [J]	23.72 ft-lbs
Closing Direction		Closing Direction	
Total Peak, [H]	15549 lbs	Total Peak, [H]	120.45 ft-lbs
Total Final, [I]	15234 lbs	Total Final, [I]	109.5 ft-lbs

Diagnostic Equipment Error Determination

TTC IN		MOVATSDia Sys / Equip Error	3000
OSS Y		If SMART STEM Capacity =	N/A lbs.
SMART STEM IN		If SMART STEM Capacity =	N/A ft-lbs.
If T.S. Repeatability applies. As Left TSS =	N/A	If SMART STEM Cap Ref DWG =	N/A

PREPARED BY: *DEB* 7/12/95

CHECK BY: *TRK* 7/12/95

MOV RECONCILIATION
WATTS BAR NUCLEAR PLANT UNIT 1

29-Aug-95

Page 2

2.0 Closing Stroke Reconciliation		Valve UNID: 1-1'CV-68-332-B	
DBR Parameters	DBR Calculation	Reconciled Parameters	Reconciled Test Data
Minimum Required Thrust :	11798 lbs	Reconciled Thrust :	13355 lbs
Minimum Required Torque :	137.00 ft-lbs	Reconciled Torque :	95.87 ft-lbs
Piston Effect :	2865 lbs	Piston Effect (from DBR Calculation) :	2865 lbs
Packing Load :	1250 lbs	Average Packing Load (Section 8.0, step 3A) :	1244 lbs
DP Load :	7683 lbs	DP Load :	9247 lbs
Seat Wedge Friction Factor (VF) :	0.4000	Seat Contact, Seat Wedge Friction Factor (VF) :	0.3654
Calculated Parameter:		Load Sensitive Behavior (ROL) :	N/A
Comparison of Stem Factors			
Stem Factor (SF) DBR Calculation :	0.0116	SF @ Static CST [G] :	0.0084
		SF @ DP CST [G] :	0.0074
		SF @ Required Closing Th, DP Test [F] :	0.0072

MARGIN EVALUATIONS OF DP TEST DATA AND DBR CALCULATION DATA

CST Thrust Margin :	1038 lbs	CST Torque Margin :	11 ft-lbs
CST Thrust Margin :	7.8 %	CST Torque Margin :	11.4 %
Methodology Margin :	-2893 lbs	Thrust Capability Margin :	3499 lbs
Methodology Margin :	-19.7 %	Thrust Capability Margin :	23.8 %
		Torque Capability Margin :	106 ft-lbs
		Torque Capability Margin :	100.1 %

3.0 Opening Stroke Reconciliation

* BASED ON POINT: STATIC [J]

DBR Parameters	DBR Calculation	Reconciled Parameters	Reconciled Test Data
Minimum Required Thrust :	12291 lbs	Reconciled Thrust :	6677 lbs
Minimum Required Torque :	143.00 ft-lbs	Reconciled Torque :	28.09 ft-lbs
Piston Effect Load :	3335 lbs	Piston Effect (from DBR Calculation) :	3335 lbs
Packing Load :	1250 lbs	Average Packing Load (Section 8.0, step 3A) :	1244 lbs
Unseating Load :	6243 lbs	Unseating (based on DP [J]) :	4412 lbs
DP Load :	8153 lbs	DP Load (based on DP [K] - Ave Pk Load + PE) :	7253 lbs
Seat Wedge Friction Factor (VF) :	0.4000	Seat Wedge Friction Factor (VF) :	0.4284
Comparison of Stem Factors			
Stem Factor (SF) :	0.0116	SF @ Max Req'd Opening Th :	0.0042

MARGIN EVALUATIONS OF DP TEST DATA AND DBR CALCULATION DATA

Methodology Margin :	4946 lbs	Thrust Capability Margin :	6276 lbs
Methodology Margin :	67.3 %	Thrust Capability Margin :	85.4 %
		Torque Capability Margin :	127 ft-lbs
		Torque Capability Margin :	411.3 %

4.0 FLAG INDICATION OF UNSATISFACTORY MARGINS ("PROBLEM" or "OK")

Closing Stroke		CST Thrust Margin :	PROBLEM
Methodology Margin :	PROBLEM	CST Torque Margin :	OK
Thrust Capability Margin :	OK	Torque Capability Margin :	OK
Opening Stroke			
Methodology Margin :	OK		
Thrust Capability Margin :	OK	Torque Capability Margin :	OK

PREPARED BY: *mj 8/31/95*
CHECK BY: *TV 8/31/95*

THIS PAGE ADDED BY REVISION 4

OPENING RECONCILED THRUST METHODS:

- For DP test pressure < DBR pressure; Reconciled Thrust = MAX of
 { STATIC [J] - Ave Static Run Load } * (Design DP/Actual DP) + Ave Static Run Load
 { DP [J] - Ave Static Run Load } * (Design DP/Actual DP) + Ave Static Run Load
 { DP [K] - Ave Static Run Load } * (Design DP/Actual DP) + Ave Static Run Load

* - indicates METHOD used to determine the opening reconciled thrust.

MOV RECONCILIATION WATTS BAR NUCLEAR PLANT UNIT 1		
30-Jun-95		Page 3
	Valve UNID: 1-FCV-68-332-B	

5.0 Remarks:

- A. Differential Pressure (DP) testing was performed at 95% of the closing DP and at 82% of the opening DP used in the WBN Design Basis Review (DBR) Calculation.
- B. The closing Load Sensitive Behavior (ROL) term of "N/A" indicates that the valve is "limit" switch controlled and ROL does not apply.
- C. The stem factors are shown to be conservative when test results are compared to the calculated values.
- D. The packing loads are shown to be conservative and correspond to those in the DBR calculation.
- E. The unseating force during the static test bounds the unseating force of the DP test.
- F. The calculated seat wedge friction factor (VF) for opening is higher than that used in the DBR calculation, but adequate margins exist between reconciled thrust/torque and the opening motor capability.
- G. The calculated seat wedge friction factor (VF) for closing is higher than that used in the DBR calculation, but adequate margins exist between reconciled thrust/torque and the closing motor capability.
- H. The PROBLEM flag in the closing direction between the reconciled thrust to the CST trip thrust indicates a narrow margin, but this valve is position seated with the position of the valve stem monitored to ensure the valve is hard seated each time the the valve is stroked closed when the "limit" switch trips the valve. Adequate margins exist above the CST to the motor capability and to the maximum limits.
- I. The PROBLEM flag in the closing direction for Methodology Margin indicates that the reconciled thrust is greater than the calculated minimum required thrust in the DBR calculation. This is influenced by the high DP effect force experienced during the DP test, which results in a high closing VF and reconciled DP Load component. The reconciled DP Load component is much larger than the value calculated in the DBR. However, adequate margin exists between the reconciled thrust and the closing motor capability.
- J. To take into account the "Aging Issue", adequate margins exists to allow for degradation of packing coefficients, partial loss of lubrication, wear of valve/actuator's internal parts, and an increase in valve's surface friction coefficients.

6.0 Conclusions:

- A. The valve's final setup is acceptable. DBR Calculation friction factor methodology are proven to be conservative with adequate margins.
- B. By successful stroking of the valve (including indication of flow isolation) during the DP test, and by adequate margins in the reconciled test data, the valve's operability has been demonstrated.

7.0 Recommended follow up actions:

None.

PREPARED BY: *250* 7/12/95

CHECKED BY: *TVX* 7/12/95

MOV RECONCILIATION
WATTS BAR NUCLEAR PLANT UNIT 1

30-Jun-95

Page 4

Valve UNID:

1-PCV-68-332-B

8.0 Determination of Packing Load

1	Packing Load, Static Test Open & Close, lbs (Line Press = 0)		
		1261 = ARLSC = Ave Running Load Static Close, lbs. "D"	
		1226 = ARLSO = Ave Running Load Static Open, lbs. "L"	
2A	Piston Load Static Test (PNLST), lbs (Line Pressure, STLP is known and not = 0) (Used in Packing Load)		
	PNLST = 0 = Piston Load Static Test = STLP x PI x SID x SID / 4		
2B	Packing Load Static Test, lbs (Line Pressure, STLP, known & not = 0)		
		1261 = Pack Load Static Test Close = ARLSC - PNLST	
		1226 = Pack Load Static Test Open = ARLSO - PNLST	
3A	Estimated Packing Load Static Test, lbs (Line Pressure, STLP is not known)		
		1244 = (ARLSC + ARLSO) / 2 = ("D" + "L") / 2	
3B	Estimated Piston Effect Load Static Test, lbs (Line Pressure is not known)		
	PNLST = 18 = (ARLSC - ARLSO) / 2 = ("D" - "L") / 2		
3C	Estimated Static Line Pressure from Piston Effect Load, lbs (STLP)		
	STLP = 14 = (4 x PNLST) / (PI x I2 x I2)		

9.0 A OPENING RECONCILED EVALUATION

9.0 Miscellaneous Intermediate Calculations		STATIC [J]	6677 lbs.
Unseating load during opening direction DP test		DP [J]	5161 lbs.
		DP [K]	5161 lbs.
0 lbs = [J] - [K] = Measured Unseating Th - Measured DP TII			

If Unseating Load < 0, then assign a value of "0" to Reconciled Unseating Load on Page 2

	Point J DP:	Point K DP:	Point J STATIC:
Max Req'd Opening Thrust to overcome DP, POINTS [J & K]:	4412	4412	5638 lbs
Max Req'd Opening Torque to overcome DP, POINTS [J & K]:	23.72	40.15	23.72 ft-lbs
Maximum Stem Factor (SF), POINTS [J] or [K]:	0.0054	0.0091	0.0042 = SF
Max Req'd Opening Thrust to overcome DP, GREATER OF POINTS [J & K]:	4412 lbs		
Piston Effect based on DP Test Line Pressure (Full Open):	2754 lbs		

10.0 Equipment Error determination

QSS - Thrust Sensor / Equip Error	YES	9.8 % Reading	TTC 0.5% of full scale evaluation	
TTC - Thrust Sensor / Equip Error		0.0 % Reading	SMB SIZE =	0
TTC - Torque Sensor / Equip Error		0.0 % Reading	000	67 lbs.
TTC - Thrust Sensor / Equip Error		0 lbs. ---->	00	117 lbs.
TTC - Torque Sensor / Equip Error		0.0 ft-lbs. -->	0	200 lbs.
SS - Thrust Sensor / Equip Error		0.0 % Capacity	1	375 lbs.
SS - Thrust Sensor / Equip Error		0 lbs.	2	500 lbs.
SS - Thrust Sensor / Equip Error		0.0 ft-lbs.	3	1000 lbs.
MOVATS Dia Sys / Equip Error	3000	2.0 % Reading	000	1.0 ft-lbs
			00	2.2 ft-lbs
T. S. Repeatability Applied	NO	0 % Reading	0	5.9 ft-lbs
		(Table below)	1	9.2 ft-lbs
			2	12.5 ft-lbs
			3	30.0 ft-lbs

Summation of Equipment Error (EIS)		T. S. Repeatability evaluation	
Equipment Error =	10.0 Percent	As Left TSS =	DP TST TOR =
		N/A	N/A
CASE EVALUATION, As Left			
	> 1.00	CASE 1	> 50' # 5
	> 1.00	CASE 2	< 50' # 10
	1.00	CASE 3	> 50' # 10
	1.00	CASE 4	< 50' # 20

REFERENCES:	T07930114839, MOVATS ER 5.0	WBN-VTM-L200-0010, section 0350
	T07930114890, TELEDYNE TR-A716-A-1	

PREPARED BY: *259 7/12/95*

CHECK BY: *TVL 7/12/95*

THIS PAGE ADDED BY REVISION 4

WBN 1	DYNAMIC TEST OF MOTOR OPERATED VALVES PROVIDING PORV AND RCP SEAL RETURN ISOLATION	TI-85.012 Revision 0 Page 34 of 66
----------	--	--

Data Package: Page _____ of _____ Date 5-13-94

6.1 Test of 1-FCV-68-332, 1-FCV-68-333 (Continued)

[45] CALCULATE maximum differential pressure (DP) across 1-FCV-68-332 using information from traces on multichannel recorder as follows.

Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7	
1-FCV-68-332 STROKE	UPSTRM PRESS (PT1, psig)	DOWNSTRM PRESS (PT2, psig)	DP (psid) (Col 2 - Col 3)	90% DESIGN DP (psid)	75% DESIGN DP (psid)	INITIALS VERIF BY	
A	OPENING	2244	0	2244	2260	1880	IRB RSM
B	CLOSING	2211	0	2211	2100	1750	IRB RSM

[46] IF Col 4A or 4B < 75% DESIGN DP, THEN

INDICATE in Chronological Test Log that data for this valve may be outside of range for extrapolation to 100% DP condition.

N/A

[47] ENSURE PRT level is minimized to the extent practicable.

RSM
Operations

[48] ENSURE PRT spray is capable of operation.

RSM
Operations

[49] ENSURE PRT temperature is below 112°F as indicated on 1-TI-68-309, RCS PRT TEMP [1-M-4].

RSM
Operations

[50] ENSURE MOVATS equipment and multichannel recorder for pressure and motor current are ready to monitor closing of 1-FCV-68-333.

3

EPM-PSA-063092

Att. 3

Pg 2/11

TEST DATA SHEET

PAGE 032 OF 61

Valve ID 1 MVOP 68 332 B WID No 91-01135-01

SECTION I: SYSTEM INFORMATION

NOTE 1 For Static Test, use sections 2, 3, 4, & 5.

NOTE 2 For Differential Pressure Test, use sections 2, 3, 6, 7, & 8.

NOTE 3 Circle Test Performed below:

A. Static GO TO Section II if Static is circled.

B. Differential Pressure Test . . . COMPLETE Section I DP data below.

~~Flow Rate: _____ GPM or LB/HR
Pressure Upstream Open: _____ PSIG Pressure Downstream Open: _____ PSIG
Pressure Upstream Closed: _____ PSIG Pressure Downstream Closed: _____ PSIG
Average Fluid Temperature: _____ Deg F
Flow Instrument Accuracies: _____ % FI Number _____ PI Number _____
Elevation: _____ Ft above sea level.~~

N R Jc 1/23/94

SECTION II: PERFORMANCE SECTIONS

- Motor Current Signature Acquisition.
- Switch Monitor Signature Acquisition.
- Spring Pack Monitor Signature Acquisition.
- Spring Pack Calibration.
- Torque-Thrust Setpoints Adjustments.
- Torque Thrust Cell Signature Acquisition.
- Quick Stem Sensor Signature Acquisition.
- other:

RECORD the vendor Calculations used in section 6.1.

MOVATS ER 5.0 REV 6
TELEPHONE TR A716-A-1
521396-B 28848-A 22416-A

[Signature] 1/23/94
ENGINEER Date

This Page Edited By Rev. 3

ERM-PSA-063092

A.H. 3

Pg 3/11

TEST DATA SHEET

PAGE 033 OF 61

SECTION III: TARGET THRUST

Target Thrust Determination	Opening stroke	Closing stroke	
Required Minimum Thrust at Torque Switch Trip:	11898	11798	LBS
Test Equipment Accuracy # 1:	10	10	%
Adjusted Minimum Thrust at Torque Switch Trip:	13088	12978	LBS
Guaranteed Maximum Thrust at T.S.Trip:	14310	19138	LBS
Test Equipment Accuracy # 2:	10	10	%
Adjusted Guaranteed Max. Thrust at T.S.Trip:	12879	17224	LBS
Maximum Total Thrust:	19600	19600	LBS
Test Equipment Accuracy # 3:	10	10	%
Maximum Adjusted Total Thrust:	17640	17640	LBS

Target Thrust Window	Opening stroke	Closing stroke	
Minimum Target Thrust at Torque Switch Trip:	13088	12978	LBS
Maximum Target Thrust at Torque Switch Trip:	12879	17224	LBS
Maximum Allowable Total Thrust:	17640	17640	LBS

Rapid Impact Overload Criteria: N/R 1/23/94
 Limit OPEN AND CLOSE 1/23/94

SECTION IV: STATIC TEST

Static Test As-Left Thrust Verification	Opening stroke	Closing Stroke	
Average Running Load:		1260	LBS
Thrust at Torque Switch Trip:		14008	LBS
Total Delivered Thrust:		14988	LBS

Static Test As-Left Torque Verification	Opening stroke	Closing Stroke	
Torque at Torque Switch Trip:	N	118.17	FT-LBS
Total Output Torque:		134.59	FT-LBS

Static Test As-Left Spring Pack Displacement	Opening stroke	Closing Stroke	
Available Displacement:	A	.1916	in.
Displacement at Torque Switch Trip:		.2078	in.
Total Displacement:		.2521	in.

Stem Factor:	N/A	.0084
Torque Switch Setting AS LEFT	1.0	1.0
Rapid Impact Overloading Test	SAT N/R	UNSAT N/R
	<u>1/23/94</u>	<u>1/23/94</u>

[Signature] 1/23/94
 ENGINEER Date

This Page Added By Rev. 3

T76 940614 847

This Page Added By Rev. 3


CLOSED STATIC Thrust lbs OPEN

B	STAT FRIC BK PT	1436	J	UNSEATING	
C	BEGINING RL	1191	K	DP EFFECT	N
D	AVERAGE RL	1261	L	POST DP / AVE RL	A
E	ENDING RL	1226	M	ENDING RL	
F	DP EFFECT	N/A			
G	CST	14008			
H	TOTAL PEAK	14988			
I	TOTAL FINAL	14813	Z	ZERO LOAD	0

<< 1-FCU-68-3323
 Switch: V232NT5
 THC : V232NT3
 HX: 1 + UX: 1
 Direction: ↓

 0.000 V
 0 LB
 0.000 Sec.

EAM-PSA-063092
 Att. 3
 PS 4/11

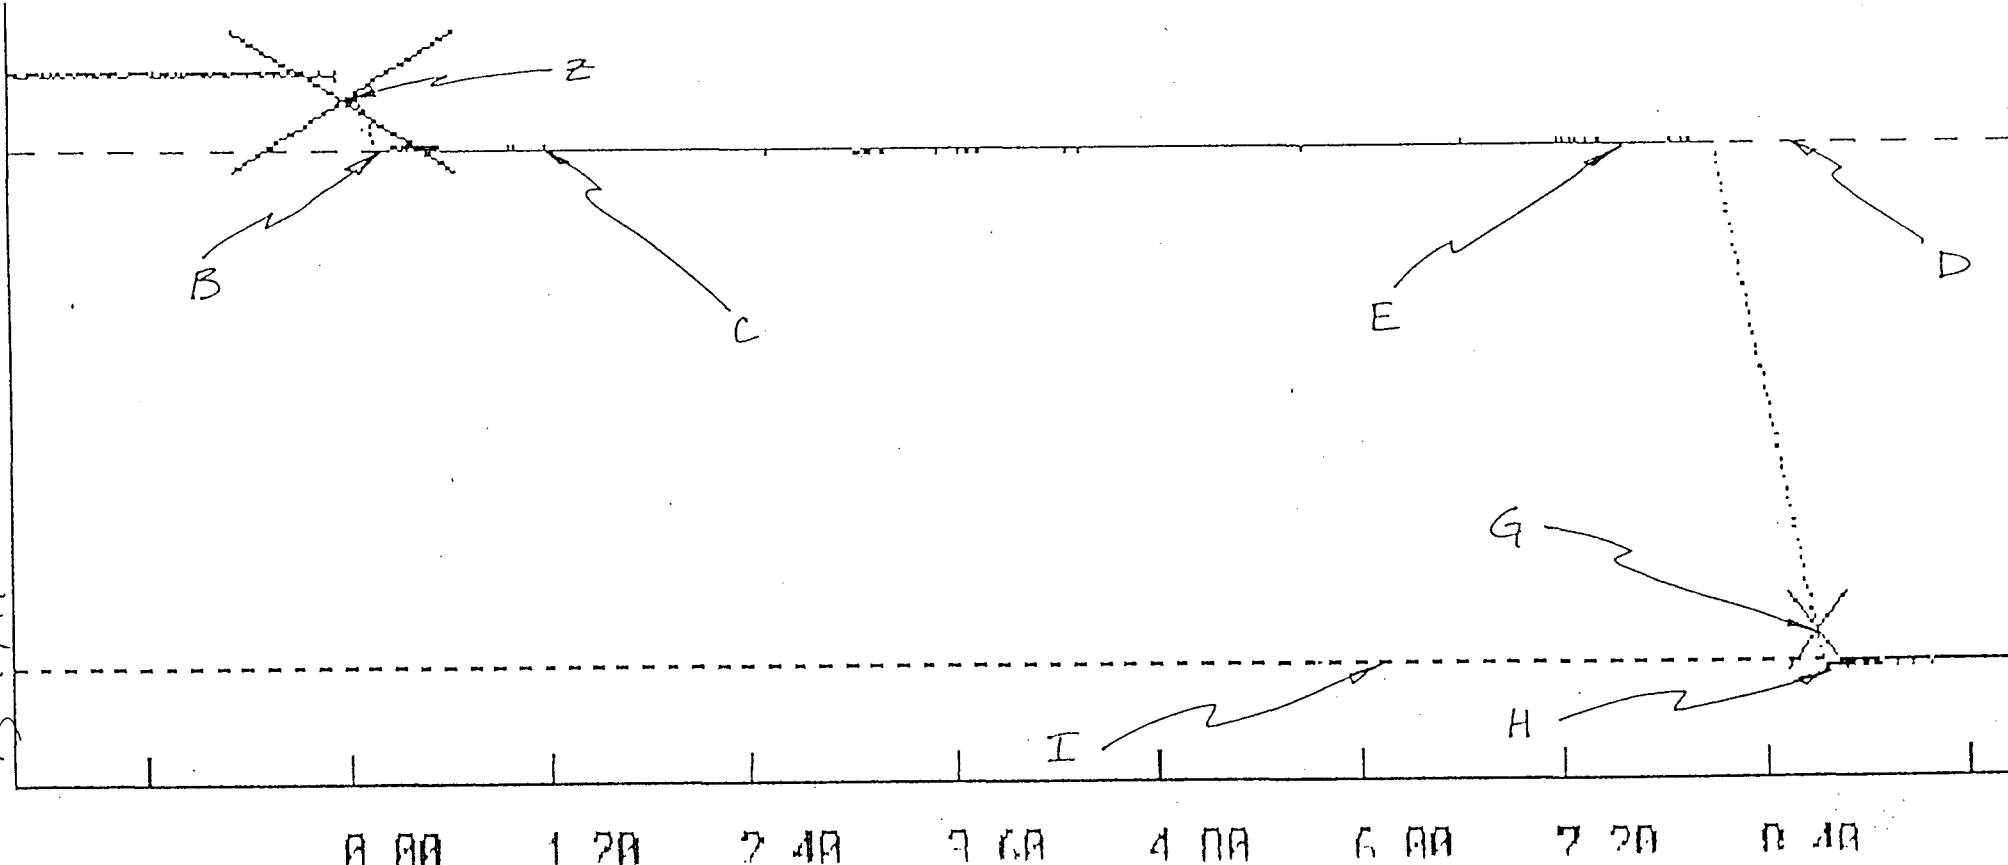

776 940614 847


This Page Added By Rev. 3

CLOSED STATIC Torque Ft-lb OPEN

B	STAT FRIC BK PT	11.86	J	UNSEATING	
C	BEGINING RL	10.95	K	DP EFFECT	N
D	AVERAGE RL	10.95	L	POST DP / AVE RL	A
E	ENDING RL	10.04	M	ENDING RL	
F	DP EFFECT	N/A			
G	CST	118.17			
H	TOTAL PEAK	135.05			
I	TOTAL FINAL	128.66	Z	ZERO LOAD	D

<< 1-FCV-68-332 >>
 Switch: V232NT5
 TQC : V232NT4
 HX: 1 * UX: 1
 Direction: ↓
 0.000 V
 0 Ft-lb
 -0.000 Sec.

EPM-PJA-063092
 Att. 3
 Pg 5 / 11

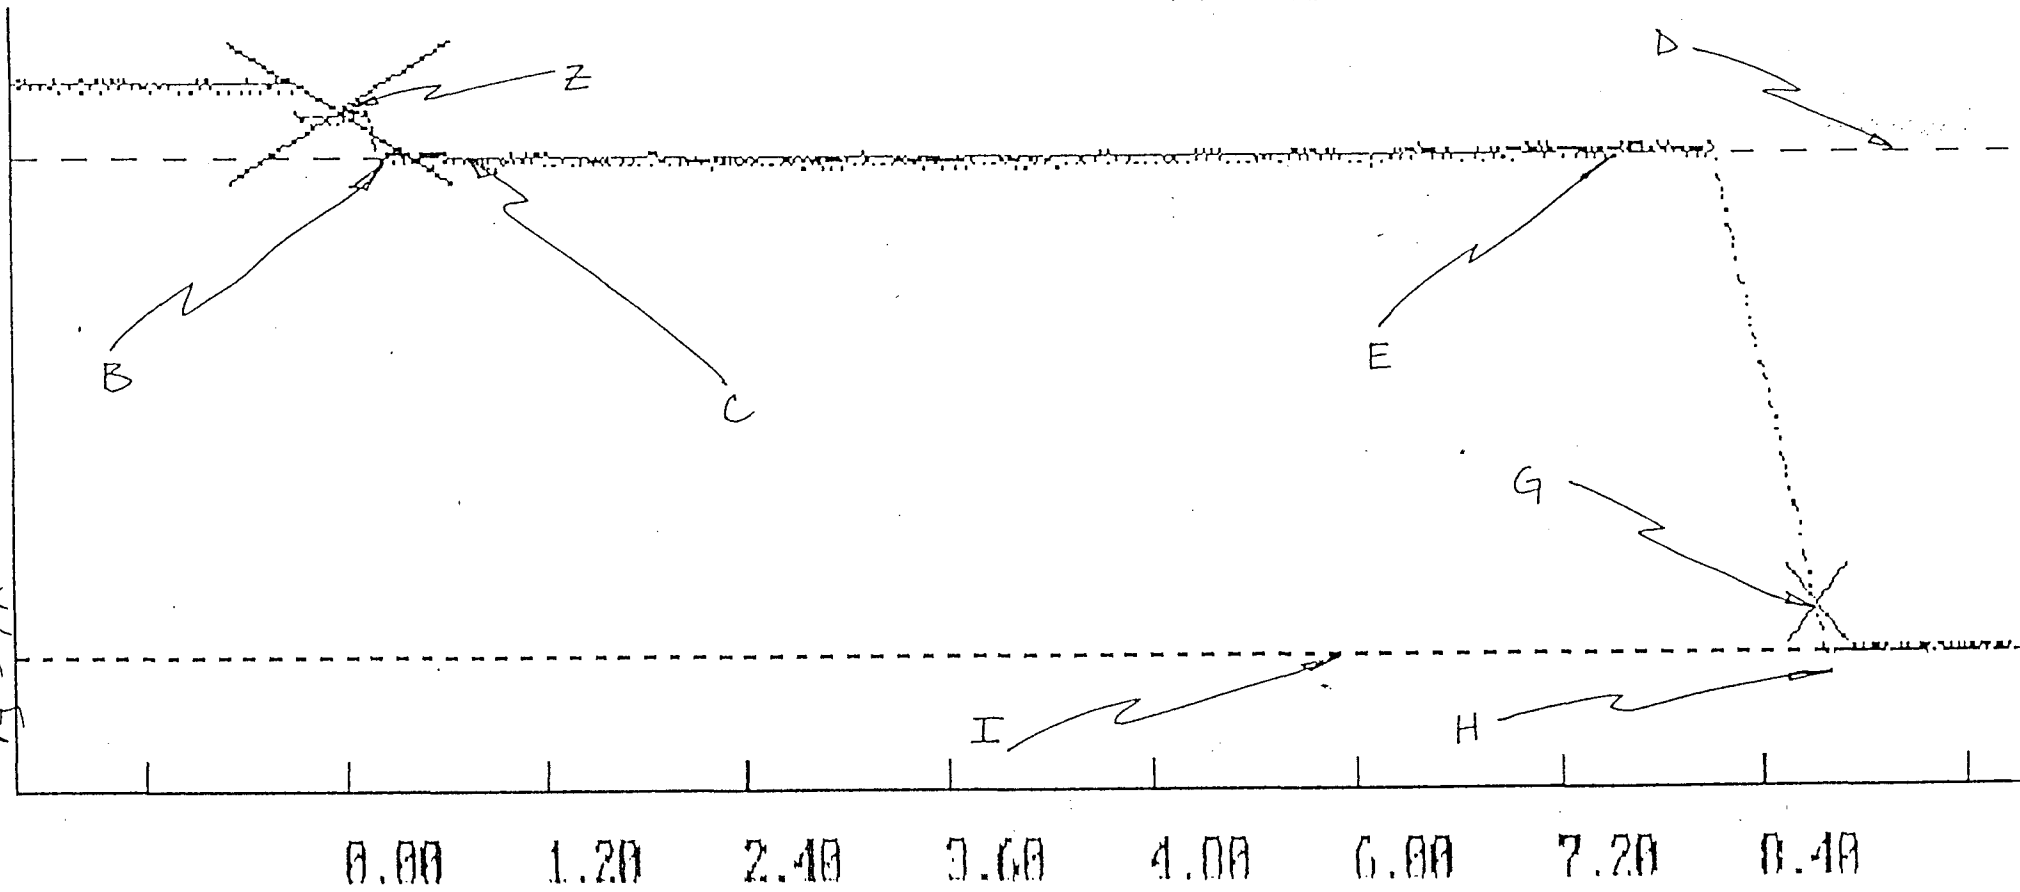

776 940614 847

This Page Added By Rev. 3

CLOSED

OPEN STATIC THRUST lb

B	STAT FRIC BK PT		J	UNSEATING	5638
C	BEGINING RL		K	DP EFFECT	N/A
D	AVERAGE RL		L	POST DP / AVE RL	1226
E	ENDING RL	N	M	ENDING RL	1086
F	DP EFFECT	A			
G	CST				
H	TOTAL PEAK				
I	TOTAL FINAL		Z	ZERO LOAD	0

<<1-FCU-68-332>>

Switch: V232\T1

THC : V232\T8

HX: 1 * UX: 1


Direction: ↑

0.000 V

0 LB

-0.000 Sec.

EPM-PSA-063092
Att. 3
Pg 6/11

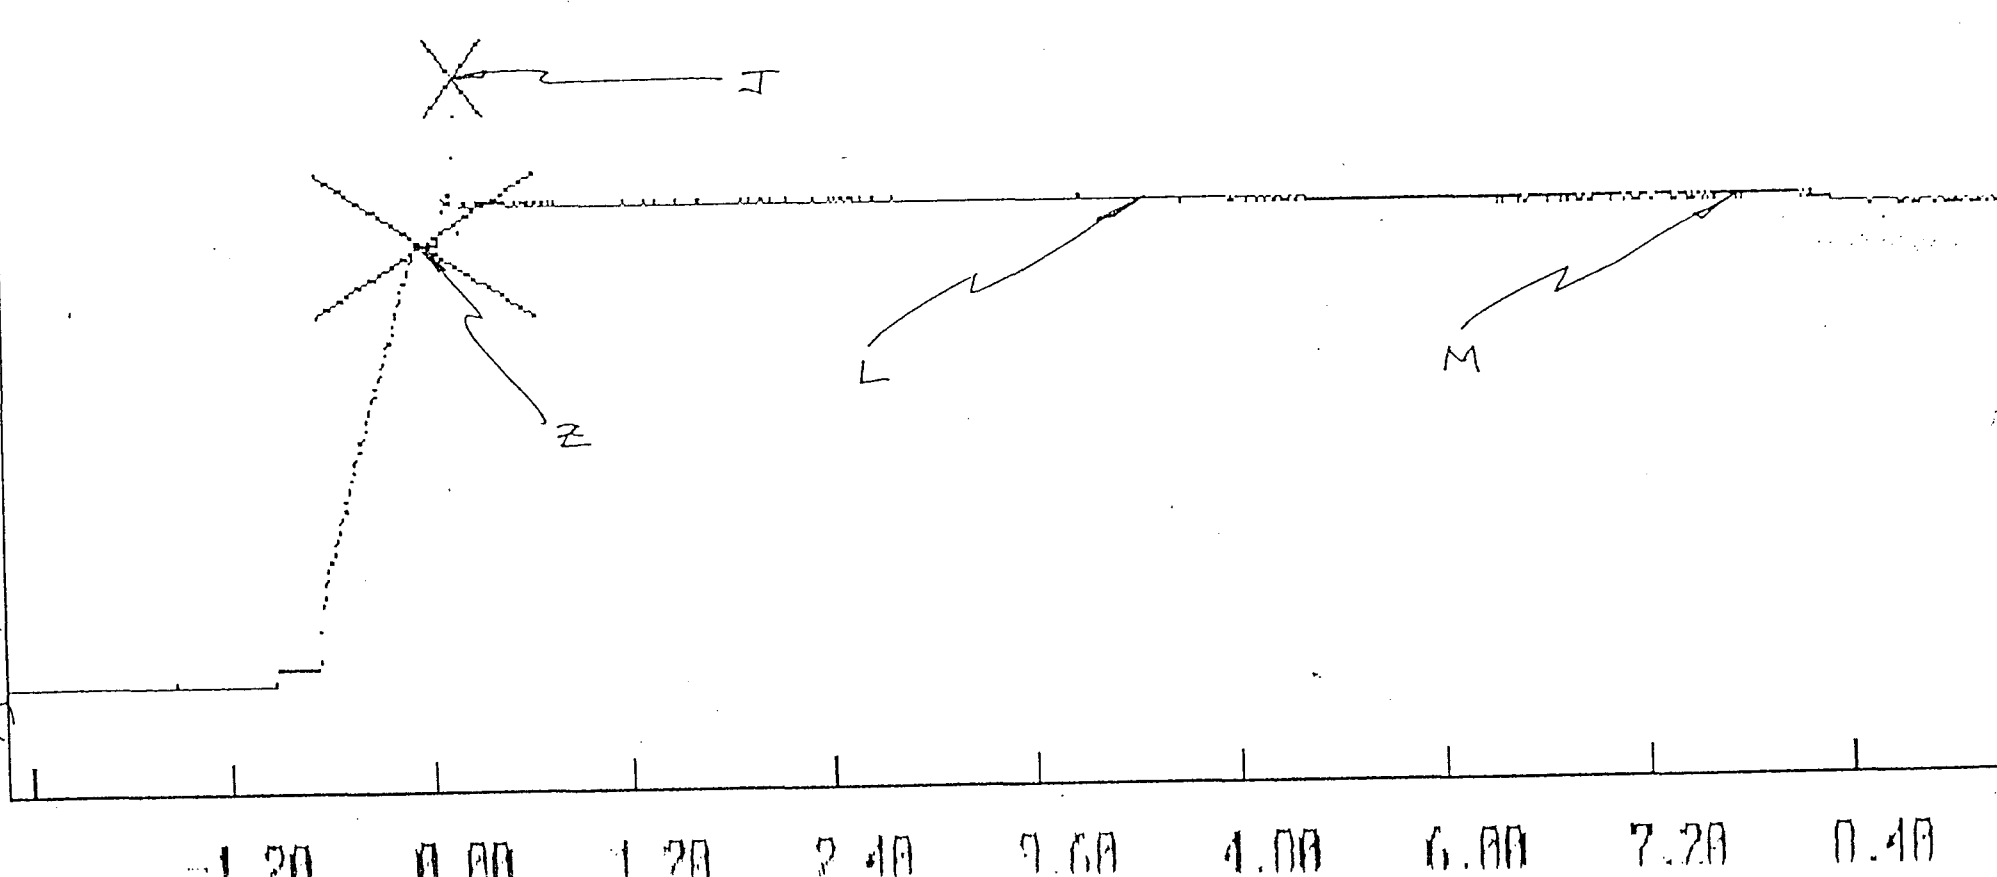

776 940614 847

This Page Added By Rev. 3

CLOSED

OPEN STATIC TORQUE FT/LB

B	STAT FRIC BK PT		J	UNSEATING	34.67
C	BEGINING RL		K	DP EFFECT	N/A
D	AVERAGE RL		L	POST DP / AVE RL	11.86
E	ENDING RL	N	M	ENDING RL	10.04
F	DP EFFECT	A			
G	CST				
H	TOTAL PEAK				
I	TOTAL FINAL		Z	ZERO LOAD	0

<<1-FCV-68-332>>

Switch: V232\T1

TQC : V232\T9


HX: 1 * UX: 1

Direction: ↑

0.000 V

0 Ft-lb

0.000 Sec.

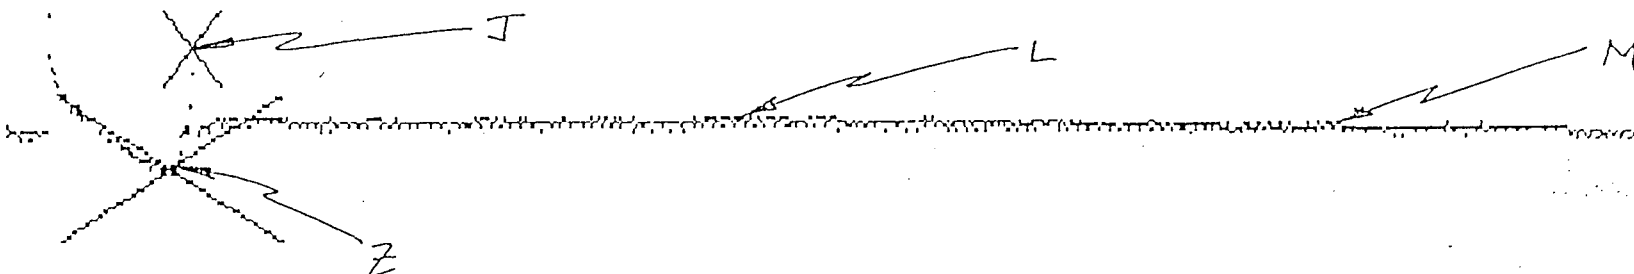

ERM-PJA-063092
Att. 3
Pg. 7 / 11

-1.20 0.00 1.20 2.40 3.60 4.80 6.00 7.20 0.40

T76 940614 847


This Page Added By Rev. 3

CLOSED DP THRUST lb OPEN

B	STAT FRIC BK PT	3257	J	UNSEATING	
C	BEGINING RL	3047	K	DP EFFECT	N
D	AVERAGE RL	3047	L	POST DP / AVE RL	A
E	ENDING RL	3047	M	ENDING RL	
F	DP EFFECT	12712			
G	CST	14393			
H	TOTAL PEAK	15549			
I	TOTAL FINAL	15234	Z	ZERO LOAD OFFSET	2171

<< 1-FCV-68-332>>
 Switch: U232\T2
 THC : U232\T1
 HX: 1 + UX: 1
 Direction: ↓
 0.000 V
 0 LB
 -0.000 Sec.

EPM-PIA-063092
 Att. 3
 Pg 8/11

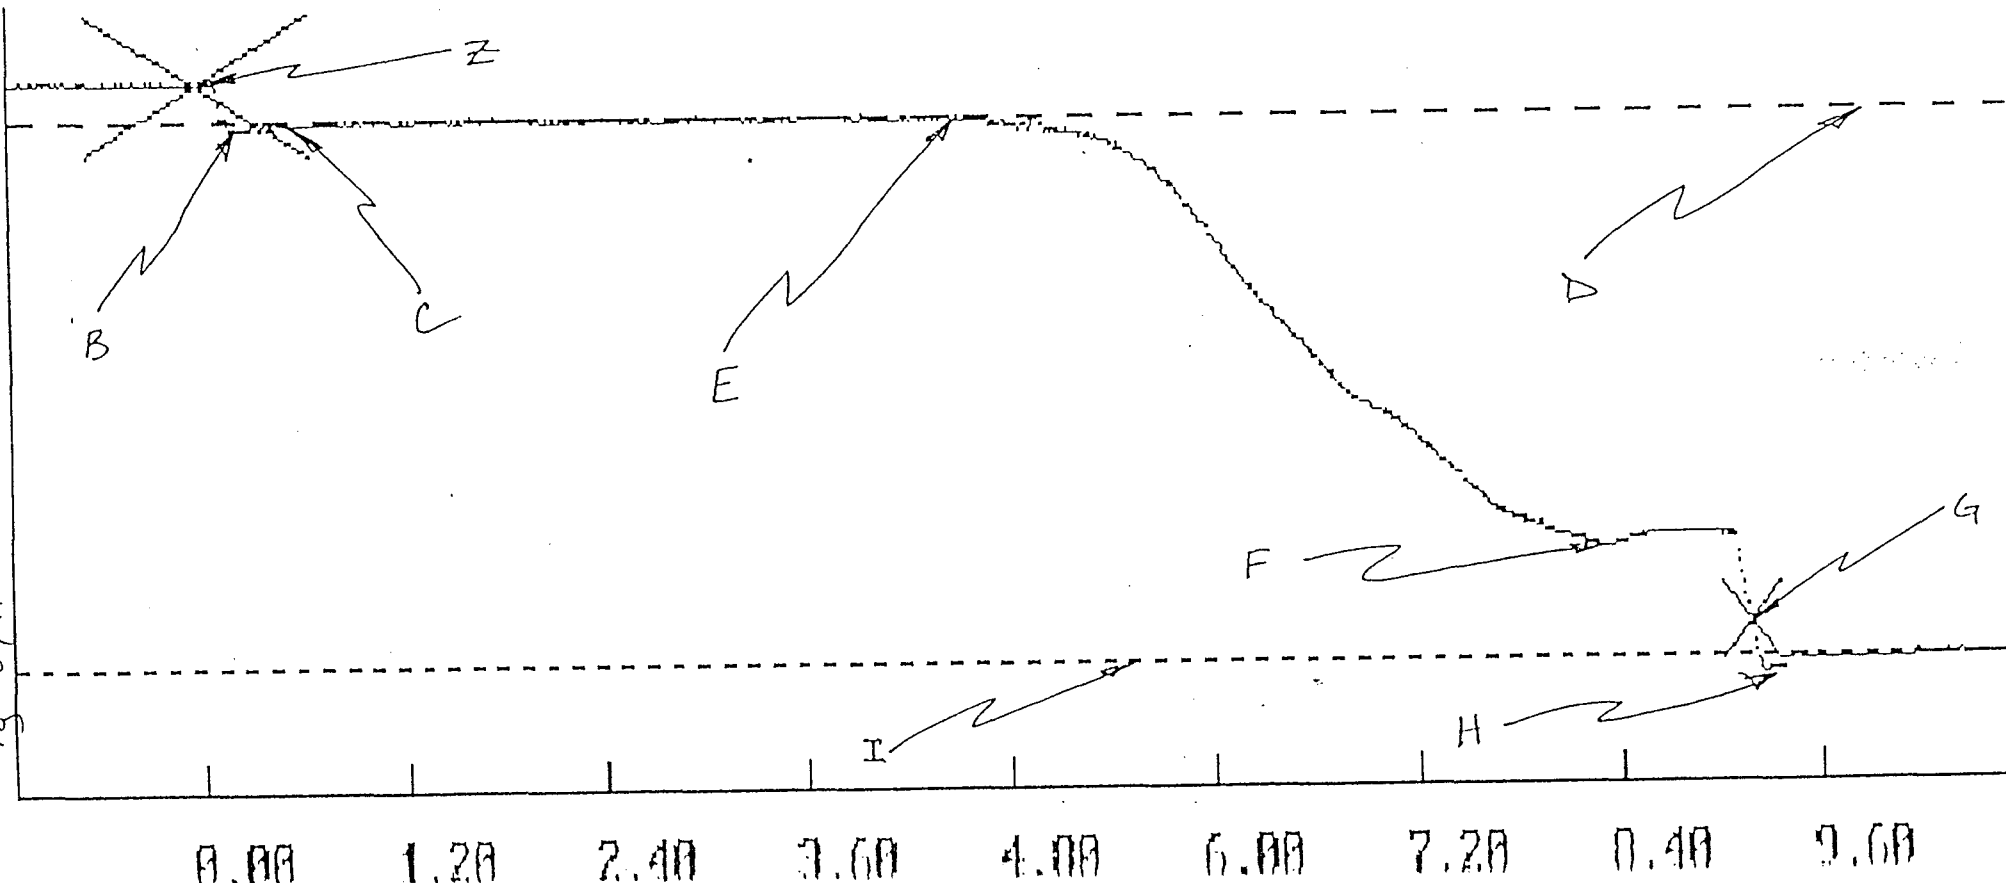

PAGE 044 OF 61

T76 940614 847


This Page Added By Rev M

CLOSED DP TORQUE FT-LB OPEN

B	STAT FRIC BK PT	34.67	J	UNSEATING	
C	BEGINING RL	31.94	K	DP EFFECT	N
D	AVERAGE RL	29.20	L	POST DP / AVE RL	A
E	ENDING RL	30.11	M	ENDING RL	
F	DP EFFECT	91.25			
G	CST	106.76			
H	TOTAL PEAK	120.45			
I	TOTAL FINAL	109.50	Z	ZERO LOAD	0

<< 1-FCU-68-332 >>
 Switch: V232NT2
 TQC : V232NT1
 HX: 1 + UX: 1
 Direction: ↓
 0.000 V
 0 FT-LB
 -0.000 Sec.

EPM-PSA-063092
Att. 3
Pg 9/11

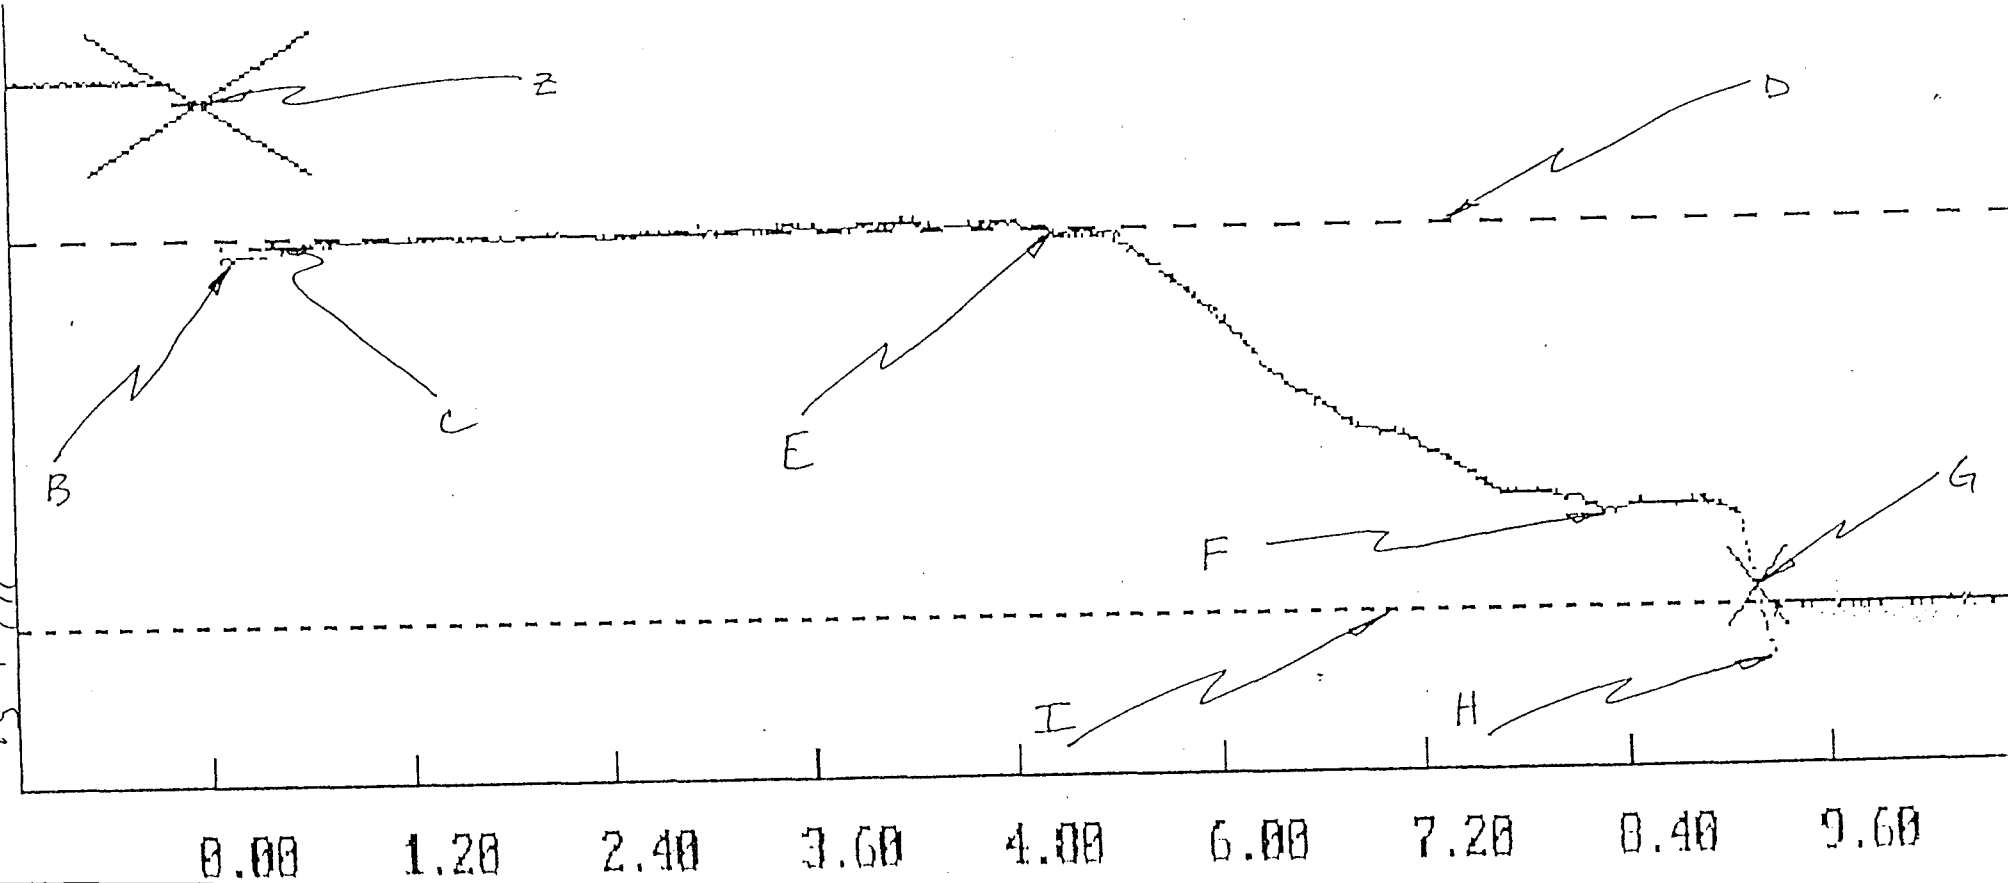

T76 940614 847

This Page Added By Rev. *M*

CLOSED

OPEN DP THRUST lb


B	STAT FRIC BK PT		J	UNSEATING	4412
C	BEGINING RL		K	DP EFFECT	4412
D	AVERAGE RL		L	POST DP / AVE RL	-2171
E	ENDING RL	N	M	ENDING RL	-2066
F	DP EFFECT	A			
G	CST				
H	TOTAL PEAK				
I	TOTAL FINAL		Z	ZERO LOAD	0

<< 1-FCV-68-332>

Switch: V232\T2
 THC : V232\T2
 HX: 1 * UX: 1
 Direction: ↑

0.000 V
 0 LB
 -0.000 Sec.

ERM-PSA-063092
 Att. 3
 PS 10/11

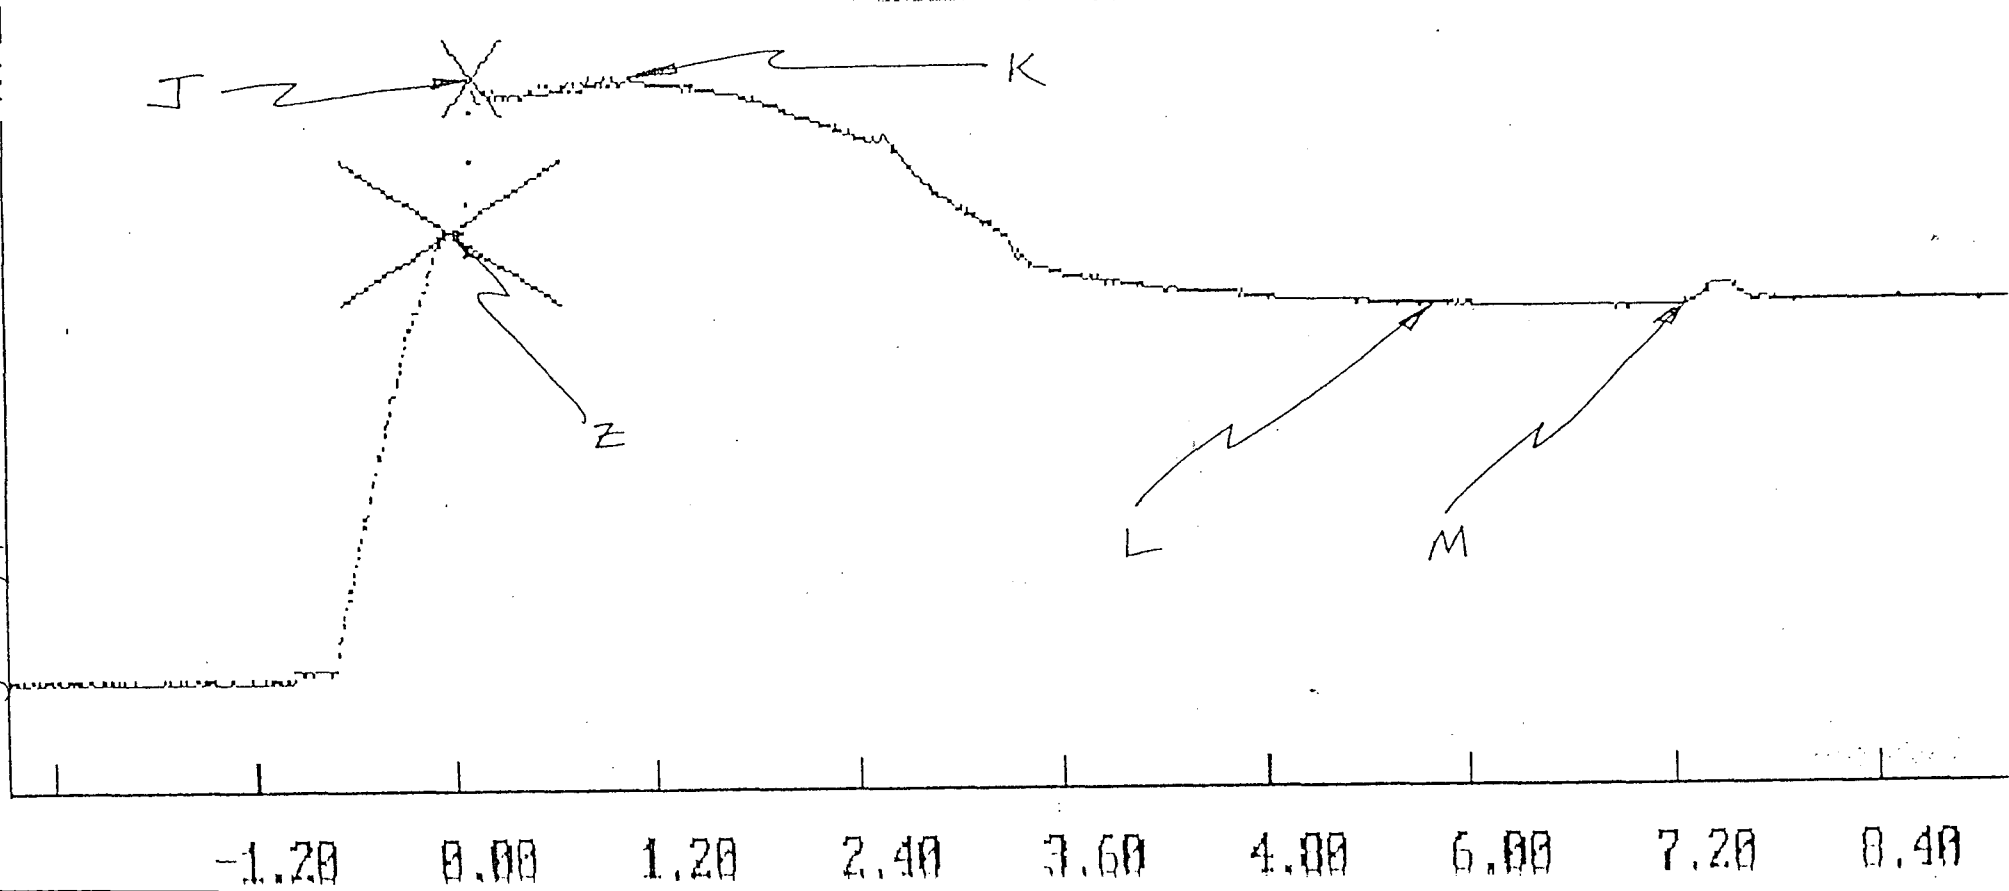

776 940614 847


This Page Added by Rev. 3

CLOSED

OPEN DP TORQUE FT Lb

B	STAT FRIC BK PT	N A	J	UNSEATING	23.72
C	BEGINING RL		K	DP EFFECT	40.15
D	AVERAGE RL		L	POST DP / AVE RL	3.19
E	ENDING RL		M	ENDING RL	5.48
F	DP EFFECT				
G	CST				
H	TOTAL PEAK				
I	TOTAL FINAL		Z	ZERO LOAD	0

<< 1-FCV-68-332>>
 Switch: U232NT2
 TQC : U232NT2
 HX: 1 * UX: 1
 Direction: ↑
 0.000 U
 0 FT-LB
 -0.000 Sec.

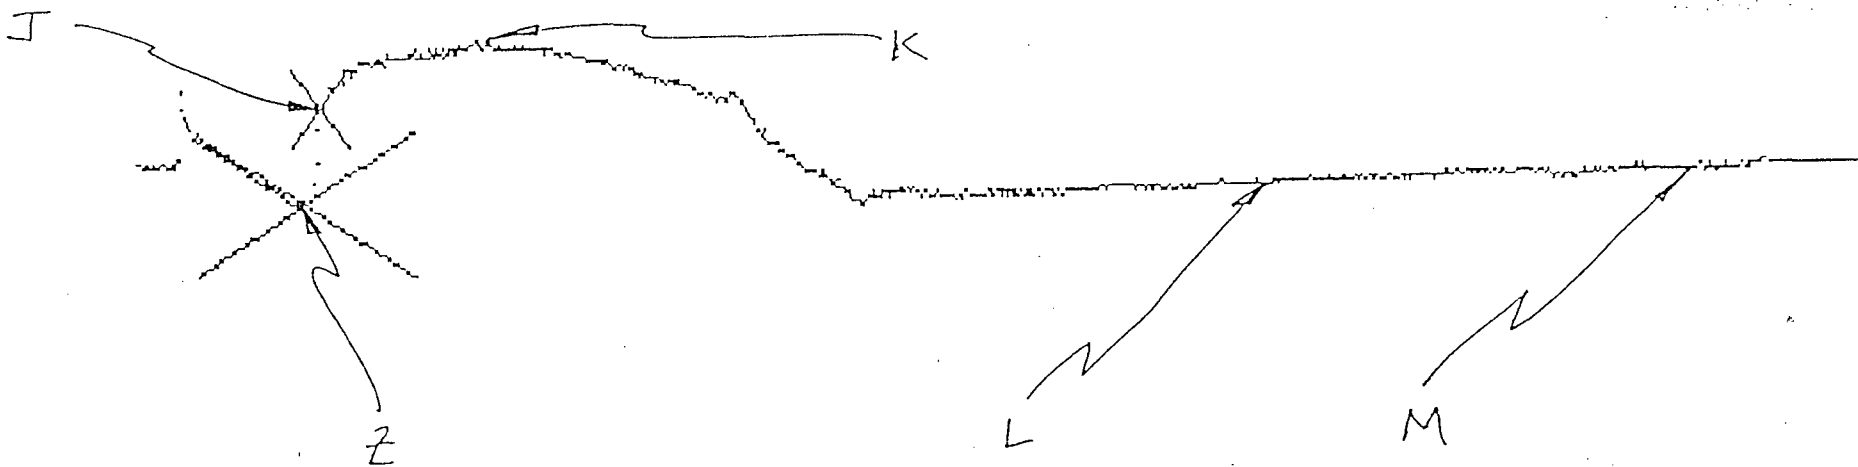

EPM-PSIA-063092
 Art 3
 Pg 11/11

-1.20 0.00 1.20 2.40 3.60 4.80 6.00 7.20 8.40