



Figure 9.4.6-1—Safeguard Building Electrical Divisions 1 and 4 Air Intake

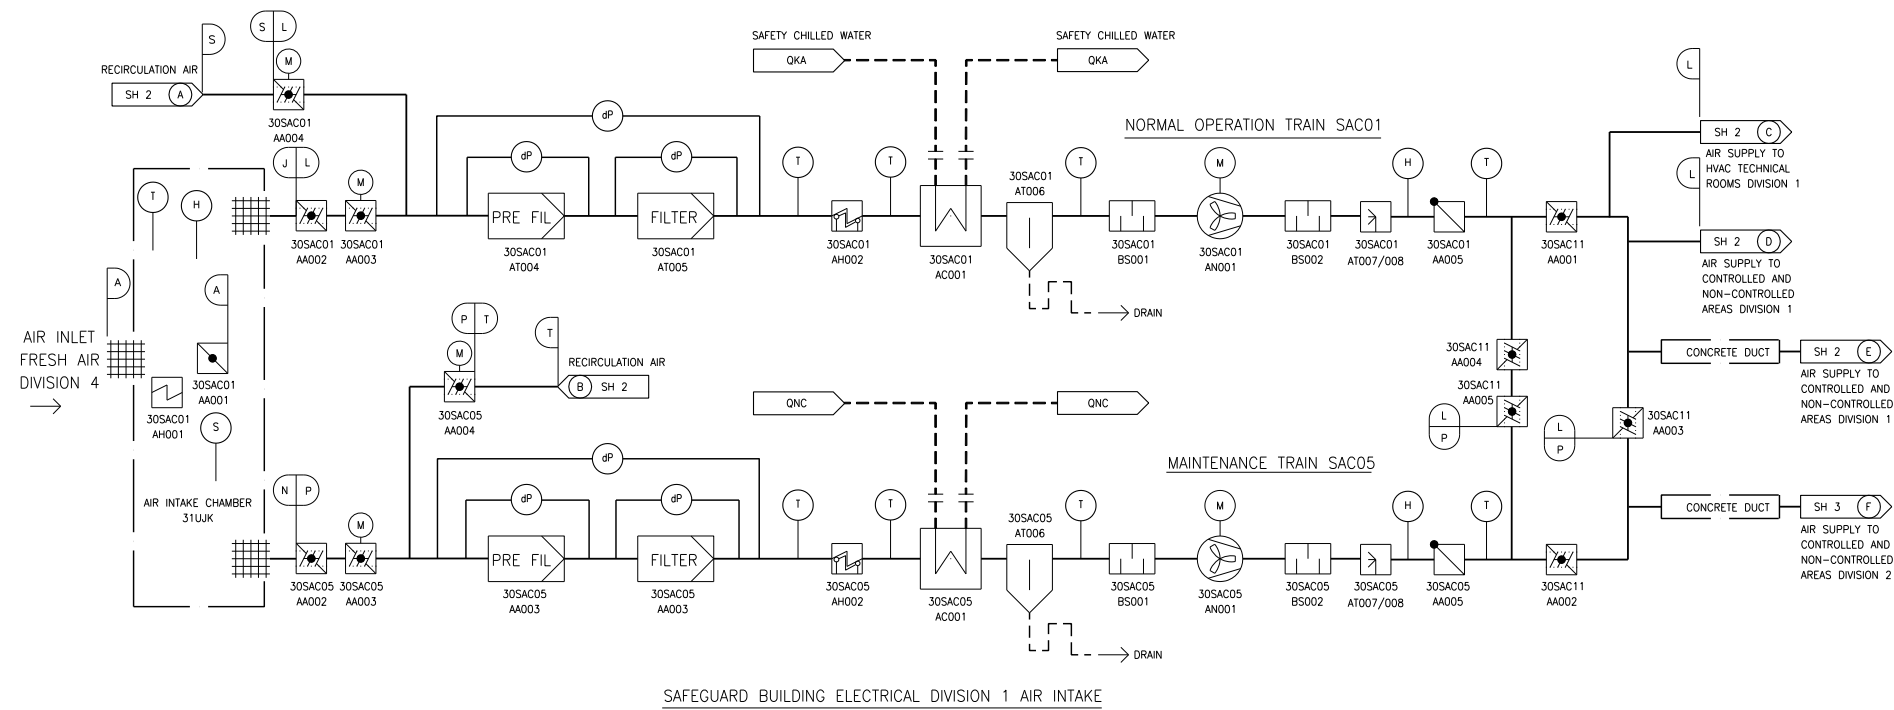


QKA - SAFETY CHILLED WATER SYSTEM
 QNC - OPERATIONAL CHILLED WATER SYSTEM
 SAC - ELECTRICAL DIVISION OF SAFEGUARD BUILDING VENTILATION SYSTEM
 31UJK - SAFEGUARD BUILDING ELECTRICAL, DIVISION 1
 34UJK - SAFEGUARD BUILDING ELECTRICAL, DIVISION 4

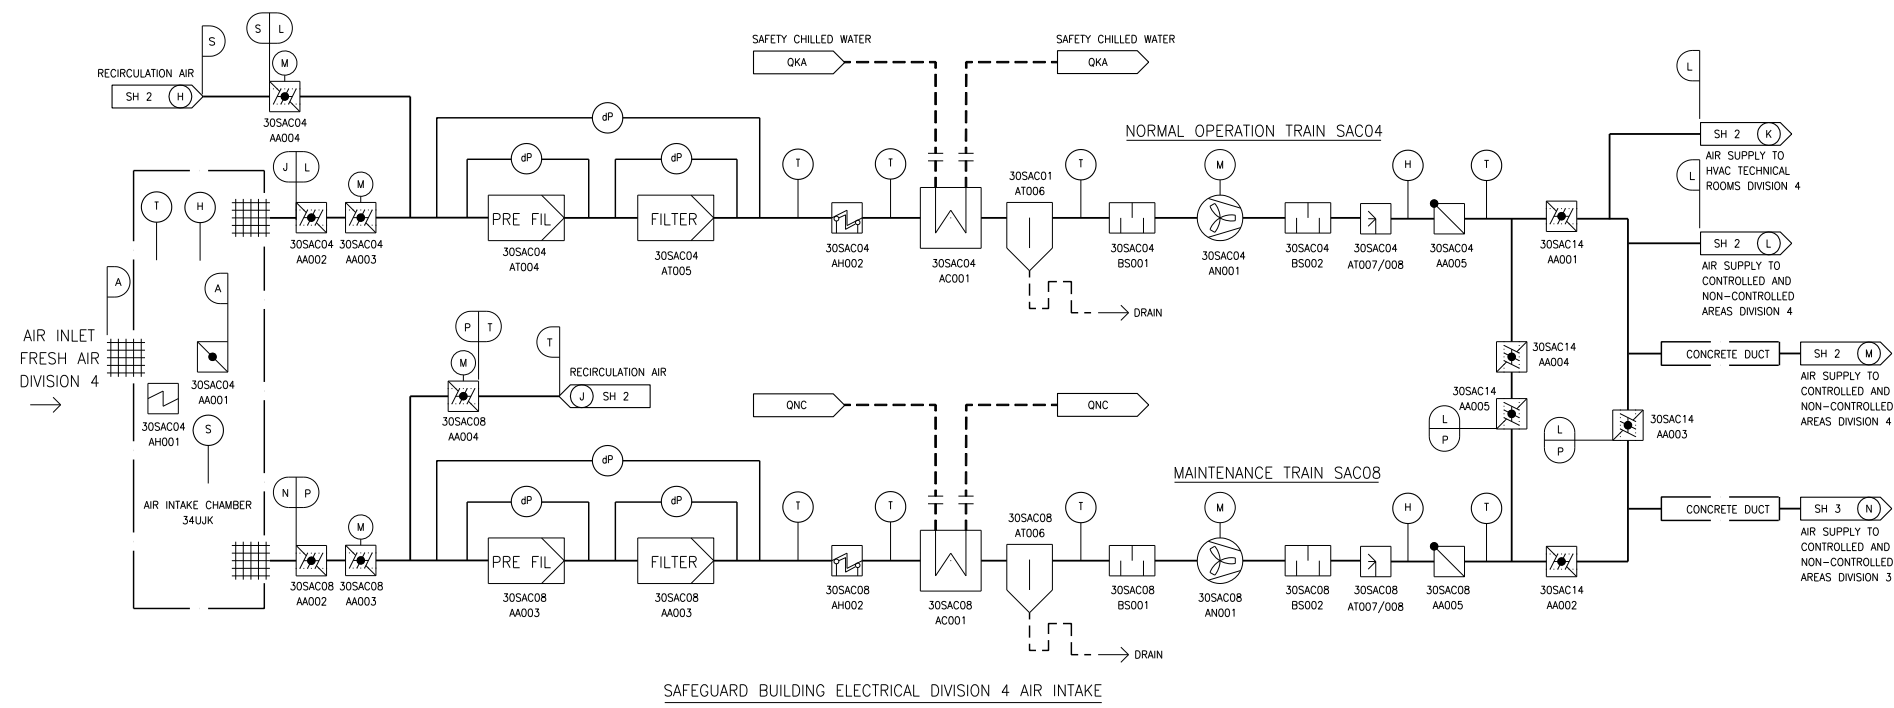


T	E	NSC
S	C	I
P	E	NSC
N	E	NSC
L	C	I
J	C	I
A	C	I
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

SAC01T2

Figure 9.4.6-2—Safeguard Building Electrical Divisions 1 and 4 Air Supply and Exhaust

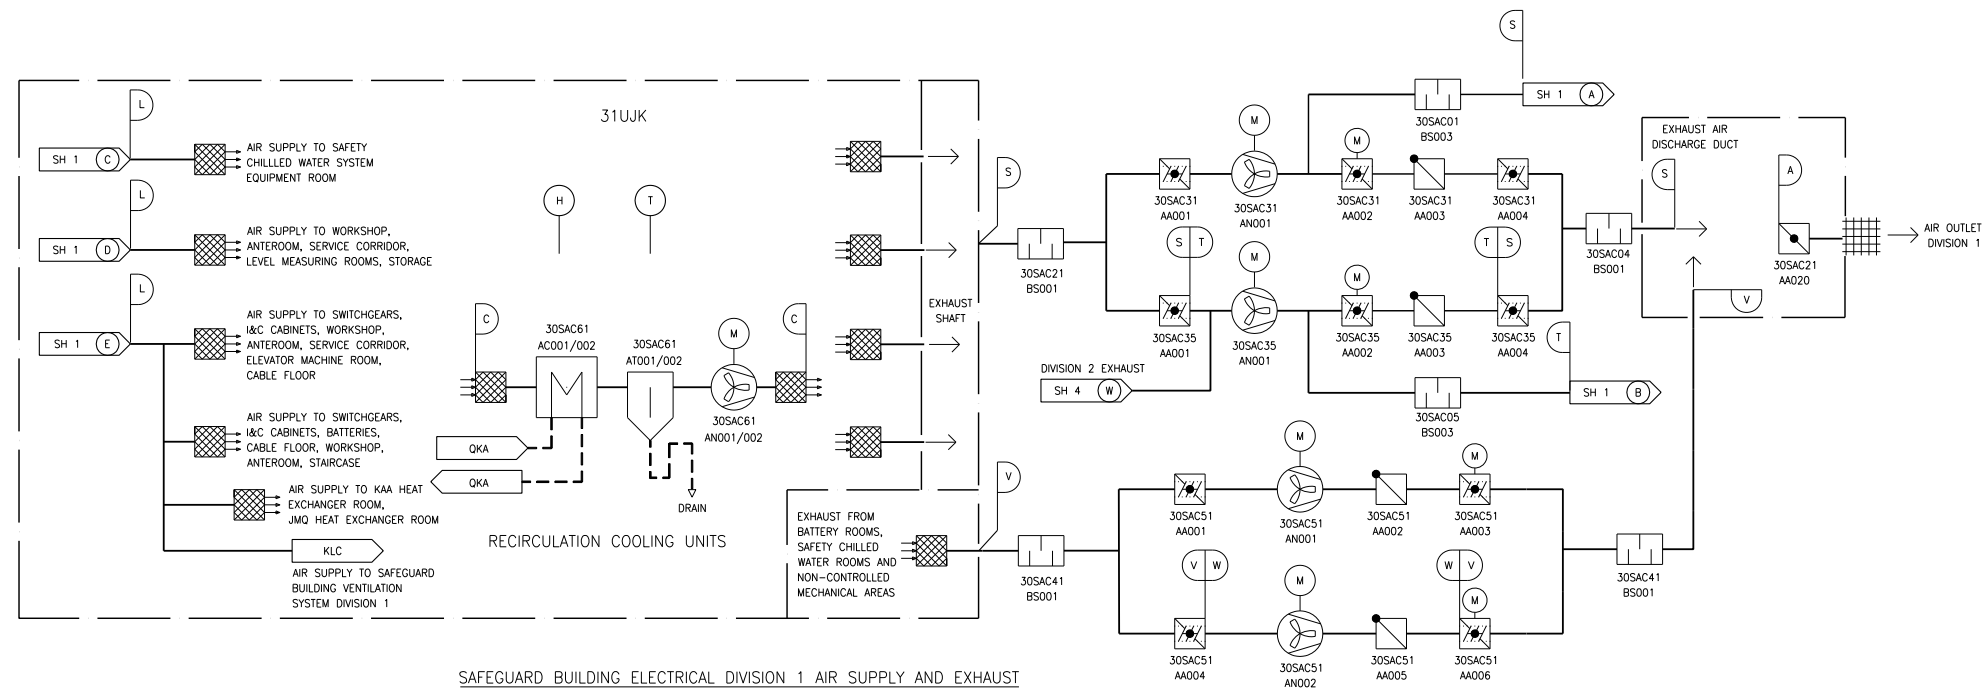


JMO - SEVERE ACCIDENT HEAT REMOVAL SYSTEM
 KAA - COMPONENT COOLING WATER SYSTEM SAFETY RELATED
 KLC - SAFEGUARD BUILDING CONTROLLED AREA VENTILATION SYSTEM
 QKA - SAFETY CHILLED WATER SYSTEM
 SAC - ELECTRICAL DIVISION OF SAFEGUARD BUILDING VENTILATION SYSTEM
 311UJK - SAFEGUARD BUILDING ELECTRICAL, DIVISION 1
 341UJK - SAFEGUARD BUILDING ELECTRICAL, DIVISION 4

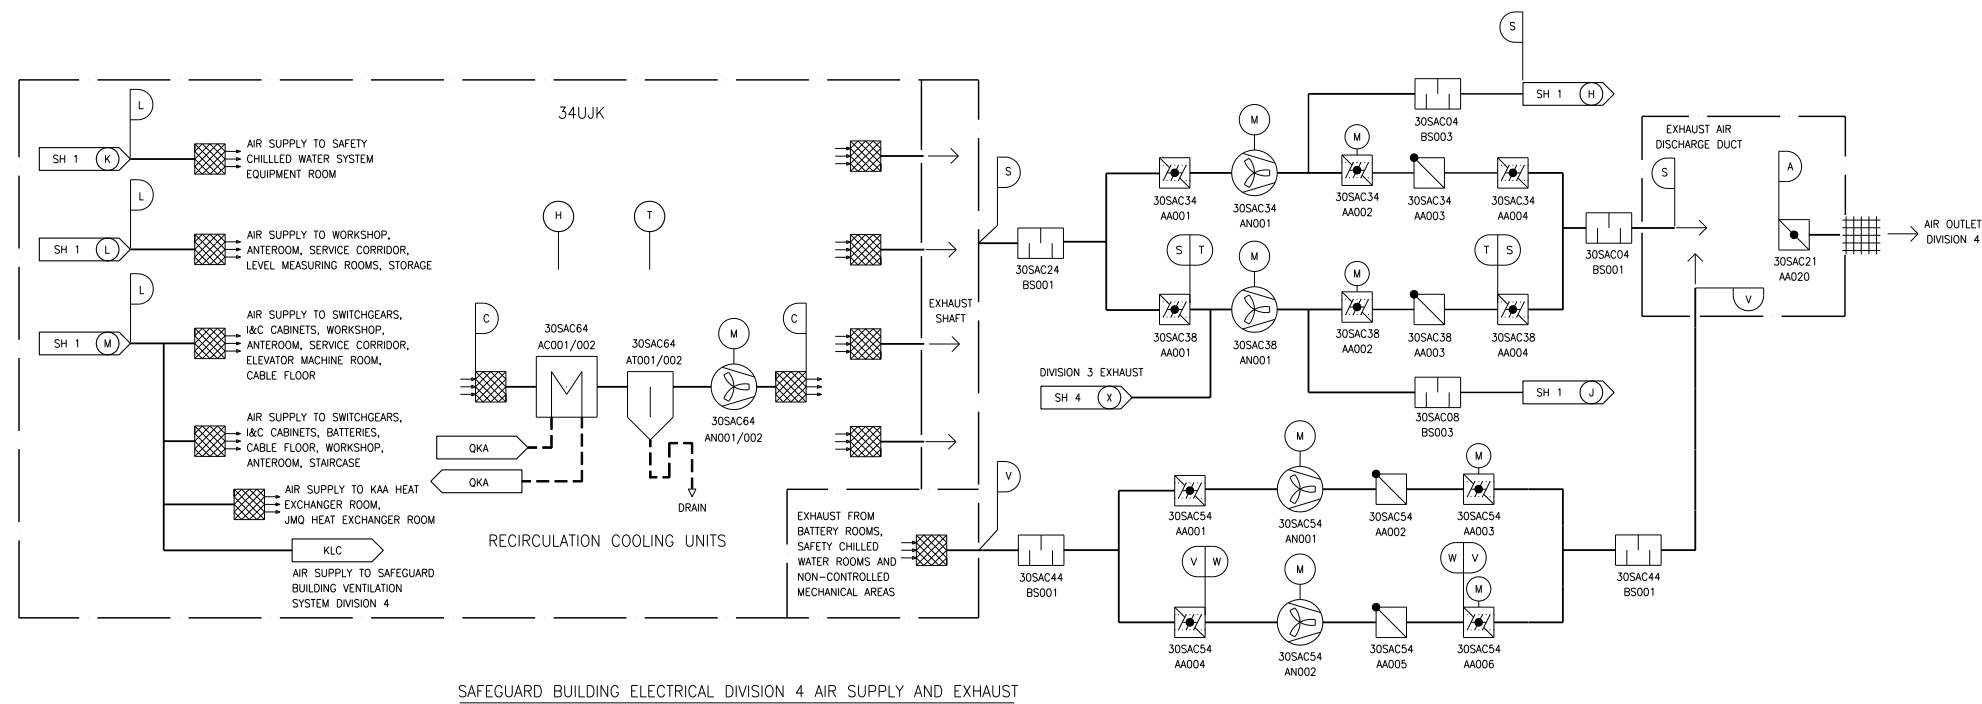

W	E	NSC
V	C	I
T	E	NSC
S	C	I
L	C	I
C	C	I
A	C	I
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS



SAC02T2

Figure 9.4.6-3—Safeguard Building Electrical Divisions 2 and 3 Air Intake

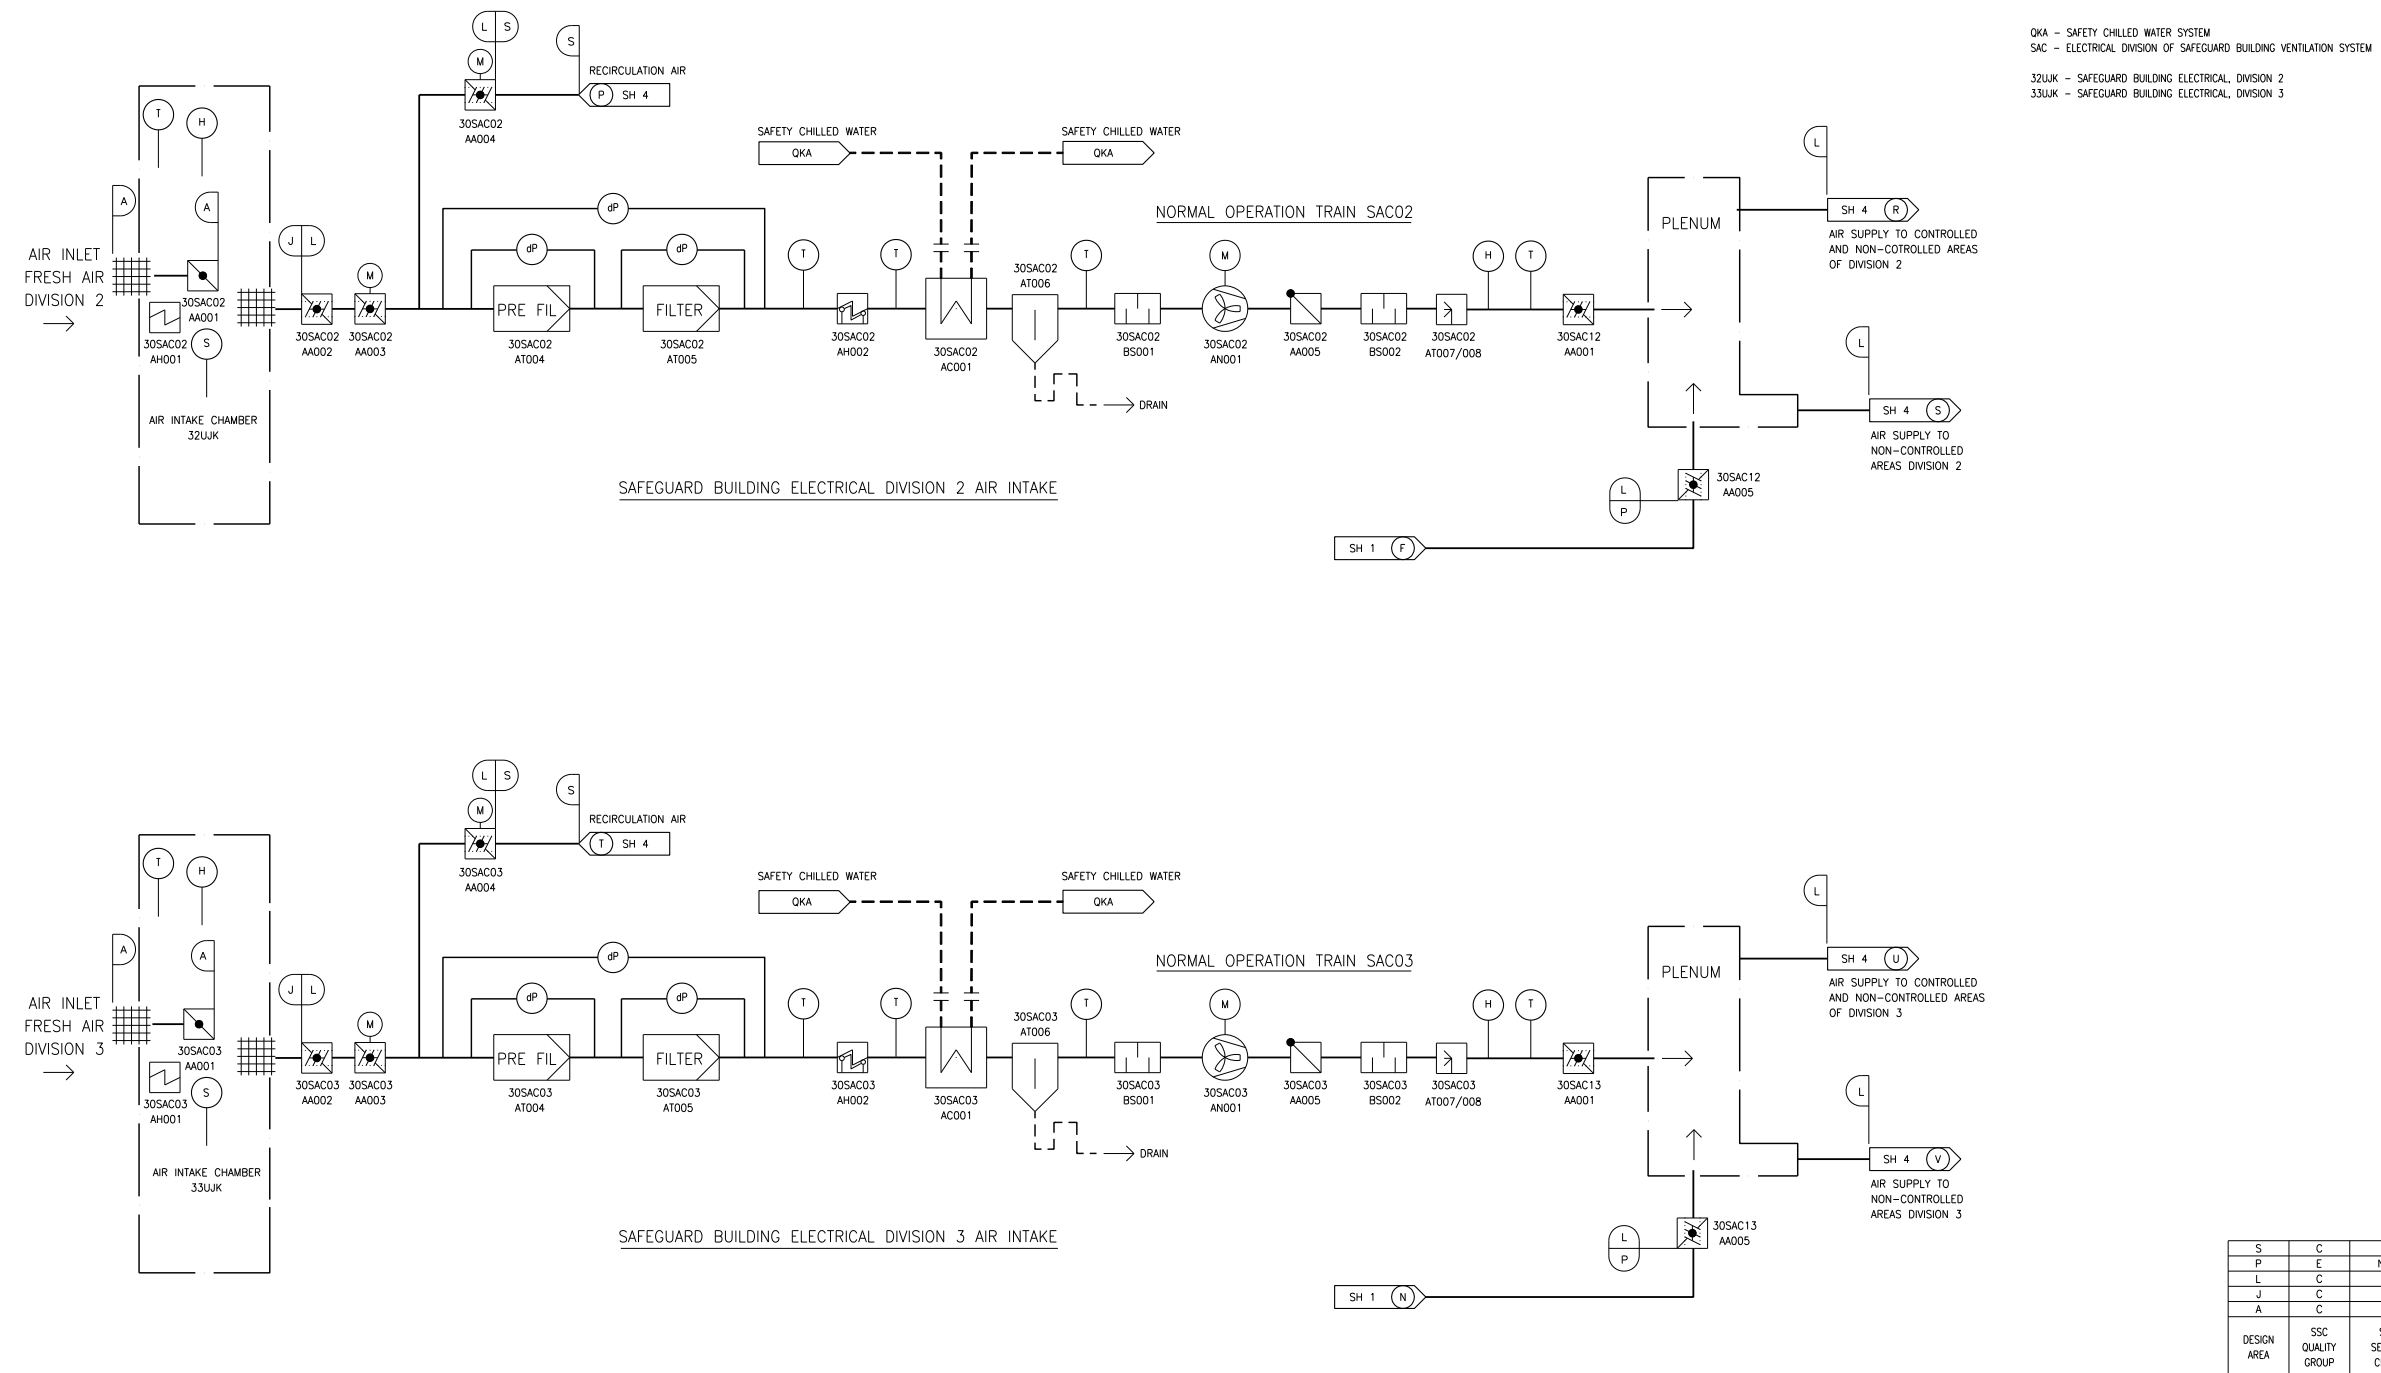

SAC03T2

Figure 9.4.6-4—Safeguard Building Electrical Divisions 2 and 3 Air Supply and Exhaust

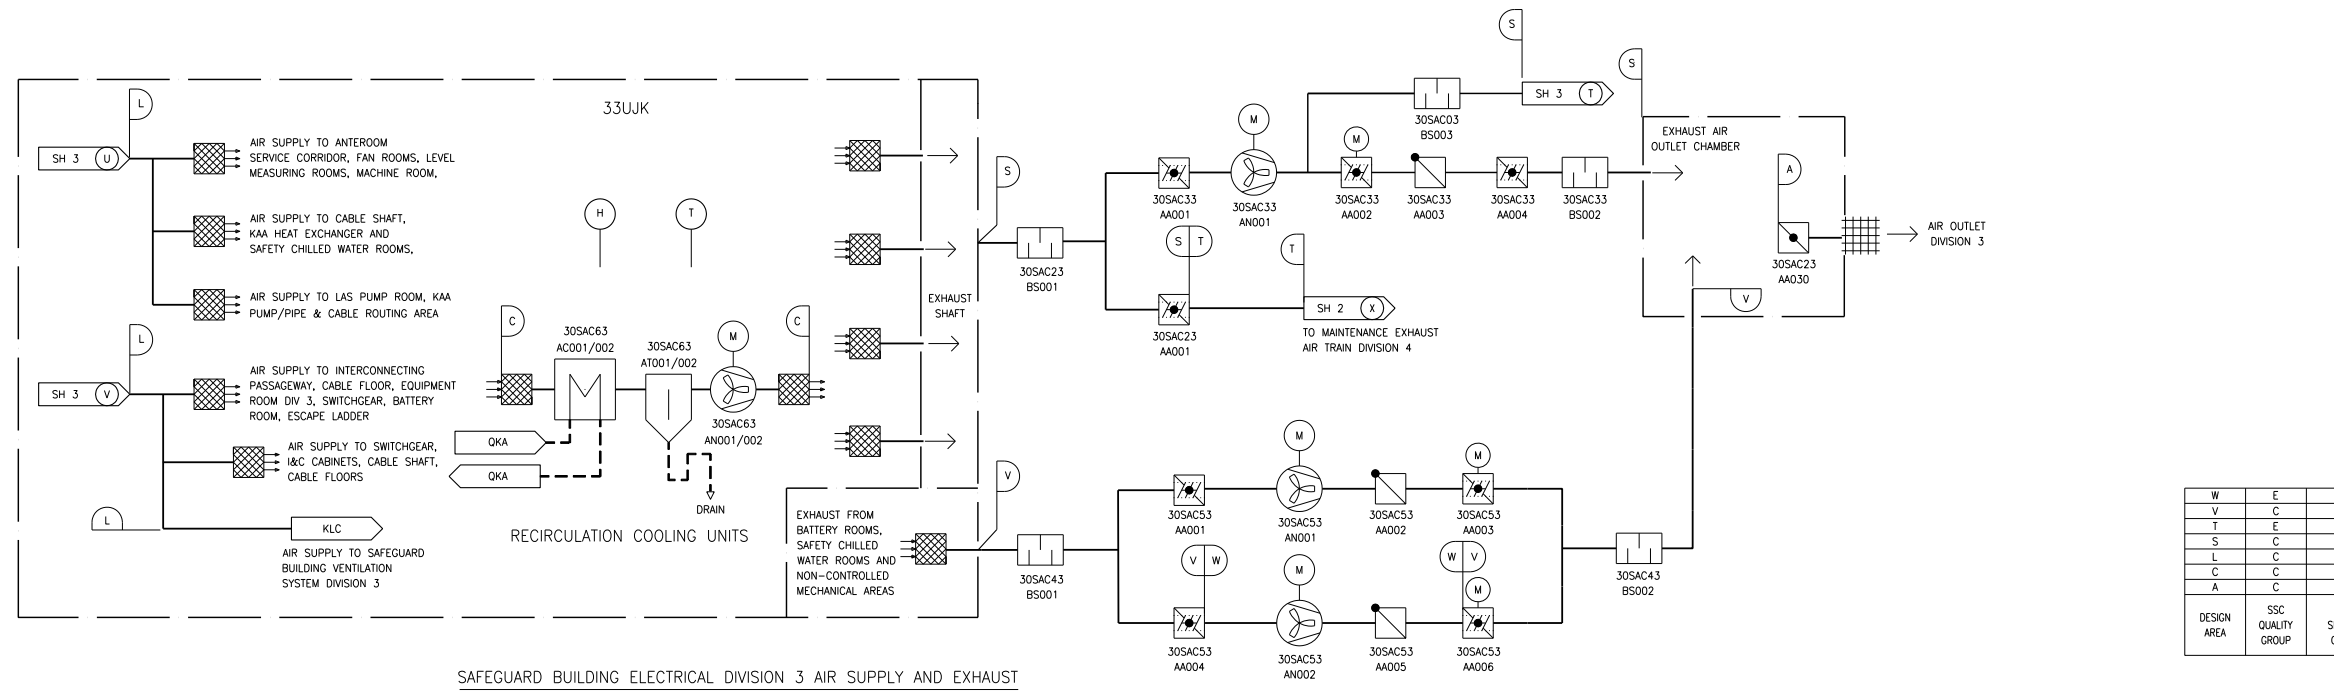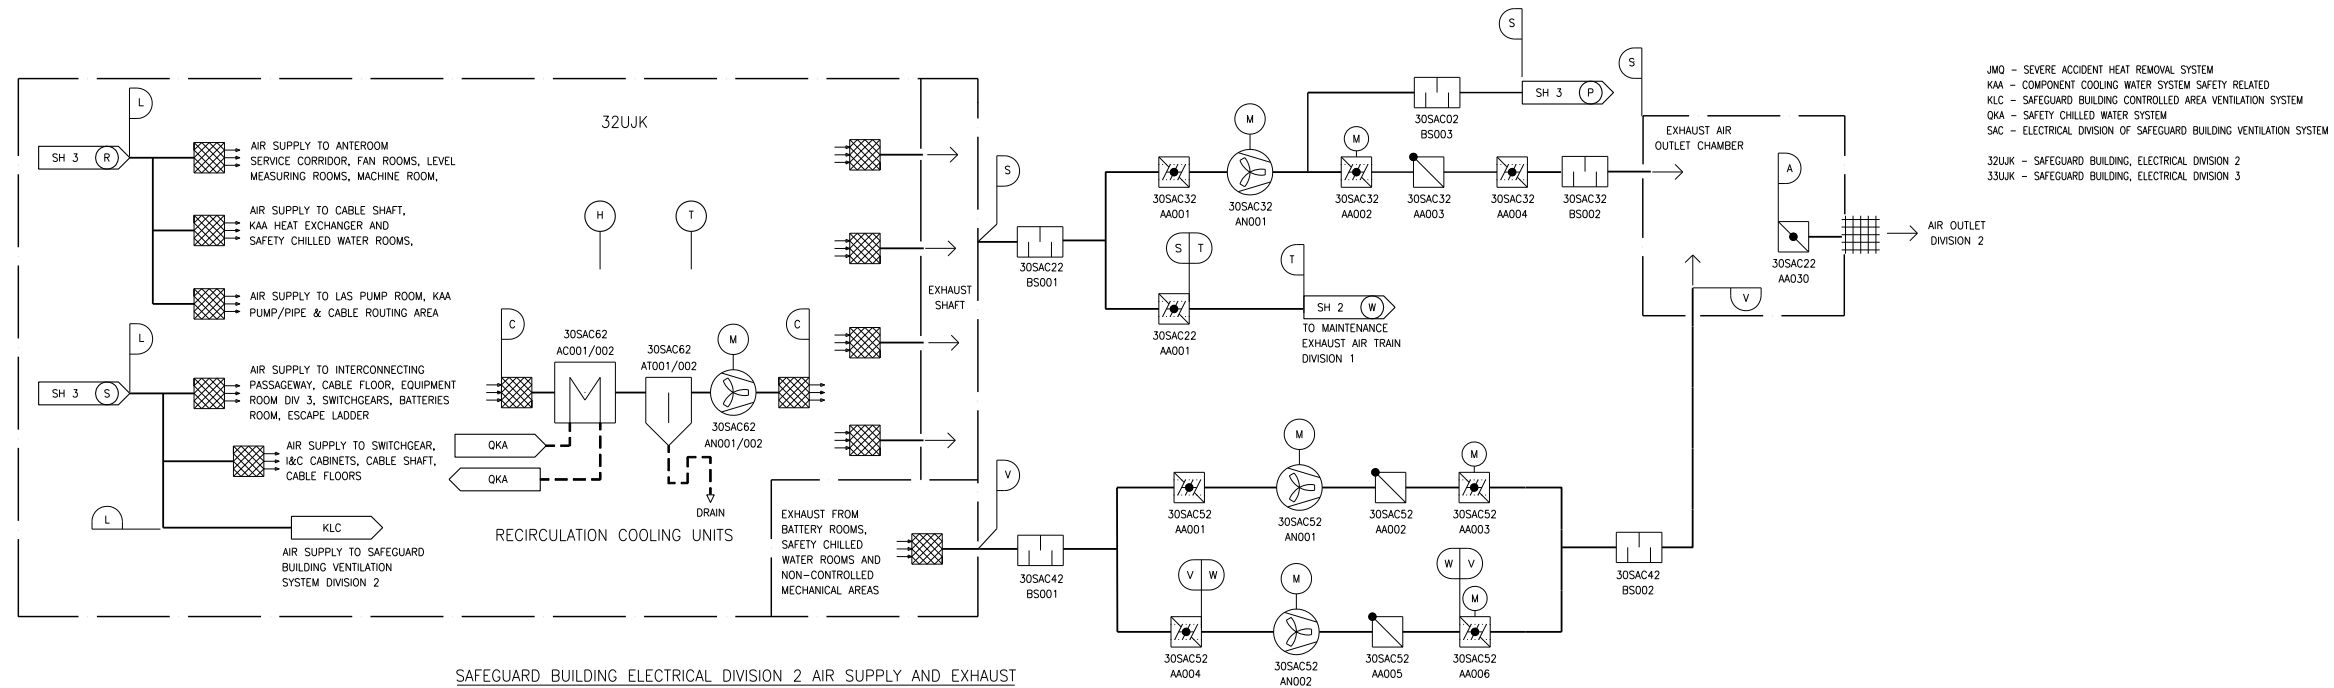

SAC04T2