




## Survey Unit Release Record

<b>Design #</b>	EP-FH-103	<b>Revision #</b>	Original	<b>Page 1 of 3</b>
<b>Survey Unit #(s)</b>	FH-103			
<b>Description</b>	<p>1) Embedded Pipe (EP) Survey Unit FH-103 meets the definition of embedded pipe for Plum Brook Reactor Facility (PBRF).</p> <p>2) EP FH-103 is a Class 1, Group 3.1 survey unit as per the PBRF Final Status Survey Plan (FSSP) and Technical Basis Document (TBD)-06-004.</p> <p>3) Surveys in EP FH-103 were performed using a scintillation detector optimized to measure gamma energies representative of Cs-137. Sample #EP 3-5 from Survey Request (SR)-13 was referenced for this decision.</p> <p>4) Survey Instructions for this survey unit are incorporated into and performed in accordance with (IAW) the Babcock Services Incorporated (BSI)/LVS-002, Work Execution Package (WEP) 05-006. Survey instructions described in this document constitute "Special Methods" and the survey design used in the acquisition of survey measurements.</p> <p>5) Instrument efficiency determinations are developed in accordance with the BSI/LVS-002, WEP 05-006, these determinations are appropriate for the types of radiation involved and the media being surveyed.</p>			
<b>Approval Signatures</b>				<b>Date:</b>
FSS/Characterization Engineer				12-12-07
Technical Reviewer (FSS/Characterization Engineer)				12-13-07
FSS/Characterization Manager	 <small>R. Case</small>			12/18/07

Form  
CS-09/1  
Rev 0

## Survey Unit: FH-103

**1.0** History/Description

- 1.1 The subject pipe system is a 4" drain line section located on the -12' el. of the Fan House building.
- 1.2 EP FH-103 consists of 4" diameter piping that is approximately 15 feet in length.

**2.0** Survey Design Information

- 2.1 EP FH-103 was surveyed IAW Procedure #BSI/LVS-002.
- 2.2 100% of the 4" ID pipe was accessible for survey. The accessible 4" ID pipe was surveyed by static measurement at one foot increments, for a total of 15 survey measurements.
- 2.3 Surface area for the 4" ID piping is 973 cm<sup>2</sup> for each foot of piping, corresponding to a total 4" ID piping surface area of 14,593 cm<sup>2</sup> (1.5 m<sup>2</sup>) for the entire length of (approximately 15') of 4" piping.

**3.0** Survey Unit Measurement Locations/Data

- 3.1 Pipe interior radiological survey forms are provided in Attachment 2 of this release record.

**4.0** Survey Unit Investigations/Results

- 4.1 None

**5.0** Data Assessment Results

- 5.1 Data assessment results are provided in the EP/Buried Pipe (BP) Survey Report provided in Attachment 1.
- 5.2 All measurement results are less than the Derived Concentration Guideline Level (DCGL) for radionuclide specific EP that corresponds to the 1 mrem/yr dose goal established in Table 3-3 of the FSSP.
- 5.3 When implementing the Unity Rule, provided in Section 3.6.3 of the FSSP, and applying the Nuclide Fraction (NF), provided in TBD-06-004, the survey unit that is constituted by EP FH-103 passes FSS.
- 5.4 Background was not subtracted from the survey measurements and the Elevated Measurement Comparison (EMC) was not employed for the accessible portion of this survey unit.

Survey Unit: FH-103

### 5.5 Statistical Summary Table

Statistical Parameter	4" Pipe
Total Number of Survey Measurements	15
Number of Measurements >MDC	2
Number of Measurements Above 50% of DCGL	0
Number of Measurements Above DCGL	0
Mean	0.0033
Median	0.0031
Standard Deviation	0.0012
Maximum	0.0054
Minimum	0.0011

### 6.0 Documentation of evaluations pertaining to compliance with the unrestricted use limit of 25 mrem/yr and dose contributions from Embedded Pipe and radionuclides contributing 10% in aggregate of the total dose for both structural scenarios and soils.

6.1 A review of the survey results has shown that the dose contribution for EP FH-103 to be less than 1 mrem/yr. The dose contribution is estimated to be 0.003 mrem/yr based on the average of the actual gross counts measured.

### 7.0 Attachments

Attachment 1 – BSI EP/BP Survey Report

Attachment 2 – Pipe Interior Radiological Survey Form

Attachment 3 – DQA Worksheet

Attachment 4 –Disc containing RR for EP FH-103 & Spreadsheet

**SECTION 7**  
**ATTACHMENT 1**  
**2 PAGE(S)**



## BSI EP/BP SURVEY REPORT

Pipe ID	EP FH-103	Survey Location	Sump Rm #7 -12' el.
Survey Date	06-Sep-06	2350-1 #	189094
Survey Time	08:16	Detector-Sled #	44-159 238367/101
Pipe Size	4"	Detector Efficiency	0.00019
DCGL (dpm/100cm2)	3.79E+06	Pipe Area Incorporated by Detector Efficiency (in cm2)	973
Pipe Area Incorporated by Survey Data (m <sup>2</sup> )	1.5	Field BKG (cpm)	36.8
Routine Survey	X	Field MDCR (cpm)	23.9
QA Survey		Nominal MDC (dpm/100cm2)	9,453
Survey Measurement Results			
Total Number of Survey Measurements		15	
Number of Measurements >MDC		2	
Number of Measurements Above 50% DCGL		0	
Number of Measurements Above DCGL		0	
Mean		0.0033	
Median		0.0031	
Standard Deviation		0.0012	
Maximum		0.0054	
Minimum		0.0011	
Survey Technician(s)	STOCK		
Survey Unit Classification		1	
TBD 06-004 Piping Group		3.1	
SR-13 Radionuclide Distribution Sample		EP 3-5	
Measured Nuclide		Cs-137	
Area Factor/EMC Used		No	
Pass/Fail FSS		Pass	
MREM/YR Contribution		<1	
COMMENTS: ACTIVITY VALUES NOT BACKGROUND CORRECTED			
RP Engineer   Date		<i>Paul Marshall</i> 12-12-07	

**EP FH-103**  
**4" Pipe**  
**TBD 06-004 Group 3.1**

Measurement #	gcpm	ncpm	Cs-137 activity (total dpm)	Cs-137 activity (dpm/100cm2)	Co-60 activity (dpm/100cm2)	Eu-152 activity (dpm/100cm2)	Eu-154 activity (dpm/100cm2)	Nb-94 activity (dpm/100cm2)	Ag-108m activity (dpm/100cm2)	Unity
1	19	19	100,000	10,279	630	-	42	-	-	0.005
2	12	12	63,158	6,492	398	-	27	-	-	0.003
3	17	17	89,474	9,197	564	-	38	-	-	0.005
4	7	7	36,842	3,787	232	-	16	-	-	0.002
5	9	9	47,368	4,869	298	-	20	-	-	0.003
6	10	10	52,632	5,410	332	-	22	-	-	0.003
7	4	4	21,053	2,164	133	-	9	-	-	0.001
8	7	7	36,842	3,787	232	-	16	-	-	0.002
9	12	12	63,158	6,492	398	-	27	-	-	0.003
10	13	13	68,421	7,033	431	-	29	-	-	0.004
11	11	11	57,895	5,951	365	-	24	-	-	0.003
12	15	15	78,947	8,115	497	-	33	-	-	0.004
13	9	9	47,368	4,869	298	-	20	-	-	0.003
14	11	11	57,895	5,951	365	-	24	-	-	0.003
15	18	18	94,737	9,738	597	-	40	-	-	0.005
									MEAN	0.003
									MEDIAN	0.003
									STD DEV	0.001
									MAX	0.005
									MIN	0.001



**SECTION 7**  
**ATTACHMENT 2**  
3 **PAGE(S)**

## Pipe Interior Radiological Survey Form

Date: 9/6/06 Time: 0816  
 Pipe ID#: FH-103 Pipe Diameter: 4" Access Point Area: Sump Rm #7  
 Building: FAN HOUSE Elevation: -12' System: DRAIN

Type of Survey Investigation \_\_\_\_\_ Characterization \_\_\_\_\_ Final Survey X Other ✓  
 Gross \_\_\_\_\_ Co60 \_\_\_\_\_ Cs ✓

Detector ID# / Sled ID# 44-159 H 238367 / 101

Detector Cal Date: 6/21/06 Detector Cal Due Date: 6/21/07

Instrument: 2350-1 Instrument ID #: 189094

Instrument Cal Date: 3/15/06 Instrument Cal Due Date: 3/15/07

From the Daily Pipe Survey Detector Control Form for the Selected Detector

Background Value 36.8 cpm

MDCR<sub>static</sub> 23.9 cpm

Efficiency Factor for Pipe Diameter 0.00019 (from detector efficiency determination)

MDC<sub>static</sub> 9463 dpm/ 100 cm<sup>2</sup>

Is the MDC<sub>static</sub> acceptable? Yes No (if no, adjust sample count time and recalculate MDCR<sub>static</sub>)

Comments: INITIAL SURVEY EP3-3 COMPLETE

Technician Signature [Signature]

## Pipe Interior Radiological Survey

Position #	Feet into Pipe from Opening	Count Time (min)	Gross Counts	Gross cpm	Net cpm	dpm/100cm <sup>2</sup>
1	1	1	19	19	n/a	n/a
2	2	↓	12	12	↓	↓
3	3	↓	17	17	↓	↓
4	4	↓	7	7	↓	↓
5	5	↓	9	9	↓	↓
6	6	↓	10	10	↓	↓
7	7	↓	4	4	↓	↓
8	8	↓	7	7	↓	↓
9	9	↓	12	12	↓	↓
10	10	↓	13	13	↓	↓

REFERENCE COPY

Package Page 1 of 3

Attachment 3, Page 1



## Pipe Interior Radiological Survey Form (Continuation Form)


Date: 9/6/06  
 Pipe ID#: PH 103 Pipe Diameter: 4' Access Point Area: Scrap Run #7  
 Building: FAN HOUSE Elevation: -12' System: DRAIN

[illegible]Package Page 2 of 3

REFERENCE COPY

FH 103

REFERENCE COPY

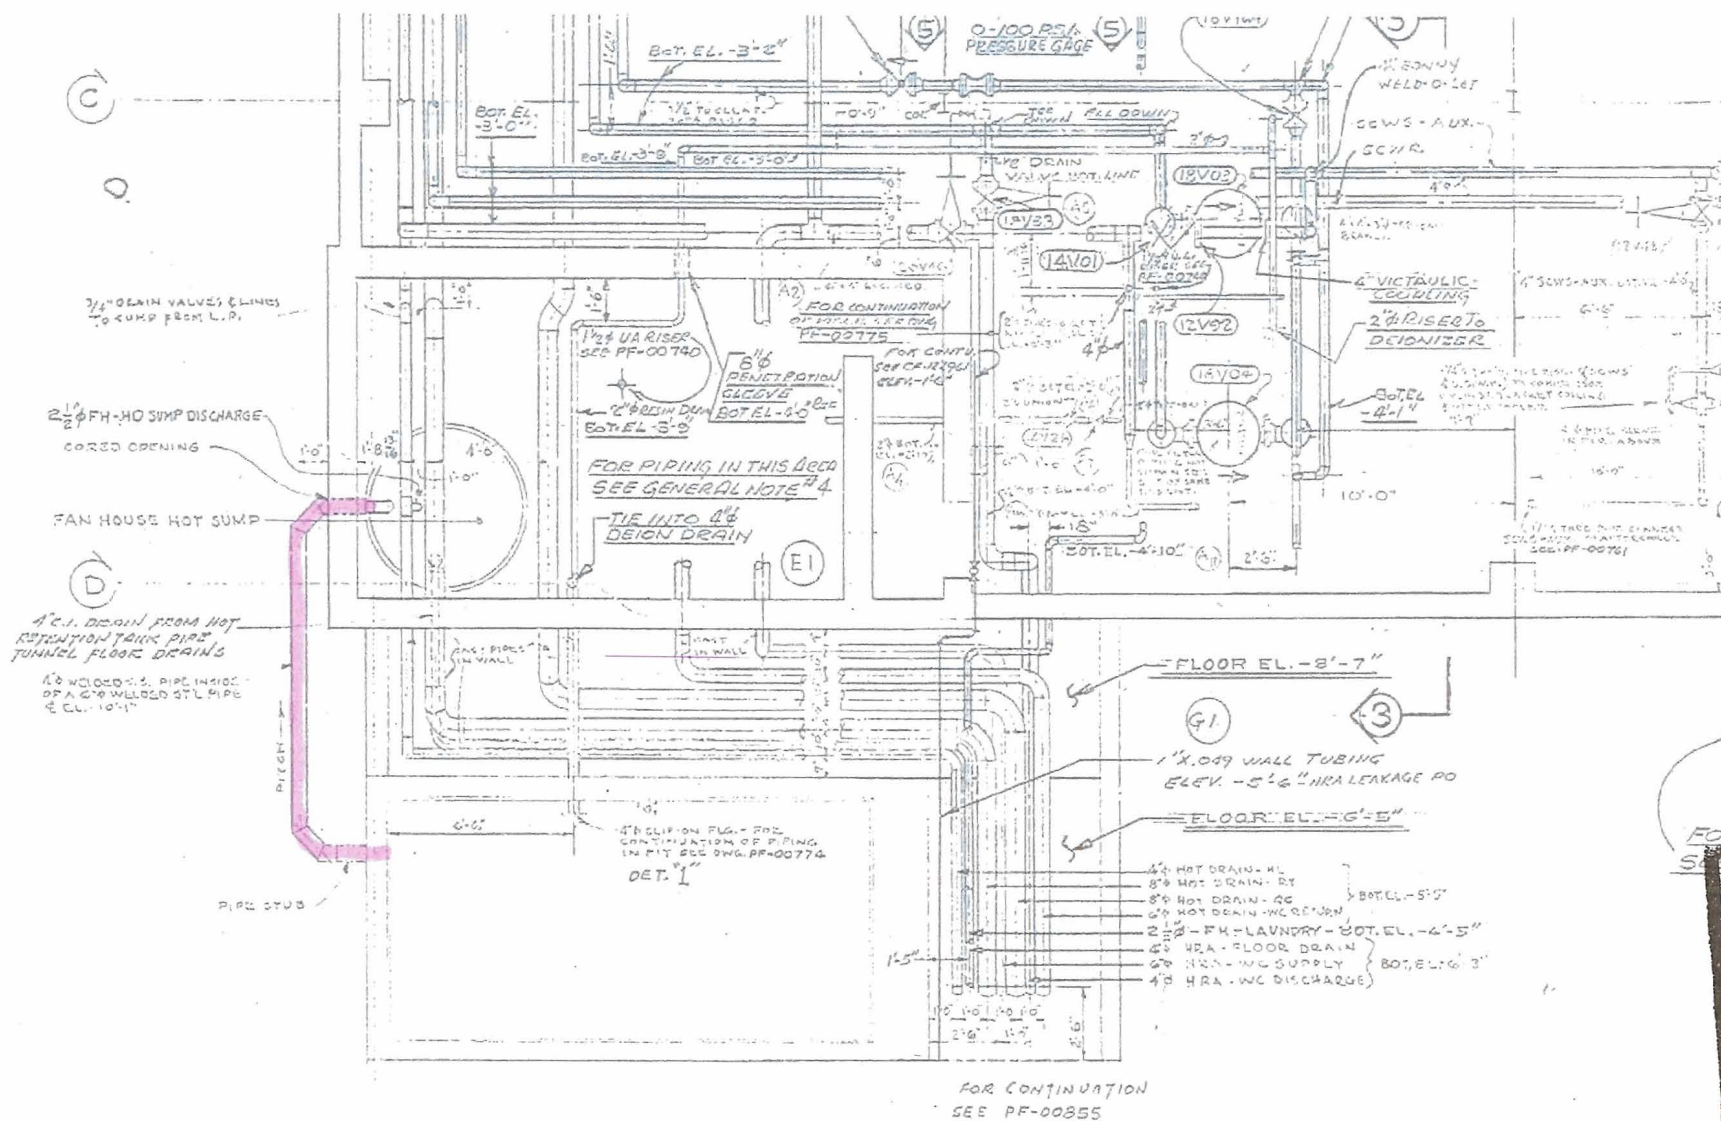



BASEMENT PLAN  
SCALE 1/8" = 1'-0"

PAGE 3 of 3

**SECTION 7**  
**ATTACHMENT 3**  
**1 PAGE(S)**



### DQA Check Sheet

Design #	EP FH-103	Revision #	Original						
Survey Unit #	EP FH-103								
<b>Preliminary Data Review</b>									
<b>Answers to the following questions should be fully documented in the Survey Unit Release Record</b>						Yes	No	N/A	
1. Have surveys been performed in accordance with survey instructions in the Survey Design?						X			
2. Is the instrumentation MDC for structure static measurements below the DCGL <sub>W</sub> for Class 1 and 2 survey units, or below 0.5 DCGL <sub>W</sub> for Class 3 survey units?								X	
3. Is the instrumentation MDC for embedded/buried piping static measurements below the DCGL <sub>W</sub> ?						X			
4. Was the instrumentation MDC for structure scan measurements, soil scan measurements, and embedded/buried piping scan measurements below the DCGL <sub>W</sub> , or, if not, was the need for additional static measurements or soil samples addressed in the survey design?								X	
5. Was the instrumentation MDC for volumetric measurements and smear analysis < 10% DCGL <sub>W</sub> ?								X	
6. Were the MDCs and assumptions used to develop them appropriate for the instruments and techniques used to perform the survey?						X			
7. Were the survey methods used to collect data proper for the types of radiation involved and for the media being surveyed?						X			
8. Were "Special Methods" for data collection properly applied for the survey unit under review?						X			
9. Is the data set comprised of qualified measurement results collected in accordance with the survey design, which accurately reflects the radiological status of the facility?						X			
<b>Graphical Data Review</b>									
1. Has a posting plot been created?								X	
2. Has a histogram (or other frequency plot) been created?								X	
3. Have other graphical data tools been created to assist in analyzing the data?								X	
<b>Data Analysis</b>									
1. Are all sample measurements below the DCGL <sub>W</sub> (Class 1 & 2), or 0.5 DCGL <sub>W</sub> (Class 3)?						X			
2. Is the mean of the sample data < DCGL <sub>W</sub> ?						X			
3. If elevated areas have been identified by scans and/or sampling, is the average activity in each elevated area < DCGL <sub>EMC</sub> (Class 1), < DCGL <sub>W</sub> (Class 2), or < 0.5 DCGL <sub>W</sub> (Class 3)?								X	
4. Is the result of the Elevated Measurements Test < 1.0?								X	
5. Is the result of the statistical test ( <i>S</i> + for Sign Test or <i>W</i> <sub>r</sub> for WRS Test) ≥ the critical value?								X	
Comments:									
FSS/Characterization Engineer (print/sign)						 G. L. Wood		Date	12.13.07
FSS/ Characterization Manager (print/sign)						 R. Case		Date	12/18/07

Form  
CS-09/2  
Rev 0

**SECTION 7**  
**ATTACHMENT 4**  
**1 DISC**