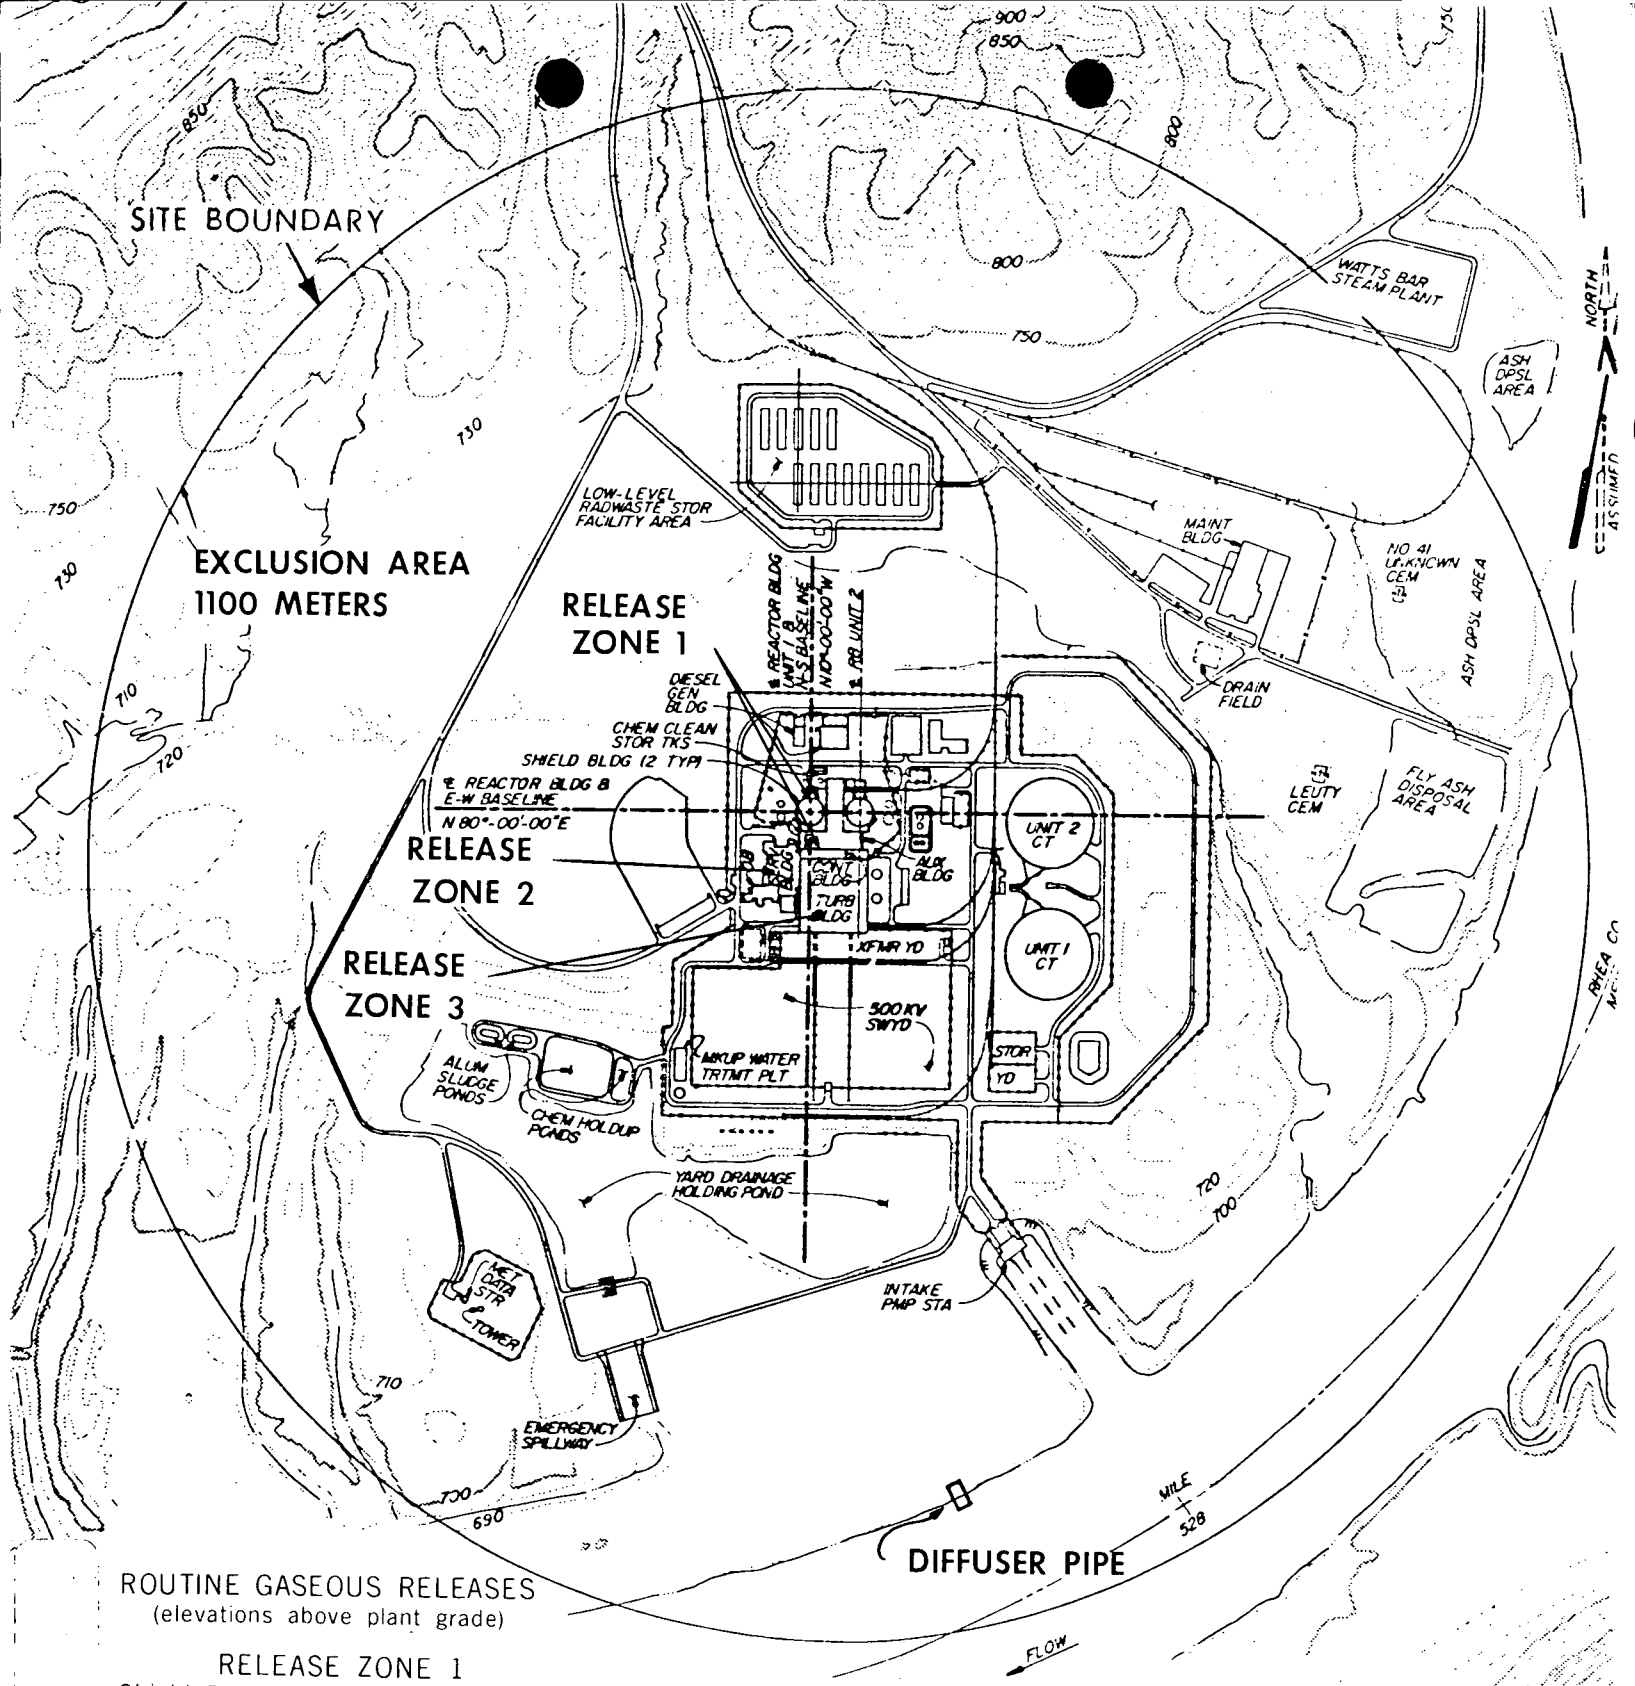

ROUTINE GASEOUS RELEASES
(elevations above plant grade)

RELEASE ZONE 1
Shield Building Vent, el. 132 ft.
Auxilliary Building Vent, el. 121 ft.

RELEASE ZONE 2
Service Building Vent, el. 26 ft.

RELEASE ZONE 3
Condenser Air Ejector Exhaust Vent, el. 102 ft.

ROUTINE LIQUID RELEASE POINT
Diffuser Pipes

NOTE: For the purpose of implementing the Radiological Effluent Technical Specifications, all areas outside the exclusion area radius are considered to be 'Unrestricted Areas'.

0 — 1100 METERS

WATTS BAR-UNIT 1

FIGURE 5.1-1
EXCLUSION AREA/SITE BOUNDARY

8508270070 850822
PDR ADOCK 05000390
A PDR