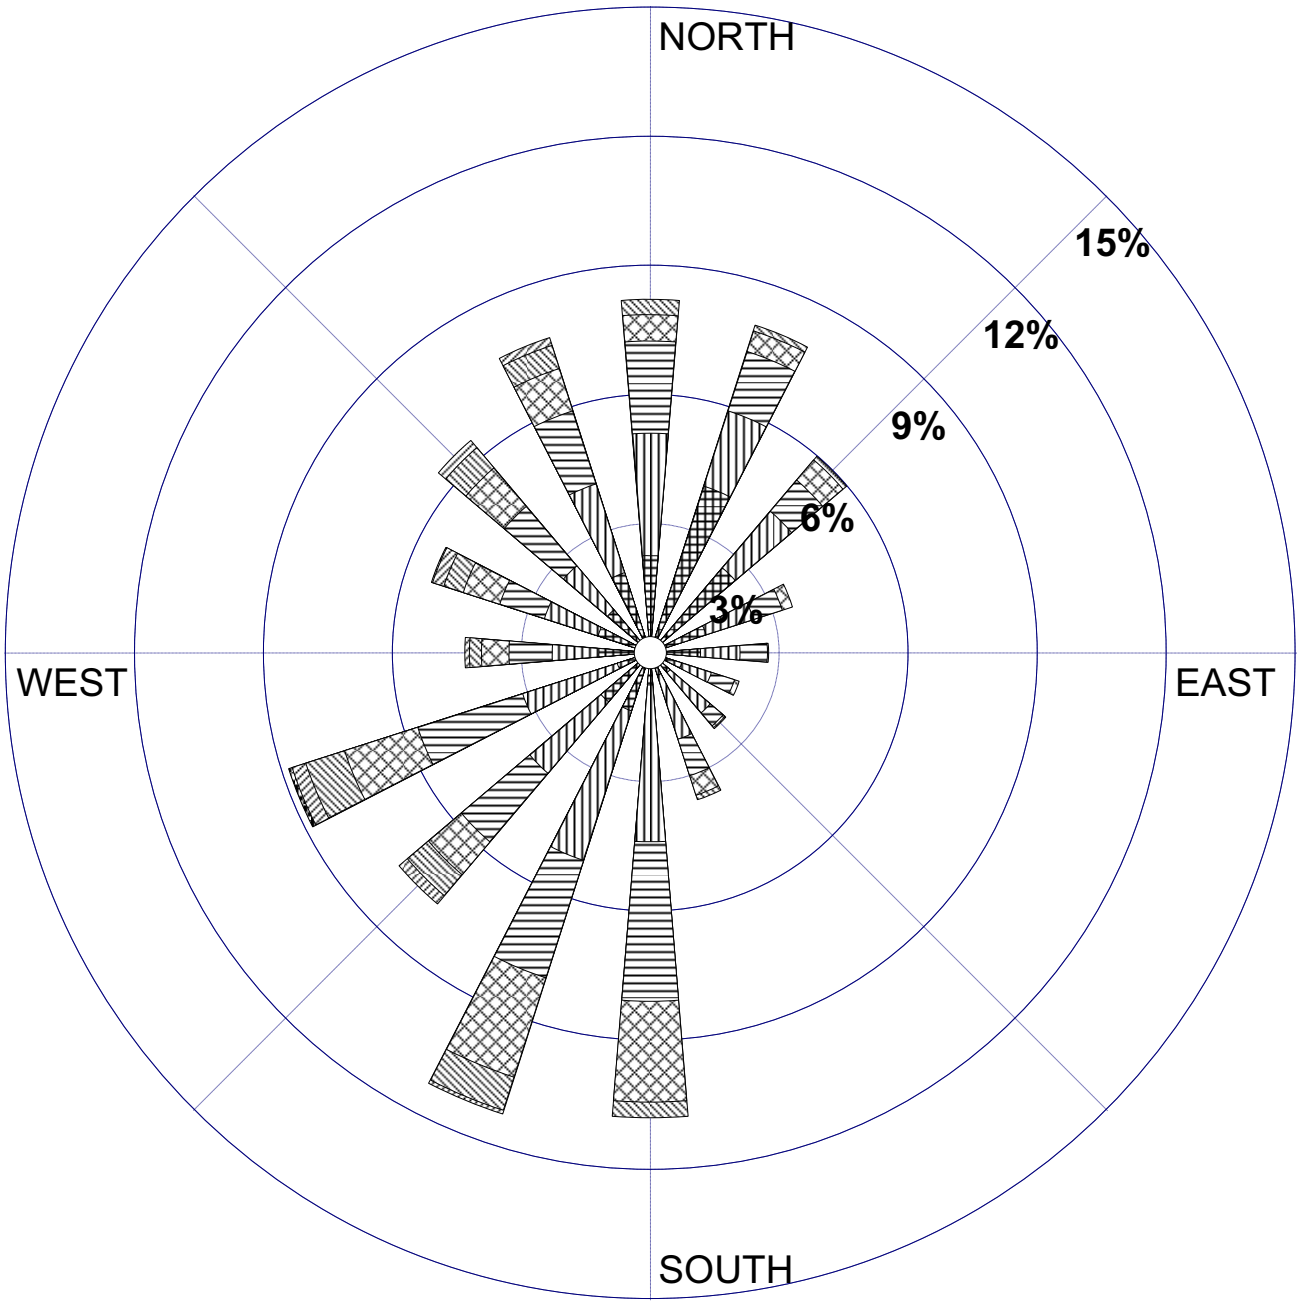

WIND SPEED
(m/s)

- >= 10.0
- 8.1 - 10.0
- 6.1 - 8.1
- 5.1 - 6.1
- 4.1 - 5.1
- 3.1 - 4.1
- 2.1 - 3.1
- 1.1 - 2.1
- 0.4 - 1.1

Calms: 1.39%

Progress Energy Carolinas

Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 2, Final Safety Analysis Report

New Hill, North Carolina

Wind Rose – Harris Nuclear Plant, Onsite Meteorological Monitoring System, March 1,1994 Through February 28,1999 (April Data)

FIGURE 2.3.2-205

Rev 0