


<i>Source Exists</i>	<i>Source is Active</i>	<i>Maximum Magnitude</i>	<i>Average Repeat Time</i>
--------------------------	-----------------------------	------------------------------	------------------------------------

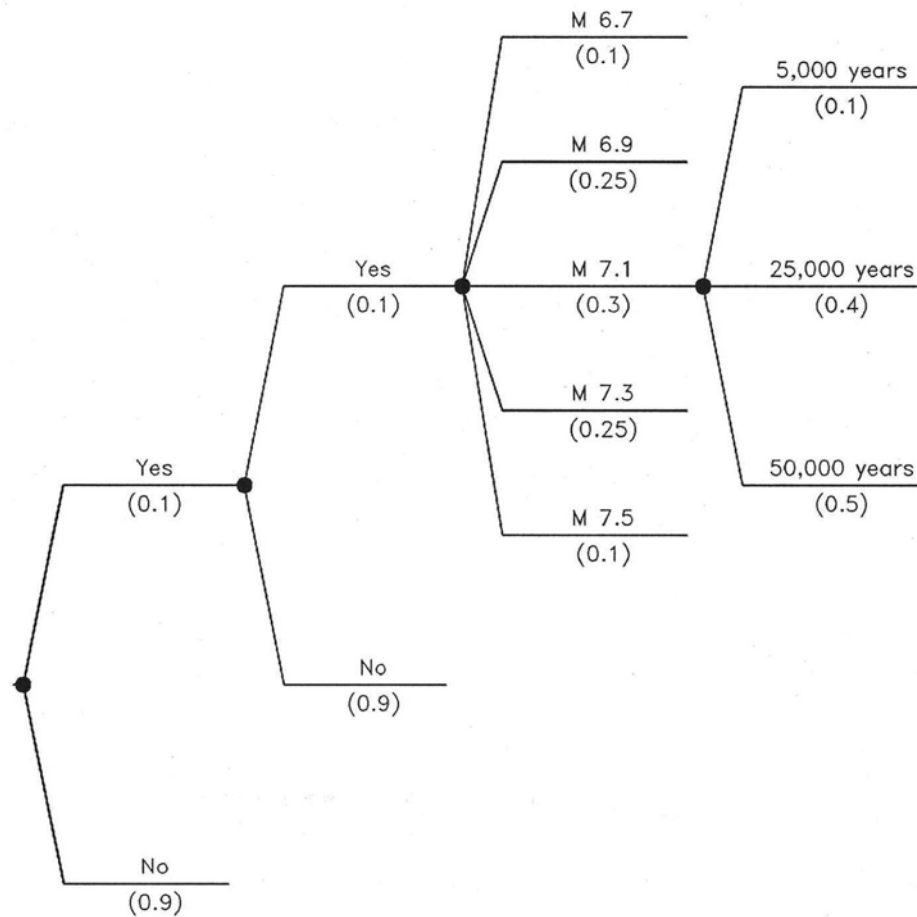

Progress Energy Carolinas
**Shearon Harris Nuclear Power Plant
 Units 2 and 3
 Part 2, Final Safety Analysis Report**

New Hill, North Carolina

Logic Tree for East Coast Fault System
 Central and Northern Sources

FIGURE 2.5.2-215

Rev. 0