


<i>Source Exists</i>	<i>Source is Active</i>	<i>Maximum Magnitude</i>	<i>Average Repeat Time</i>
----------------------	-------------------------	--------------------------	----------------------------

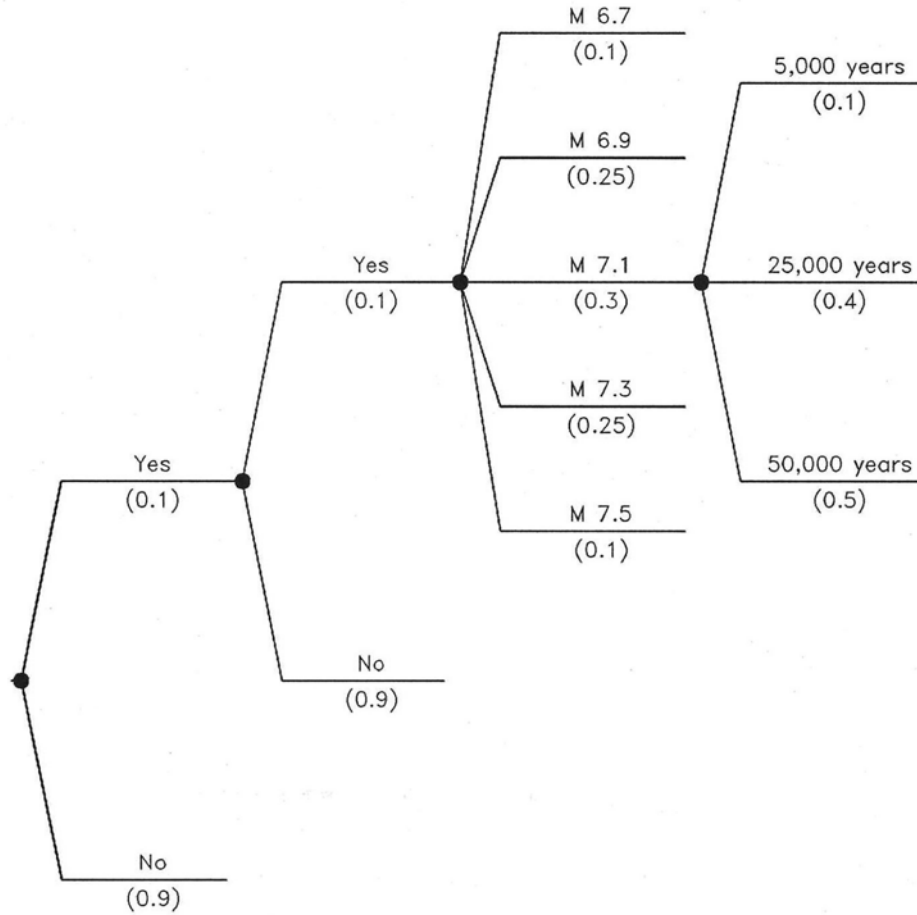

Progress Energy Carolinas
**Shearon Harris Nuclear Power Plant
 Units 2 and 3**
Part 2, Final Safety Analysis Report
 New Hill, North Carolina

Logic Tree for East Coast Fault System
 Central and Northern Sources
 FIGURE 2.5.2-215 Rev. 0