



Crystal River Nuclear Plant
Docket No. 50-302
Operating License No. DPR-72

Ref: 10 CFR 50.55a

March 12, 2008
3F0308-04

U.S. Nuclear Regulatory Commission
Attn: Document Control Desk
Washington, DC 20555-0001

Subject: Crystal River Unit 3 – Relief Request #08-001-RR, Revision 1

- References:
1. Crystal River Unit 3 to NRC letter, 3F0308-03, submitted March 7, 2008 (incorrectly identified in the letter as March 7, 2007), “Crystal River Unit 3 – Relief Request #08-001-RR, Revision 0”
 2. NRC memorandum from Stewart Bailey (NRC) to Tom Boyce (NRC) dated March 11, 2008 (ML080710257), “Request for Additional Information – Weld Overlay of the Decay Heat Drop Line Relief Request #08-001-RR, Revision 0”

Dear Sir:

Pursuant to 10 CFR 50.55a(a)(3)(i), Florida Power Corporation (FPC), doing business as Progress Energy Florida, Inc., is hereby submitting Revision 1 of Relief Request #08-001-RR (Enclosure 1) to support the application of a structural weld overlay to the decay heat drop line at Crystal River Unit 3 (CR3). Reference 2 documents an NRC Request for Additional Information (RAI) that was discussed in a March 10, 2008 phone call between NRC and Progress Energy staff. The RAI responses have been incorporated into Revision 1 of Relief Request #08-001-RR and Enclosure 2 to this document. For the convenience of the NRC reviewer, revision bars have been included in the relief request (Enclosure 1) in order to identify revised text. The revision bars, located in the right margin, identify deleted and/or revised text which is denoted with a single underline under the affected text. This letter replaces Reference 1, Relief Request #08-001-RR, Revision 0, in its entirety.

This submittal contains Regulatory Commitments discussed in Enclosure 2 and listed in Enclosure 3.


CR3 is currently in an outage. FPC requests an approval of Relief Request #08-001-RR, Revision 1 by March 14, 2008, to support scheduling for completion of activities during this outage. Welding commenced on March 9, 2008.

Progress Energy Florida, Inc.
Crystal River Nuclear Plant
15760 W. Powerline Street
Crystal River, FL 34428

A047
NRR

If you have any questions regarding this submittal, please contact Dennis Herrin, Acting Supervisor, Licensing and Regulatory Programs at (352) 563-4633.

Sincerely,

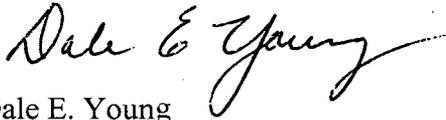

Dale E. Young
Vice President
Crystal River Nuclear Plant

DEY/dar

- Enclosures:
1. Relief Request #08-001-RR, Revision 1
 2. Response to Request for Additional Information
 3. List of Regulatory Commitments

xc: NRR Project Manager
Regional Administrator, Region II
Senior Resident Inspector

STATE OF FLORIDA

COUNTY OF CITRUS


Dale E. Young states that he is the Vice President, Crystal River Nuclear Plant for Florida Power Corporation, doing business as Progress Energy Florida, Inc.; that he is authorized on the part of said company to sign and file with the Nuclear Regulatory Commission the information attached hereto; and that all such statements made and matters set forth therein are true and correct to the best of his knowledge, information, and belief.

Dale E Young
Dale E. Young
Vice President
Crystal River Nuclear Plant

The foregoing document was acknowledged before me this 12 day of March, 2008, by Dale E. Young.

Carolyn E Portmann

Signature of Notary Public
State of Florida

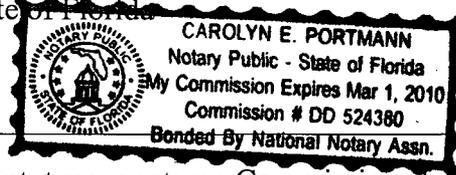

(Print, type, or stamp Commissioned
Name of Notary Public)

Personally Produced
Known -OR- Identification

PROGRESS ENERGY FLORIDA, INC.

CRYSTAL RIVER UNIT 3

DOCKET NUMBER 50 - 302 / LICENSE NUMBER DPR - 72

RELIEF REQUEST #08-001-RR, REVISION 1

ENCLOSURE 1

Relief Request #08-001-RR, Revision 1

USE OF WELD OVERLAYS AS AN ALTERNATIVE REPAIR TECHNIQUE

INSERVICE INSPECTION RELIEF REQUEST

#08-001-RR, REVISION 1 THIRD TEN YEAR INTERVAL

REFERENCE CODE: The American Society of Mechanical Engineers Boiler and Pressure Vessel Code (ASME), Section XI, 1989 Edition with no Addenda.

1.0 ASME Code Components Affected

The ASME Code component associated with this request is a high safety significant Class 1 dissimilar metal weld (DMW) with Alloy 82/182 weld metal that is believed to be susceptible to Primary Water Stress Corrosion Cracking (PWSCC). There is one decay heat line to hot leg nozzle weld that will require a full structural weld overlay (SWOL).

1.1 Category and System Details:

Code Class: Class 1

System Welds: Reactor Coolant System

Examination Categories: R-A*

*Welds are included in the Risk Informed Inservice Inspection Program

1.2 Component Descriptions:

This alternative is to apply an SWOL on the decay heat line nozzle to pipe weld on the "B" hot leg. The applicable item and description is:

Decay Heat Nozzle Buttering and Decay Heat Nozzle Weld No. B4.5.254

1.3 Component Materials:

1. "B" Hot Leg pipe Decay Heat nozzle is carbon steel A 105 Grade II (P-No. 1)
2. Piping attached to the "B" hot leg *decay heat* nozzle weld is wrought seamless austenitic stainless steel A 376 TP 316 (P-No. 8) (*Decay heat pipe is 12" Schedule 160: 10.126" nominal inside diameter, 12.75" nominal outside diameter, and 1.312" nominal wall thickness*)
3. Weld and butter are Alloy 82/182 (F-No. 43)

2.0 Applicable Code Edition and Addenda

Crystal River Unit 3 (CR3) is currently in the third 10-year Inservice Inspection (ISI) interval. The American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code (Code) of record for the current 10-year ISI interval is Section XI, 1989 Edition, no Addenda (Reference 1). This is also the edition used for the Repair/Replacement Program.

3.0 Applicable Code Requirement

The applicable Code requirements for which the relief is requested are:

- ASME Code Section XI, 1989 Edition, no Addenda (Reference 1), IWA-4120(a), IWA-4340(a)
- ASME Boiler and Pressure Vessel Code, Section XI, 1995 Edition through 1996 Addenda, Appendix VIII, Supplement 11, "Qualification Requirements for Full Structural Overlaid Wrought Austenitic Piping Welds"

4.0 Reason for Request

Primary Water Stress Corrosion Cracking (PWSCC) has been identified as a degradation mechanism for Alloy 82/182 welds and weld buttering. During a maintenance outage that commenced March 1, 2008, an indication was detected via a linear phased array UT. The indication originates from the inner diameter of the weld and is approximately 65% throughwall at the *outermost extent*. *Florida Power Corporation (FPC)* has concluded that the application of a full-structural weld overlay (FSWOL) over the decay heat nozzle Alloy 82/182 weld is the most appropriate course of action to ensure the integrity of the reactor coolant pressure boundary. FPC will apply a full structural overlay during this outage. The overlay is designed to improve the configurations for future examinations.

ASME Code Section XI, 1989 Edition, no Addenda does not provide rules for the design of weld overlays or for repairs without removal of flaws. In addition, Code Case N-504-3, which has been approved by the NRC for use, does not provide the methodology for overlaying nickel alloy welds joining austenitic and ferritic base materials; therefore, FPC proposes the following alternative.

5.0 Proposed Alternative

The Crystal River Unit 3 station proposes a FSWOL for the nozzle weld identified in Section 1.0 of this request using Alloy 52M weld metal. References to Alloy 52M weld metal in the relief request are intended to apply to use of 52M or 152 weld metal. The FSWOL will extend around the full circumference of the existing nozzle Alloy 82/182 weld, overlapping the neighboring sections of low alloy steel nozzle and stainless steel piping. A WOL configuration typical of the one to be applied is shown in Figure 1.

The design of the overlay will be based on the applicable rules of ASME Section XI and ASME draft code case N-740-2. The rules to be used for design and implementation are summarized in Attachments 1 and 2. For ease of reference, a comparison of the requirements of previously approved Code Case N-504-3 to the proposed method is given in Attachment 3.

6.0 Basis for Use

The use of weld overlay materials resistant to PWSCC (e.g., Alloy 52M) that create low tensile or compressive residual stresses in the original weld provide increased assurance of structural integrity. The weld overlay is of sufficient thickness and length to meet the applicable stress limits from ASME Section III, NB-3200. Crack growth evaluations for PWSCC and fatigue of *the* as-found flaw will ensure that structural integrity will be maintained.

As a part of the design of the weld overlay, the weld length, surface finish, and flatness are specified in order to allow qualified ASME Section XI, Appendix VIII Ultrasonic test (UT) examinations, as implemented through the EPRI Performance Demonstration Initiative (PDI) Program, of the weld overlay and the required volume of the base material and original weld. The examinations specified in this proposed alternative, versus those limited examinations performed on the original dissimilar welds, will provide improved assurance of structural integrity.

The implementation of the alternative reduces the likelihood for PWSCC in the identified weld and improves piping geometries to permit Appendix VIII UT examinations as implemented through the PDI program. Weld overlay repairs of dissimilar metal welds have been installed and performed successfully for many years in both PWR and BWR applications. The alternative provides improved structural integrity and reduced likelihood of leakage for the primary system. Accordingly, the use of the alternative provides an acceptable level of quality and safety in accordance with 10 CFR 50.55a(a)(3)(i).

A full-structural Alloy 52M overlay will be applied to the dissimilar metal Alloy 82/182 weld identified in Section 1.0. In lieu of using the existing IWA-4000 Repair Procedures in Reference 1, FPC proposes to use the alternative requirements for design, fabrication, pressure testing, and examination of weld overlay repairs enumerated in Attachments 1 and 2. This will provide an acceptable methodology for preventing future PWSCC and for reducing *the* defect observed in this weld to acceptable size by increasing the wall thickness through deposition of the weld overlay. The use of weld overlay filler metals that are resistant to PWSCC (e.g., Alloy 52M), weld overlay procedures that create compressive residual stress profiles in the original weld, and post overlay preservice and inservice inspection requirements provide assurance that structural integrity will be maintained for the life of the plant. The weld overlay will also meet the applicable stress limits from ASME Section III. Crack growth evaluations for PWSCC and fatigue of *the* as-found flaw will demonstrate that structural integrity will be maintained.

A. Weld Overlay Design and Verification

The fundamental design basis for full structural weld overlays is to maintain the original safety margins *for primary loading*, with no credit taken for the underlying PWSCC susceptible weldments. The assumed, design basis flaw for the purpose of structural sizing of the overlay is 360 degrees and 100% through the original wall thickness of the DMWs. For the crack growth analyses, initial flaw sizes will be assumed equal to the

crack sizes observed by *the pre-overlay* NDE of the weld (or *the size of any flaw* detected in the outer 25% of the original material during the overlay preservice examination, whichever is greater).

Following is a list of the specific analyses and verifications that will be performed.

1. Nozzle specific stress analyses will be performed to establish a residual stress profile in the nozzle. Severe ID weld repairs will be assumed in these analyses that effectively bound any actual weld repairs that may have occurred in the nozzles. The analysis will then simulate application of the weld overlay to determine the final residual stress profile. Post weld overlay residual stresses at normal operating conditions will be shown to result in beneficial compressive stresses on the inside surface of the components, assuring that further crack initiation due to PWSCC is highly unlikely. The design requirements are as outlined in Attachment 1.
2. Fracture mechanics analyses will also be performed to predict crack growth, assuming that cracks exist that are equal to the detected flaw sizes. Crack growth will be evaluated due to PWSCC as well as due to fatigue crack growth in the original DMW. The crack growth analyses will consider all design loads and transients, plus the post weld overlay, through-wall residual stress distributions, and will demonstrate that the detected crack will not grow beyond the design basis for the weld overlay for the time period until the next scheduled inservice inspection.
3. The analyses will demonstrate that application of the weld overlay does not impact the conclusions of the existing nozzle Stress Reports. ASME Code, Section III stress and fatigue criteria will be met for regions of the overlay remote from observed (or assumed) cracks.
4. Shrinkage will be measured during the overlay application. Shrinkage stresses at other locations in the piping systems arising from the weld overlay will be demonstrated not to have an adverse effect on the systems. Clearances of affected supports and restraints will be checked after the overlay repair, and will be reset within the design ranges as required.
5. The total added weight on the piping systems due to the overlay will be evaluated for potential impact on piping system stresses and dynamic characteristics.
6. The as-built dimensions of the weld overlay will be measured and evaluated to demonstrate that they equal to or exceed the minimum design dimensions of the overlay.

B. Suitability of Proposed NDE

As a part of the design of the weld overlay, the weld length, surface finish, and flatness are specified to allow qualified ASME Section XI, Appendix VIII UT examinations, as implemented through the EPRI Performance Demonstration Initiative (PDI) Program, of the weld overlay and the required volume of the base material and original weld (Attachment 1, Figures A1-1 and A1-2). The examinations specified in this proposed

alternative will provide adequate assurance of structural integrity for the following reasons:

- The UT examinations to be performed with the proposed alternative are in accordance with ASME XI, Appendix VIII, Supplement 11, as implemented through the PDI. PDI modifications are detailed in Attachment 4. These examinations are considered more sensitive for detection of defects, either from fabrication or service induced, than either ASME Section III RT or UT methods. Further, construction flaws have been included in the PDI qualification sample sets for evaluating procedures and personnel.
- Section XI has developed specific acceptance criteria and evaluation methodology to be utilized with the results from these more sensitive examinations. They consider the materials in which the flaw indications are detected, the orientation and size of the indications, and ultimately their potential structural effects on the component. The acceptance criteria include allowable flaw indication tables for planar flaws (Table IWB-3514-2) and for laminar flaws (Table IWB-3514-3).
- A laminar flaw is defined in Section XI as a flaw oriented within 10 degrees of a plane parallel to the surface of the component. This definition is applicable to welds and weld overlays as well as base materials. The standard imposed for evaluating laminar flaws in Section XI is more restrictive than the Section III standard for evaluating laminations. The Section XI laminar flaw standards, Table IWB-3514-3, are supplemented in Attachment 1 such that the total laminar flaw shall not exceed 10% of the weld overlay surface area and no linear dimension of the laminar flaw shall exceed 3 in. For weld overlay areas where examination is precluded by the presence of the flaw, it is required to postulate the area as being cracked.
- Any planar flaws found during either the weld overlay acceptance or pre-service examinations are required to meet the pre-service standards of Table IWB-3514-2. In applying the planar flaw standards, the thickness of the component will be defined as the thickness of the weld overlay.
- The NRC staff has conditionally approved Code Case N-504-3 for weld overlays and the required NDE with the imposition of the requirements contained in ASME Section XI 2005 Addenda, Appendix Q. The NDE discussed above and detailed in Attachment 1 meet the approved rules. This is consistent with recent NRC approvals.
- Weld overlays for repair of cracks in piping are not addressed by ASME Section III. ASME Section III utilizes nondestructive examination procedures and techniques with flaw detection capabilities that are within the practical limits of workmanship standards for welds. These standards are most applicable to volumetric examinations conducted by radiographic examination. Radiography *testing* (RT) of weld overlays is not practical because of presence of radioactive material in the Reactor Coolant system and water in the pipes. The Section III acceptance standards are written for a range of fabrication flaws including lack of fusion, incomplete penetration, cracking,

slag inclusions, porosity, and concavity. However, experience and fracture mechanics have demonstrated that many of the flaws that would be rejected using ASME Section III acceptance standards do not have a significant effect on the structural integrity of the component.

- The Section XI acceptance standards are the logical choice for evaluation of potential flaw indications in post-overlay examinations, in which unnecessary repairs to the overlay would result in additional personnel radiation exposure without a compensating increase in safety and quality, and could potentially degrade the effectiveness of the overlay by affecting the favorable residual stress field that they produce. They are consistent with previous criteria approved by the NRC for weld overlay installations. Weld overlays have been used for repair and mitigation of cracking in Boiling Water Reactors for many years. In Generic Letter 88-01, the NRC approved the use of Section XI inspection procedures for determining the acceptability of installed weld overlays. In addition, for a number of years the NRC has accepted various versions of Code Case N-504 in RG 1.147 with no conditions regarding the use of Section XI acceptance standards for determining the acceptability of weld overlays. Code Case N-504 (and its later versions) was developed to codify the BWR weld overlay experience and NRC approval is consistent with the NRC acceptability of BWR weld overlays. Similarly, Code Case N-638 was acceptable for use in RG 1.147 Rev. 13 with no conditions and has been approved by the NRC for use in both BWR and PWR weld overlay installations using the Section XI acceptance standards. The NRC staff found the use of the Section XI, Appendix VIII, Supplement 11 acceptable for identifying both construction and service induced flaws in the SER for DC Cook Plant dated February 19, 2006 and tacitly approved the associated Section XI acceptance criteria, Tables IWB-3514-2 and IWB-3514-3. The staff also accepted the use of Section XI acceptance standards in an SER dated July 21, 2004 for the TMI Plant, for disposition of flaws identified in a weld overlay by PDI qualified UT examinations, with additional restrictions similar to those proposed herein for regions in which inspection is precluded by the flaws.

C. Suitability of Proposed Ambient Temperature Temper Bead Technique

The overlay addressed by this Relief Request will be performed using ambient temperature temperbead welding in lieu of Post Weld Heat Treatment, in accordance with Attachment 2. Research by the Electric Power Research Institute (EPRI) and other organizations on the use of an ambient temperature temper bead process using the machine GTAW process is documented in EPRI Report GC-111050 (*Reference 3*). According to the EPRI report, repair welds performed with an ambient temperature temper bead procedure utilizing the machine GTAW welding process exhibit mechanical properties equivalent to or better than those of the surrounding base material. Laboratory testing, analysis, successful procedure qualifications, and successful repairs have all demonstrated the effectiveness of this process.

The effects of the ambient temperature temper bead welding process of Attachment 1 on mechanical properties of repair welds, hydrogen cracking, cold restraint cracking, and

extent of overlay coverage of ferritic base metal are addressed in the following paragraphs:

Mechanical Properties

The principal reasons to preheat a component prior to repair welding is to minimize the potential for cold cracking. The two cold cracking mechanisms are hydrogen cracking and restraint cracking. Both of these mechanisms occur at ambient temperature. Preheating slows down the cooling rate resulting in a ductile, less brittle microstructure thereby lowering susceptibility to cold cracking. Preheat also increases the diffusion rate of monatomic hydrogen that may have been trapped in the weld during solidification. As an alternative to preheat, the ambient temperature temper bead welding process utilizes the tempering action of the welding procedure to produce tough and ductile microstructures. Because precision bead placement and heat input control are utilized in the machine GTAW process, effective tempering of weld heat affected zones is possible without the application of preheat. According to Section 2-1 of EPRI Report GC 111050, "the temper bead process is carefully designed and controlled such that successive weld beads supply the appropriate quantity of heat to the untempered heat affected zone such that the desired degree of carbide precipitation (tempering) is achieved. The resulting microstructure is very tough and ductile."

The IWA-4530 temper bead process also includes a postweld soak requirement. Performed at 300°F for 4 hours (P-No. 3 base materials), this postweld soak assists diffusion of any remaining hydrogen from the repair weld. As such, the postweld soak is a hydrogen bake-out and not a postweld heat treatment as defined by the ASME Code. At 300°F, the postweld soak does not stress relieve, temper, or alter the mechanical properties of the weldment in any manner.

The alternative in Attachment 2 establishes detailed welding procedure qualification requirements for base materials, filler metals, restraint, impact properties, and other procedure variables. The qualification requirements contained provide assurance that the mechanical properties of repair welds will be equivalent to or superior to those of the surrounding base material.

Hydrogen Cracking

Hydrogen cracking is a form of cold cracking. It is produced by the action of internal tensile stresses acting on low toughness heat affected zones. The internal stresses are produced from localized build-ups of monatomic hydrogen. Monatomic hydrogen forms when moisture or hydrocarbons interact with the welding arc and molten weld pool. The monatomic hydrogen can be entrapped during weld solidification and tends to migrate to transformation boundaries or other microstructure defect locations. As concentrations build, the monatomic hydrogen will recombine to form molecular hydrogen – thus generating localized internal stresses at these internal defect locations. If these stresses exceed the fracture toughness of the material, hydrogen induced cracking will occur. This form of cracking requires the presence of hydrogen and low toughness materials. It is manifested by intergranular cracking of susceptible materials and normally occurs within 48 hours of welding.

IWA-4500 establishes elevated preheat and postweld soak requirements. The elevated preheat temperature of 300°F increases the diffusion rate of hydrogen from the weld. The postweld soak at 300°F was also established to bake-out or facilitate diffusion of any remaining hydrogen from the weldment. However, while hydrogen cracking is a concern for SMAW, which uses flux covered electrodes, the potential for hydrogen cracking is significantly reduced when using the machine GTAW welding.

The machine GTAW welding process is inherently free of hydrogen. Unlike the SMAW process, GTAW welding filler metals do not rely on flux coverings that may be susceptible to moisture absorption from the environment. Conversely, the GTAW process utilizes dry inert shielding gases that cover the molten weld pool from oxidizing atmospheres. Any moisture on the surface of the component being welded will be vaporized ahead of the welding torch. The vapor is prevented from being mixed with the molten weld pool by the inert shielding gas that blows the vapor away before it can be mixed. Furthermore, modern filler metal manufacturers produce wires having very low residual hydrogen. This is important because filler metals and base materials are the most realistic sources of hydrogen for automatic or machine GTAW temper bead welding. Therefore, the potential for hydrogen-induced cracking is greatly reduced by using the machine GTAW process. Extensive research has been performed by EPRI (*Reference 7*) which provides a technical basis for starting the 48-hour hold after completing the third temper bead weld layer rather than waiting for the weld overlay to cool to ambient temperature. The hold time required by N-638 will be implemented in accordance with this latest research. This approach has been previously reviewed and approved by the NRC for pressurizer *and hot leg surge* nozzle overlays.

Cold Restraint Cracking

Cold cracking generally occurs during cooling at temperatures approaching ambient temperature. As stresses build under a high degree of restraint, cracking may occur at defect locations. Brittle microstructures with low ductility are subject to cold restraint cracking. However, the ambient temperature temper bead process is designed to provide a sufficient heat inventory so as to produce the desired tempering for high toughness. Because the machine GTAW temper bead process provides precision bead placement and control of heat, the toughness and ductility of the heat affected zone will typically be superior to the base material. Therefore, the resulting structure will be appropriately tempered to exhibit toughness sufficient to resist cold cracking.

Area Limitation

IWA-4500 and early versions of Code Case N-638 for temper bead welding contained a limit of 100 square inches for the surface area of temper bead weld over the ferritic base metal. The associated limitation proposed in Attachment 1 is 500 square inches, *consistent with Code Case N-740-2*.

An ASME white paper (*Reference 2*) describes the technical justification for allowing increased overlay areas up to 500 square inches. The white paper notes that the original limit of 100 square inches in Code Case N-638-1 was arbitrary. It cites evaluations of a 12 inch diameter nozzle weld overlay to demonstrate adequate tempering of the weld heat

affected zone (Section 2a of the white paper), residual stress evaluations demonstrating acceptable residual stresses in weld overlays ranging from 100 to 500 square inches (Section 2b of the white paper), and service history in which weld repairs exceeding 100 square inches were NRC approved and applied to DMW nozzles in several BWRs and PWRs (Section 3c of the white paper). Some of the cited repairs are greater than 15 years old, and have been inspected several times with no evidence of any continued degradation.

It is important to note that the above theoretical arguments and empirical data have been verified in practice by extensive field experience with temper bead weld overlays, with ferritic material coverage ranging from less than 10 square inches up to and including 325 square inches. Table 1 below provides a partial list of such applications. It is seen from this table that the original DMW weld overlay was applied over 20 years ago, and WOLs with low alloy steel (LAS) coverage in the 100 square inch range have been in service for 5 to 15 years. Several overlays have been applied with LAS coverage significantly greater than the 100 square inches. Relief requests for these large overlays have been previously approved. These overlays have been examined with PDI qualified techniques, in some cases multiple times, and none have shown any signs of new cracking or growth of existing cracks.

7.0 Duration of Proposed Alternative

This proposed alternative is for application during the current outage. The proposed alternative, once installed, will remain in place for the remaining service life of the affected components.

8.0 Implementation

The structural WOL will be installed during the Crystal River 3 Nuclear Station Spring 2008 outage as a means of repair for identified flaws in the dissimilar metal weld. NRC approval is requested by before entry into Mode 4 which under current schedule could occur on March 14, 2008, to support scheduling for completion of activities during the outage. Welding commenced on March 9, 2008.

9.0 Precedents

Similar requests have been submitted to address the issues that are contained in this request. The technical approach and basis for the proposed alternative in this request is very similar to the request from South Carolina Electric and Gas's Virgil C. Summer station for application of full SWOLs to their pressurizer nozzle DMWs in letter RC-07-0085, "Request to Use Alternatives to ASME Code Section XI Requirements for Application of Weld Overlay Repairs" (ADAMS Accession Number ML071550420), dated June 1, 2007.

A similar relief request was also previously submitted by Entergy for Arkansas Nuclear One and was approved by the NRC through the NRC Letter to Entergy, Arkansas

Nuclear One, Unit 1 – Request for Alternative to the American Society of Mechanical Engineers Boiler and Pressure Vessel Code Requirements for Pressurizer Nozzle Weld Overlay Repairs (TAC NO. MD4019), April 6, 2007.

10.0 References

1. The American Society of Mechanical Engineers Boiler and Pressure Vessel Code (ASME), Section XI, 1989 Edition with no Addenda.
2. “Justification for the Removal of the 100 Square Inch Limitation for Ambient Temperature Temper Bead Welding on P-3 Material”, EPRI-NP-1011898, February 2005.
3. EPRI Report GC-111050, Ambient Temperature Preheat for Machine GTAW Temperbead Applications.
4. Not used.
5. Not used.
6. ASME Draft Code Case N-740-2, “Full Structural Dissimilar Metal Weld Overlay for Repair or Mitigation of Class 1, 2, and 3 Items.”
7. EPRI Report 1013558, Temperbead Welding Applications - 48 hour Hold for Ambient Temperature Temperbead Welding.

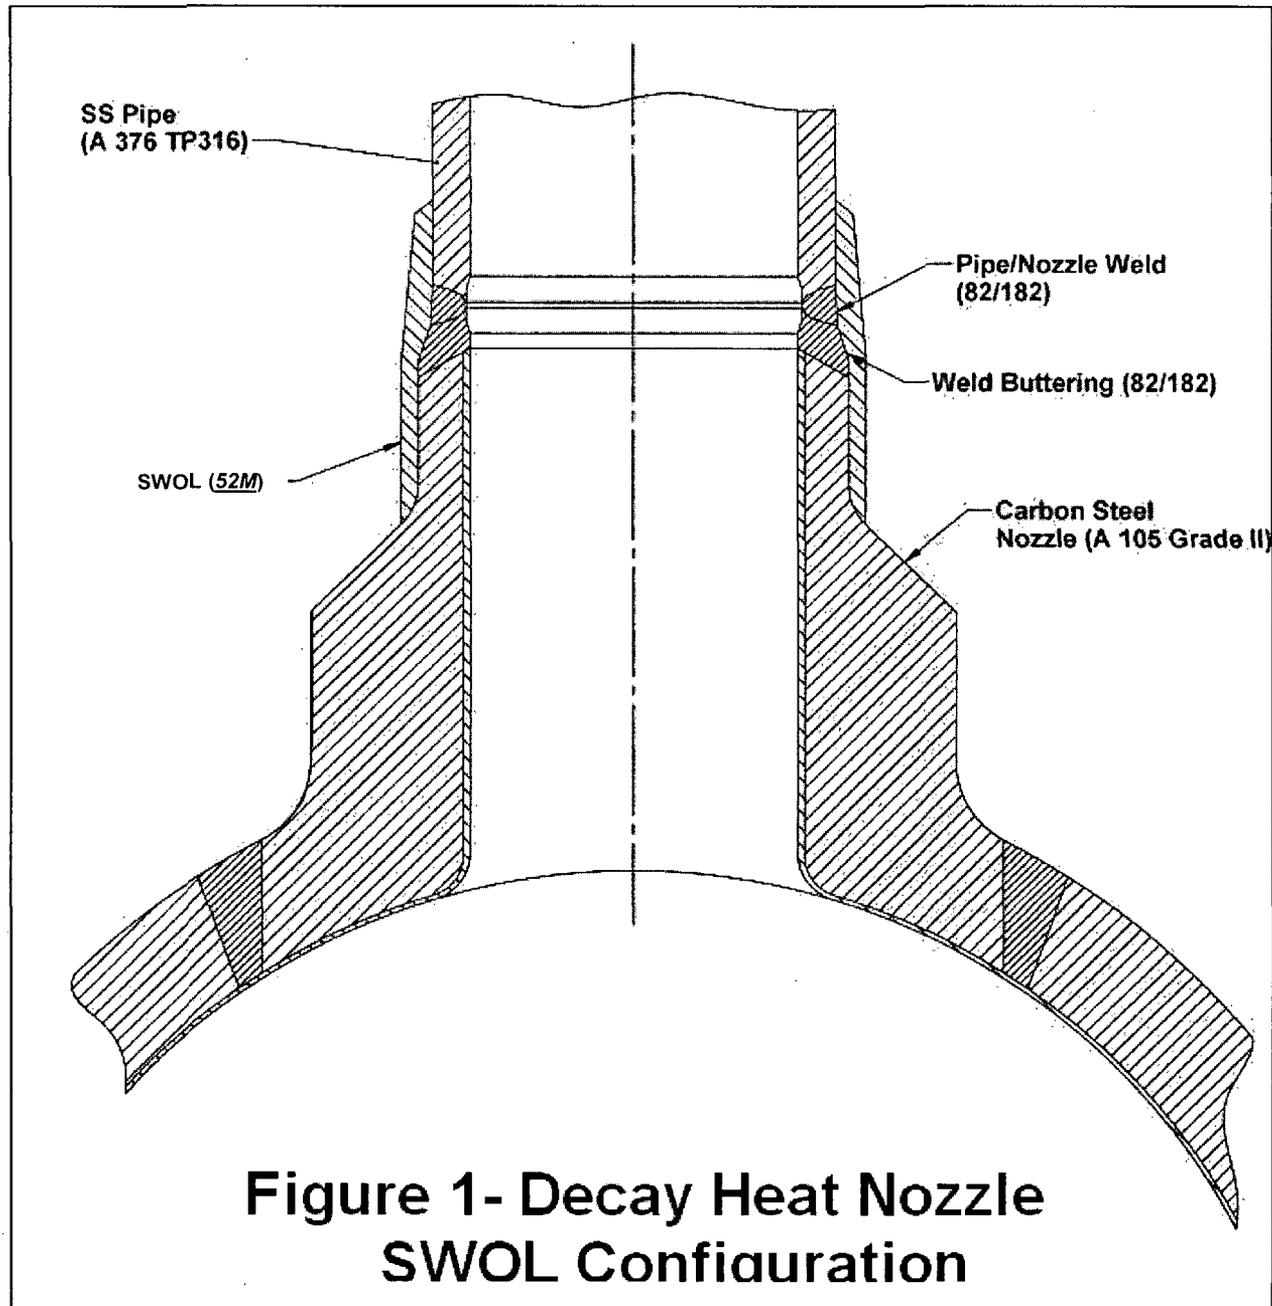


Table 1. Recent Overlay Experience

| Date | Plant | Component | Nozzle Diameter (in) | Approx. LAS Coverage (in²) |
|---------------|--------------------------|-----------------------------|-----------------------------|--|
| November 2006 | SONGS Unit 3 | PZR spray nozzle | 5.1875 | 40 |
| | | safety/relief nozzles | 8 | 60 |
| | | PZR surge nozzle | 12.75 | 110 |
| November 2006 | Catawba Unit 1 | PZR spray nozzle | 4 | 30 |
| | | safety/relief nozzles | 6 | 50 |
| | | PZR surge nozzle | 14 | 120 |
| November 2006 | Oconee Unit 1 | PZR spray nozzle | 4.5 | 30 |
| | | safety/relief nozzles | 4.5 | 30 |
| | | PZR surge nozzle | 10.875 | 105 |
| | | HL Surge Nozzle | 10.75 | 70 |
| October 2006 | McGuire Unit 2 | PZR spray nozzle | 4 | 30 |
| | | safety/relief nozzles | 6 | 50 |
| | | PZR surge nozzle | 14 | 120 |
| April 2006 | Davis Besse | Hot leg drain nozzle | 4 | 16 |
| February 2006 | SONGS Unit 2 | PZR spray nozzle | 8 | 50 |
| | | safety/relief nozzles | 6 | 28 |
| November 2005 | Kuosheng Unit 2 | Recirculation outlet nozzle | 22 | 250 |
| April 2004 | Susquehanna Unit 1 | Recirc. inlet nozzle | 12 | 100 |
| | | Recirc. outlet nozzle | 28 | 325 |
| November 2003 | TMI Unit 1 | Surge line nozzle | 11.5 | 75 |
| October 2003 | Pilgrim | Core spray nozzle | 10 | 50 |
| | | CRD return nozzle | 5 | 20 |
| October 2002 | Peach Bottom Units 2 & 3 | Core spray nozzle | 10 | 50 |
| | | Recirc. outlet nozzle | 28 | 325 |
| | | CRD return nozzle | 5 | 20 |
| October 2002 | Oyster Creek | Recirc. outlet nozzle | 26 | 285 |
| December 1999 | Duane Arnold | Recirc. inlet nozzle | 12 | 100 |
| June 1999 | Perry | Feedwater nozzle | 12 | 100 |
| June 1998 | Nine Mile Point Unit 2 | Feedwater nozzle | 12 | 100 |
| March 1996 | Brunswick Units 1 & 2 | Feedwater nozzle | 12 | 100 |
| February 1996 | Hatch Unit 1 | Recirc. inlet nozzle | 12 | 100 |
| January 1991 | River Bend | Feedwater nozzle | 12 | 100 |
| March 1986 | Vermont Yankee | Core spray nozzle | 10 | 50 |

Attachment 1
Proposed Method for Implementing Full Structural Weld Overlays
(Based on ASME Code Case N-704-2)

A1.1 GENERAL REQUIREMENTS

Definitions

Full Structural Weld Overlay - Deposition of weld reinforcement on the outside diameter of the piping, component, or associated weld, such that the weld reinforcement is capable of supporting the design loads, without consideration of the piping, component, or associated weld beneath the weld reinforcement. Full structural weld overlay can either be mitigative or repair weld overlay as defined below.

Mitigative Weld Overlay – *Not used.*

Repair Weld Overlay - Weld overlay that is applied over material with an inside-surface-connected flaw or subsurface defect, or where a pre-weld overlay examination is not performed

(a) A full-structural weld overlay shall be applied by deposition of weld reinforcement (weld overlay) on the outside surface of circumferential welds. Weld overlays may be applied to austenitic nickel alloy and austenitic stainless steel welds between the following:

P-No. 8 or P-No. 43 and P-Nos. 1, 3, 12A, 12B, or 12C¹

P-No. 43 and P-Nos. 1, 3, 12A, 12B, and 12C

P-No. 8 and P-No. 43

Between P-Nos. 1, 3, 12A, 12B, and 12C materials

(b) Weld overlay filler metal shall be nickel alloy (28% Cr min., ERNiCrFe-7X) meeting the requirements of A1.1(e)(1) below applied 360 deg around the circumference of the item and deposited using a Welding Procedure Specification (WPS) for groove welding, qualified in accordance with the Construction Code and Owner's Requirements identified in the Repair/Replacement Plan. As an alternative to the postweld heat treatment (PWHT) requirements of the Construction Code and Owner's requirements, the following provisions may be applied.

(1) *Not used.*

(a) *Not used.*

¹ P- Nos. 12A, 12B, and 12C designations refer to specific material classifications originally identified in Section III and subsequently reclassified in a later Edition of Section IX.

- (b) Not used.
- (2) Ambient-temperature temper bead welding in accordance with Attachment 2 shall be used.
- (c) Prior to deposition of the weld overlay, the surface to be welded overlaid shall be examined using the liquid penetrant method. Indications with major dimension greater than 1/16 in. (1.5 mm) shall be removed, reduced in size, or weld repaired in accordance with the following requirements.
- (1) One or more layers of weld metal shall be applied to seal unacceptable indications in the area to be repaired with or without excavation. The thickness of these layers shall not be used in meeting weld reinforcement design thickness requirements. Peening the unacceptable indication prior to welding is permitted.
 - (2) If weld repair of indications identified in A1.1(d)(1) is required, the area where the weld overlay is to be deposited, including any local weld repairs or initial weld overlay layer, shall be examined by the liquid penetrant method. The area shall contain no indications with major dimension greater than 1/16 in. (1.5 mm) prior to application of the structural layers of the weld overlay.
 - (3) To reduce the potential of hot cracking when applying an austenitic nickel alloy over P-No. 8 base metal, it is permissible to apply a buffer (transitional) layer of austenitic stainless steel filler metal (ER308L) over the austenitic stainless steel base metal. The ER308L filler metal will have a delta ferrite content of 5 – 15 FN as reported on the Certified Material Test Report. The thickness of the buffer layer shall not be used in meeting weld reinforcement design thickness requirements.
- (d) Weld overlay deposits shall meet the following requirements:
- (1) The austenitic nickel alloy weld overlay shall consist of at least two weld layers deposited using a filler material with a Cr content of at least 28%. The first layer of weld metal deposited may not be credited toward the required thickness. A first diluted layer may be credited toward the required thickness, provided the portion of the layer over the austenitic base material, austenitic filler material weld, and the associated dilution zone from an adjacent ferritic base material contain at least 24% Cr, and the Cr content of the deposited weld metal is determined by chemical analysis of the production weld or of a representative coupon taken from a mockup prepared in accordance with the WPS for the production weld.
- (e) This proposed method is only for welding in applications predicted not to have exceeded fast neutron ($E > 1 \text{ MeV}$) fluence of 1×10^{17} neutrons per cm^2 prior to welding.
- (f) A new weld overlay shall not be installed over the top of an existing weld overlay that has been in service.

A1.2 CRACK GROWTH AND DESIGN

(a) *Crack Growth Calculation of Flaws in the Original Weld or Base Metal.* The size of all flaws detected or postulated in the original weld or base metal shall be used to define the life of the overlay. In no case shall the inspection interval be longer than the life of the overlay or that specified in A1.3(c). Crack growth due to both stress corrosion and fatigue, shall be evaluated. Flaw characterization and evaluation shall be based on the examination results of the flaw, as described below. If the flaw is at or near the boundary of two different materials, evaluation of flaw growth in both materials is required.

(1) For repair overlays, the initial flaw size for crack growth in the original weld or base metal shall be based on the as-found flaw or postulated flaw, if no pre-overlay examination is performed.

(2) *Not used.*

(3) *Not used.*

(4) *Not used.*

(5) There may be circumstances in which an overlay examination is performed using an ultrasonic examination procedure qualified in accordance with Appendix VIII, Supplement 11 for depths greater than the outer 25% of the original wall thickness (Fig. A1-2). For such cases, the initial flaw depths assumed would be the detected depth found by the Appendix VIII, Supplement 11 qualified examination plus the postulated worst case flaw in the region not covered by the Appendix VIII ultrasonic examination.

(6) In determining the expected life of the overlay, any inside-surface-connected planar flaw found by the overlay preservice inspection of A1.3(b) that exceeds the depth of (3), (4) or (5) above shall be used as part of the initial flaw depth. The initial flaw depth assumed is the detected flaw depth plus the postulated worst-case flaw depth in the region of the pipe wall thickness, which was not examined using an ultrasonic examination procedure meeting Appendix VIII for that region. An overlay meeting this condition shall be considered repair, rather than mitigation.

(b) *Structural Design and Sizing of the Overlay.* The design of the weld overlay shall satisfy the following, using the assumptions and flaw characterization restrictions in A1.2(a). The following design analysis shall be completed in accordance with IWA-4311:

(1) The axial length and end slope of the weld overlay shall cover the weld and heat-affected zones on each side of the weld as well as any SCC susceptible base material adjacent to weld, and provide for load redistribution from the item into the weld overlay and back into the item without violating applicable stress limits of NB-3200. Any laminar flaws in the weld overlay shall be evaluated in the analysis to ensure that load redistribution complies with the above. These requirements will usually be

- satisfied if the weld overlay full thickness length extends axially beyond the SCC susceptible material or projected flaw by at least $0.75\sqrt{Rt}$, where R is the outer radius of the item and t is the nominal wall thickness of the item at the applicable side of the overlay (i.e. R and t of the nozzle on the nozzle side and R and t of the safe-end on the safe-end side).
- (2) Unless specifically analyzed in accordance with A1.2(b)(1), the end transition slope of the overlay shall not exceed 30 deg.
 - (3) For full structural overlays, the assumed flaw in the underlying base material or weld shall be based on the limiting case of the two below that results in the larger required overlay thickness:
 - (a) 100% through-wall for the entire circumference
 - (b) 100% through-wall for 1.5 in. (38 mm) or the combined width of the weld plus buttering plus any SCC susceptible material, whichever is greater, in the axial direction at the worst location around the circumference.
 - (c) When examinations reveal axial flaws, an evaluation shall be performed to confirm the flaws are shown to be bounded by (b) above.
 - (4) The overlay design thickness shall be verified, using only the weld overlay thickness conforming to the deposit analysis requirements of A1.1(e). The combined wall thickness at the weld overlay, or any postulated worst-case planar flaws under the laminar flaws in the weld overlay, and the effects of any discontinuity (e.g., another weld overlay or reinforcement for a branch connection) within a distance of $2.5\sqrt{Rt}$ from the toes of the weld overlay, including the flaw size assumptions defined in 2(b)(4), (5), or (6) above, shall be evaluated and shall meet the requirements of IWB-3640, IWC-3640, or IWD-3640, as applicable.
 - (5) The effects of any changes in applied loads, as a result of weld shrinkage from the entire overlay, on other items in the piping system (e.g., support loads and clearances, nozzle loads, and changes in system flexibility and weight due to the weld overlay) shall be evaluated. Existing flaws previously accepted by analytical evaluation shall be evaluated in accordance with IWB-3640, IWC-3640, or IWD-3640, as applicable.

A1.3 EXAMINATION

In lieu of all other examination requirements, the examination requirements of this proposed method shall be met for the life of the overlay. Nondestructive examination methods shall be in accordance with IWA-2200, except as specified herein. Nondestructive examination personnel shall be qualified in accordance with IWA-2300. Ultrasonic examination procedures and personnel shall be qualified in accordance with Appendix VIII, Supplement 11. The examination shall be performed to the maximum extent practicable, for axial and circumferential

flaws. If 100% coverage of the required volume for axial flaws cannot be achieved, but essentially 100% coverage for circumferential flaws (100% of the susceptible volume) can be achieved, the examination for axial flaws shall be performed to achieve the maximum coverage practicable, with limitations noted in the examination report. The examination coverage requirements shall be considered to be met.

(a) Acceptance Examination

- (1) The weld overlay shall have a surface finish of 250 $\mu\text{in.}$ (6.3 μm) RMS or better and contour that permits ultrasonic examination in accordance with procedures qualified in accordance with Appendix VIII. The weld overlay shall be inspected to verify acceptable configuration.
- (2) The weld overlay and the adjacent base material for at least $\frac{1}{2}$ in. (13 mm) from each side of the overlay shall be examined using the liquid penetrant method. The weld overlay shall satisfy the surface examination acceptance criteria for welds of the Construction Code or NB-5300. The adjacent base material shall satisfy the surface examination acceptance criteria for base material of the Construction Code or NB-2500. If ambient temperature temper bead welding is performed, the liquid penetrant examination of the completed weld overlay shall be conducted no sooner than 48 hrs following completion of the three tempering layers over the ferritic steel.
- (3) The examination volume A-B-C-D in Fig. A1-1(a) shall be ultrasonically examined to assure adequate fusion (i.e., adequate bond) with the base material and to detect welding flaws, such as interbead lack of fusion, inclusions, or cracks. The interface C-D shown between the overlay and the weld includes the bond and heat-affected zone from the overlay. If ambient temperature temper bead welding is performed, the ultrasonic examination shall be conducted at least 48 hrs following completion of the three tempering layers over the ferritic steel. Planar flaws detected in the weld overlay acceptance examination shall meet the preservice examination standards of Table IWB-3514-2. In applying the acceptance standards to planar indications, the thickness, t_1 or t_2 , defined in Fig. A1-1(b), shall be used as the nominal wall thickness in Table IWB-3514-2, provided the base material beneath the flaw (i.e., safe end, nozzle, or piping material) is not susceptible to stress corrosion cracking (SCC). For susceptible material, t_1 shall be used. If a flaw in the overlay crosses the boundary between the two regions, the more conservative of the two dimensions (t_1 or t_2) shall be used.
- (4) Laminar flaws in the weld overlay shall meet the following requirements:
 - (a) The acceptance standards of Table IWB-3514-3 shall be met, with the additional limitation that the total laminar flaw shall not exceed 10% of the weld surface area, and that no linear dimension of the laminar flaw area shall exceed the greater of 3 in. (76 mm) or 10% of the pipe circumference.
 - (b) For examination volume A-B-C-D in Fig. A1-1(a), the reduction in coverage due to laminar flaws shall be less than 10%. The uninspectable volume is the volume

in the weld overlay underneath the laminar flaws for which coverage cannot be achieved with the angle beam examination method.

- (c) Any uninspectable volume in the weld overlay shall be assumed to contain the largest radial planar flaw that could exist within that volume. This assumed flaw shall meet the preservice examination acceptance standards of Table IWB-3514-2, with nominal wall thickness as defined above for planar flaws. Alternatively, the assumed flaw shall be evaluated and shall meet the requirements of IWB-3640, IWC-3640, and IWD-3640, as applicable. Both axial and circumferential planar flaws shall be assumed.

- (5) After completion of all welding activities, VT-3 visual examination shall be performed on all affected restraints, supports, and snubbers, to verify that design tolerances are met.

(b) *Preservice Inspection*

- (1) The examination volume in Fig. A1-2 shall be ultrasonically examined. The angle beam shall be directed perpendicular and parallel to the piping axis, with scanning performed in four directions, to locate and size any planar flaws that have propagated into the outer 25% of the base metal thickness or into the weld overlay.
- (2) The preservice examination acceptance standards of Table IWB-3514-2 shall be met for the weld overlay. In applying the acceptance standards, wall thickness shall be the thickness of the weld overlay as defined in Fig. A1-1(b). Planar flaws in the outer 25% of the base material thickness shall meet the design analysis requirements of A1.2(b).
- (3) The flaw evaluation requirements of IWB-3640, IWC-3640, or IWD-3640 shall not be applied to planar flaws, identified during preservice examination, that exceed the preservice examination acceptance standards of Table IWB-3514-2.

(c) *Inservice Inspection*

- (1) The weld overlay examination shall be added to the inspection plan. The weld overlay inspection interval shall not be greater than the life of the overlay as determined in 2(a) above. All weld overlays shall be examined prior to the end of their design life.
- (2) The weld overlay examination volume in Fig. A1-2 shall be ultrasonically examined during the first or second refueling outage following application.
- (3) The weld overlay examination volume in Fig. A1-2 shall be ultrasonically examined to determine if any new or existing planar flaws have propagated into the outer 25% of the base material thickness or into the overlay. The angle beam shall be directed perpendicular and parallel to the piping axis, with scanning performed in four directions.

- (4) The weld overlay shall meet the inservice examination acceptance standards of Table IWB-3514-2. If the acceptance standards of Table IWB-3514-2 cannot be met, the weld overlay shall meet the acceptance standards of IWB-3600, IWC-3600, or IWD-3600, as applicable. If a planar flaw is detected in the outer 25% of the base material thickness, it shall be included in the design analysis required by Section A1.2. Any indication characterized as stress corrosion cracking in the weld overlay material is unacceptable.
- (5) Weld overlay examination volumes in Fig. A1-2 that show no indication of planar flaw growth or new planar flaws shall be placed into a population to be examined on a sample basis, except as required by A1.3(c)(1). Twenty-five percent of this population shall be examined once during each inspection interval.
- (6) If inservice examinations reveal planar flaw growth, or new planar flaws, meeting the acceptance standards of IWB-3514, IWB-3600, IWC-3600, or IWD-3600, the weld overlay examination volume shall be reexamined during the first or second refueling outage following discovery of the growth or new flaws.
- (7) For weld overlay examination volumes with unacceptable indications in accordance with A1.3(c) (4), the weld overlay and original defective weld shall be removed. A repair/replacement activity shall be performed in accordance with IWA-4000.
- (8) Not used.

(d) *Additional Examinations.*

If inservice examinations reveal a defect, in accordance with A1.3(c)(4), planar flaw growth into the weld overlay design thickness, or axial flaw growth beyond the specified examination volume, additional weld overlay examination volumes, equal to the number scheduled for the current inspection period, shall be examined prior to return to service. If additional defects are found in the second sample, 50% of the total population of weld overlay examination volumes shall be examined prior to return to service. If additional defects are found, the entire remaining population of weld overlay examination volumes shall be examined prior to return to service.

A1.4 PRESSURE TESTING


A system leakage test shall be performed in accordance with IWA-5000. The NRC previously approved Code Case N-416-2, "Alternative Pressure Test Requirement for Welded Repairs, Fabrication Welds for Replacement Parts and Piping Subassemblies, or Installation of Replacement Items by Welding, Class 1, 2, and 3," for use at Crystal River 3. The code case allows use of a system leakage test, in conjunction with specified NDE, in lieu of a system hydrostatic test to detect leakage from welded repairs, fabrication welds for replacement parts and piping subassemblies, or welds for installation of replacement items. For a system leakage test to be used, Code Case N-416-2 requires:

- Performance of NDE in accordance with the methods of Non-Mandatory Appendix O and acceptance criteria of the applicable Subsection of the 1992 Edition of Section III (as described in Section 5.4).


- Performance of a visual examination (VT-2) prior to or immediately upon return to service in conjunction with a system leakage test, using the 1992 Edition of Section XI, in accordance with IWA-5000, at nominal operating pressure and temperature.
- Documentation of use of this Case on an NIS-2 Form.

A1.5 DOCUMENTATION

Use of this proposed method shall be documented on Form NIS-2.

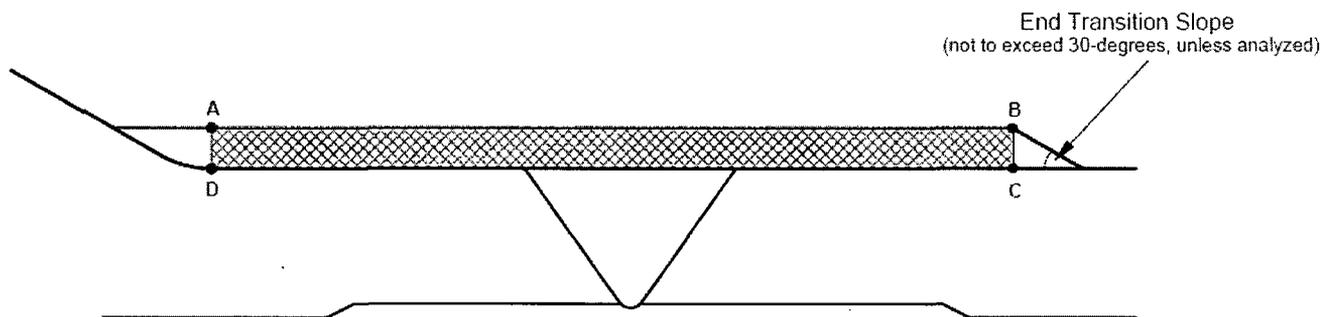

(a) Examination Volume A-B-C-D

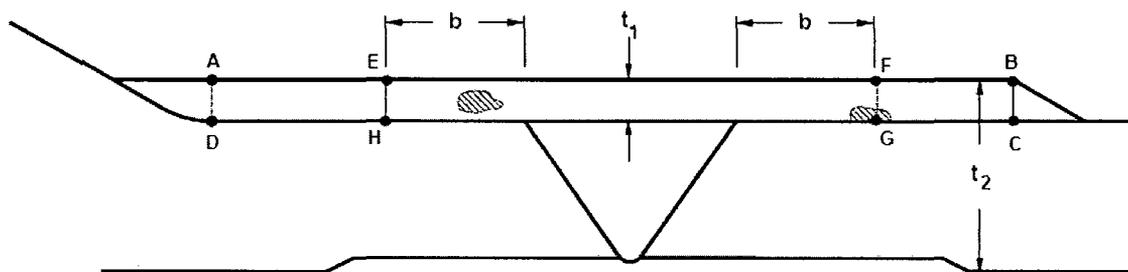

(b) Thickness (t_1 and t_2) for Table IWB-3514-2

FIG. A1-1 EXAMINATION VOLUME AND THICKNESS DEFINITIONS

GENERAL NOTES:

- (a) Dimension b is equivalent to the nominal thickness of nozzle or pipe being overlaid, as appropriate.
- (b) The nominal wall thickness is t_1 for flaws in E-F-G-H, and t_2 for flaws in A-E-H-D or F-B-C-G,].
- (c) For flaws that span two examination volumes (such as illustrated at F-G in the figure), the t_1 thickness shall be used.

The weld includes the nozzle butter, where applied, plus any SCC susceptible base material in the nozzle.

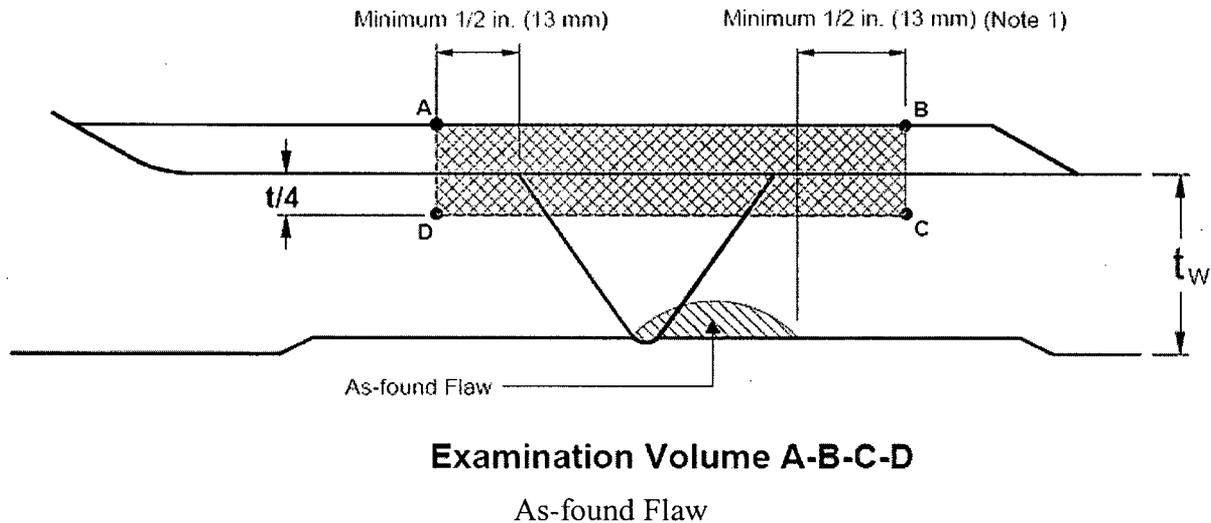


FIG. A1-2 PRESERVICE AND INSERVICE EXAMINATION VOLUME

NOTE:

- (1) For axial or circumferential flaws, the axial extent of the examination volume shall extend at least 1/2 in. (13 mm) beyond the as-found flaw and at least 1/2 in. (13 mm) beyond the toes of the original weld, including weld end butter, where applied.

GENERAL NOTE:

The weld includes the nozzle butter, where applied.

Attachment 2

Proposed Temperbead Method

A2.1 GENERAL REQUIREMENTS

(a) This Appendix applies to dissimilar austenitic filler metal welds between P-Nos. 1, 3, 12A, 12B, and 12C² materials and their associated welds and welds joining P-No. 8 or 43 materials to P-Nos. 1, 3, 12A, 12B, and 12C materials with the following limitation: This Appendix shall not be used to repair SA-302 Grade B material unless the material has been modified to include from 0.4% to 1.0% nickel, quenching, tempering, and application of a fine grain practice.

(b) The maximum area of an individual weld overlay based on the finished surface over the ferritic base material shall be 500 in.² (325 000 mm²).

(c) Repair/replacement activities on a dissimilar-metal weld in accordance with this Appendix are limited to those along the fusion line of a nonferritic weld to ferritic base material on which 1/8 in. (3 mm) or less of nonferritic weld deposit exists above the original fusion line.

(d) If a defect penetrates into the ferritic base material, repair of the base material, using a nonferritic weld filler material, may be performed in accordance with this Appendix, provided the depth of repair in the base material does not exceed 3/8 in. (10 mm).

(e) Prior to welding, the area to be welded and a band around the area of at least 1½ times the component thickness or 5 in. (130 mm), whichever is less, shall be at least 50°F (10°C).

(f) Welding materials shall meet the Owner's Requirements and the Construction Code and Cases specified in the Repair/Replacement Plan. Welding materials shall be controlled so that they are identified as acceptable until consumed.

(g) Peening may be used, except on the initial and final layers.

A2.2 WELDING QUALIFICATIONS

The welding procedures and operators shall be qualified in accordance with Section IX and the requirements of A2.2.1 and A2.2.2.

² P- Nos. 12A, 12B, and 12C designations refer to specific material classifications originally identified in Section III and subsequently reclassified in a later Edition of Section IX.

A2.2.1 Procedure Qualification

(a) The base materials for the welding procedure qualification shall be of the same P-Number and Group Number as the materials to be welded. The materials shall be postweld heat treated to at least the time and temperature that was applied to the materials being welded.

(b) The maximum interpass temperature for the first three layers of the test assembly shall be 150°F (66°C).

(c) The weld overlay shall be qualified using a groove weld coupon. The test assembly groove depth shall be at least 1 in. (25 mm). The test assembly thickness shall be at least twice the test assembly groove depth. The test assembly shall be large enough to permit removal of the required test specimens. The test assembly dimensions on either side of the groove shall be at least 6 in. (150 mm). The qualification test plate shall be prepared in accordance with Fig. A2-1.

(d) Ferritic base material for the procedure qualification test shall meet the impact test requirements of the Construction Code and Owner's Requirements. If such requirements are not in the Construction Code and Owner's Requirements, the impact properties shall be determined by Charpy V-notch impact tests of the procedure qualification base material at or below the lowest service temperature of the item to be repaired. The location and orientation of the test specimens shall be similar to those required in A2.2.1(e), but shall be in the base metal.

(e) Charpy V-notch tests of the ferritic heat-affected zone (HAZ) shall be performed at the same temperature as the base metal test of A2.2.1(d). Number, location, and orientation of test specimens shall be as follows:

(1) The specimens shall be removed from a location as near as practical to a depth of one-half the thickness of the deposited weld metal. The coupons for HAZ impact specimens shall be taken transverse to the axis of the weld and etched to define the HAZ. The notch of the Charpy V-notch specimen shall be cut approximately normal to the material surface in such a manner as to include as much HAZ as possible in the resulting fracture.

(2) If the material thickness permits, the axis of a specimen shall be inclined to allow the root of the notch to be aligned parallel to the fusion line.

(3) If the test material is in the form of a plate or a forging, the axis of the weld shall be oriented parallel to the principal direction of rolling or forging.

(4) The Charpy V-notch test shall be performed in accordance with SA-370. Specimens shall be in accordance with SA-370, Fig. 11, Type A. The test shall consist of a set of three full-size 10 mm x 10 mm specimens. The lateral expansion, percent shear, absorbed energy, test temperature, orientation, and location of all test specimens shall be reported in the Procedure Qualification Record.

(f) The average lateral expansion value of the three HAZ Charpy V-notch specimens shall be equal to or greater than the average lateral expansion value of the three unaffected base metal

specimens. However, if the average lateral expansion value of the HAZ Charpy V-notch specimens is less than the average value for the unaffected base metal specimens and the procedure qualification meets all other requirements of this Appendix, either of the following shall be performed:

- (1) The welding procedure shall be requalified.
- (2) An Adjustment Temperature for the procedure qualification shall be determined in accordance with the applicable provisions of NB-4335.2 of Section III, 2001 Edition with 2002 Addenda. The RT_{NDT} or lowest service temperature of the materials for which the welding procedure will be used shall be increased by a temperature equivalent to that of the Adjustment Temperature.

A2.2.2 Performance Qualification

Welding operators shall be qualified in accordance with Section IX.


A2.3 WELDING PROCEDURE REQUIREMENTS


The welding procedure shall include the following requirements.

- (a) The weld metal shall be deposited by the automatic or machine GTAW process.
- (b) Dissimilar metal welds shall be made using A-No. 8 weld metal (QW-442) for P-No. 8 to P-No. 1, 3, or 12 (A, B, or C)¹ weld joints or F-No. 43 weld metal (QW-432) for P-No. 8 or 43 to P-No. 1, 3, or 12 (A, B, or C)¹ weld joints.
- (c) The area to be welded shall be buttered with a deposit of at least three layers to achieve at least 1/8 in. (3 mm) overlay thickness with the heat input for each layer controlled to within $\pm 10\%$ of that used in the procedure qualification test. The heat input of the first three layers shall not exceed 45 kJ/in. (1.8 kJ/mm) under any conditions. Particular care shall be taken in the placement of the weld layers of the austenitic overlay filler material at the toe of the overlay to ensure that the HAZ and ferritic base metal are tempered. Subsequent layers shall be deposited with a heat input not exceeding that used for layers beyond the third layer in the procedure qualification.
- (d) The maximum interpass temperature for field applications shall be 350°F (180°C) for all weld layers regardless of the interpass temperature used during qualification. The interpass temperature limitation of QW-406.3 need not be applied.
- (e) The interpass temperature shall be determined as follows:

Direct temperature measurement (e.g. pyrometers, temperature-indicating crayons, and thermocouples) during welding or if direct measurement is impractical, one of the following methods shall be used to determine the interpass temperature:

- (a) heat-flow calculations using the variables listed below as a minimum
 - (1) welding heat input
 - (2) initial base material temperature
 - (3) configuration, thickness, and mass of the item being welded
 - (4) thermal conductivity and diffusivity of the materials being welded
 - (5) arc time per weld pass and delay time between each pass
 - (6) arc time to complete the weld
- (b) measurement of the maximum interpass temperature on a test coupon that is equal to or less than the thickness of the item to be welded. The maximum heat input of the welding procedure shall be used in welding the test coupon.
- (f) Particular care shall be given to ensure that the weld region is free of all potential sources of hydrogen. The surfaces to be welded, filler metals, and shielding gas shall be suitably controlled.

| | | |
|-------------------------|--|-----------------------|
| Discard | | |
| Transverse Side Bend | | |
| Reduced Section Tensile | | |
| Transverse Side Bend | | |
| |  | HAZ Charpy V-Notch |
| Transverse Side Bend | | |
| Reduced Section Tensile | | |
| Transverse Side Bend | | |
| Discard | | |

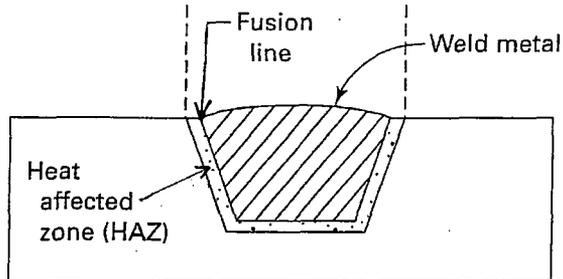

GENERAL NOTE: Base metal Charpy impact specimens are not shown.

FIG. A2-1 QUALIFICATION TEST PLATE

Attachment 3

COMPARISON OF ASME CODE CASE N-504-3 AND APPENDIX Q OF ASME SECTION XI WITH THE PROPOSED ALTERNATIVE OF ATTACHMENT 1 FOR FULL STRUCTURAL WELD OVERLAYS

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|---|--|
| <p>Code Case N-504-3 provides requirements for reducing a defect to a flaw of acceptable size by deposition of weld reinforcement (weld overlay) on the outside surface of the pipe using austenitic stainless steel filler metal as an alternative to defect removal. Code Case N-504-3 is applicable to austenitic stainless steel piping only. According to Regulatory Guide 1.147, the provisions of Nonmandatory Appendix Q of ASME Section XI must also be met when using this Case. Therefore, the Code Case N-504-3 requirements presented below have been supplemented by Appendix Q of ASME Section XI.</p> | <p>The proposed alternative of Attachment 1 provides requirements for installing a full structural weld overlay by deposition of weld reinforcement (weld overlay) on the outside surface of the item using Nickel Alloy 52M filler metal. Attachment 1 is applicable to dissimilar metal welds associated with ferritic, stainless steel, and nickel alloy materials. It is also applicable to similar metal welds in austenitic stainless steels. The proposed alternative of Attachment 1 is based on Code Case N-740-2.</p> |
| <p>General Requirements</p> | <p>A1.1 General Requirements</p> |
| <p>Code Case N-504-3 and Appendix Q are only applicable to P-No. 8 austenitic stainless steels.</p> | <p>As specified in paragraph A1.1(a) of Attachment 1, the proposed alternative is applicable to dissimilar metal 82/182 welds joining P-No. 3 to P-No. 8 or 43 materials and P-No. 8 to P-No. 43 materials. It is also applicable to austenitic stainless steel welds joining P-No. 8 materials.</p> <p>Basis: Code Case N-504-3 and Appendix Q are applicable to austenitic weld overlays of P-No. 8 austenitic stainless steel materials. Based on Code Case N-740-2, the proposed alternative of Attachment 1 was specifically written to address the application of weld overlays over dissimilar metal welds and austenitic stainless steel welds.</p> |
| <p>According to paragraph (b) of Code Case N-504-3 as supplemented by Appendix Q, weld overlay filler metal shall be low carbon (0.035% max.) austenitic stainless steel applied 360° around the circumference of the pipe, and shall be deposited using a Welding Procedure Specification for groove welding, qualified in accordance with the Construction Code and Owner's Requirements and identified in the repair/replacement plan</p> | <p>The weld filler metal and procedure requirements of Attachment 1, paragraph 1.0(b) are equivalent to Code Case N-504-3 and Appendix Q except as noted below:</p> <ul style="list-style-type: none"> Weld overlay filler metal shall be austenitic Nickel Alloy 52M (ERNiCrFe-7A) filler metal which has a chromium content of at least 28%. <p>As an alternative to post-weld heat treatment, the provisions for "Ambient Temperature Temperbead Welding" may be used on the ferritic nozzle as described in Attachment 2.</p> |

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|--|---|
| | <p>Basis: The weld overlay will be deposited with ERNiCrFe-7 (Alloy 52M) filler metal. It has been included into ASME Section IX as F-No. 43 filler metals. Containing 28.0 - 31.5% chromium (roughly twice the chromium content of 82/182 filler metal), this filler metal has excellent resistance to PWSCC. This point has been clearly documented in EPRI Technical Report MRP-115, Section 2.2. Regarding the WPS, paragraph 1.0(b) of Attachment 1 provides clarification that the WPS used for depositing weld overlays must be qualified as a groove welding procedure to ensure that mechanical properties of the WPS are appropriately established. Where welding is performed on ferritic nozzles, an ambient temperature temperbead WPS will be used. Suitability of an ambient temperature temperbead WPS is addressed in Section VI.A.2 of this Request.</p> |
| <p>According to paragraph (e) of Code Case N-504-3 as supplemented by Appendix Q, the weld reinforcement shall consist of at least two weld layers having as-deposited delta ferrite content of at least 7.5 FN. The first layer of weld metal with delta ferrite content of at least 7.5 FN shall constitute the first layer of the weld reinforcement that may be credited toward the required thickness. Alternatively, first layers of at least 5 FN provided the carbon content is determined by chemical analysis to be less than 0.02%.</p> | <p>The weld overlay described in Attachment 1 is deposited using Nickel Alloy 52M filler metal instead of austenitic stainless steel filler metals. Therefore, the basis for crediting the first layer towards the required design thickness will be based on the chromium content of the nickel alloy filler metal. According to paragraph 1.0(d) of Attachment 1, the first layer of Nickel Alloy 52M deposited weld metal may be credited toward the required thickness provided the portion of the layer over the austenitic base material, austenitic weld, and the associated dilution zone from an adjacent ferritic base material contains at least 24% chromium. The chromium content of the deposited weld metal may be determined by chemical analysis of the production weld or from a representative coupon taken from a mockup prepared in accordance with the WPS for the production weld.</p> <p>Basis: The weld overlay will be deposited with ERNiCrFe-7 (Alloy 52M) filler metal. Credit for the first weld layer may not be taken toward the required thickness unless it has been shown to contain at least 24% chromium. This is a sufficient amount of chromium to prevent PWSCC. Section 2.2 of EPRI Technical Report MRP-115 states the following: "The only well explored effect of the compositional differences among the weld alloys on PWSCC is the influence of chromium. Buisine, et al. evaluated the PWSCC resistance of nickel-based weld metals with various chromium contents ranging from about 15% to 30% chromium. Testing was performed in doped steam and primary water. Alloy 182, with about 14.5% chromium, was the most susceptible. Alloy 82 with 18-20% chromium took three or four times longer to crack. For chromium contents between 21 and 22%, no stress corrosion crack initiation was observed ... "</p> |

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|--|--|
| <p>Design and Crack Growth Considerations</p> | <p>A1.2 Design and Crack Growth Considerations</p> |
| <p>The design and flaw characterization provisions of Code Case N504-3, paragraphs (f) and (g) as supplemented by Appendix Q are summarized below:</p> <p>(i) Flaw characterization and evaluation are based on the as-found flaw. Flaw evaluation of the existing flaws is based on IWB3640 for the design life.</p> <ul style="list-style-type: none"> • Multiple circumferential flaws shall be treated as one flaw of length equal to the sum of the lengths of the individual flaws. • Circumferential flaws are postulated as 100% through-wall for the entire circumference with one exception. When the combined length of circumferential flaws does not exceed 10% of the circumference, the flaws are only assumed to be 100% through-wall for the combined length of the flaws. • For axial flaws 1.5 inches or longer, or for five or more axial flaws of any length, the flaws shall be assumed to be 100% through-wall for the axial length of the flaw and entire circumference of the pipe. <p>(ii) For four or fewer axial flaws less than 1.5 inches in length, the weld overlay thickness need only consist of two or more layers of weld metal meeting the deposit analysis requirements.</p> <p>(iii) The axial length and end slope of the weld overlay shall cover the weld and HAZs on each side of the weld, and shall provide for load redistribution from the item into the weld overlay and back into the item without violating applicable stress limits of the Construction Code. Any laminar flaws in the weld overlay shall be evaluated in the analysis to ensure that load redistribution complies with the above. These requirements are usually met if the weld overlay extends beyond the projected flaw by at least 0.75 (Rt)1/2.</p> <p>(iv) Unless specifically analyzed, the end transition slope of the overlay shall not exceed 45°, and a slope of not more than 1:3 is recommended.</p> | <p>The design and flaw evaluation provisions in the proposed alternative of Attachment 1, Section A1.2 are the same as Code Case N-504-3 as supplemented in Appendix Q with the exceptions below.</p> <p>For crack growth evaluations, <i>if</i> the flaw is at or near the boundary of two different materials, evaluation of flaw growth in both materials is required.</p> <p>For design, flaws shall be assumed to be 100% through the original wall thickness for the entire circumference. <u>Unless specifically analyzed, the end transition slope of the overlay shall not exceed 30°.</u></p> <p>Basis: Regarding the crack growth analysis, <u>the proposed alternative of Attachment 1 allows for the possibility that the flaw is at or near the boundary of the overlay material, which is different than the base material.</u> With regard to design, flaws are considered to be 100% through the original weld and no structural credit is taken for the weld. <u>The maximum transition end slope, without specific analysis, is limited to 30° instead of 45° to minimize transition discontinuity stresses.</u> All other requirements are equivalent to Code Case N-504-3 as supplemented by Appendix Q.</p> |

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|--|---|
| <p>(v) The overlay design thickness of items shall be based on the measured diameter, using only the weld overlay thickness conforming to the deposit analysis requirements. The combined wall thickness at the weld overlay, any planar flaws in the weld overlay, and the effects of any discontinuity (e.g., another weld overlay or reinforcement for a branch connection) within a distance of 0.75 (Rt)1/2 from the toes of the weld overlay, shall be evaluated and meet the requirements of IWB-, IWC-, or IWD-3640.</p> <p>(vi) The effects of any changes in applied loads, as a result of weld shrinkage or existing flaws previously accepted by analytical evaluation shall be evaluated in accordance with IWB-3640, IWC-3640, or IWD-3640, as applicable.</p> | |
| <p>Examination and Inspection</p> | <p>A1.3 Examination and Inspection</p> |
| <p>Code Case N-504-3 does not include requirements for acceptance examination or inservice examination of weld overlays. Preservice examination is addressed. However, Appendix Q, Article Q-4000 does specify requirements applicable to weld acceptance examinations, preservice examinations, and inservice examinations.</p> | <p>Attachment 1, Section 3.0 of the proposed alternative specifies requirements applicable to weld acceptance examinations, preservice examinations, and inservice examinations.</p> |
| <p>Acceptance Examination</p> | <p>A1.3(a) Acceptance Examination</p> |
| <p>Acceptance Examination Q-4100(c) states that the examination volume in Figure Q-4100-1 shall be ultrasonically examined to assure adequate fusion (i.e., adequate bond) with the base metal and to detect welding flaws, such as inter-bead lack of fusion, inclusions, or cracks. Planar flaws shall meet the preservice examination standards of Table IWB-3514-2. Laminar flaws shall meet the following:</p> | <p>The acceptance standards in paragraph A1.3(a)(3) of Attachment 1 are identical to those of paragraph Q-4100(c) except that paragraph A1.3(a)(3) includes requirements and clarifications that are not included in Appendix Q. First, it specifies that the ultrasonic examination shall be conducted at least 48 hours after completing the third layer of the weld overlay when ambient temperature temperbead welding is used. Secondly, it provides the following clarifications:</p> <p style="padding-left: 40px;">The interface C-D between the weld overlay and the weld includes the bond and the HAZ from the weld overlay.</p> <p style="padding-left: 40px;">In applying the acceptance standards, wall thickness "tw" shall be the thickness of the weld overlay.</p> <p>Basis: Appendix Q is applicable to austenitic stainless steel materials only; therefore, ambient temperature temperbead welding would not be applicable. It is applicable to</p> |

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|--|---|
| | <p>welding performed in the proposed alternative. When ambient temperature temperbead welding is performed, nondestructive examinations must be performed at least 48 hours after completing the third layer of the weld overlay to allow sufficient time for hydrogen cracking to occur (if it is to occur). Technical justification for starting the 48 hours after completion of the third layer of the weld overlay is provided in paragraph 6.C of the Request. The other two changes are simply clarifications that were added to ensure that the examination requirements were appropriately performed.</p> |
| <p>Q-4100(c)(1) states that laminar flaws shall meet the acceptance standards of Table IWB-3514-3.</p> | <p>The acceptance standards in paragraph A1.3(a)(3)(i) of Attachment 1 are identical to paragraph Q-4100(c)(1) except that paragraph A1.3(a)(3)(i) includes the additional limitation that the total laminar flaw shall not exceed 10% of the weld surface area and that no linear dimension of the laminar flaw area exceeds 3.0 in.</p> <p>Basis: These changes were made to provide additional conservatism to the weld overlay examination and to reduce the size of the un-inspectable volume beneath a laminar flaw. See paragraph 6.B of this Relief Request for additional information</p> |
| <p>Q-4100(c)(4) allows the performance of radiography in accordance with the Construction Code as an alternative to Q-4100(c)(3).</p> | <p>The acceptance standards in paragraph A1.3(a)(3) of Attachment 1 do not include the radiographic alternative of paragraph Q-4100(c)(4).</p> <p>Basis: The UT examinations performed in accordance with the proposed alternative are in accordance with ASME Code Section XI, Appendix VIII, Supplement 11 as implemented through the PDI. These examinations are considered more sensitive for detection of defects, either from fabrication or service-induced, than either ASME Code Section III radiographic or ultrasonic methods. Furthermore, construction type flaws have been included in the PDI qualification sample sets for evaluating procedures and personnel. See Section 6.B of this Relief Request for additional justification.</p> |
| <p>Preservice Inspection</p> | <p>A1.3(b) Preservice Inspection</p> |
| <p>Q-4200(b) states that the preservice examination acceptance standards of Table IWB-3514-2 shall be met for the weld overlay. Cracks in the outer 25% of the base metal shall meet the design analysis requirements of Q-3000.</p> | <p>The acceptance standards in paragraph A1.3(b)(2) of Attachment 1 are identical to paragraph Q-4200(b) except paragraph A1.3(b)(2) includes the following statement: "In applying the acceptance standards, wall thickness, t_w, shall be the thickness of the weld overlay."</p> |

| Code Case N-504-3 and Appendix Q of ASME Section XI | Proposed Alternatives of Attachment 1 |
|--|---|
| | <p>Basis: This provision is actually a clarification that the nominal wall thickness of Table IWB-3514-2 shall be considered the thickness of the weld overlay. It must be remembered that the acceptance standards were originally written for the welds identified in IWB-2500. Because IWB-2500 does not address weld overlays, this clarification was provided to avoid any potential confusion. However, defining the weld overlay thickness as the nominal wall thickness of Table IWB-3514-2 has always been the practice since it literally becomes the new design wall of the piping or component nozzle.</p> |
| <p>Pressure Testing</p> | <p>A1.4 Pressure Testing</p> |
| <p>(h) The completed repair shall be pressure tested in accordance with IWA-5000. A system hydrostatic test is required if the flaw penetrated the pressure boundary. A system leakage test may be performed if pressure boundary is not penetrated.</p> | <p>The pressure testing requirements of Section A1.4 of Attachment 1 are similar to paragraph (h) of Code Case N-504-3 except that only a system leakage test per IWA-5000 is required.</p> |

Attachment 4
COMPARISON OF ASME SECTION XI APPENDIX VIII, SUPPLEMENT 11
TO PERFORMANCE DEMONSTRATION INITIATIVE (PDI)

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlay Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|--|---|
| 1.0 SPECIMEN REQUIREMENTS | |
| 1.1 General. The specimen set shall conform to the following requirements. | No Change |
| <p>(b) The specimen set shall consist of at least three specimens having different nominal pipe diameters and overlay thicknesses. They shall include the minimum and maximum nominal pipe diameters for which the examination procedure is applicable. Pipe diameters within a range of 0.9 to 1.5 times a nominal diameter shall be considered equivalent. If the procedure is applicable to pipe diameters of 24 in. or larger, the specimen set must include at least one specimen 24 in. or larger but need not include the maximum diameter. The specimen set must include at least one specimen with overlay thickness within -0.1 in. to +0.25 in. of the maximum nominal overlay thickness for which the procedure is applicable.</p> | <p>(b) The specimen set shall consist of at least three specimens having different nominal pipe diameters and overlay thicknesses. They shall include the minimum and maximum nominal pipe diameters for which the examination procedure is applicable. Pipe diameters within a range of 0.9 to 1.5 times a nominal diameter shall be considered equivalent. If the procedure is applicable to pipe diameters of 24 in. or larger, the specimen set must include at least one specimen 24 in. or larger but need not include the maximum diameter. The specimen set shall include specimens with overlays not thicker than 0.1 in. more than the minimum thickness, nor thinner than 0.25 in. of the maximum nominal overlay thickness for which the examination procedure is applicable.</p> <p>Basis: To avoid confusion, the overlay thickness tolerance contained in the last sentence was reworded</p> |
| (d) <i>Flaw Conditions</i> | |
| <p>(1) <i>Base metal flaws.</i> All flaws must be cracks in or near the butt weld heat-affected zone, open to the inside surface, and extending at least 75% through the base metal wall. Flaws may extend 100% through the base metal and into the overlay material; in this case, intentional overlay fabrication flaws shall not interfere with ultrasonic detection or characterization of the cracking. Specimens containing IGSCC shall be used when available.</p> | <p>(1) <i>Base metal flaws.</i> All flaws must be in or near the butt weld heat affected zone, open to the inside surface, and extending at least 75% through the base metal wall. Intentional overlay fabrication flaws shall not interfere with ultrasonic detection or characterization of the base metal flaws. Specimens containing IGSCC shall be used when available. At least 70 percent of the flaws in the detection and sizing tests shall be cracks and the remainder shall be alternative flaws. Alternative flaw mechanisms, if used, shall provide crack-like reflective characteristics and shall be limited by the following :</p> <p>(a) The use of Alternative flaws shall be limited to when the implantation of cracks produces spurious reflectors that are uncharacteristic of actual flaws.</p> <p>(b) Flaws shall be semi-elliptical with a tip width of less than or equal to 0.002 inches.</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlayed Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|--|---|
| | <p>Basis: Paragraph 1.1 (d)(1) requires that all base metal flaws be cracks. Implanting a crack requires excavation of the base material on at least one side of the flaw. While this may be satisfactory for ferritic materials, it does not produce a useable axial flaw in austenitic materials because the sound beam, which normally passes only through base material, must now travel through weld material on at least one side, producing an unrealistic flaw response. To resolve this issue, the PDI program revised this paragraph to allow use of alternative flaw mechanisms under controlled conditions. For example, alternative flaws shall be limited to when implantation of cracks precludes obtaining an effective ultrasonic response, flaws shall be semielliptical with a tip width of less than or equal to 0.002 inches, and at least 70% of the flaws in the detection and sizing test shall be cracks and the remainder shall be alternative flaws. The statement "intentional overlay fabrication flaws shall not interfere with ultrasonic detection or characterization of the base metal flaws" was included into paragraph 1.1(d)(1). Additionally, to avoid confusion, the phrase "and the remainder shall be alternate flaws" was added to the second to last sentence of this paragraph.</p> |
| <p><i>(e) Detection Specimens</i></p> | |
| <p>(1) At least 20% but less than 40% of the flaws shall be oriented within ± 20 deg. of the pipe axial direction. The remainder shall be oriented circumferentially. Flaws shall not be open to any surface to which the candidate has physical or visual access. The rules of IWA-3300 shall be used to determine whether closely spaced flaws should be treated as single or multiple flaws.</p> | <p>(1) At least 20% but less than 40% of the base metal flaws shall be oriented within ± 20 deg. of the pipe axial direction. The remainder shall be oriented circumferentially. Flaws shall not be open to any surface to which the candidate has physical or visual access.</p> <p>Basis: The requirement for axially oriented overlay fabrication flaws in paragraph 1.1 (e)(1) was excluded from the PDI Program as an improbable scenario. Weld overlays are typically applied using automated Gas Tungsten Arc Welding techniques with the filler metal being applied in a circumferential direction. Because resultant fabrication induced discontinuities would also be expected to have major dimensions oriented in the circumferential direction axial overlay fabrication flaws are unrealistic. The requirement for using IWA-3300 for proximity flaw evaluation in paragraph 1.1 (e)(1) was excluded, instead, indications will be sized based on their individual merits.</p> |
| <p>(2) Specimens shall be divided into base and overlay grading units. Each specimen shall contain one or both types of grading units.</p> | <p>(2) Specimens shall be divided into base metal and overlay fabrication grading units. Each specimen shall contain one or both types of grading units. Flaws shall not interfere with ultrasonic detection or characterization of other flaws.</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlaid Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement-11 Requirements |
|---|--|
| <p>(a)(1) A base grading unit shall include at least 3 in. of the length of the overlaid weld. The base grading unit includes the outer 25% of the overlaid weld and base metal on both sides. The base grading unit shall not include the inner 75% of the overlaid weld and base metal overlay material, or base metal-to-overlay interface.</p> | <p>(a)(1) A base metal grading unit includes the overlay material and the outer 25% of the original overlaid weld. The base metal grading unit shall extend circumferentially for at least 1 in. and shall start at the weld centerline and be wide enough in the axial direction to encompass one half of the original weld crown and a minimum of 0.50" of the adjacent base material.</p> <p>Basis: The phrase "and base metal on both sides", was inadvertently included in the description of a base metal grading unit. The PDI program intentionally excludes this requirement because some of the qualification samples include flaws on both sides of the weld. This paragraph was also modified to require that a base metal grading unit include at least 1 inch of the length of the overlaid weld, rather than 3 inches.</p> |
| <p>(a)(2) When base metal cracking penetrates into the overlay material, the base grading unit shall include the overlay metal within 1 in. of the crack location. This portion of the overlay material shall not be used as part of any overlay grading unit.</p> | <p>(a)(2) When base metal flaws penetrate into the overlay material, the base metal grading unit shall not be used as part of any overlay fabrication grading unit.</p> |
| <p>(a)(3) When a base grading unit is designed to be unflawed, at least 1 in. of unflawed overlaid weld and base metal shall exist on either side of the base grading unit. The segment of weld length used in one base grading unit shall not be used in another base grading unit. Base grading units need not be uniformly spaced around the specimen.</p> | <p>(a)(3) Sufficient unflawed overlaid weld and base metal shall exist on all sides of the grading unit to preclude interfering reflections from adjacent flaws.</p> <p>Basis: This paragraph was modified to require sufficient unflawed overlaid weld and base metal to exist on all sides of the grading unit to preclude interfering reflections from adjacent flaws, rather than the 1 inch requirement.</p> |
| <p>(b)(1) An overlay grading unit shall include the overlay material and the base metal-to-overlay interface of at least 6 square inch. The overlay grading unit shall be rectangular, with minimum dimensions of 2 inches.</p> | <p>(b)(1) An overlay fabrication grading unit shall include the overlay material and the base metal-to-overlay interface for a length of at least 1 inch.</p> <p>Basis: This paragraph was modified to define an overlay fabrication grading unit as including the overlay material and the base metal-to-overlay interface for a length of at least 1 in, rather than the 6 square inch requirement.</p> |
| <p>(b)(2) An overlay grading unit designed to be unflawed shall be surrounded by unflawed overlay material and unflawed base <u>metal-to-overlay</u> interface for at least 1 in. around its entire perimeter. The specific area used in one overlay grading unit shall not be used in another overlay grading unit. Overlay grading units need not be spaced uniformly about the specimen.</p> | <p>(b)(2) Overlay fabrication grading units designed to be unflawed shall be separated by unflawed overlay material and unflawed base metal-to-overlay interface for at least 1 in. at both ends. Sufficient unflawed overlaid weld and base metal shall exist on both sides of the overlay fabrication grading unit to preclude interfering reflections from adjacent flaws. The specific area used in one overlay fabrication grading unit shall not be used in another overlay</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlaid Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|---|--|
| | <p>fabrication grading unit. Overlay fabrication grading units need not be spaced uniformly about the specimen.</p> <p>Basis: This paragraph states that overlay fabrication grading units designed to be unflawed shall be separated by unflawed overlay material and unflawed base metal-to-overlay interface for at least 1 in. at both ends, rather than around its entire perimeter.</p> |
| <p>(b)(3) Detection sets shall be selected from Table VIII-S2-1. The minimum detection sample set is five flawed base grading units, ten unflawed base grading units, five flawed overlay grading units, and ten unflawed overlay grading units. For each type of grading unit, the set shall contain at least twice as many unflawed as flawed grading units</p> | <p>(b)(3) Detection sets shall be selected from Table VIII-S2-1. The minimum detection sample set is five flawed base metal grading units, ten unflawed base metal grading units, five flawed overlay fabrication grading units, and ten unflawed overlay fabrication grading units. For each type of grading unit, the set shall contain at least twice as many unflawed as flawed grading units. For initial procedure qualification, detection sets shall include the equivalent of three personnel qualification sets. To qualify new values of essential variables, at least one personnel qualification set is required.</p> <p>Basis: Clarified the guidance for initial procedure qualifications versus qualifying new values of essential variables.</p> |
| <p>(f) Sizing Specimen</p> | |
| <p>(1) The minimum number of flaws shall be ten. At least 30% of the flaws shall be overlay fabrication flaws. At least 40% of the flaws shall be cracks open to the inside surface.</p> | <p>(1) The minimum number of flaws shall be ten. At least 30% of the flaws shall be overlay fabrication flaws. At least 40% of the flaws shall be open to the inside surface. Sizing sets shall contain a distribution of flaw dimensions to assess sizing capabilities. For initial procedure qualification, sizing sets shall include the equivalent of three personnel qualification sets. To qualify new values of essential variables, at least one personnel qualification set is required.</p> |
| <p>(3) Base metal cracking used for length sizing demonstrations shall be oriented circumferentially.</p> | <p>(3) Base metal flaws used for length sizing demonstrations shall be oriented circumferentially.</p> |
| <p>(4) Depth sizing specimen sets shall include at least two distinct locations where cracking in the base metal extends into the overlay material by at least 0.1 in. in the through-wall direction.</p> | <p>(4) Depth sizing specimen sets shall include at least two distinct locations where a base metal flaw extends into the overlay material by at least 0.1 in. in the through-wall direction.</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlayed Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|--|--|
| 2.0 CONDUCT OF PERFORMANCE DEMONSTRATION | |
| <p>The specimen inside surface and identification shall be concealed from the candidate. All examinations shall be completed prior to grading the results and presenting the results to the candidate. Divulgence of particular specimen results or candidate viewing of unmasked specimens after the performance demonstration is prohibited.</p> | <p>The specimen inside surface and identification shall be concealed from the candidate. All examinations shall be completed prior to grading the results and presenting the results to the candidate. Divulgence of particular specimen results or candidate viewing of unmasked specimens after the performance demonstration is prohibited. The overlay fabrication flaw test and the base metal flaw test may be performed separately.</p> <p>Basis: The PDI Program revised paragraph 2.0 allowing the overlay fabrication and base metal flaw tests to be performed separately.</p> |
| 2.1 Detection Test. | |
| <p>Flawed and unflawed grading units shall be randomly mixed. Although the boundaries of specific grading units shall not be revealed to the candidate, the candidate shall be made aware of the type or types of grading units (base or overlay) that are present for each specimen.</p> | <p>Flawed and unflawed grading units shall be randomly mixed. Although the boundaries of specific grading units shall not be revealed to the candidate, the candidate shall be made aware of the type or types of grading units (base metal or overlay fabrication) that are present for each specimen.</p> |
| 2.2 Length Sizing Test | |
| <p>(d) For flaws in base grading units, the candidate shall estimate the length of that part of the flaw that is in the outer 25% of the base wall thickness.</p> | <p>(d) For flaws in base metal grading units, the candidate shall estimate the length of that part of the flaw that is in the outer 25% of the base metal wall thickness.</p> |
| 2.3 Depth Sizing Test. | |
| <p>For the depth sizing test, 80% of the flaws shall be sized at a specific location on the surface of the specimen identified to the candidate. For the remaining flaws, the regions of each specimen containing a flaw to be sized shall be identified to the candidate. The candidate shall determine the maximum depth of the flaw in each region.</p> | <p>(a) The depth sizing test may be conducted separately or in conjunction with the detection test. (b) When the depth sizing test is conducted in conjunction with the detection test and the detected flaws do not satisfy the requirements of 1.1(f), additional specimens shall be provided to the candidate. The regions containing a flaw to be sized shall be identified to the candidate. The candidate shall determine the maximum depth of the flaw in each region. (c) For a separate depth sizing test, the regions of each specimen containing a flaw to be sized shall be identified to the candidate. The candidate shall determine the maximum depth of the flaw in each region.</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlaid Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|--|--|
| 3.0 ACCEPTANCE CRITERIA | |
| <p>Examination procedures, equipment, and personnel are qualified for detection when the results of the performance demonstration satisfy the acceptance criteria of Table VIII-S2-1 for both detection and false calls. The criteria shall be satisfied separately by the demonstration results for base grading units and for overlay grading units.</p> | <p>(a) Examination procedures are qualified for detection when;</p> <p>(1) All flaws within the scope of the procedure are detected and the results of the performance demonstration satisfy the acceptance criteria of Table VIII-S2-1 for false calls.</p> <p>(2) At least one successful personnel demonstration has been performed meeting the acceptance criteria defined in (3b).</p> <p>(3) Examination equipment and personnel are qualified for detection when the results of the performance demonstration satisfy the acceptance criteria of Table VIII-S2-1 for both detection and false calls.</p> <p>(4) The criteria in (2), (3) shall be satisfied separately by the demonstration results for base metal grading units and for overlay fabrication grading units.</p> <p>Basis: The PDI Program allows procedure qualification to be performed separately from personnel and equipment qualification. Historical data indicate that, if ultrasonic detection or sizing procedures are thoroughly tested, personnel and equipment using those procedures have a higher probability of successfully passing a qualification test. In an effort to increase the passing rate, PDI has elected to perform procedure qualifications separately in order to assess and modify essential variables that may affect overall system capabilities. For a procedure to be qualified, the PDI program requires three times as many flaws to be detected (or sized) as shown in Supplement 11 for the entire ultrasonic system. The personnel and equipment are still required to meet Supplement 11.</p> |
| 3.2 Sizing Acceptance Criteria. | |
| <p>(a) The RMS error of the flaw length measurements, as compared to the true flaw lengths, is less than or equal to 0.75 inch. The length of base metal cracking is measured at the 75% <i>through-base-metal</i> position.</p> | <p>(a) The RMS error of the flaw length measurements, as compared to the true flaw lengths, is less than or equal to 0.75 inch. The length of base metal flaws is measured at the 75% through-base-metal position.</p> |
| <p>(b) All extensions of base metal cracking into the overlay material by at least 0.1 inch are reported as being intrusions into the overlay material.</p> | <p>This requirement is omitted.</p> <p>Basis: The requirement for reporting all extensions of cracking into the overlay is omitted from the PDI Program because it is redundant to the RMS calculations performed in paragraph 3.2(c), and its presence adds confusion and ambiguity to depth sizing as required by paragraph 3.2(c). This also makes the weld overlay program consistent with the Supplement 2 depth sizing criteria.</p> |

| Appendix VIII Supplement 11: Qualification Requirements for Full Structural Overlaid Wrought Austenitic Piping Welds | PDI Program: The Proposed Alternative to Supplement 11 Requirements |
|--|--|
| <i>(c)</i> The RMS error of the flaw depth measurements, as compared to the true flaw depths, is less than or equal to 0.125 inch. | <i>(b)</i> The RMS error of the flaw depth measurements, as compared to the true flaw depths, is less than or equal to 0.125 inch. |

PROGRESS ENERGY FLORIDA, INC.

CRYSTAL RIVER UNIT 3

DOCKET NUMBER 50 - 302 / LICENSE NUMBER DPR - 72

RELIEF REQUEST #08-001-RR, REVISION 1

ENCLOSURE 2

Response to Request for Additional Information

Response to Request for Additional Information

The referenced document (at the end of the following page) contains a Nuclear Regulatory Commission (NRC) Request for Additional Information (RAI) regarding the Crystal River Unit 3 Relief Request #08-001-RR, Revision 0. This RAI was discussed in a March 10, 2008 phone call between NRC and Progress Energy staff. All RAI responses but one have been incorporated into Revision 1 of Relief Request contained in Enclosure 1 of this document. The remaining RAI concerns commitments to provide reports after the welding activity. This RAI is addressed below.

NRC Request

Licensees who have previously submitted weld overlay relief requests have committed to provide the following reports within fourteen days from completing the final ultrasonic examinations of the completed weld overlays:

- (1) Weld overlay examination results including a listing of indications detected. The recording criteria of the ultrasonic examination procedure to be used for the examination of the overlays requires that all indications, regardless of amplitude, be investigated to the extent necessary to provide accurate characterization, identity, and location. Additionally, the procedure requires that all indications, regardless of amplitude, that cannot be clearly attributed to the geometry of the overlay configuration be considered flaw indications.**
- (2) Disposition of indications using the standards of ASME Section XI, IWB-3514-2 and/or IWB-3514-3 criteria and, if possible, the type and nature of the indications. The ultrasonic examination procedure requires that all suspected flaw indications are to be plotted on a cross-sectional drawing of the weld and that the plots should accurately identify the specific origin of the reflector.**
- (3) A discussion of any repairs to the weld overlay material and/or base metal and the reason for the repairs.**
- (4) A stress analysis summary demonstrating that the subject piping will perform its intended design functions after the weld overlay installation. The stress analysis report will include results showing that the requirements of NB-3200 and NB-3600 of the ASME Code, Section III, are satisfied. The stress analysis will also include results showing that the requirements of IWB-3000 of the ASME Code, Section XI, are satisfied. The results will show that the postulated crack including its growth in the nozzles will not adversely affect the integrity of the overlaid welds. This information will be submitted to the NRC prior to entry into Mode 4 start-up.**

Discuss whether the above reports will be submitted to the NRC within 14 days from completing the final ultrasonic examinations of the completed weld overlays.

FPC Response

Reports addressing weld overlay examination results (described in item 1, above), the disposition of indications (described in item 2, above), and the repairs (described in item 3, above) will be submitted to the NRC within fourteen days after Engineering acceptance of the ultrasonic examinations results as verbally agreed upon with the NRC Project Manager. A report providing a stress analysis summary (described in item 4, above) will be submitted to the NRC within sixty days following entry into Mode 4 start-up. The submittal of this information sixty days after Mode 4 start-up rather than prior to entry into Mode 4 start-up was agreed upon with the NRC Project Manager during the March 10, 2008 phone call.

The submittal of these four reports has been captured as regulatory commitments. These are identified in Enclosure 3 of this letter.

Reference:

NRC memorandum from Stewart Bailey (NRC) to Tom Boyce (NRC) dated March 11, 2008 (ML080710257), "Request for Additional Information – Weld Overlay of the Decay Heat Drop Line Relief Request #08-001-RR, Revision 0"

PROGRESS ENERGY FLORIDA, INC.

CRYSTAL RIVER UNIT 3

DOCKET NUMBER 50 - 302 / LICENSE NUMBER DPR - 72

RELIEF REQUEST #08-001-RR, REVISION 1

ENCLOSURE 3

List of Regulatory Commitments

List of Regulatory Commitments

The following table identifies those actions committed to by Florida Power Corporation (FPC) in this document. Any other actions discussed in the submittal represent intended or planned actions by FPC. They are described to the NRC for the NRC's information and are not regulatory commitments. Please notify the Supervisor, Licensing and Regulatory Programs of any questions regarding this document or any associated regulatory commitments.

| Commitment | Due Date |
|--|--|
| <p>Provide a report of the weld overlay examination results including a listing of indications detected. The recording criteria of the ultrasonic examination procedure to be used for the examination of the overlays requires that all indications, regardless of amplitude, be investigated to the extent necessary to provide accurate characterization, identity, and location. Additionally, the procedure requires that all indications, regardless of amplitude, that cannot be clearly attributed to the geometry of the overlay configuration be considered flaw indications.</p> | <p>Fourteen days after Engineering acceptance of the Ultrasonic Examination results.</p> |
| <p>Provide a report documenting the disposition of indications using the standards of ASME Section XI, IWB-3514-2 and/or IWB-3514-3 criteria and, if possible, the type and nature of the indications. The ultrasonic examination procedure requires that all suspected flaw indications are to be plotted on a cross-sectional drawing of the weld and that the plots should accurately identify the specific origin of the reflector.</p> | <p>Fourteen days after Engineering acceptance of the Ultrasonic Examination results.</p> |
| <p>Provide a report discussing any repairs to the weld overlay material and/or base metal and the reason for the repairs.</p> | <p>Fourteen days after Engineering acceptance of the Ultrasonic Examination results.</p> |
| <p>Provide a report documenting a stress analysis summary demonstrating that the subject piping will perform its intended design functions after the weld overlay installation. The stress analysis report will include results showing that the requirements of NB-3200 and NB-3600 of the ASME Code, Section III, are satisfied. The stress analysis will also include results showing that the requirements of IWB-3000 of the ASME Code, Section XI, are satisfied. The results will show that the postulated crack including its growth in the nozzles will not adversely affect the integrity of the overlaid welds.</p> | <p>Sixty days after entry into Mode 4 start-up.</p> |