

RAS J-34

U.S. NUCLEAR REGULATORY COMMISSION
 In the Matter of Entergy (Piggin Nuclear Power Station)
 Docket No. 50-277-LR Official Exhibit No. 4
 OFFERED by: Applicant/Licensee Intervenor
 Other: Entergy Exh. 10
 NRC Staff
 IDENTIFIED on 4-10-08 Witness/Panel
 Action Taken: ADMITTED REJECTED WITHDRAWN
 Reporter/Clerk: Thibault


DOCKETED
 USNRC
 April 15, 2008 (10:00am)
 OFFICE OF SECRETARY
 RULEMAKINGS AND
 ADJUDICATIONS STAFF

REFERENCE:

- ① DWG C-341 FOR PIPING IN THE CST VAULT AND BURIED PIPING.
- ② DWG M100-7199 FOR PIPING IN THE AUX BAY

NORTH ↑

(PIPING IN THE CST VAULT)
 REF. DWG C-341

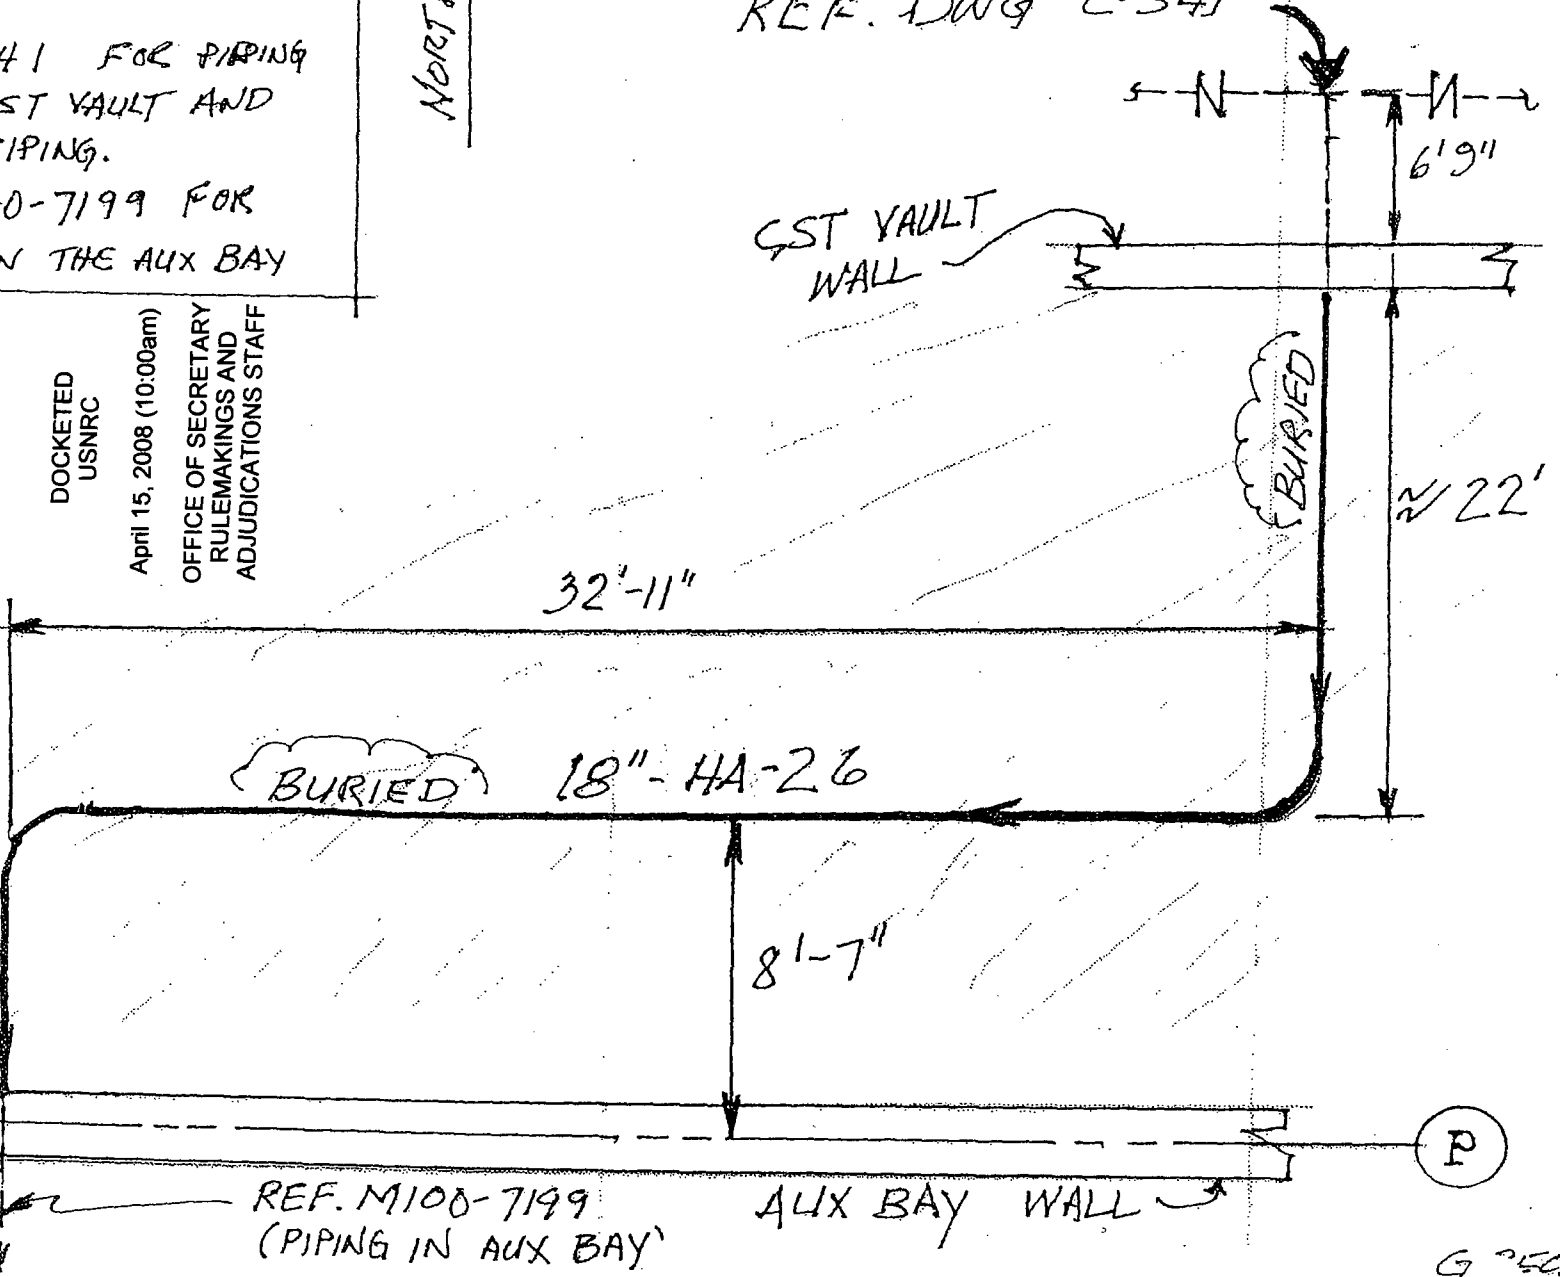

TO HPI/RIC

REF. M100-7199
 (PIPING IN AUX BAY)

G. PECHEN
 4. 08

TEMP = 504-028

DS03