REFERENCE:

1. DWG C-341 FOR PIPING IN THE CST VAULT AND BURIED PIPING.
2. DWG M100-7199 FOR PIPING IN THE AUX BAY

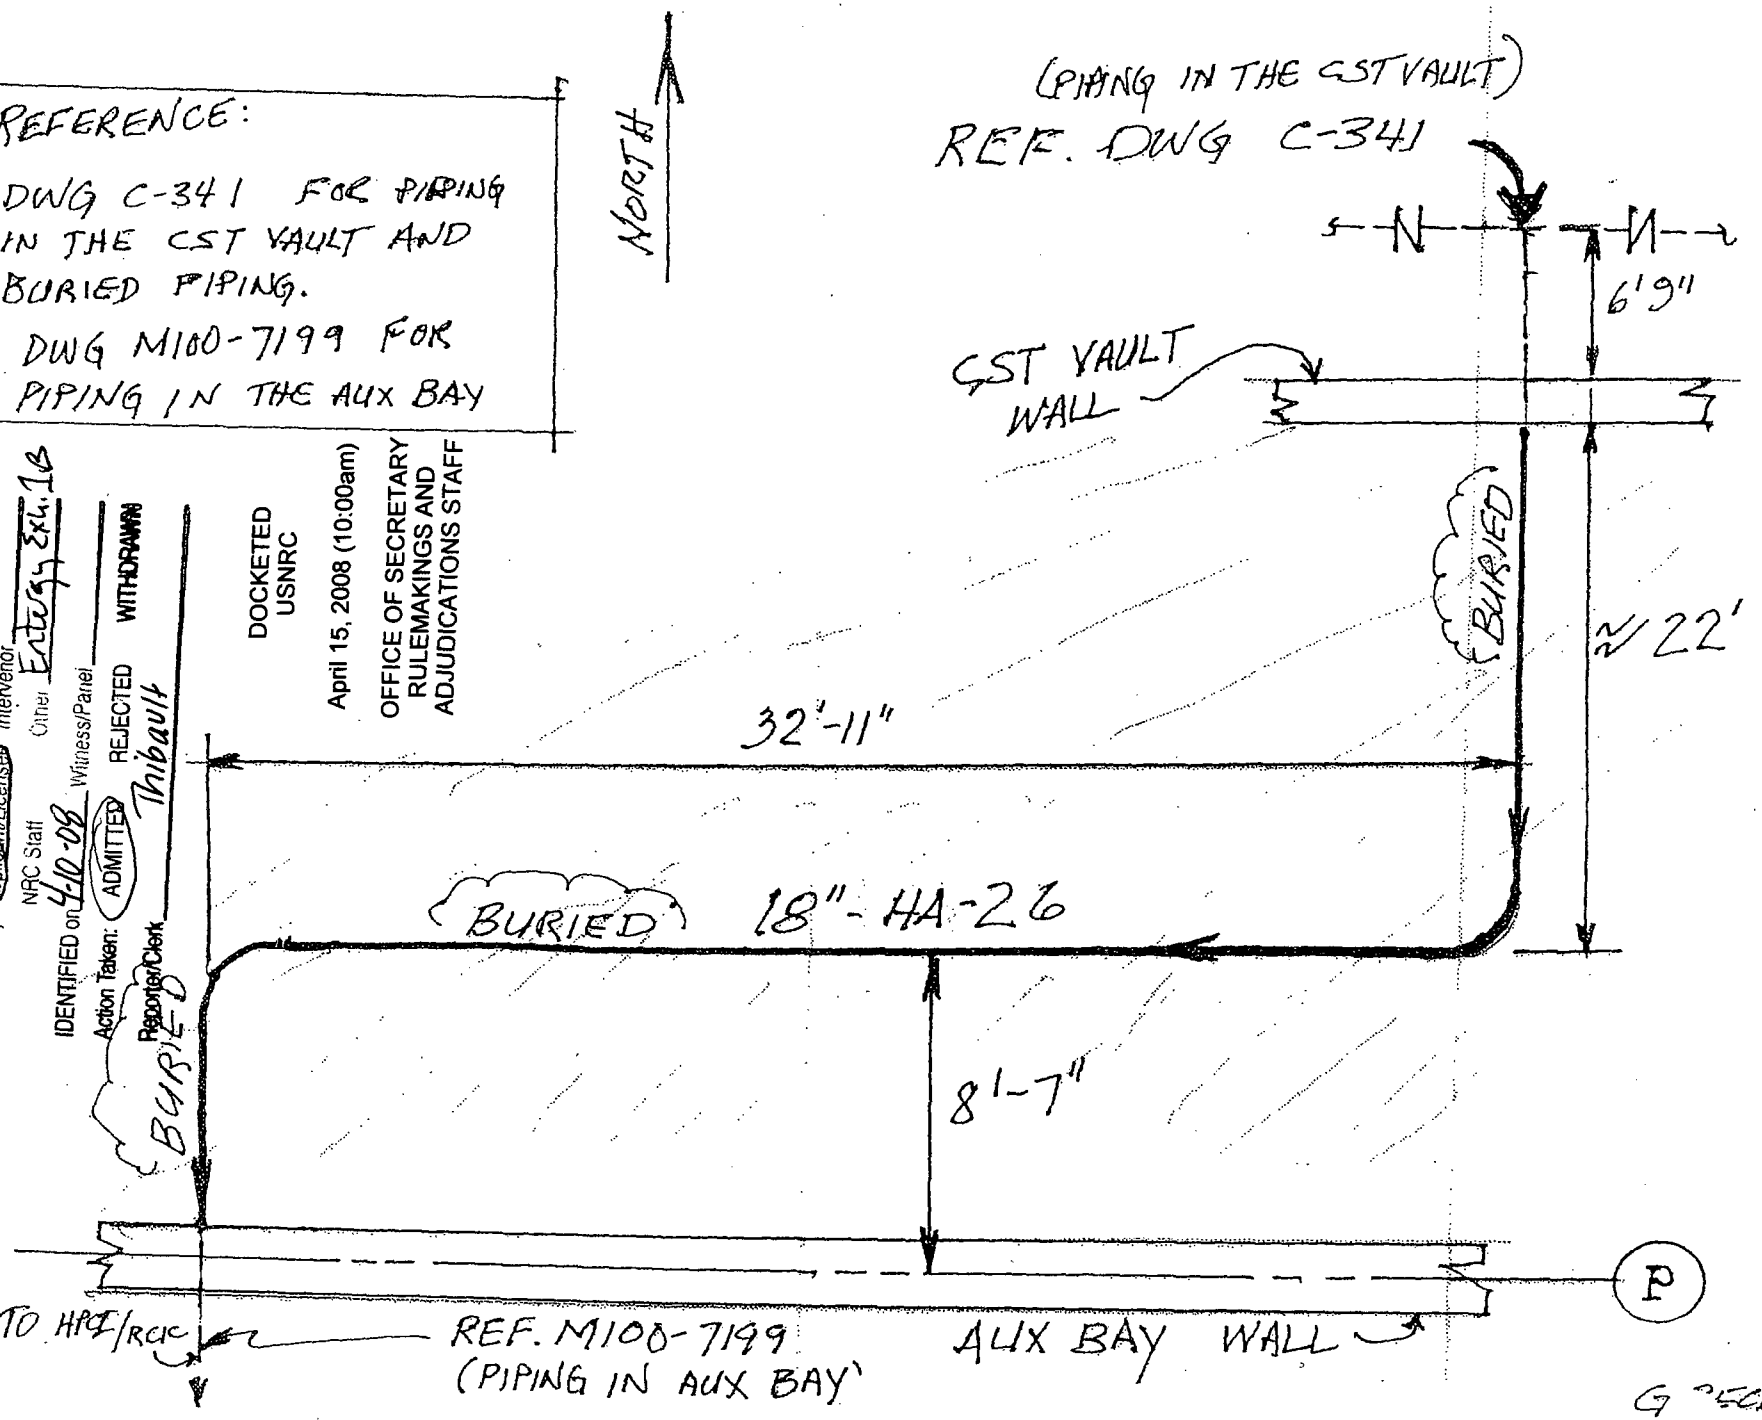

U.S. NUCLEAR REGULATORY COMMISSION
In the Matter of Entergy (Pilgrim Nuclear Power Station)
Docket No. 50-293-LR Official Exhibit No. 4
OFFERED by: Applicant/Licensee Intervenor
NRC Staff Other Entergy Exh. 1B
IDENTIFIED on 4-10-08 Witness/Panel
Action Taken: ADMITTED REJECTED WITHDRAWN
Reporter/Clerk Thibault

DOCKETED
USNRC
April 15, 2008 (10:00am)
OFFICE OF SECRETARY
RULEMAKINGS AND
ADJUDICATIONS STAFF

RAS J-34

DS03

TEMP = SECY-028

G. BECHEN
[illegible] 08