



APR 25 2008

Attn: Document Control Desk
U. S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Serial No. 08-0179
LIC/NW/R0
Docket No.: 50-305
License No.: DPR-43

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION
CYCLE 29 CORE OPERATING LIMITS REPORTS

Pursuant to Kewaunee Power Station (KPS) Technical Specification (TS) 6.9.a.4.D, enclosed are copies of the KPS Technical Requirements Manual (TRM) Section 2.1, Kewaunee Power Station Core Operating Limits Report (COLR), Cycle 29, Revision 0 and Revision 1.

KPS TS 6.9.a.4.D states that the COLR, including any mid-cycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC. COLR Cycle 29, Revision 0 was approved but not issued. COLR Cycle 29, Revision 0 was not issued because COLR Cycle 29, Revision 1 was approved before the core was reloaded.

If you have any questions or require additional information, please contact Mr. Gerald Riste at (920) 388-8424.

Very truly yours,


Michael J. Wilson
Director Safety and Licensing
Kewaunee Power Station

Commitments made by this letter: None

Enclosures:

1. TRM 2.1, Kewaunee Power Station Core Operating Limits Report (COLR), Cycle 29, Revision 0
2. TRM 2.1, Kewaunee Power Station Core Operating Limits Report (COLR), Cycle 29, Revision 1

A001
NRR

cc: Regional Administrator, Region III
U.S. Nuclear Regulatory Commission
2443 Warrenville Road
Suite 210
Lisle, IL 60532-4352

Ms. M. H. Chernoff
Senior Project Manager
U.S. Nuclear Regulatory Commission
One White Flint North, Mail Stop O8-H4A
11555 Rockville Pike
Rockville, MD 20852-2738

NRC Senior Resident Inspector
Kewaunee Power Station

ENCLOSURE 1

**TECHNICAL REQUIREMENTS MANUAL 2.1
KEWAUNEE POWER STATION CORE OPERATING LIMITS REPORT (COLR),
CYCLE 29, REVISION 0**

**KEWAUNEE POWER STATION
DOMINION ENERGY KEWAUNEE, INC.**

TRM 2.1

Kewaunee Power Station

CORE OPERATING LIMITS REPORT
(COLR)

CYCLE 29

REVISION 0

Approved


FSRG Chairman


Date


Mtg.#

Table of Contents

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	CORE OPERATING LIMITS REPORT	1
2.0	OPERATING LIMITS	2
2.1	Reactor Core Safety Limits	2
2.2	Shutdown Margin (SDM)	2
2.3	Moderator Temperature Coefficient	2
2.4	Shutdown Bank Insertion Limit	2
2.5	Control Bank Insertion Limits	2
2.6	Nuclear Heat Flux Hot Channel Limits ($F_Q^N(Z)$)	3
2.7	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)	4
2.8	Axial Flux Difference (AFD)	4
2.9	Overtemperature ΔT Setpoint	5
2.10	Overpower ΔT Setpoint	5
2.11	RCS Pressure, Temperature, and Flow Departure From	6
	Nucleate Boiling (DNB) Limits	
2.12	Refueling Boron Concentration	6

List of Figures

<u>Figure</u>	<u>Title</u>	<u>Page</u>
1.	Reactor Core Safety Limits Curve (1772 MWt).....	7
2.	Required Shutdown Reactivity vs. Boron Concentration.....	8
3.	Hot Channel Factor Normalized Operating Envelope (K(z)).....	9
4.	Control Bank Insertion Limits.....	10
5.	W(Z) Values (Top and Bottom 9% excluded).....	11
6.	Penalty Factor, F_p (%), for $F_Q^{EQ}(Z)$	13
7.	Axial Flux Difference.....	14

List of Tables

<u>Table</u>	<u>Title</u>	<u>Page</u>
1.	NRC Approved Methodologies for COLR Parameters	15

CORE OPERATING LIMITS REPORT CYCLE 29

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Kewaunee Power Station (KPS) has been prepared in accordance with the requirements of Technical Specification (TS) 6.9.a.4.

A cross-reference between the COLR sections and the KPS Technical Specifications affected by this report is given below:

COLR Section	KPS TS	Description
2.1	2.1	Reactor Core Safety Limits
2.2	3.10.a	Shutdown Margin
2.3	3.1.f.3	Moderator Temperature Coefficient
2.4	3.10.d.1	Shutdown Bank Insertion Limit
2.5	3.10.d.2	Control Bank Insertion Limits
2.6	3.10.b.1.A	Heat Flux Hot Channel Factor ($F_Q(Z)$)
	3.10.b.5	
	3.10.b.6	
	3.10.b.6.C.i	
	3.10.b.7	
2.7	3.10.b.1.B	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)
2.8	3.10.b.8	Axial Flux Difference (AFD)
2.9	2.3.a.3.A	Overtemperature ΔT Setpoint
2.10	2.3.a.3.B	Overpower ΔT Setpoint
2.11	3.10.k	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
	3.10.l	
	3.10.m.1	
2.12	3.8.a.5	Refueling Boron Concentration
Figure 1		Reactor Core Safety Limits (1772 MWt)
Figure 2		Required Shutdown Margin
Figure 3		K(Z) Normalized Operating Envelope
Figure 4		Control Bank Insertion Limits
Figure 5		W(Z) Values (Top and Bottom 9% excluded)
Figure 6		Penalty Factor, F_p , for $F_Q^{EQ}(Z)$
Figure 7		Axial Flux Difference

CORE OPERATING LIMITS REPORT CYCLE 29

2.0 Operating Limits

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC approved methodologies specified in Technical Specification 6.9.a.4.

2.1 Reactor Core Safety Limits

The combination of rated power level, coolant pressure, and coolant temperature shall not exceed the limits shown in COLR Figure 1 (1772 MWt). The safety limit is exceeded if the point defined by the combination of Reactor Coolant System average temperature and power level is at any time above the appropriate pressure line.

2.2 Shutdown Margin

2.2.1 When the reactor is subcritical prior to reactor startup, the SHUTDOWN margin shall be at least that shown in COLR Figure 2.

2.3 Moderator Temperature Coefficient

2.3.1 When the reactor is critical and $\leq 60\%$ RATED POWER, the moderator temperature coefficient shall be ≤ 5.0 pcm/ $^{\circ}$ F, except during LOW POWER PHYSICS TESTING. When the reactor is $> 60\%$ RATED POWER, the moderator temperature coefficient shall be zero or negative.

2.3.2 The reactor will have a moderator temperature coefficient no less negative than -8 pcm/ $^{\circ}$ F for 95% of the cycle time at full power.

2.4 Shutdown Bank Insertion Limit

2.4.1 The shutdown rods shall be fully withdrawn (≥ 225 steps and ≤ 230 steps) when the reactor is critical or approaching criticality.

2.5 Control Bank Insertion Limits

2.5.1 The control banks shall be limited in physical insertion; insertion limits are shown in COLR Figure 4.

CORE OPERATING LIMITS REPORT CYCLE 29

2.6 Nuclear Heat Flux Hot Channel Factor ($F_Q^N(Z)$)

2.6.1 $F_Q^N(Z)$ Limits for Fuel

$$F_Q^N(Z) \times 1.03 \times 1.05 \leq (2.50)/P \times K(Z) \text{ for } P > 0.5 \quad [422 \text{ V+}]$$

$$F_Q^N(Z) \times 1.03 \times 1.05 \leq (5.00) \times K(Z) \text{ for } P \leq 0.5 \quad [422 \text{ V+}]$$

where:

P is the fraction of full power at which the core is OPERATING

K(Z) is the function given in Figure 3

Z is the core height location for the F_Q of interest

2.6.2 The measured $F_Q^{EQ}(Z)$ hot channel factors under equilibrium conditions shall satisfy the following relationship for the central axial 80% of the core for fuel:

$$F_Q^{EQ}(Z) \times 1.03 \times 1.05 \times W(Z) \times F_p \leq (2.5)/P \times K(Z) \quad [422 \text{ V+}]$$

where:

P is the fraction of full power at which the core is OPERATING

K(Z) is the function given in Figure 3

Z is the core height location for the F_Q of interest

F_p is the $F_Q^{EQ}(Z)$ penalty factor described in 2.6.3.

W(Z) is the function given in Figure 5

$F_Q^{EQ}(Z)$ is a measured F_Q distribution obtained during the target flux determination

2.6.3 The penalty factor of 1.0 shall be used for TS 3.10.b.6.A and TS 3.10.b.6.B. The penalty factor provided in Figure 6 shall be used for TS 3.10.b.6.C.i. The penalty factor for all burnups outside the range of Figure 6 shall be 2%.

CORE OPERATING LIMITS REPORT CYCLE 29

2.7 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)

2.7.1 $F_{\Delta H}^N$ Limits for Fuel

$$F_{\Delta H}^N \times 1.04 \leq 1.70 [1 + 0.3(1-P)] \quad [422 V+]$$

where:

P is the fraction of full power at which the core is OPERATING

2.8 Axial Flux Difference (AFD)

2.8.1 The Axial Flux Difference (AFD) acceptable operation limits are provided in Figure 7.

CORE OPERATING LIMITS REPORT CYCLE 29

2.9 Overtemperature ΔT Setpoint

Overtemperature ΔT setpoint parameter values:

- ΔT_0 = Indicated ΔT at RATED POWER, %
T = Average temperature, °F
T' \leq 573.0 °F
P = Pressurizer Pressure, psig
P' = 2235 psig
K₁ = 1.195
K₂ = 0.015/°F
K₃ = 0.00072/psig
 τ_1 = 30 seconds
 τ_2 = 4 seconds
f(ΔI) = An even function of the indicated difference between top and bottom detectors of the power range nuclear ion chambers. Selected gains are based on measured instrument response during plant startup tests, where q_t and q_b are the percent power in the top and bottom halves of the core respectively, and $q_t + q_b$ is total core power in percent of RATED POWER, such that
- (a) For $q_t - q_b$ within -15, +6 %, $f(\Delta I) = 0$
 - (b) For each percent that the magnitude of $q_t - q_b$ exceeds +6 % the ΔT trip setpoint shall be automatically reduced by an equivalent of 1.51 % of RATED POWER.
 - (c) For each percent that the magnitude of $q_t - q_b$ exceed -15 % the ΔT trip setpoint shall be automatically reduced by an equivalent of 3.78% of RATED POWER.

2.10 Overpower ΔT Setpoint

Overpower ΔT setpoint parameter values:


- ΔT_0 = Indicated ΔT at RATED POWER, %
T = Average temperature, °F
T' \leq 573.0 °F
K₄ \leq 1.095
K₅ \geq 0.0275/°F for increasing T; 0 for decreasing T
K₆ \geq 0.00103/°F for T > T' ; 0 for T < T'
 τ_3 = 10 seconds
f(ΔI) = 0 for all ΔI

CORE OPERATING LIMITS REPORT CYCLE 29

- 2.11 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
 - 2.11.1 During steady state power operation, T_{avg} shall be $< 576.7^{\circ}\text{F}$ for control board indication or $< 576.5^{\circ}\text{F}$ for computer indication.
 - 2.11.2 During steady state power operation, Pressurizer Pressure shall be > 2217 psig for control board indication or > 2219 psig for computer indication
 - 2.11.3 During steady state power operation, reactor coolant total flow rate shall be $\geq 186,000$ gpm.
- 2.12 Refueling Boron Concentration
 - 2.12.1 When there is fuel in the reactor, a minimum boron concentration of 2500 ppm and a shutdown margin of $\geq 5\% \Delta k/k$ shall be maintained in the Reactor Coolant System during reactor vessel head removal or while loading and unloading fuel from the reactor.


CORE OPERATING LIMITS REPORT CYCLE 29

Figure 1

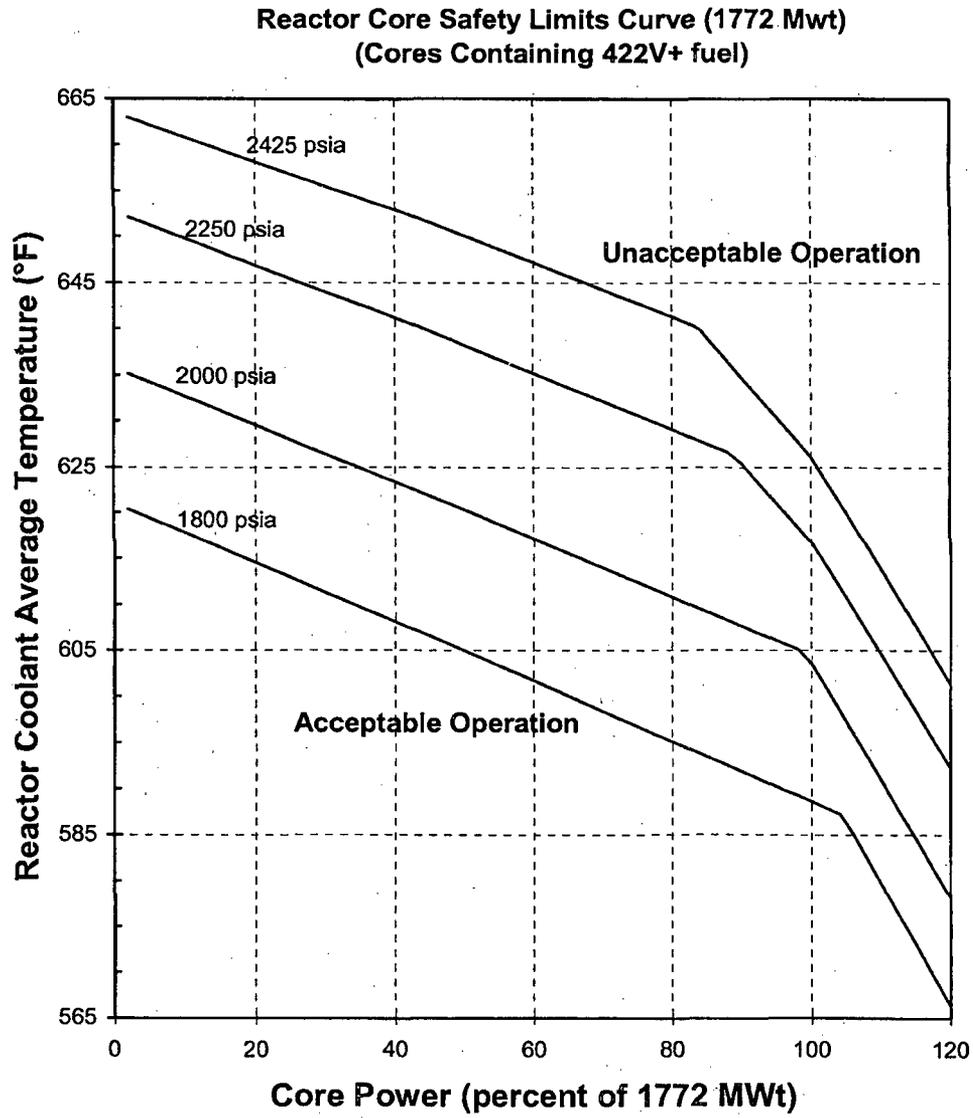


CORE OPERATING LIMITS REPORT CYCLE 29

Figure 2
Required Shutdown Reactivity vs. Boron
Concentration

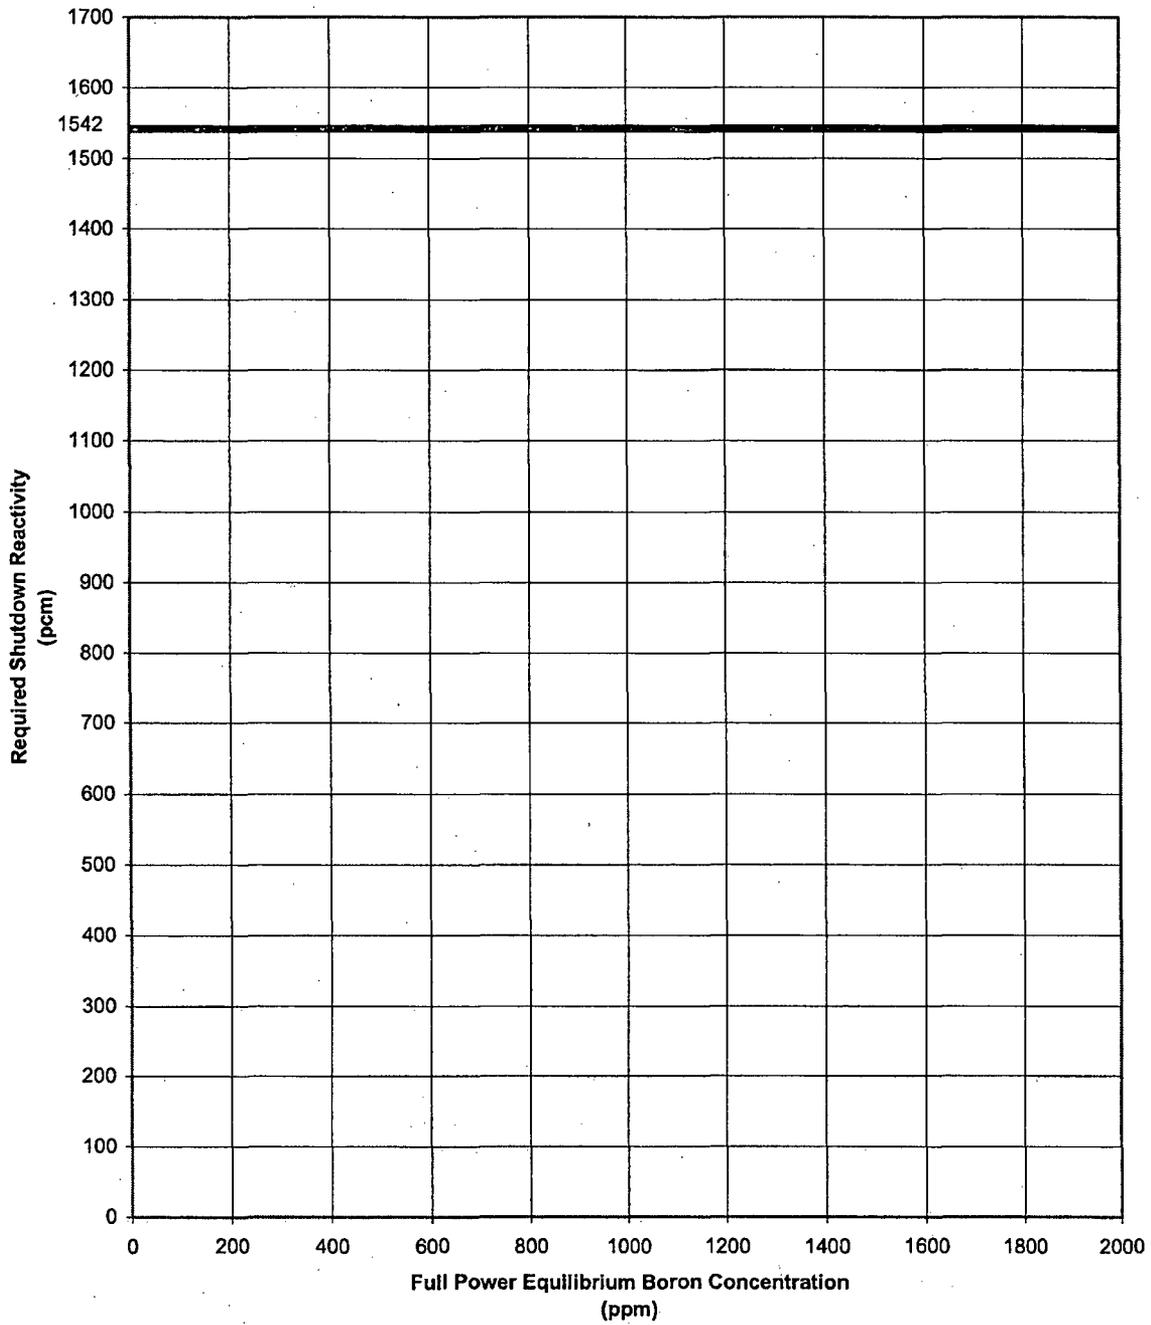


CORE OPERATING LIMITS REPORT CYCLE 29

Figure 3
Hot Channel Factor Normalized Operating Envelope (K(z))

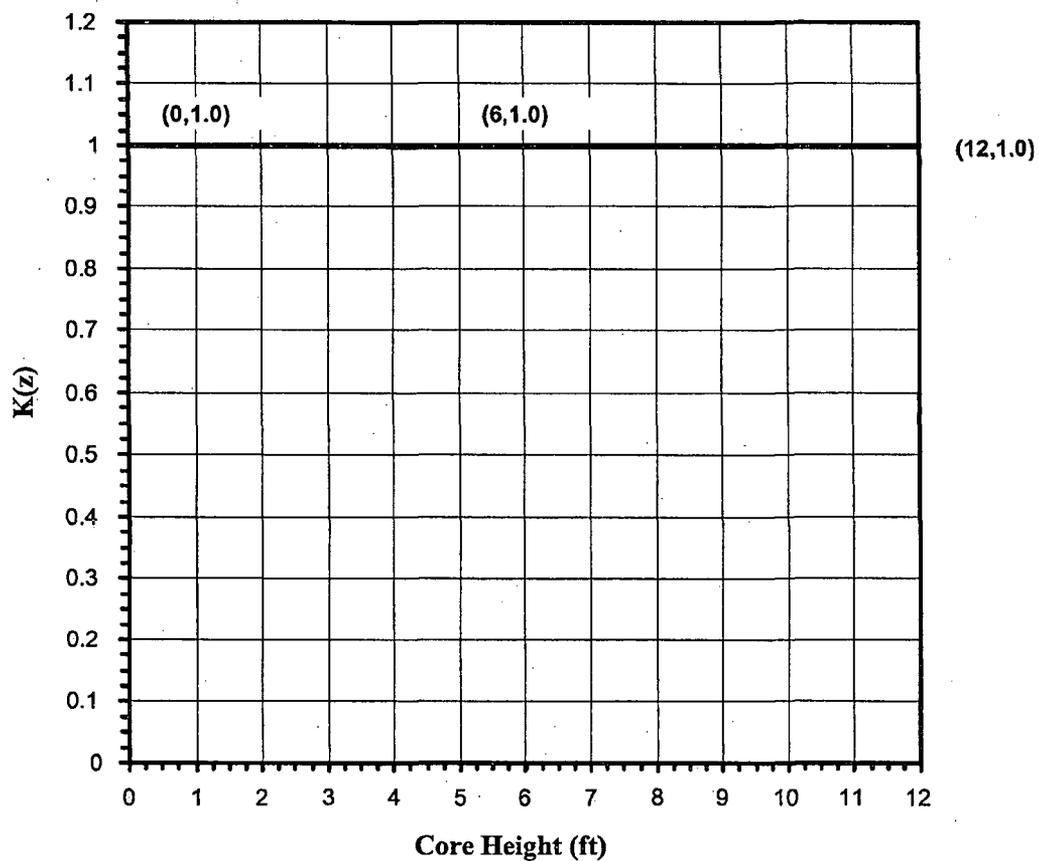

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 4
Control Bank Insertion Limits

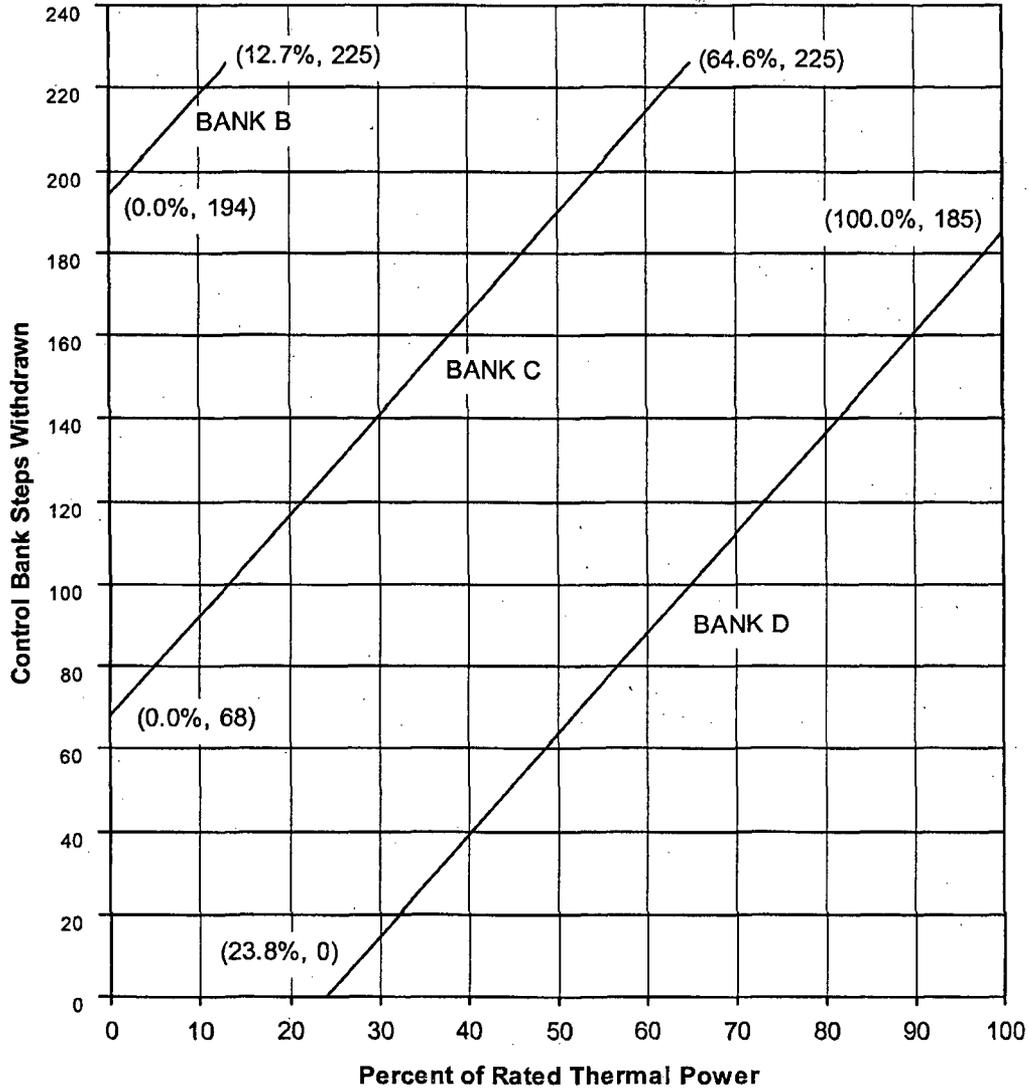

Fully withdrawn shall be the condition where control rods are at a position between the interval ≥ 225 and ≤ 230 steps withdrawn.

Note: The Rod Bank Insertion Limits are based on a control bank tip-to-tip distance of 126 steps.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 5 - W(Z) Values
 (Top and Bottom 9% excluded)

	Height [ft]	BU [MWd/MTU]				
		150	2000	6000	12000	17000
		AO = 2.11%	AO = -0.08%	AO = -2.43%	AO = -2.99%	AO = -3.07%
[BOTTOM] 1	0.00	1.0000	1.0000	1.0000	1.0000	1.0000
2	0.20	1.0000	1.0000	1.0000	1.0000	1.0000
3	0.40	1.0000	1.0000	1.0000	1.0000	1.0000
4	0.60	1.0000	1.0000	1.0000	1.0000	1.0000
5	0.80	1.0000	1.0000	1.0000	1.0000	1.0000
6	1.00	1.0000	1.0000	1.0000	1.0000	1.0000
7	1.20	1.3735	1.2862	1.2244	1.1994	1.1670
8	1.40	1.3580	1.2728	1.2133	1.1902	1.1591
9	1.60	1.3398	1.2573	1.2003	1.1797	1.1505
10	1.80	1.3194	1.2404	1.1860	1.1681	1.1414
11	2.00	1.2974	1.2248	1.1702	1.1556	1.1319
12	2.20	1.2742	1.2098	1.1545	1.1424	1.1222
13	2.40	1.2505	1.1938	1.1400	1.1291	1.1126
14	2.60	1.2267	1.1779	1.1264	1.1158	1.1032
15	2.80	1.2030	1.1617	1.1127	1.1020	1.0941
16	3.00	1.1816	1.1478	1.1019	1.0925	1.0858
17	3.20	1.1652	1.1394	1.0972	1.0892	1.0842
18	3.40	1.1561	1.1355	1.0970	1.0887	1.0908
19	3.60	1.1534	1.1313	1.0963	1.0880	1.0973
20	3.80	1.1506	1.1263	1.0955	1.0899	1.1036
21	4.00	1.1468	1.1226	1.0947	1.0928	1.1098
22	4.20	1.1428	1.1199	1.0936	1.0950	1.1154
23	4.40	1.1381	1.1166	1.0926	1.0970	1.1205
24	4.60	1.1330	1.1130	1.0921	1.0989	1.1249
25	4.80	1.1274	1.1087	1.0922	1.1018	1.1286
26	5.00	1.1212	1.1050	1.0922	1.1046	1.1314
27	5.20	1.1144	1.1018	1.0920	1.1067	1.1336
28	5.40	1.1072	1.0981	1.0923	1.1090	1.1346
29	5.60	1.0995	1.0940	1.0963	1.1132	1.1348
30	5.80	1.0912	1.0878	1.1012	1.1209	1.1392
31	6.00	1.0892	1.0899	1.1058	1.1312	1.1508
32	6.20	1.0942	1.0990	1.1124	1.1419	1.1649
33	6.40	1.1007	1.1065	1.1217	1.1512	1.1769
34	6.60	1.1061	1.1134	1.1304	1.1596	1.1879
35	6.80	1.1107	1.1195	1.1383	1.1668	1.1975
36	7.00	1.1146	1.1246	1.1449	1.1729	1.2056
37	7.20	1.1174	1.1289	1.1511	1.1787	1.2122
38	7.40	1.1194	1.1325	1.1573	1.1840	1.2170
39	7.60	1.1219	1.1363	1.1626	1.1877	1.2200
40	7.80	1.1235	1.1391	1.1667	1.1899	1.2210
41	8.00	1.1241	1.1408	1.1695	1.1906	1.2200
42	8.20	1.1237	1.1413	1.1710	1.1898	1.2169
43	8.40	1.1224	1.1408	1.1713	1.1873	1.2118
44	8.60	1.1202	1.1392	1.1702	1.1830	1.2063
45	8.80	1.1172	1.1378	1.1661	1.1792	1.2071
46	9.00	1.1216	1.1448	1.1679	1.1800	1.2075
47	9.20	1.1359	1.1638	1.1778	1.1845	1.2076
48	9.40	1.1485	1.1802	1.1899	1.1921	1.2129
49	9.60	1.1677	1.1966	1.2015	1.2098	1.2341
50	9.80	1.1854	1.2105	1.2114	1.2315	1.2562
51	10.00	1.2019	1.2299	1.2271	1.2525	1.2755
52	10.20	1.2142	1.2519	1.2446	1.2707	1.2939
53	10.40	1.2210	1.2690	1.2576	1.2896	1.3110

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 5 Cont'd
(Top and Bottom 9% excluded)

	Height [ft]	BU [MWd/MTU]				
		150	2000	6000	12000	17000
		AO = 2.11%	AO = -0.08%	AO = -2.43%	AO = -2.99%	AO = -3.07%
54	10.60	1.2336	1.2877	1.2715	1.3049	1.3283
55	10.80	1.2480	1.3015	1.2779	1.3142	1.3430
56	11.00	1.0000	1.0000	1.0000	1.0000	1.0000
57	11.20	1.0000	1.0000	1.0000	1.0000	1.0000
58	11.40	1.0000	1.0000	1.0000	1.0000	1.0000
59	11.60	1.0000	1.0000	1.0000	1.0000	1.0000
60	11.80	1.0000	1.0000	1.0000	1.0000	1.0000
[TOP] 61	12.00	1.0000	1.0000	1.0000	1.0000	1.0000

Note: These W(Z)'s are based upon the previous cycle's RAOC Band of 1.0%, -9%, +8%, 0.5%, -27%, 28%. The current RAOC Band of 1.0%, -9%, +6%, 0.5%, -27%, 28% is less inclusive, thus, these W(Z)'s are conservative.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 6

Penalty Factor, F_p (%), for $F_Q^{EQ}(Z)$

Cycle Burnup (MWD/MTU)	Penalty Factor F_p (%)
150	2.00
18,185	2.00


Note: Linear interpolation is adequate for intermediate cycle burnups.

All cycle burnups outside the range of the table shall use a penalty factor, F_p , of 2.0%.

Refer to TS 3.10.b.6.C.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 7
Axial Flux Difference

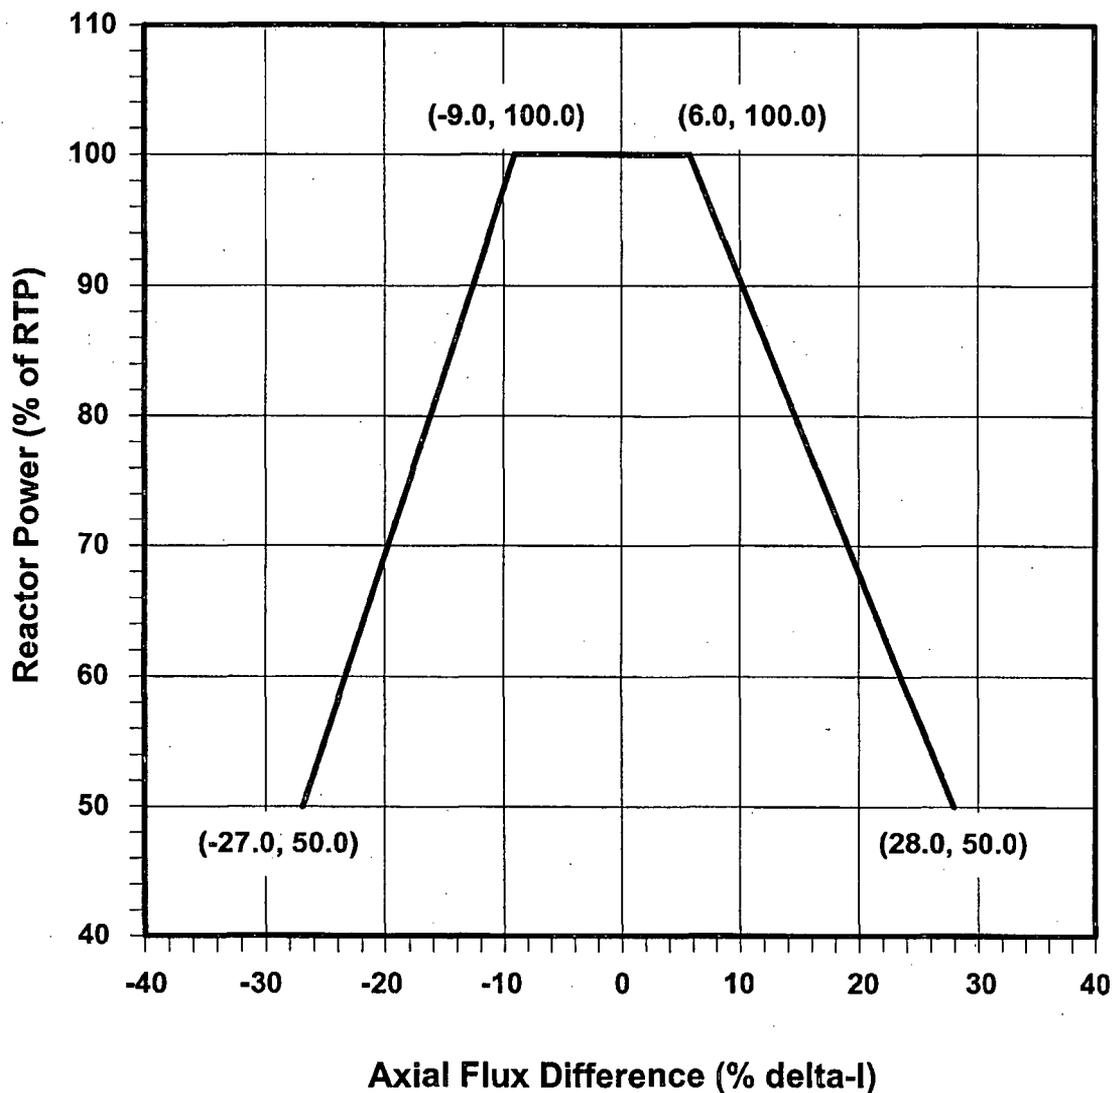

Note: This figure represents the Relaxed Axial Offset Control (RAOC) band used in safety analyses, it may be administratively tightened depending on in-core flux map results. Refer to Figure RD 11.4.1 of the Reactor Data Manual.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.1	Reactor Core Safety Limits	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p>
2.2	Shutdown Margin	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p>
2.3	Moderator Temperature Coefficient	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p>
2.4	Shutdown Bank Insertion Limit	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p>

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
		Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.
2.5	Control Bank Insertion Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985. Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.
2.6	Heat Flux Hot Channel Factor	WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset Control-F _Q Surveillance Technical Specification," February 1994. Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978. WCAP-12945-P-A (Proprietary), "Westinghouse Code Qualification Document for Best-Estimate Loss-of-Coolant Accident Analysis," Volume I, Rev.2, and Volumes II-V, Rev.1, and WCAP-14747 (Non-Proprietary), March 1998.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
		(F _Q (Z)) WCAP-14449-P-A, "Application Of Best Estimate Large Break LOCA Methodology To Westinghouse PWRs With Upper Plenum Injection," Revision 1, and WCAP-14450-NP- A, Rev.1 (Non-Proprietary), October 1999.
		WCAP-12610-P-A, "Vantage+ Fuel Assembly Reference Core Report," April 1995.
	Model	WCAP-10054-P-A/WCAP-10081-NP-A, "Westinghouse Small Break ECCS Evaluation Using the NOTRUMP Code," August 1985.
	NOTRUMP	WCAP-10054-P-A/WCAP-10081-NP-A, Addendum 2, Revision 1, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the Code: Safety Injection into the Broken Loop and COSI Condensation Model," July 1997.
2.7	Nuclear Enthalpy Rise Hot Channel Factor (F ^N _{ΔH})	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985. Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.8	Axial Flux Difference	<p>WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset (AFD) Control-F_Q Surveillance Technical Specification," February 1994.</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p>
2.9	Reactor Protection System (RPS) Instrumentation-Overtemperature ΔT	<p>WCAP-8745-P-A, "Design Bases For The Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p> <p>CENP-397-P-A, "Improved Flow Measurement Accuracy Using Cross Flow Ultrasonic Flow Measurement Technology," Rev. 1, May 2000.</p>

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.10	Reactor Protection System (RPS) Instrumentation-Overpower ΔT	<p>WCAP-8745-P-A, "Design Bases For The Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p> <p>CENP-397-P-A, "Improved Flow Measurement Accuracy Using Cross Flow Ultrasonic Flow Measurement Technology," Rev. 1, May 2000.</p>
2.11	RCS Pressure, Temperature, and Flow Departure From Nucleate (DNB) Limits	<p>WCAP-11397-P-A, "Revised Thermal Design Procedure, "April 1989, for those events analyzed using RTDP</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p> <p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985 for those events not utilizing RTDP.</p>
2.12	Boron Concentration	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.</p> <p>Safety Evaluation by the Office of Nuclear Reactor Regulation on "Qualifications of Reactor Physics Methods for Application to Kewaunee" Report, dated August 21, 1979, report date September 29, 1978.</p>

ENCLOSURE 2

**TECHNICAL REQUIREMENTS MANUAL 2.1
KEWAUNEE POWER STATION CORE OPERATING LIMITS REPORT (COLR),
CYCLE 29, REVISION 1**

**KEWAUNEE POWER STATION
DOMINION ENERGY KEWAUNEE, INC.**

TRM 2.1


Kewaunee Power Station

CORE OPERATING LIMITS REPORT
(COLR)

CYCLE 29

REVISION 1

Approved


FSRC Chairman

4-22-08
Date

08-038
Mtg.#

Table of Contents

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	CORE OPERATING LIMITS REPORT	1
2.0	OPERATING LIMITS	2
2.1	Reactor Core Safety Limits	2
2.2	Shutdown Margin	2
2.3	Moderator Temperature Coefficient (MTC)	2
2.4	Shutdown Bank Insertion Limits	2
2.5	Control Bank Insertion Limits	2
2.6	Nuclear Heat Flux Hot Channel Limits ($F_Q^N(Z)$)	3
2.7	Nuclear Enthalpy Rise Hot Channel Factor Limits ($F_{\Delta H}^N$)	4
2.8	Axial Flux Difference (AFD) Target Band	4
2.9	Overtemperature ΔT Setpoint	5
2.10	Overpower ΔT Setpoint	5
2.11	RCS Pressure, Temperature, and Flow Departure From Nucleate Boiling (DNB) Limits	6
2.12	Refueling Boron Concentration	6

List of Figures

Figure	Title	Page
1.	Reactor Core Safety Limits Curve (1772 MWt).....	7
2.	Required Shutdown Reactivity vs. Boron Concentration.....	8
3.	Hot Channel Factor Normalized Operating Envelope (K(z)).....	9
4.	Control Bank Insertion Limits.....	10
5.	W(Z) Values (Top and Bottom 9% excluded).....	11
6.	Penalty Factor, F_p (%), for $F_a^N(Z)$	13
7.	Axial Flux Difference Envelope.....	14

List of Tables

<u>Table</u>	<u>Title</u>	<u>Page</u>
1.	NRC Approved Methodologies for COLR Parameters	15

CORE OPERATING LIMITS REPORT CYCLE 29

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Kewaunee Power Station (KPS) has been prepared in accordance with the requirements of Technical Specification (TS) 6.9.a.4.

A cross-reference between the COLR sections and the KPS Technical Specifications affected by this report is given below:

COLR Section	KPS TS	Description
2.1	2.1	Reactor Core Safety Limits
2.2	3.10.a	Shutdown Margin
2.3	3.1.f.3	Moderator Temperature Coefficient (MTC)
2.4	3.10.d.1	Shutdown Bank Insertion Limits
2.5	3.10.d.2	Control Bank Insertion Limits
2.6	3.10.b.1.A 3.10.b.5 3.10.b.6 3.10.b.6.C.i 3.10.b.7	Heat Flux Hot Channel Factor Limits ($F_Q^N(Z)$)
2.7	3.10.b.1.B	Nuclear Enthalpy Rise Hot Channel Factor Limits ($F_{\Delta H}^N$)
2.8	3.10.b.8	Axial Flux Difference (AFD) Target Band
2.9	2.3.a.3.A	Overtemperature ΔT Setpoint
2.10	2.3.a.3.B	Overpower ΔT Setpoint
2.11	3.10.k 3.10.l 3.10.m.1	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
2.12	3.8.a.5	Refueling Boron Concentration
Figure 1		Reactor Core Safety Limits (1772 MWt)
Figure 2		Required Shutdown Margin
Figure 3		K(Z) Normalized Operating Envelope
Figure 4		Control Bank Insertion Limits
Figure 5		W(Z) Values (Top and Bottom 9% excluded)
Figure 6		Penalty Factor, F_p (%), for $F_Q^N(Z)$
Figure 7		Axial Flux Difference Envelope

CORE OPERATING LIMITS REPORT CYCLE 29

2.0 Operating Limits

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC approved methodologies specified in Technical Specification 6.9.a.4.

2.1 Reactor Core Safety Limits

The combination of rated power level, coolant pressure, and coolant temperature shall not exceed the limits shown in COLR Figure 1 (1772 MWt). The safety limit is exceeded if the point defined by the combination of Reactor Coolant System average temperature and power level is at any time above the appropriate pressure line.

2.2 Shutdown Margin

2.2.1 When the reactor is subcritical prior to reactor startup, the SHUTDOWN margin shall be at least that shown in COLR Figure 2.

2.3 Moderator Temperature Coefficient

2.3.1 When the reactor is critical and $\leq 60\%$ RATED POWER, the moderator temperature coefficient shall be ≤ 5.0 pcm/ $^{\circ}$ F, except during LOW POWER PHYSICS TESTING. When the reactor is $> 60\%$ RATED POWER, the moderator temperature coefficient shall be zero or negative.

2.3.2 The reactor will have a moderator temperature coefficient no less negative than -8 pcm/ $^{\circ}$ F for 95% of the cycle time at full power.

2.4 Shutdown Bank Insertion Limit

2.4.1 The shutdown rods shall be fully withdrawn (≥ 225 steps and ≤ 230 steps) when the reactor is critical or approaching criticality.

2.5 Control Bank Insertion Limits

2.5.1 The control banks shall be limited in physical insertion; insertion limits are shown in COLR Figure 4.

CORE OPERATING LIMITS REPORT CYCLE 29

2.6 Nuclear Heat Flux Hot Channel Factor ($F_Q^N(Z)$)

2.6.1 $F_Q^N(Z)$ Limits for Fuel

$$F_Q^N(Z) \times 1.03 \times 1.05 \leq (2.50)/P \times K(Z) \text{ for } P > 0.5 \quad [422 \text{ V+}]$$

$$F_Q^N(Z) \times 1.03 \times 1.05 \leq (5.00) \times K(Z) \text{ for } P \leq 0.5 \quad [422 \text{ V+}]$$

where:

P is the fraction of full power at which the core is OPERATING

K(Z) is the function given in Figure 3

Z is the core height location for the F_Q of interest

2.6.2 The measured $F_Q^N(Z)$ hot channel factors under equilibrium conditions shall satisfy the following relationship for the central axial 80% of the core for fuel:

$$F_Q^N(Z) \times 1.03 \times 1.05 \times W(Z) \times F_p \leq (2.5)/P \times K(Z) \quad [422 \text{ V+}]$$

where:

P is the fraction of full power at which the core is OPERATING

K(Z) is the function given in Figure 3

Z is the core height location for the F_Q of interest

F_p is the $F_Q^N(Z)$ penalty factor described in 2.6.3.

W(Z) is the function given in Figure 5

$F_Q^N(Z)$ is a measured F_Q distribution obtained during the target flux determination

2.6.3 The penalty factor of 1.0 shall be used for TS 3.10.b.6.A and TS 3.10.b.6.B. The penalty factor provided in Figure 6 shall be used for TS 3.10.b.6.C.i. The penalty factor for all burnups outside the range of Figure 6 shall be 2%.

CORE OPERATING LIMITS REPORT CYCLE 29

2.7 Nuclear Enthalpy Rise Hot Channel Factor Limits ($F_{\Delta H}^N$)

2.7.1 $F_{\Delta H}^N$ Limits for Fuel

$$F_{\Delta H}^N \times 1.04 \leq 1.70 [1 + 0.3(1-P)] \quad [422 V+]$$

where:

P is the fraction of full power at which the core is OPERATING

2.8 Axial Flux Difference (AFD) Target Band

2.8.1 The Axial Flux Difference (AFD) acceptable operation limits are provided in Figure 7.

CORE OPERATING LIMITS REPORT CYCLE 29

2.9 Overtemperature ΔT Setpoint

Overtemperature ΔT setpoint parameter values:

- ΔT_0 = Indicated ΔT at RATED POWER, %
T = Average temperature, °F
T' \leq 573.0 °F
P = Pressurizer Pressure, psig
P' = 2235 psig
K₁ = 1.195
K₂ = 0.015/°F
K₃ = 0.00072/psig
 τ_1 = 30 seconds
 τ_2 = 4 seconds
f(ΔI) = An even function of the indicated difference between top and bottom detectors of the power range nuclear ion chambers. Selected gains are based on measured instrument response during plant startup tests, where q_t and q_b are the percent power in the top and bottom halves of the core respectively, and $q_t + q_b$ is total core power in percent of RATED POWER, such that
- (a) For $q_t - q_b$ within -15, +6 %, $f(\Delta I) = 0$
 - (b) For each percent that the magnitude of $q_t - q_b$ exceeds +6 % the ΔT trip setpoint shall be automatically reduced by an equivalent of 1.51 % of RATED POWER.
 - (c) For each percent that the magnitude of $q_t - q_b$ exceed -15 % the ΔT trip setpoint shall be automatically reduced by an equivalent of 3.78% of RATED POWER.

2.10 Overpower ΔT Setpoint

Overpower ΔT setpoint parameter values:

- ΔT_0 = Indicated ΔT at RATED POWER, %
T = Average temperature, °F
T' \leq 573.0 °F
K₄ \leq 1.095
K₅ \geq 0.0275/°F for increasing T; 0 for decreasing T
K₆ \geq 0.00103/°F for T > T' ; 0 for T < T'
 τ_3 = 10 seconds
f(ΔI) = 0 for all ΔI

CORE OPERATING LIMITS REPORT CYCLE 29

2.11 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits

2.11.1 During steady state power operation, T_{avg} shall be $< 576.7^{\circ}\text{F}$ for control board indication or $< 576.5^{\circ}\text{F}$ for computer indication.

2.11.2 During steady state power operation, Pressurizer Pressure shall be > 2217 psig for control board indication or > 2219 psig for computer indication

2.11.3 During steady state power operation, reactor coolant total flow rate shall be $\geq 186,000$ gpm.


2.12 Refueling Boron Concentration

2.12.1 When there is fuel in the reactor, a minimum boron concentration of 2500 ppm and a shutdown margin of $\geq 5\% \Delta k/k$ shall be maintained in the Reactor Coolant System during reactor vessel head removal or while loading and unloading fuel from the reactor.

CORE OPERATING LIMITS REPORT CYCLE 29


Figure 1

Reactor Core Safety Limits Curve (1772 Mwt)
(Cores Containing 422V+ fuel)

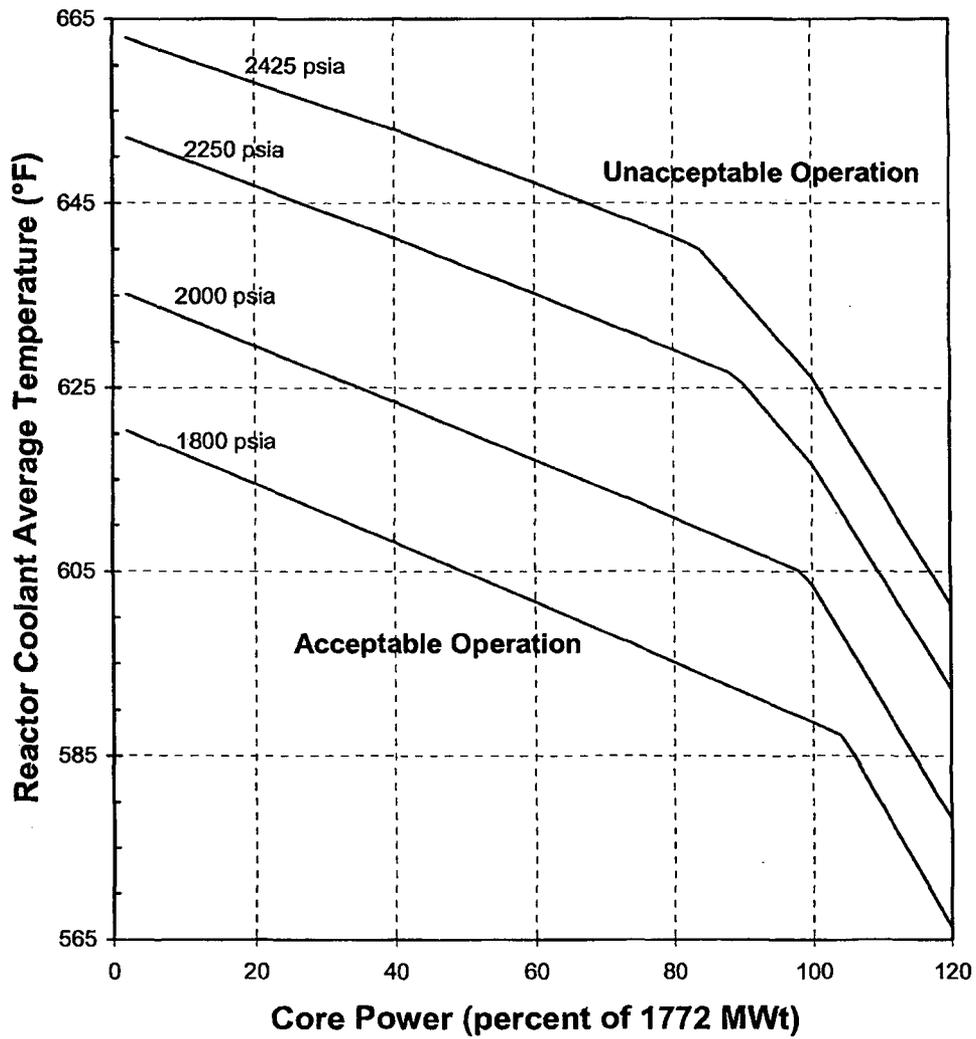


CORE OPERATING LIMITS REPORT CYCLE 29

Figure 2
Required Shutdown Reactivity vs. Boron
Concentration

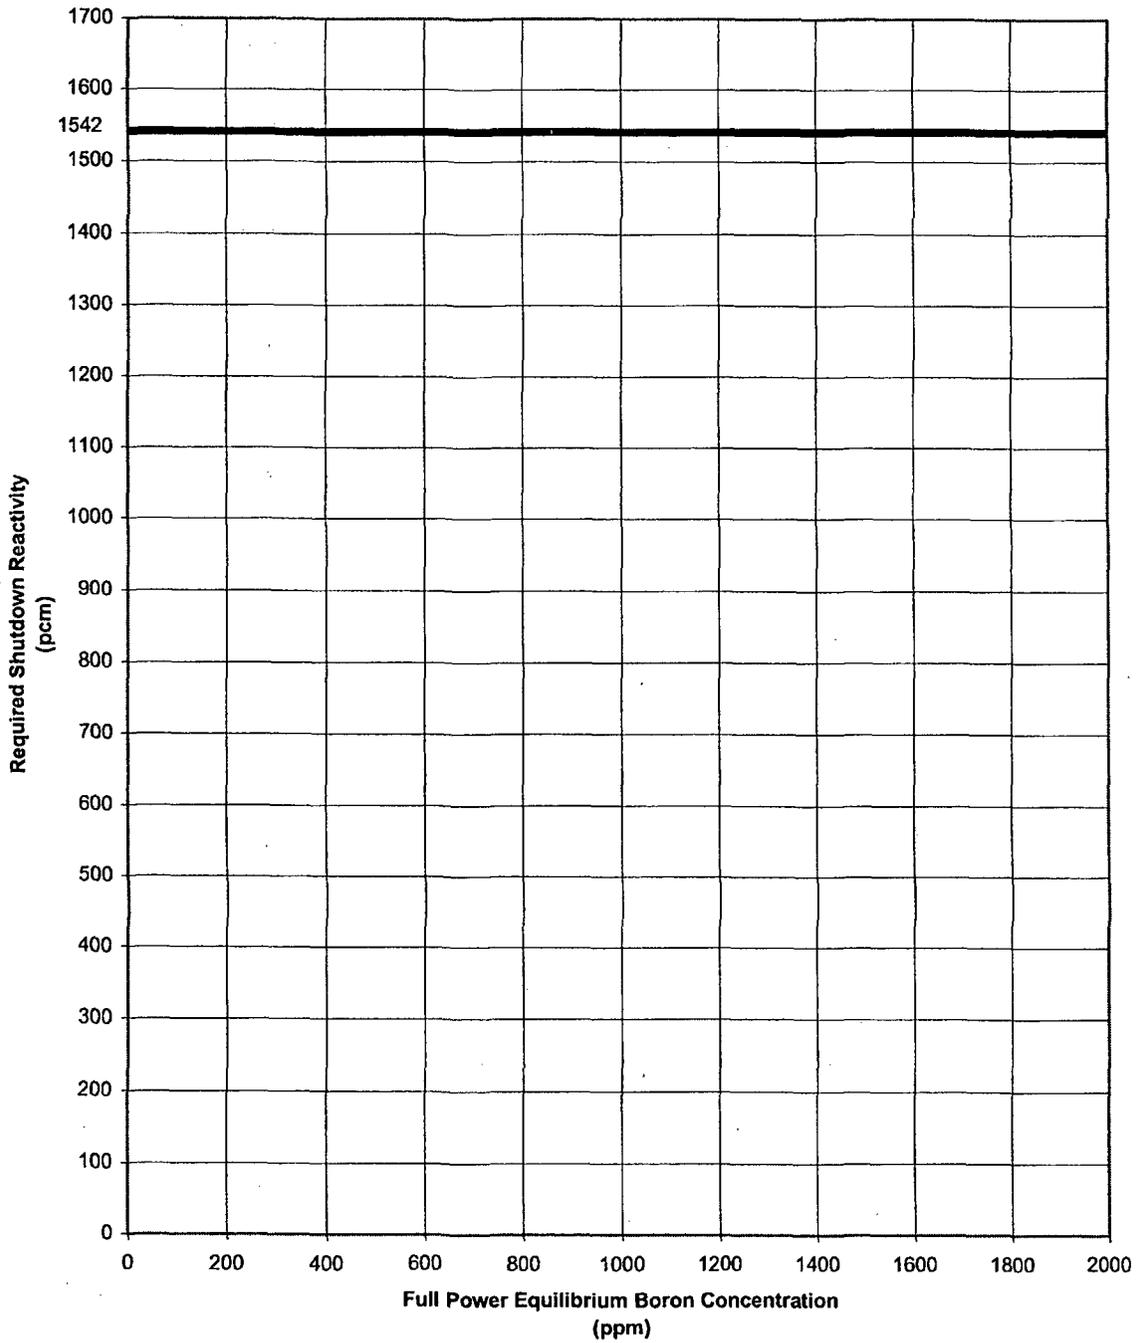


CORE OPERATING LIMITS REPORT CYCLE 29

Figure 3
Hot Channel Factor Normalized Operating Envelope (K(Z))

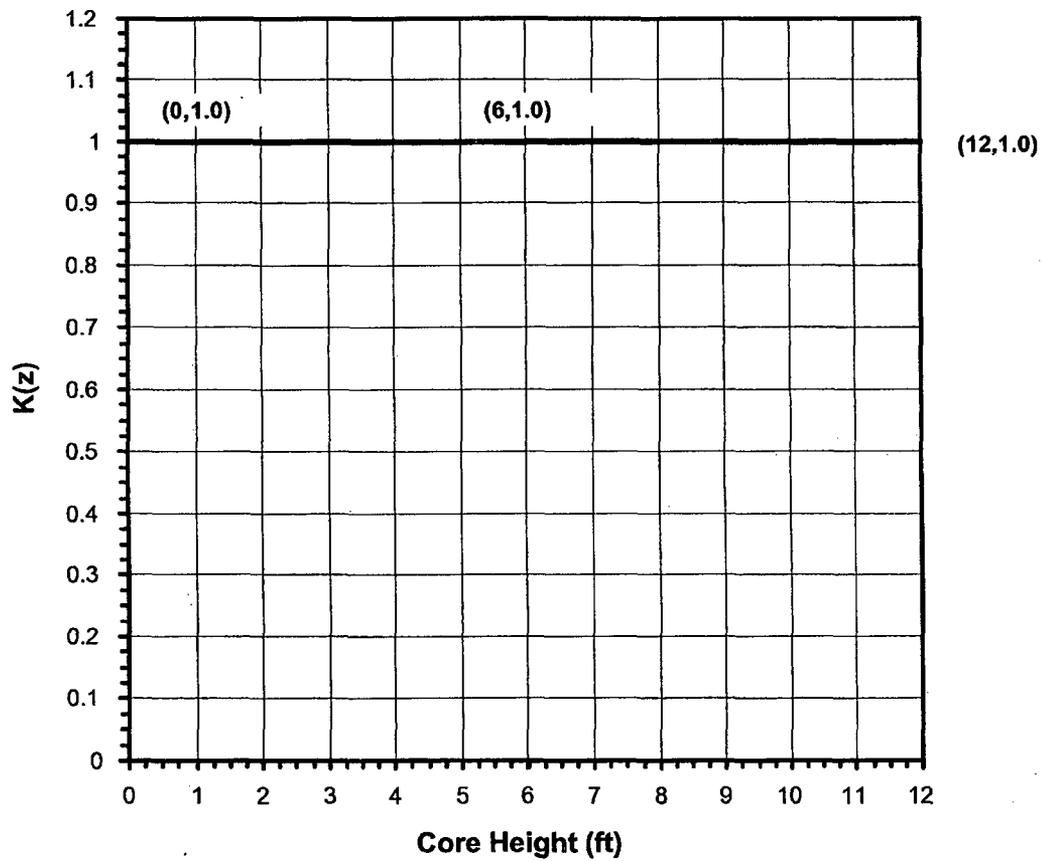

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 4
Control Bank Insertion Limits

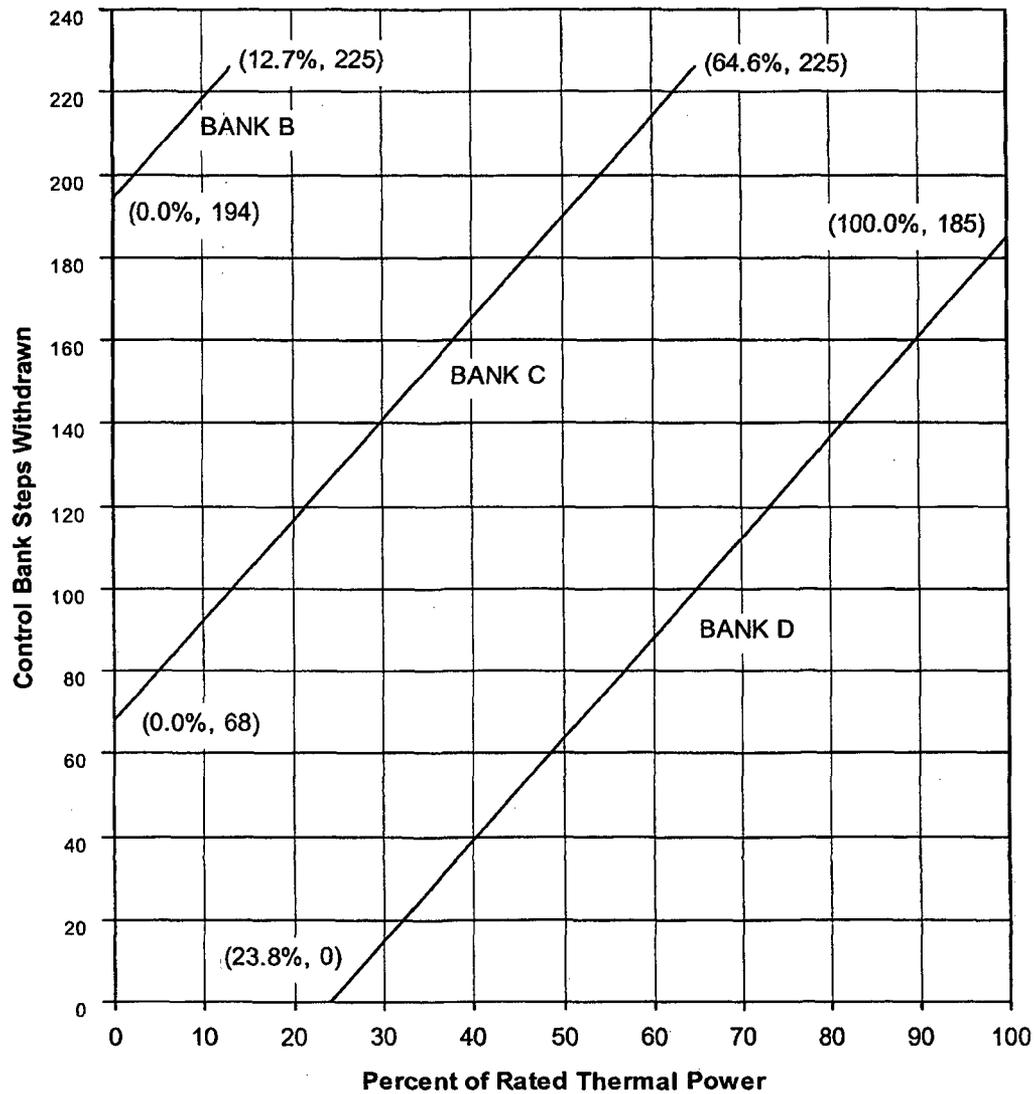

Fully withdrawn shall be the condition where control rods are at a position between the interval ≥ 225 and ≤ 230 steps withdrawn.

Note: The Rod Bank Insertion Limits are based on a control bank tip-to-tip distance of 126 steps.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 5 - W(Z) Values
 (Top and Bottom 9% excluded)

	Height [ft]	BU [MWd/MTU]				
		150	2000	6000	12000	17000
		AO = 2.11%	AO = -0.08%	AO = -2.43%	AO = -2.99%	AO = -3.07%
[BOTTOM] 1	0.00	1.0000	1.0000	1.0000	1.0000	1.0000
2	0.20	1.0000	1.0000	1.0000	1.0000	1.0000
3	0.40	1.0000	1.0000	1.0000	1.0000	1.0000
4	0.60	1.0000	1.0000	1.0000	1.0000	1.0000
5	0.80	1.0000	1.0000	1.0000	1.0000	1.0000
6	1.00	1.0000	1.0000	1.0000	1.0000	1.0000
7	1.20	1.3735	1.2862	1.2244	1.1994	1.1670
8	1.40	1.3580	1.2728	1.2133	1.1902	1.1591
9	1.60	1.3398	1.2573	1.2003	1.1797	1.1505
10	1.80	1.3194	1.2404	1.1860	1.1681	1.1414
11	2.00	1.2974	1.2248	1.1702	1.1556	1.1319
12	2.20	1.2742	1.2098	1.1545	1.1424	1.1222
13	2.40	1.2505	1.1938	1.1400	1.1291	1.1126
14	2.60	1.2267	1.1779	1.1264	1.1158	1.1032
15	2.80	1.2030	1.1617	1.1127	1.1020	1.0941
16	3.00	1.1816	1.1478	1.1019	1.0925	1.0858
17	3.20	1.1652	1.1394	1.0972	1.0892	1.0842
18	3.40	1.1561	1.1355	1.0970	1.0887	1.0908
19	3.60	1.1534	1.1313	1.0963	1.0880	1.0973
20	3.80	1.1506	1.1263	1.0955	1.0899	1.1036
21	4.00	1.1468	1.1226	1.0947	1.0928	1.1098
22	4.20	1.1428	1.1199	1.0936	1.0950	1.1154
23	4.40	1.1381	1.1166	1.0926	1.0970	1.1205
24	4.60	1.1330	1.1130	1.0921	1.0989	1.1249
25	4.80	1.1274	1.1087	1.0922	1.1018	1.1286
26	5.00	1.1212	1.1050	1.0922	1.1046	1.1314
27	5.20	1.1144	1.1018	1.0920	1.1067	1.1336
28	5.40	1.1072	1.0981	1.0923	1.1090	1.1346
29	5.60	1.0995	1.0940	1.0963	1.1132	1.1348
30	5.80	1.0912	1.0878	1.1012	1.1209	1.1392
31	6.00	1.0892	1.0899	1.1058	1.1312	1.1508
32	6.20	1.0942	1.0990	1.1124	1.1419	1.1649
33	6.40	1.1007	1.1065	1.1217	1.1512	1.1769
34	6.60	1.1061	1.1134	1.1304	1.1596	1.1879
35	6.80	1.1107	1.1195	1.1383	1.1668	1.1975
36	7.00	1.1146	1.1246	1.1449	1.1729	1.2056
37	7.20	1.1174	1.1289	1.1511	1.1787	1.2122
38	7.40	1.1194	1.1325	1.1573	1.1840	1.2170
39	7.60	1.1219	1.1363	1.1626	1.1877	1.2200
40	7.80	1.1235	1.1391	1.1667	1.1899	1.2210
41	8.00	1.1241	1.1408	1.1695	1.1906	1.2200
42	8.20	1.1237	1.1413	1.1710	1.1898	1.2169
43	8.40	1.1224	1.1408	1.1713	1.1873	1.2118
44	8.60	1.1202	1.1392	1.1702	1.1830	1.2063
45	8.80	1.1172	1.1378	1.1661	1.1792	1.2071
46	9.00	1.1216	1.1448	1.1679	1.1800	1.2075
47	9.20	1.1359	1.1638	1.1778	1.1845	1.2076
48	9.40	1.1485	1.1802	1.1899	1.1921	1.2129
49	9.60	1.1677	1.1966	1.2015	1.2098	1.2341
50	9.80	1.1854	1.2105	1.2114	1.2315	1.2562
51	10.00	1.2019	1.2299	1.2271	1.2525	1.2755
52	10.20	1.2142	1.2519	1.2446	1.2707	1.2939
53	10.40	1.2210	1.2690	1.2576	1.2896	1.3110

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 5 Cont'd
(Top and Bottom 9% excluded)

	Height [ft]	BU [MWd/MTU]				
		150	2000	6000	12000	17000
		AO = 2.11%	AO = -0.08%	AO = -2.43%	AO = -2.99%	AO = -3.07%
54	10.60	1.2336	1.2877	1.2715	1.3049	1.3283
55	10.80	1.2480	1.3015	1.2779	1.3142	1.3430
56	11.00	1.0000	1.0000	1.0000	1.0000	1.0000
57	11.20	1.0000	1.0000	1.0000	1.0000	1.0000
58	11.40	1.0000	1.0000	1.0000	1.0000	1.0000
59	11.60	1.0000	1.0000	1.0000	1.0000	1.0000
60	11.80	1.0000	1.0000	1.0000	1.0000	1.0000
[TOP] 61	12.00	1.0000	1.0000	1.0000	1.0000	1.0000

Note: These W(Z)'s are based upon the previous cycle's RAOC Band of 1.0%, -9%, +8%, 0.5%, -27%, 28%. The current RAOC Band of 1.0%, -9%, +6%, 0.5%, -27%, 28% is less inclusive, thus, these W(Z)'s are conservative.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 6
Penalty Factor, F_p (%), for $F_Q^N(Z)$

Cycle Burnup (MWD/MTU)	Penalty Factor F_p (%)
150	2.00
18,185	2.00


Note: Linear interpolation is adequate for intermediate cycle burnups.

All cycle burnups outside the range of the table shall use a penalty factor, F_p , of 2.0%.

Refer to TS 3.10.b.6.C.

CORE OPERATING LIMITS REPORT CYCLE 29

Figure 7
Axial Flux Difference Envelope

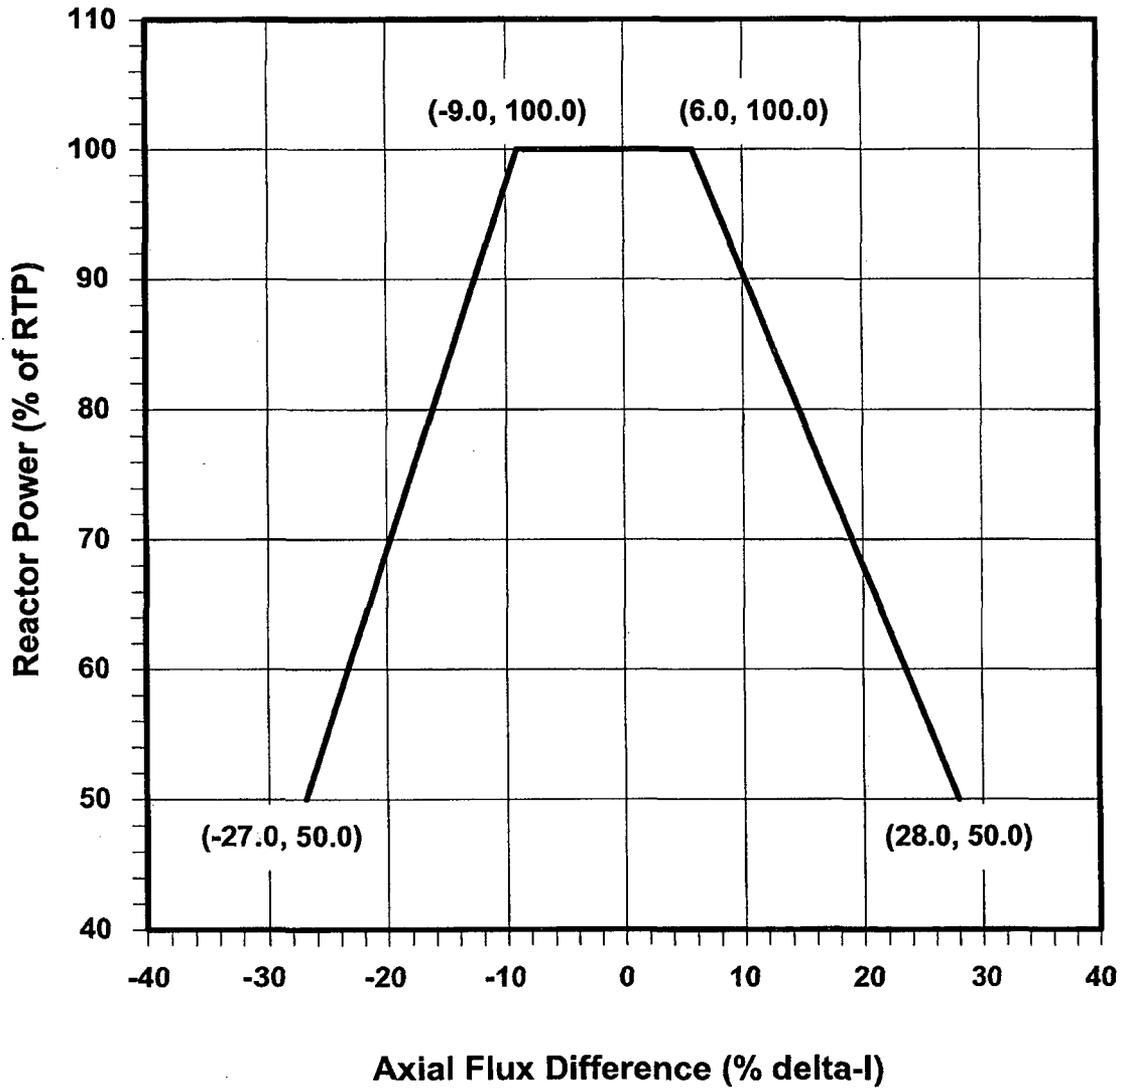

Note: This figure represents the Relaxed Axial Offset Control (RAOC) band used in safety analyses. It may be administratively tightened depending on in-core flux map results. Refer to Figure RD 11.4.1 of the Reactor Data Manual.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1
NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.1	Reactor Core Safety Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.
2.2	Shutdown Margin	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.3	Moderator Temperature Coefficient	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.
2.4	Shutdown Bank Insertion Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.
2.5	Control Bank Insertion Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.6	Nuclear Heat Flux Hot Channel Limits ($F_Q^N(Z)$)	<p>WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset Control-F_Q Surveillance Technical Specification," February 1994.</p> <p>WCAP-12945-P-A (Proprietary), "Westinghouse Code Qualification Document for Best-Estimate Loss-of-Coolant Accident Analysis," Volume I, Rev.2, and Volumes II-V, Rev.1, and WCAP-14747 (Non-Proprietary), March 1998.</p> <p>($F_Q(Z)$) WCAP-14449-P-A, "Application Of Best Estimate Large Break LOCA Methodology To Westinghouse PWRs With Upper Plenum Injection," Revision1, and WCAP-14450-NP- A, Rev.1 (Non-Proprietary), October 1999.</p> <p>WCAP-12610-P-A, "Vantage+ Fuel Assembly Reference Core Report," April 1995.</p>
	Model	WCAP-10054-P-A/WCAP-10081-NP-A, "Westinghouse Small Break ECCS Evaluation Using the NOTRUMP Code," August 1985.
	NOTRUMP	WCAP-10054-P-A/WCAP-10081-NP-A, Addendum 2, Revision 1, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the Code: Safety Injection into the Broken Loop and COSI Condensation Model," July 1997.

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.7	Nuclear Enthalpy Rise Hot Channel Factor Limits	<p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p>
2.8	Axial Flux Difference Target Band	<p>WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset (AFD) Control-F_Q Surveillance Technical Specification," February 1994.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p>
2.9	Reactor Protection System (RPS) Instrumentation-Overtemperature ΔT	<p>WCAP-8745-P-A, "Design Bases For The Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986.</p> <p>Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001.</p> <p>CENP-397-P-A, "Improved Flow Measurement Accuracy Using Cross Flow Ultrasonic Flow Measurement Technology," Rev. 1, May 2000.</p>

CORE OPERATING LIMITS REPORT CYCLE 29

Table 1 (cont)

NRC Approved Methodologies for COLR Parameters

<u>COLR Section</u>	<u>Parameter</u>	<u>NRC Approved Methodology</u>
2.10	Reactor Protection System (RPS) Instrumentation-Overpower ΔT	WCAP-8745-P-A, "Design Bases For The Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986. Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001. CENP-397-P-A, "Improved Flow Measurement Accuracy Using Cross Flow Ultrasonic Flow Measurement Technology," Rev. 1, May 2000.
2.11	RCS Pressure, Temperature, and Flow Departure From Nucleate Boiling (DNB) Limits	WCAP-11397-P-A, "Revised Thermal Design Procedure," April 1989, for those events analyzed using RTDP Kewaunee Nuclear Power Plant-Review for Kewaunee Reload Safety Evaluation Methods Topical Report WPSRSEM-NP, Revision 3 (TAC NO MB0306) dated September 10, 2001. WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985 for those events not utilizing RTDP.
2.12	Refueling Boron Concentration	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.