

V. C. Summer Nuclear Station, Units 2 and 3
COL Application
Part 2, FSAR

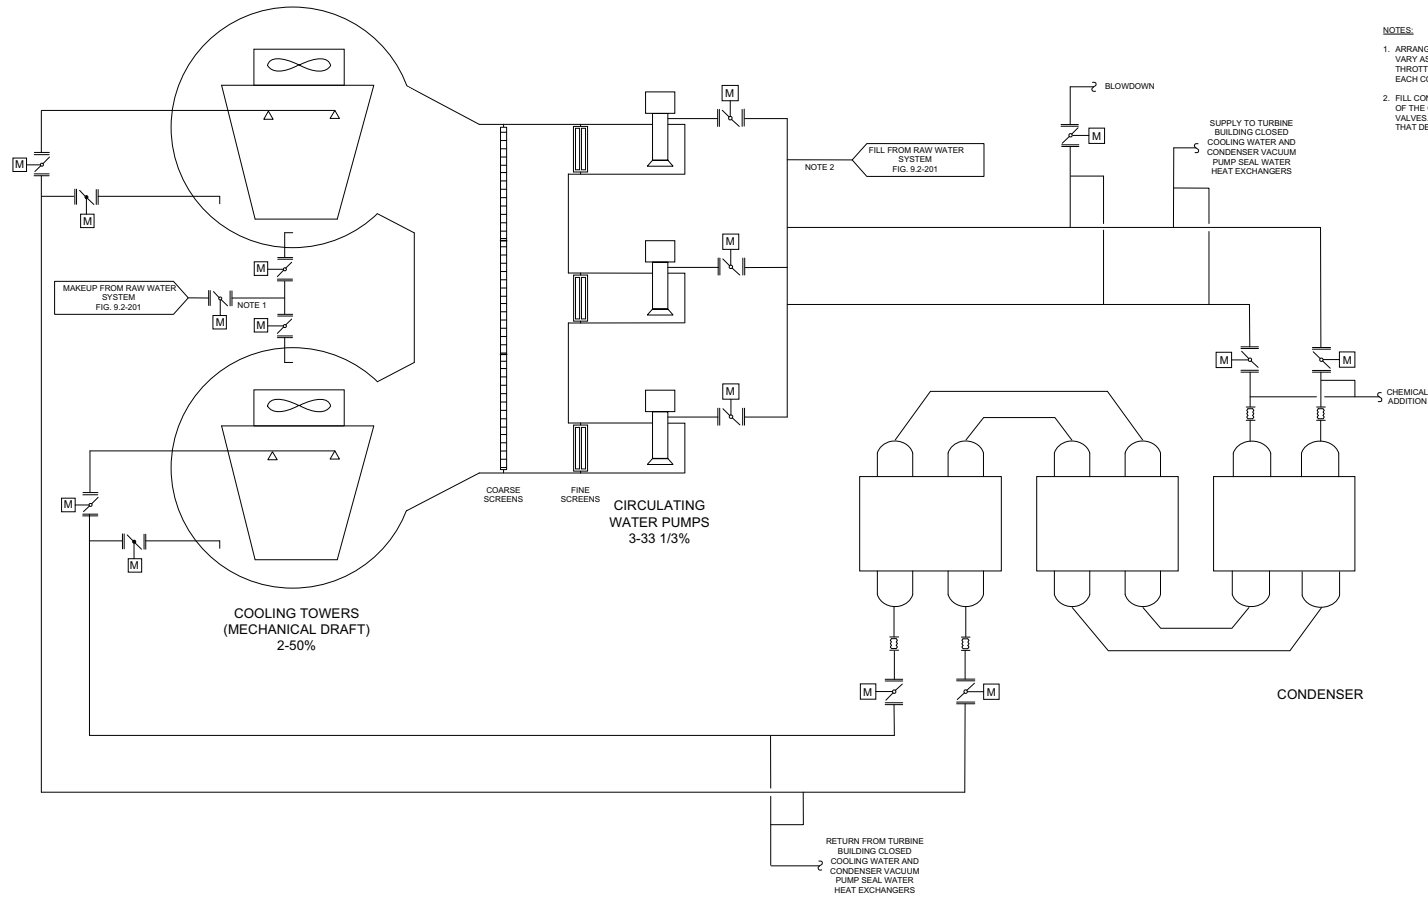


Figure 10.4-201
Circulating Water System Flow Diagram