



Argonne
NATIONAL
LABORATORY

... for a brighter future



U.S. Department
of Energy

UChicago ►
Argonne_{LLC}



A U.S. Department of Energy laboratory
managed by UChicago Argonne, LLC

SCC CGRs of Alloys 690 and 152 Weld in PWR Water

*Bogdan Alexandreanu, Omesh Chopra, and Bill Shack
Nuclear Engineering Division
Argonne National Laboratory*

2008 EAC-ICG Meeting



Work sponsored by the US Nuclear Regulatory Commission

Program Objectives and Presentation Topics

ANL NRC Program Objectives

- SCC CGRs of Alloys 690/52/152
- SCC CGRs of service Alloys 600/82/182 (previous work included materials from Davis-Besse and V.C. Summer plants)

Presentation Topics

- CGR testing in simulated primary water
 - experimental approach
- Crack Growth Rates for Alloy 690
 - cold-worked and as-received conditions
- Crack Growth Rates for Alloy 152 Weld

Stress Corrosion Cracking Testing Facilities

- Four (of eight) hydraulic testing frames:
 - upgraded with Instron digital controls
 - 1-6L autoclaves rated to 320-350°C
 - instrumented for CGR measurements
 - independent water loops
- Crack initiation facility:
 - two 8-L autoclaves rated to 350°C
 - independent water loops
 - accommodate reverse U-bend and tubular specimens



Experiment

- Temperature: 320°C
- PWR Water (<10 ppb DO, 1000 ppm B, 2 ppm Li, ≈23 cc/kg hydrogen)
- Flow Rate: ≈55 mL/min
- Conductivity: ≈20 μS/cm
- Loading sequence to facilitate the transitioning from transgranular fatigue cracking to intergranular SCC cracking

Transitioning to SCC

- ANL approach very similar to the widely-used method (increasing R and decreasing frequency) but with a few differences:
 - Precracking is always conducted in the environment¹
 - Use of slow/fast sawtooth with increasing rise times
 - Loading takes into account possible ΔK and ΔK_{th} effects²
 - Monitor specimen response
 - Calculate cyclic CGRs based on rise time³
 - Monitor cyclic rates for environmental enhancement⁴
 - Attempt to transition only from those conditions that show environmental enhancement

¹ Provides (essential) baseline cyclic data

² $\Delta K/\Delta K_{th}$ effects have been observed/formulated for Alloy 690

³ Well-characterized cyclic CGR also enables the calculation of the SCC component for periods with hold times or constant load with periodic unloading

⁴ Accomplished by plotting the measured in the environment vs. the rates that would be expected in air under the same loading conditions

The Analysis of Cyclic CGR Data*


- Superposition model (Kassner & Shack)

$$\dot{a}_{env} = \dot{a}_{air} + \dot{a}_{CF} + \dot{a}_{SCC}$$

- For Ni-welds:



$$\dot{a}_{air} + \dot{a}_{CF} = \dot{a}_{air} + 0.018 \cdot (\dot{a}_{air})^{0.78}$$

$$\dot{a}_{SCC} = \alpha \exp\left[-\frac{Q}{R}\left(\frac{1}{T} - \frac{1}{T_{ref}}\right)\right] K^\beta$$

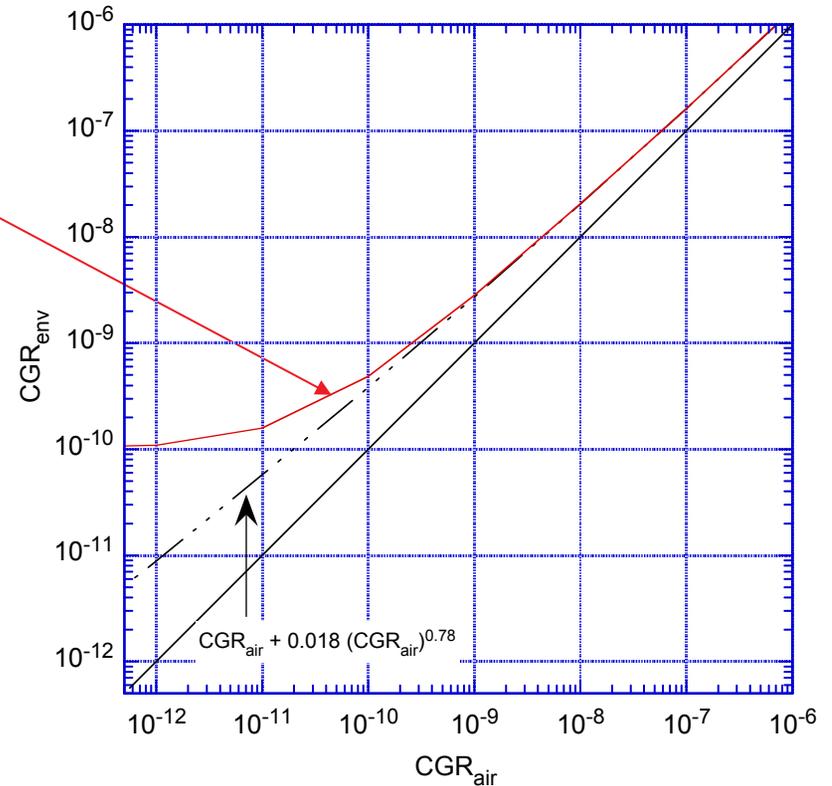

* Example shown is for Ni-alloy welds, the approach for Alloy 690 is similar



Cyclic CGR Data for Alloy 690 in PWR and HP Water at 320°C

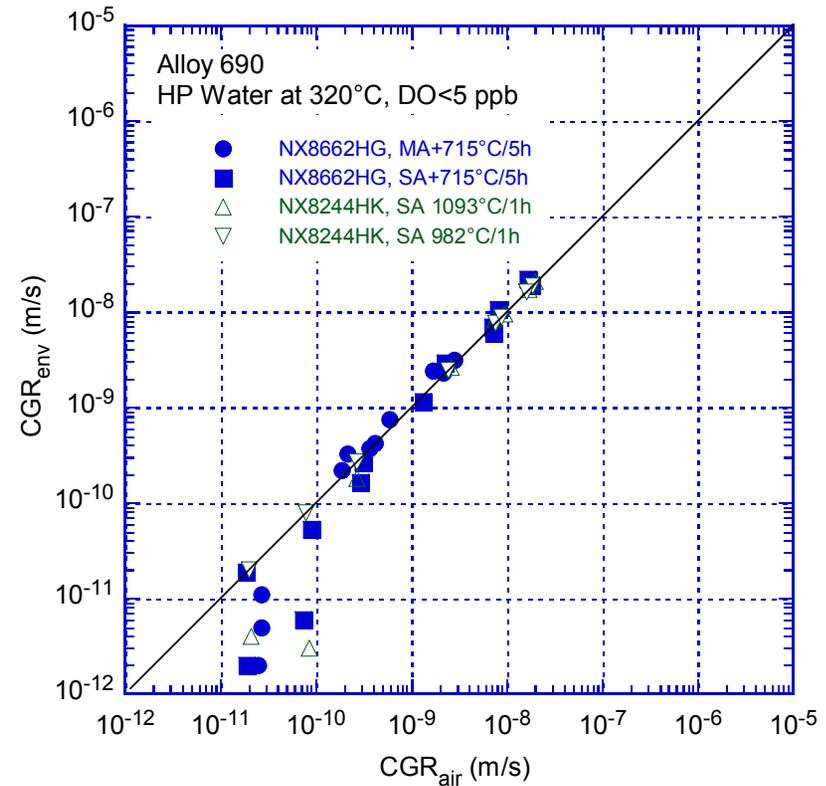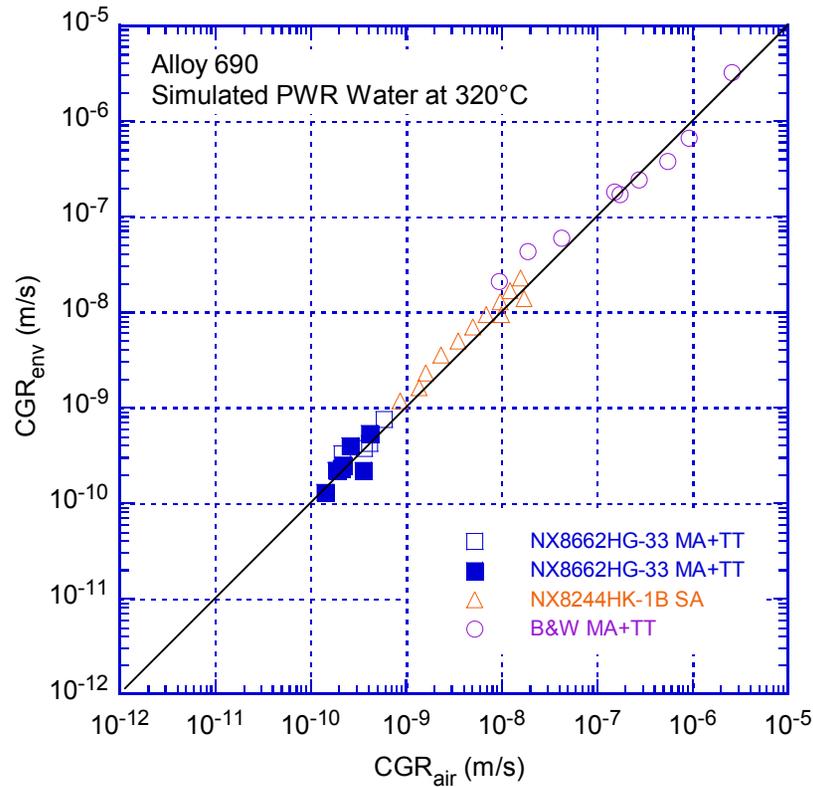

- Earlier ANL and B&W data in good agreement; no environmental enhancement
- $\Delta K/\Delta K_{th}$ was observed/formulated for Alloy 690; the effect is taken into account in current tests



Cold-Rolled Alloy 690 Specimens

- Alloy 690 in plate form (MIL-DTL-24802), Heat NX3297HK12
 - Cold-rolled in three passes to achieve approx. 26% reduction in thickness
 - Deformation is inhomeogeneous: near-surface harder than mid-plane by 12%
 - 1/2T-CT specimens were cut in SL and ST orientations (mid-plane)

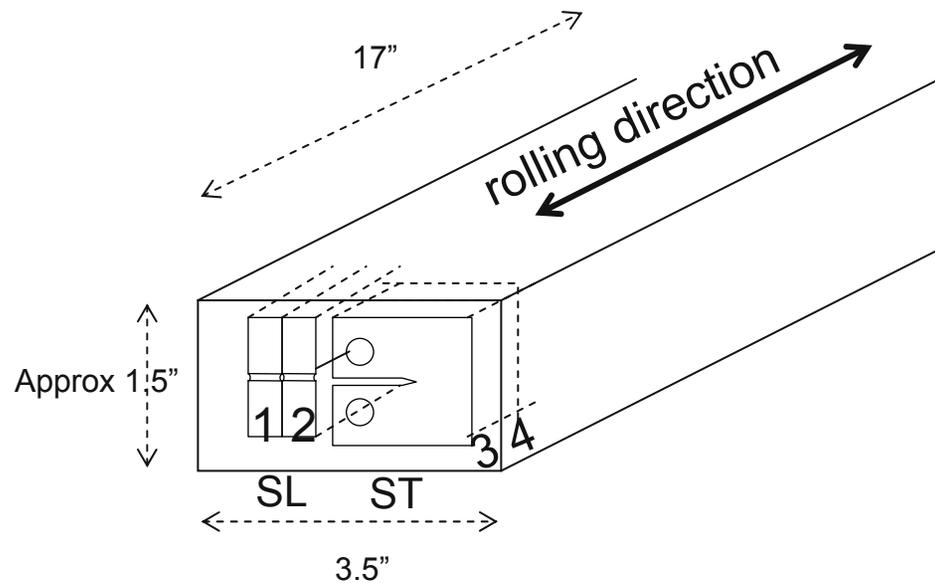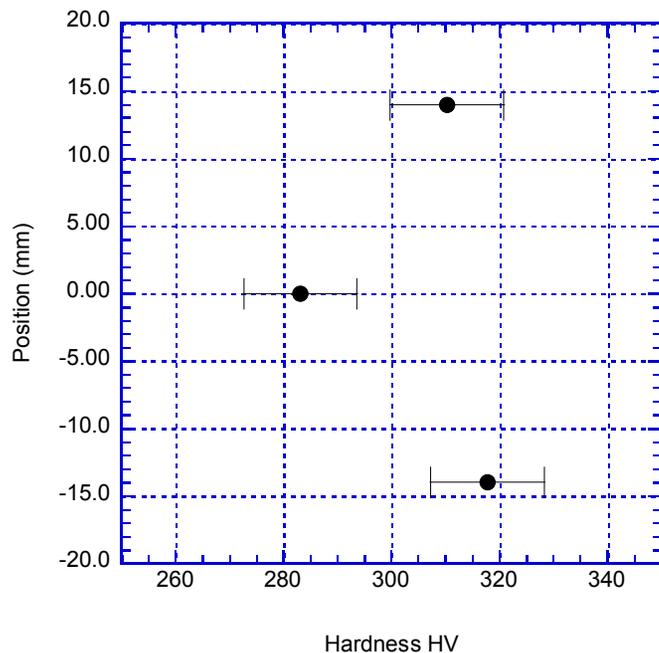


Alloy 690TT Specimens

- Alloy 690TT CRDM tubing, 2541 – Heat WP142
 - 1/2T-CT specimens were cut from tubing (in as-received condition) in CR and LR orientations

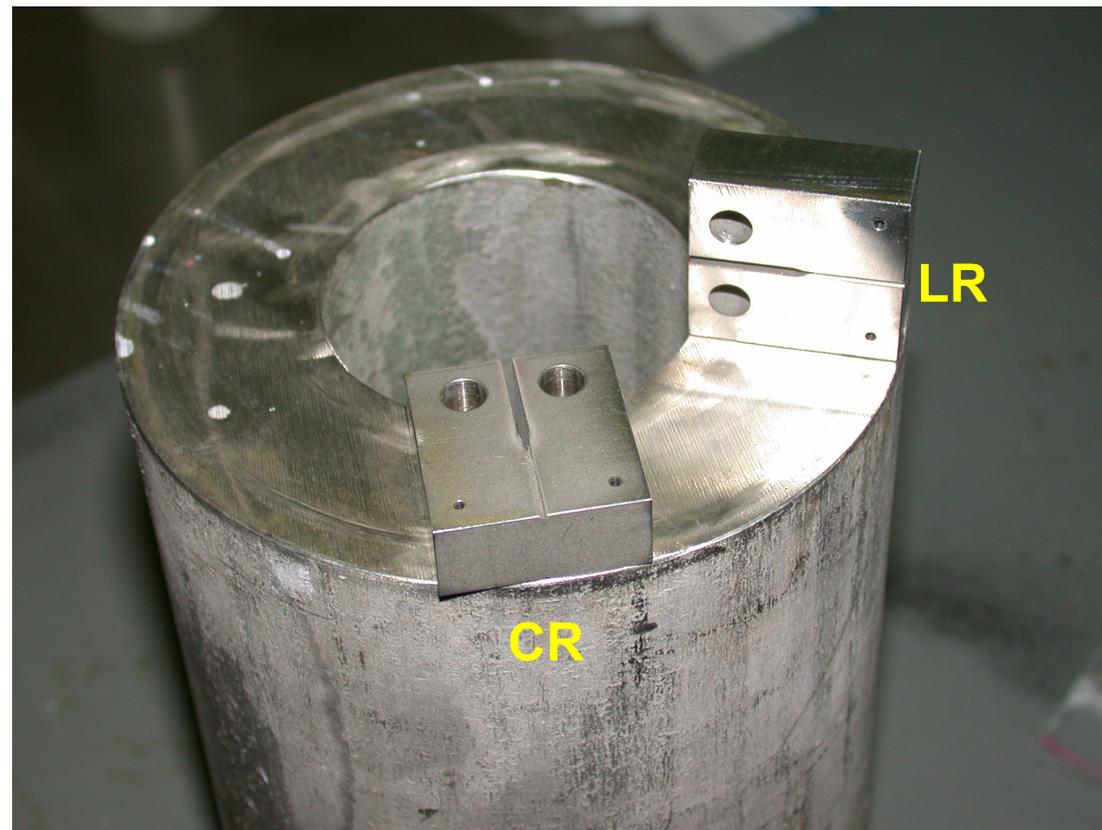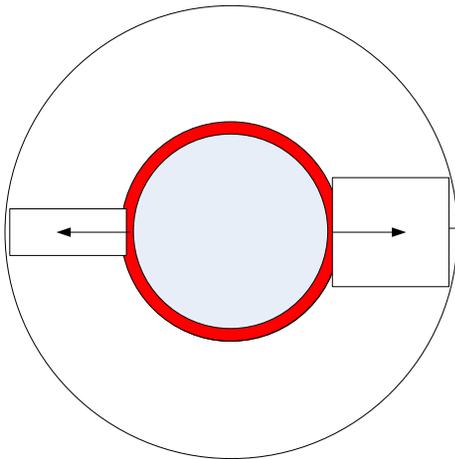


Cold-Rolled Alloy 690 Specimen A690WC-SL-1

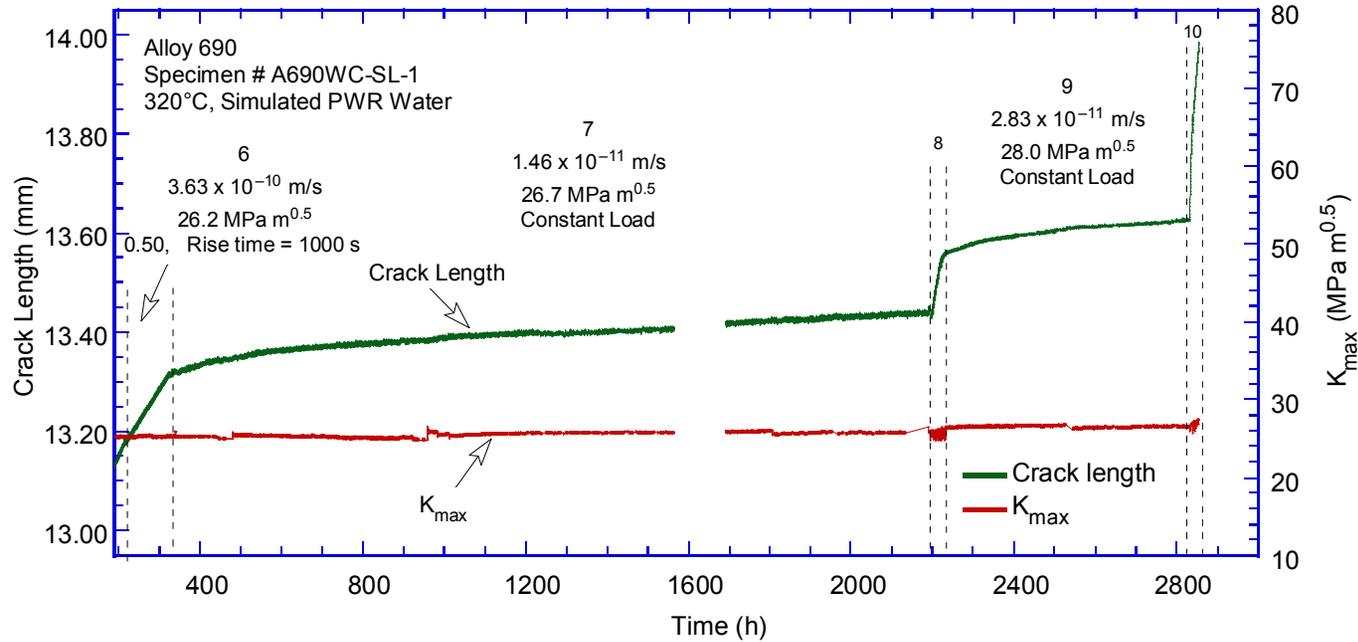



- Well-behaved crack advance under constant load

Cold-Rolled Alloy 690 Specimen A690WC-ST-1

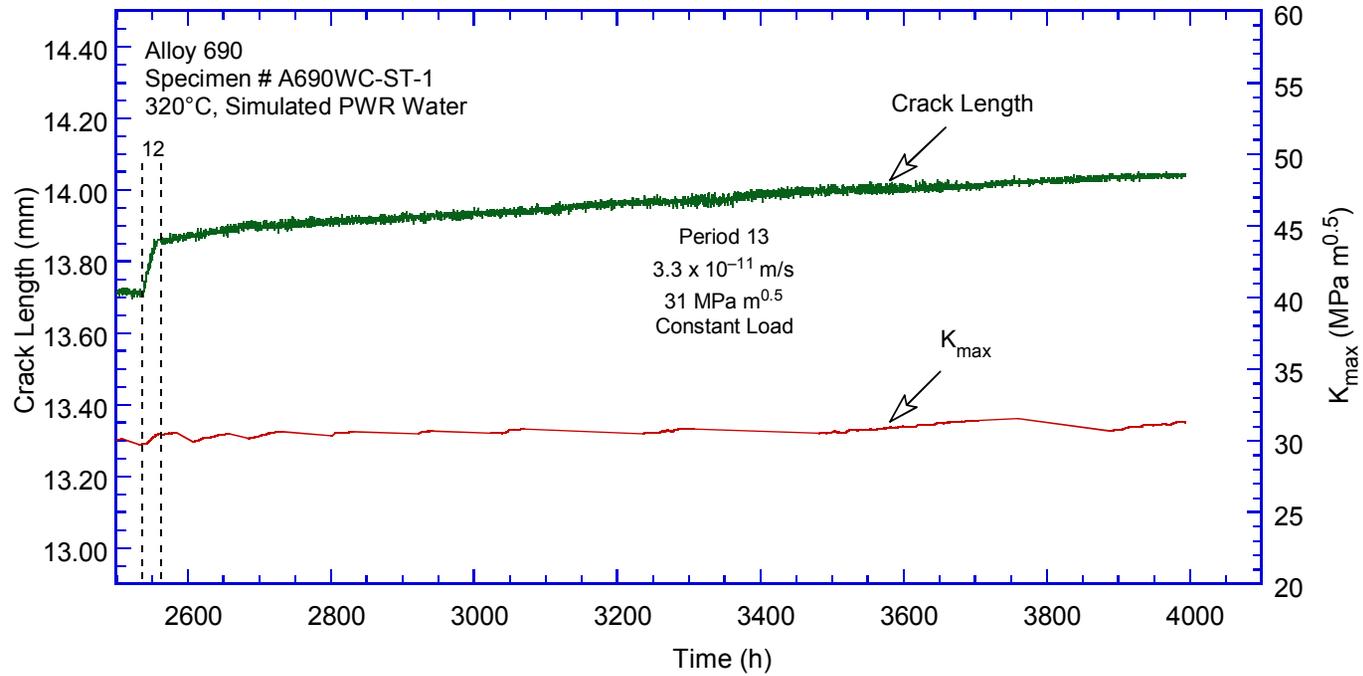


- Well-behaved crack advance under constant load

Fracture surfaces of A690WC-SL-1 and A690WC-ST-1

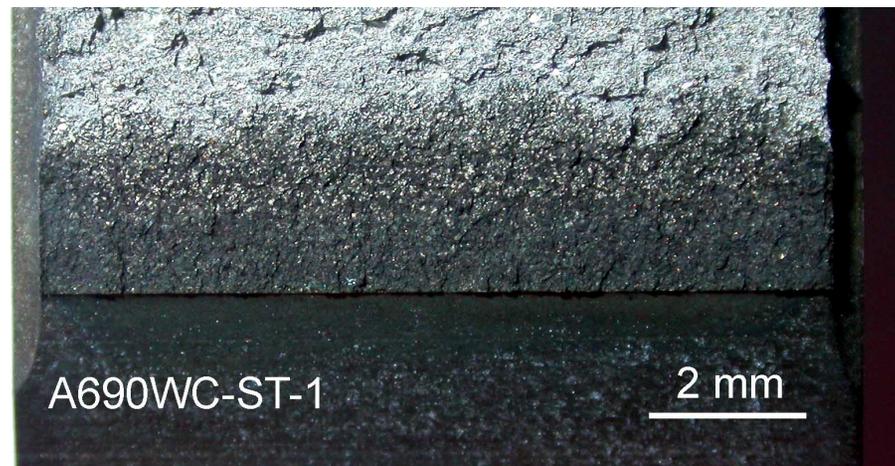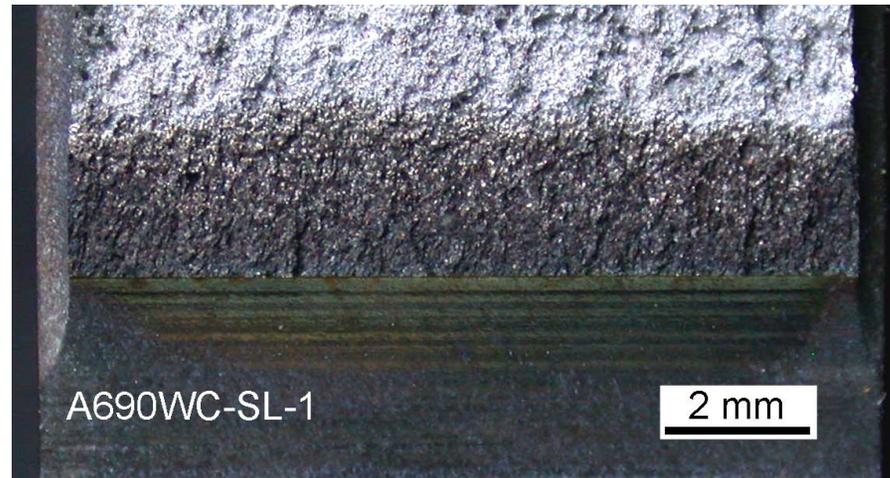

- Straight fracture surfaces, uniform SCC engagement


Cold-Rolled Alloy 690 Specimen A690WC-ST-2*

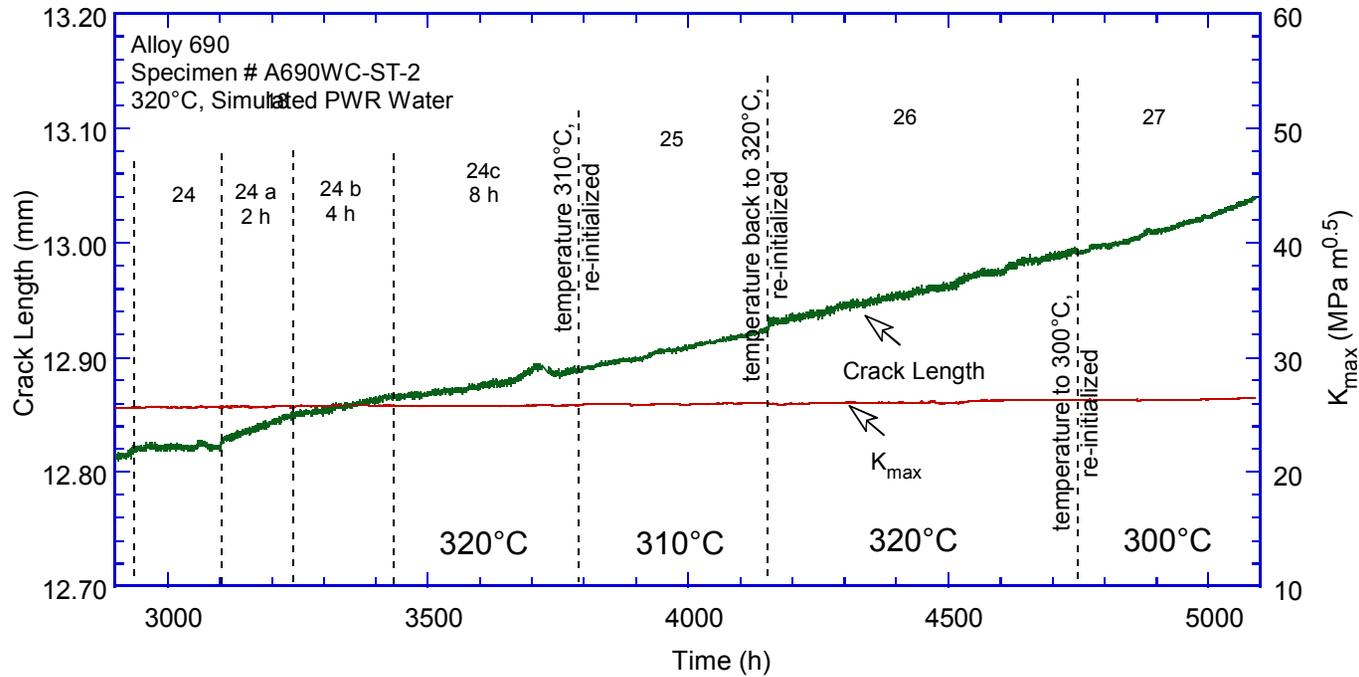

■ No effect of temperature (good agreement with Bettis and GE observations)

* Test in progress



Alloy 690 Specimen C690-CR-1* (as-received condition)

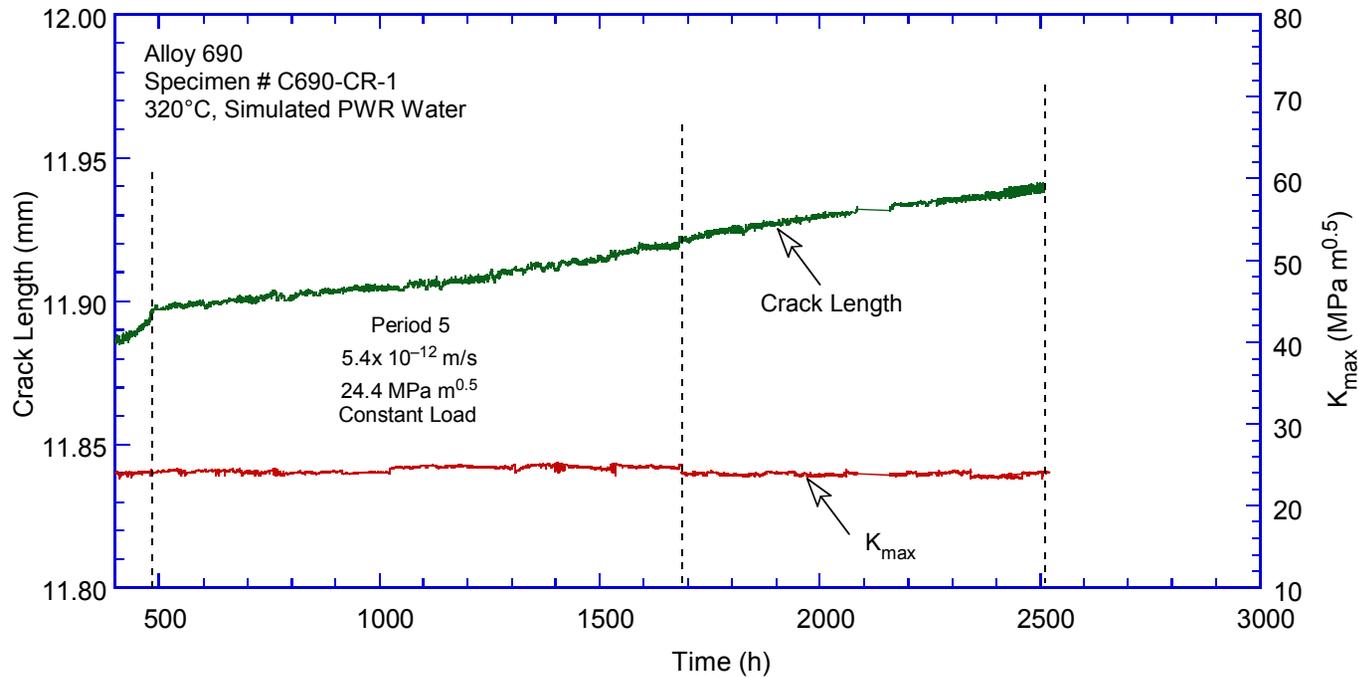

- CGR of 5×10^{-12} m/s maintained for approx. 1100 h under constant load


* Test in progress

Cyclic CGR data for Alloy 690

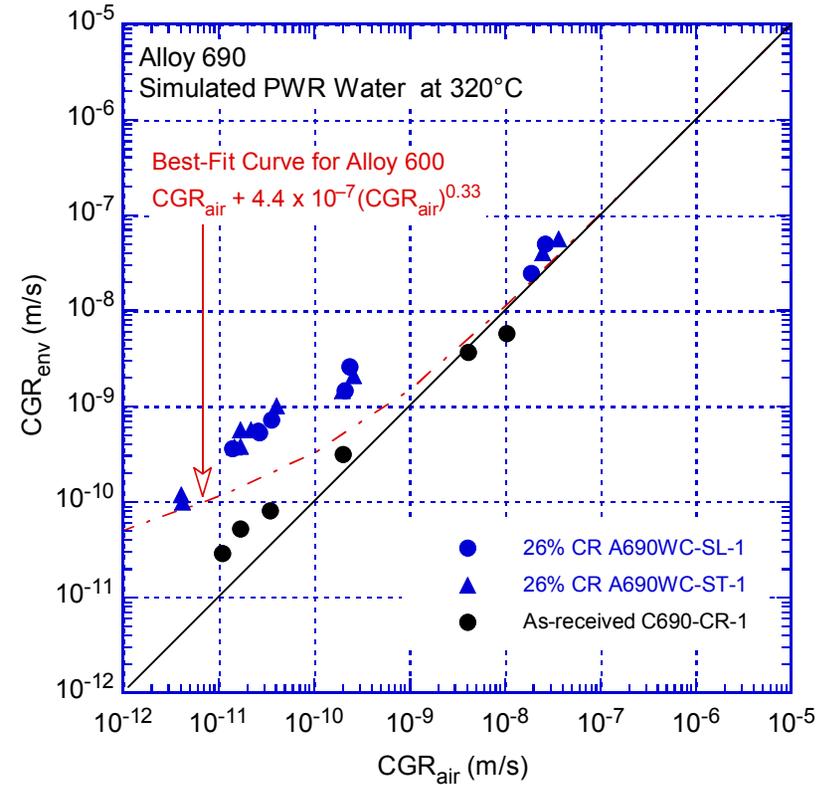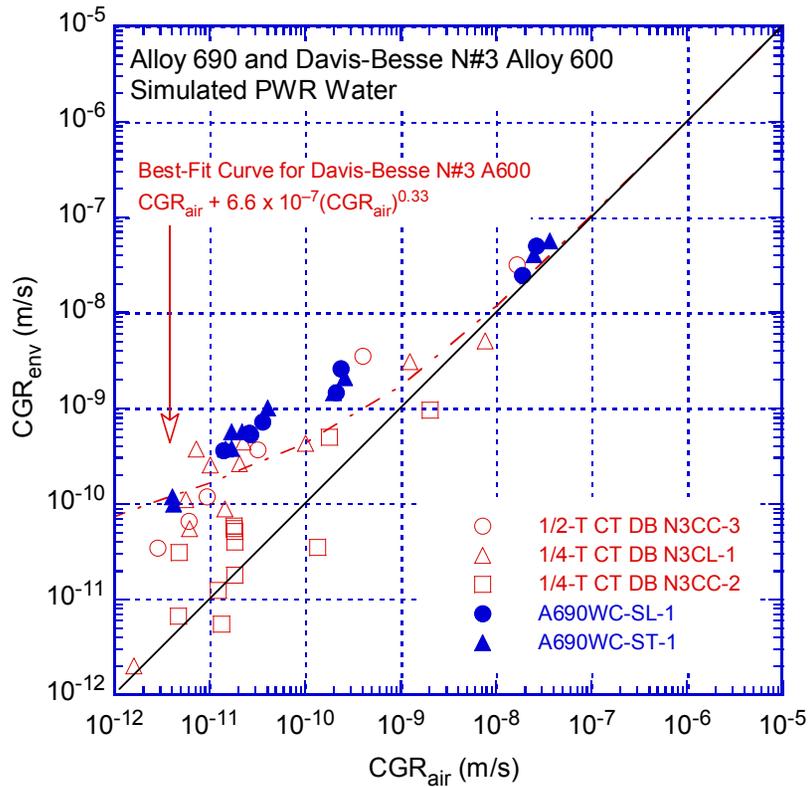


- Alloy 690 cold-rolled shows significant environmental enhancement, comparable to Alloy 600 from Davis-Besse (Nozzle #3)
- Cyclic CGR rates for as-received alloy lower than those for cold-rolled alloy

SCC CGRs vs. K for Alloy 690

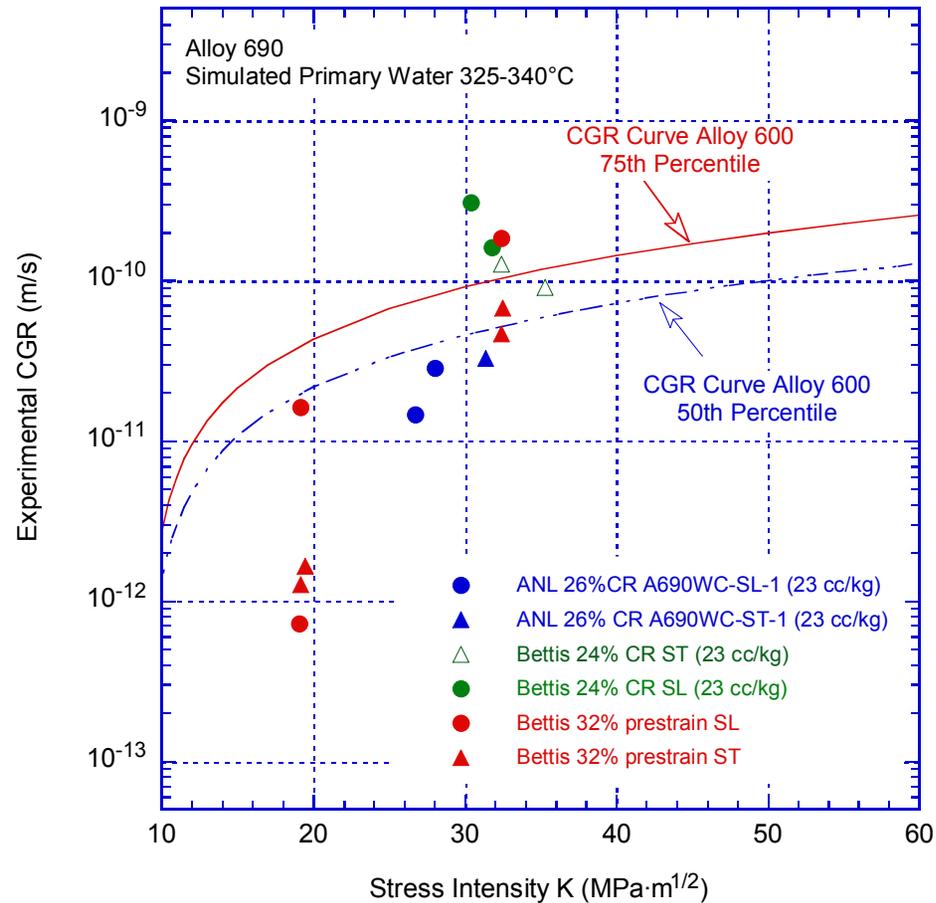


- Good agreement with Bettis data at the same hydrogen level (23 cc/kg)
 - ANL data: CGR rates for as-received* alloy lower than those for cold-rolled alloy
- * C690-CR-1 testing in progress

Alloy 152 Specimens (A152-TS-2 and A152-TS-4)

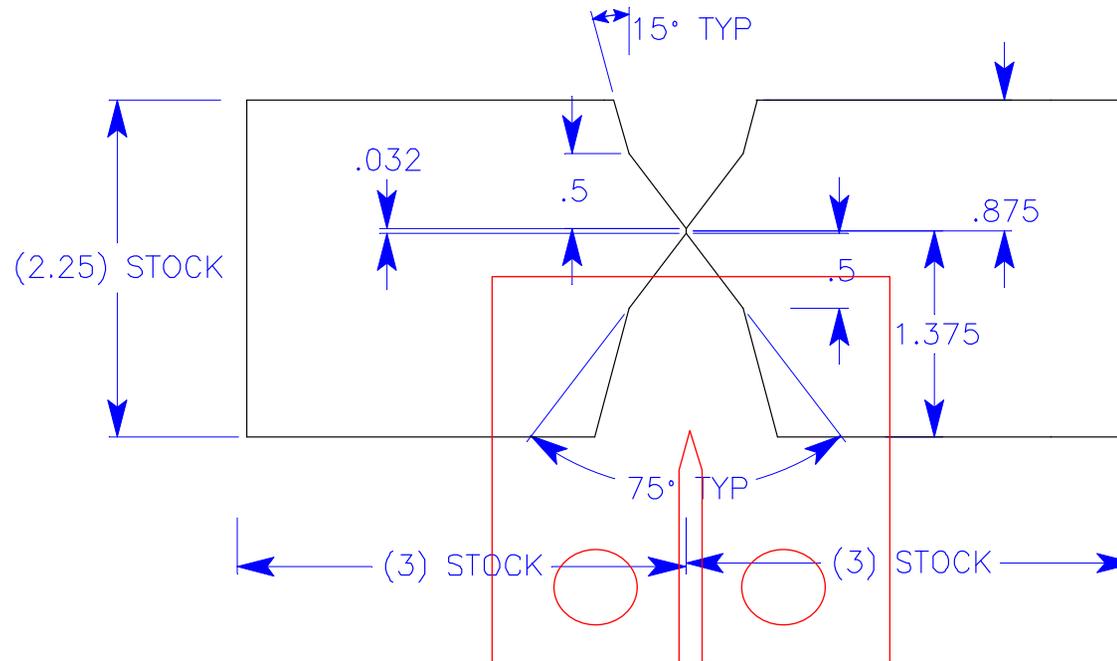



- Electrode heats: NX168IJK (52, 3/32), WC96D8 (152, 1/8), WC43E9 (152, 3/32), **WCO4F6 (152, 1/8)**
- 1-T CT specimens cut in TS orientation (T= long transverse, S = short transverse). Crack growth is along the direction of dendrites

Alloy 152 specimen A152-TS-2


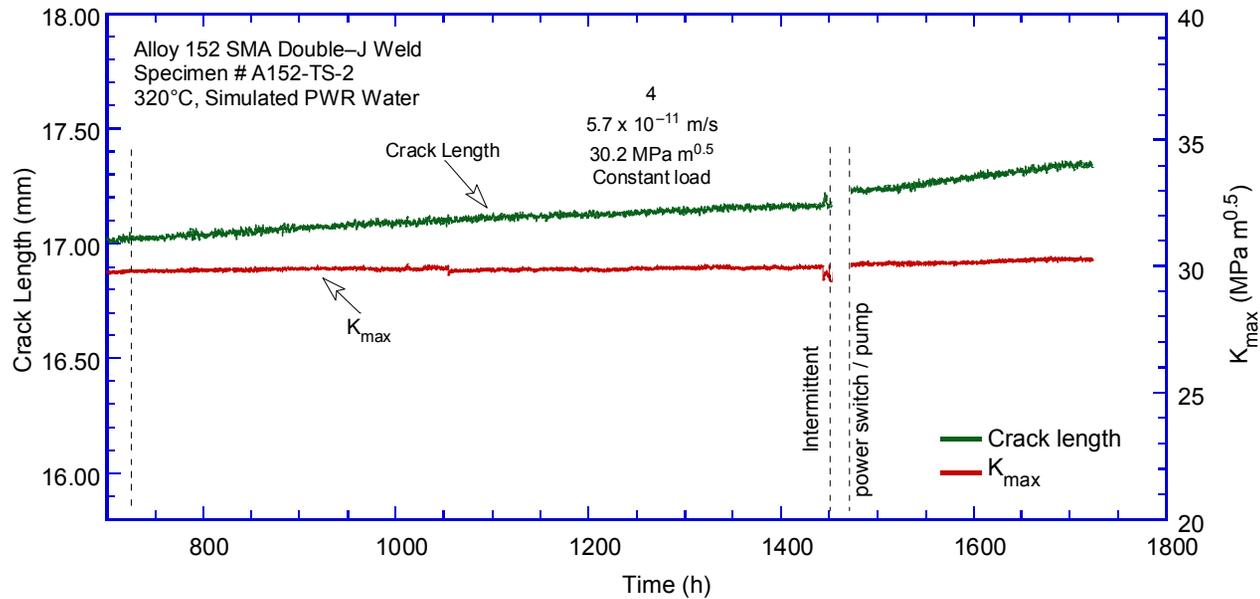


- Well-behaved crack advance under constant load


Fracture surface of A152-TS-2

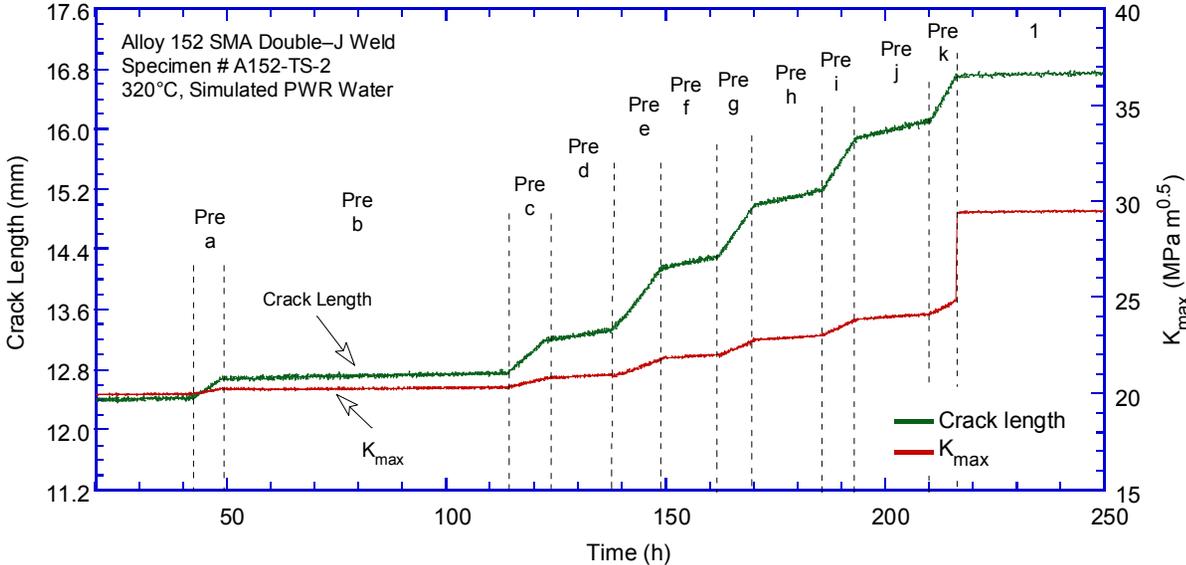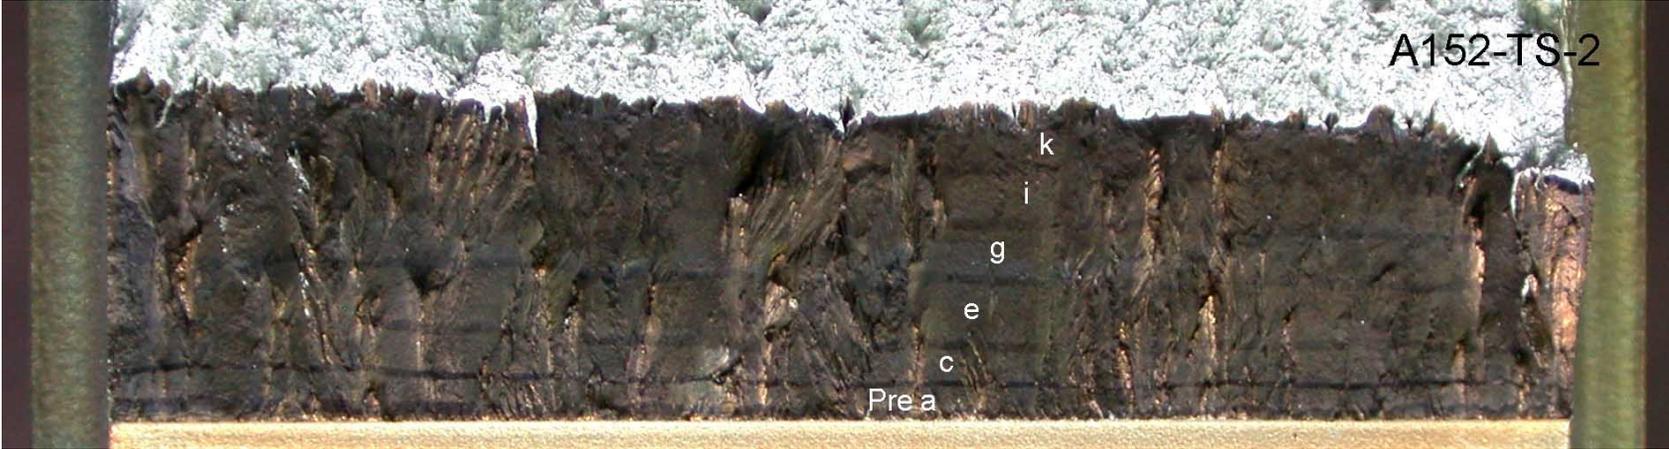

Fracture surface of A152-TS-2

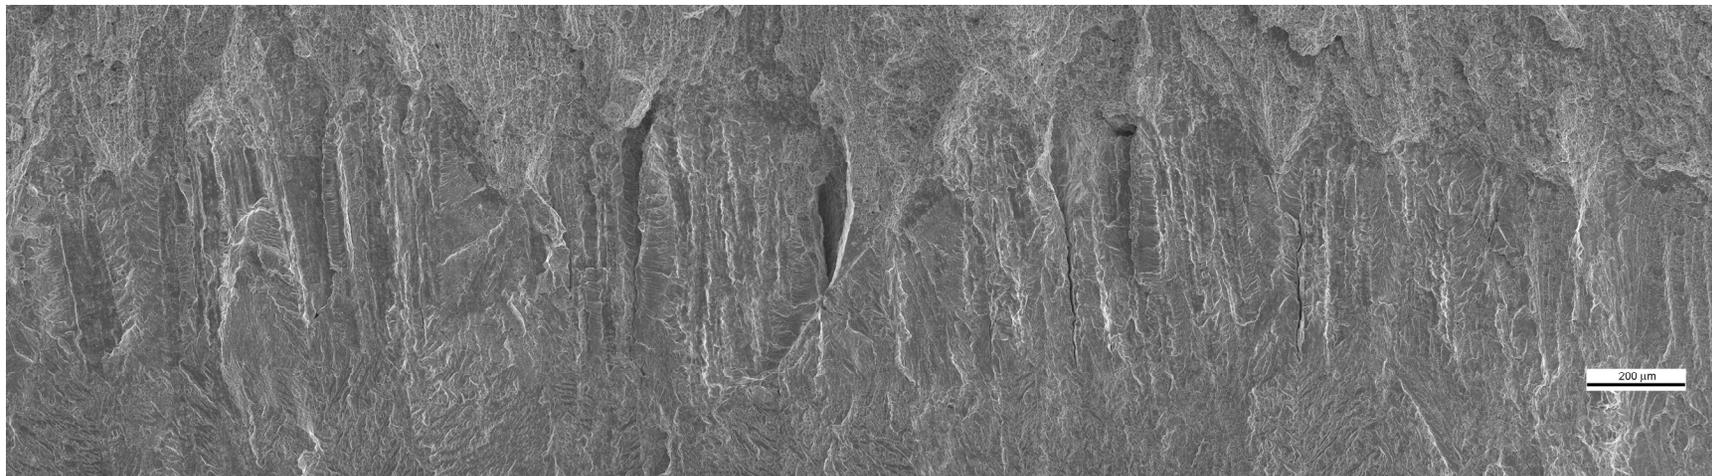
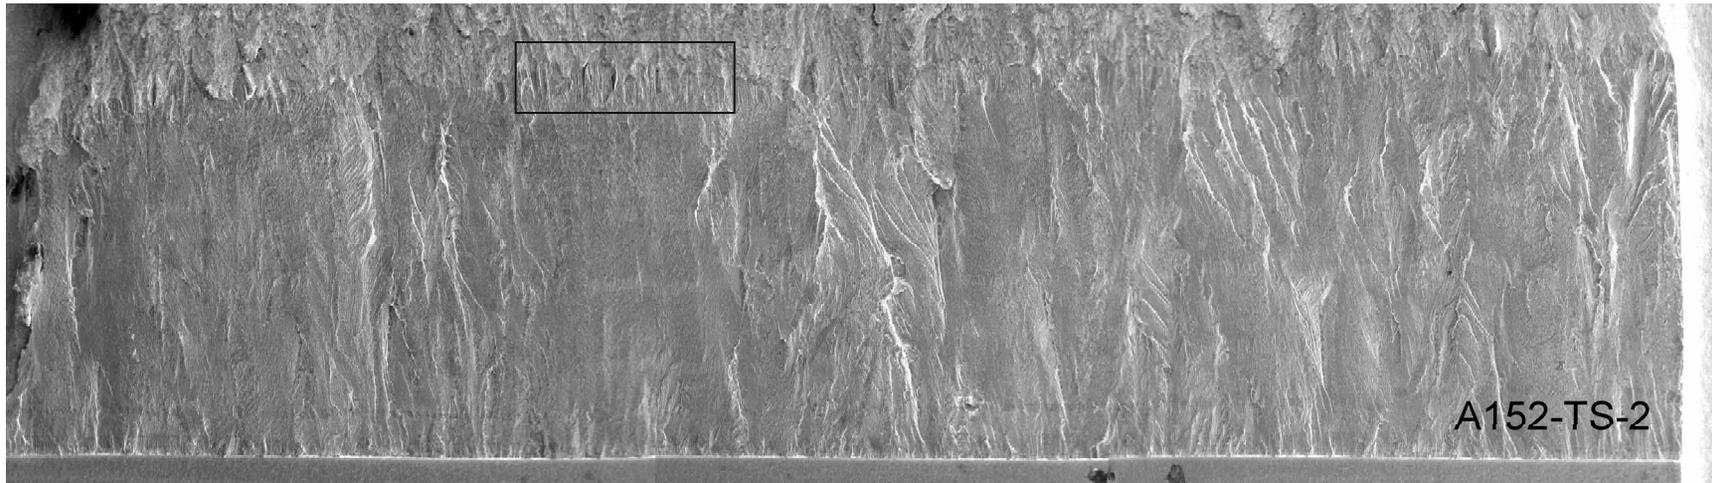


Alloy 152 specimen A152-TS-4

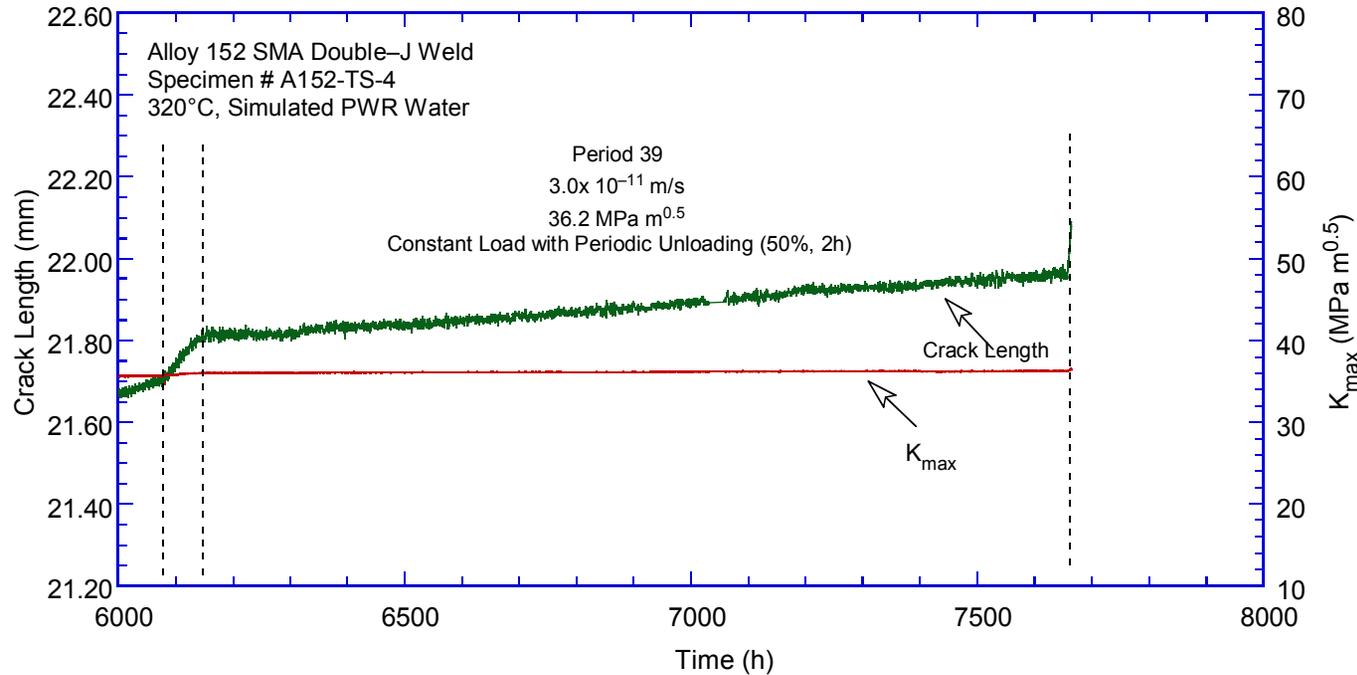




- Well-behaved crack advance under constant load with periodic unloading (this type of loading was necessary to break the ligaments)

Fracture surface of A152-TS-4

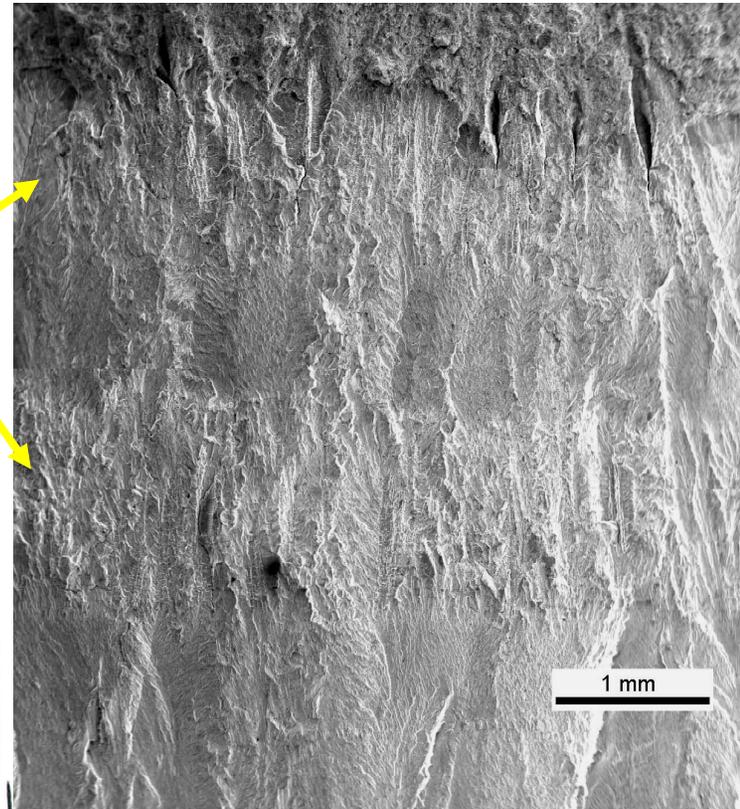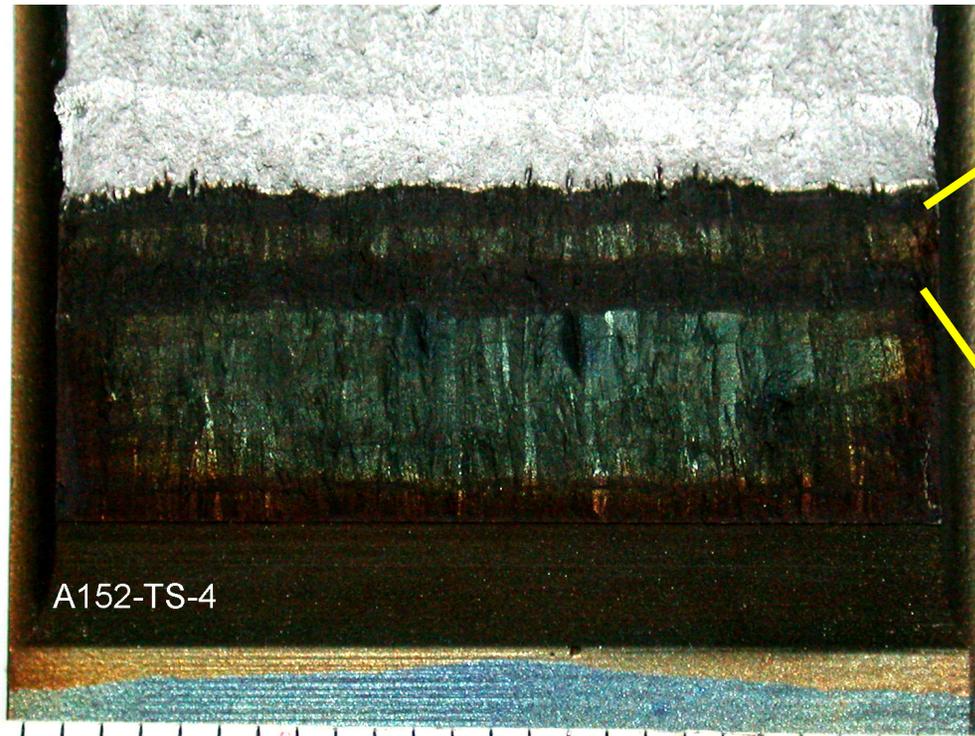


- Specimen was transitioned to SCC twice, maintained growth under constant load conditions only in 2 of 7 attempts
- Observed behavior suggested the formation of ligaments
- SCC CGRs measured during cyclic loading with hold times or at constant load with periodic unloading

Fracture surface of A152-TS-4 (Examples of Ligaments)

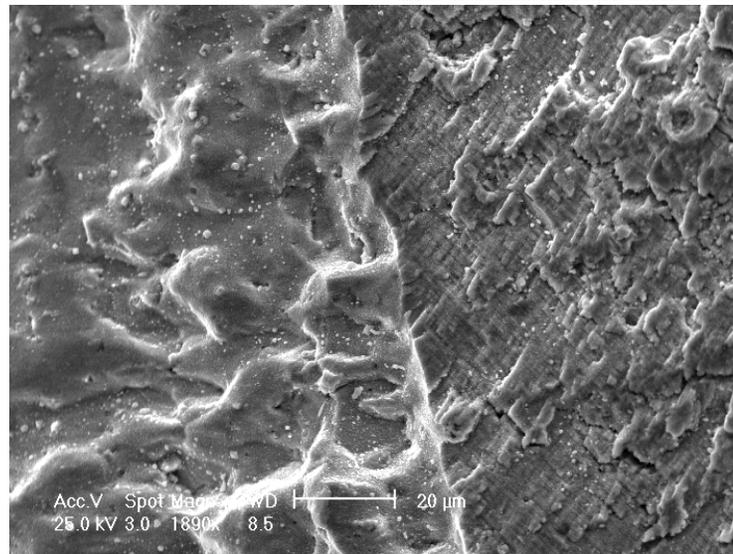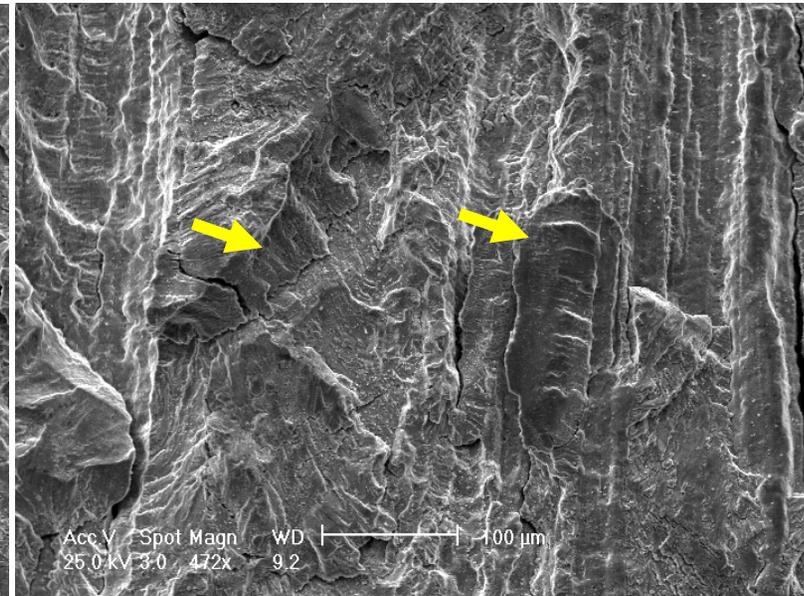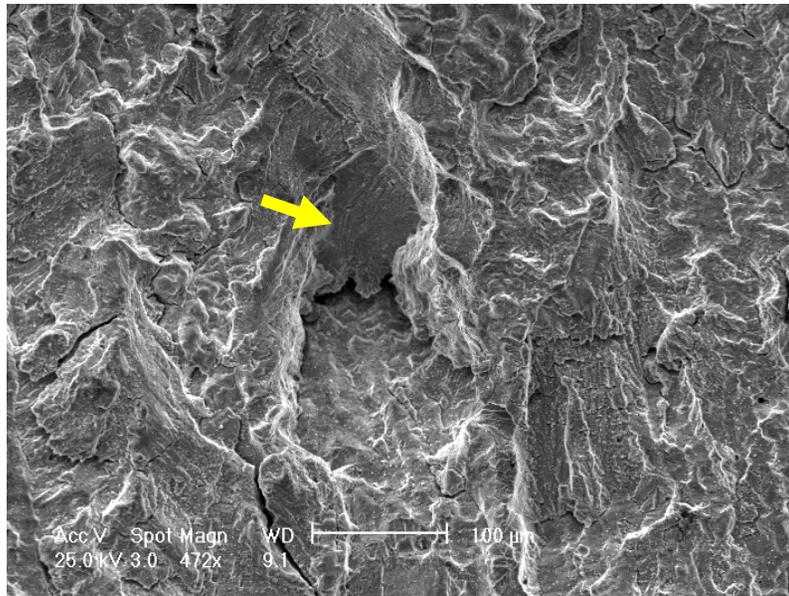


Cyclic CGR Data for Alloy 152 Weld

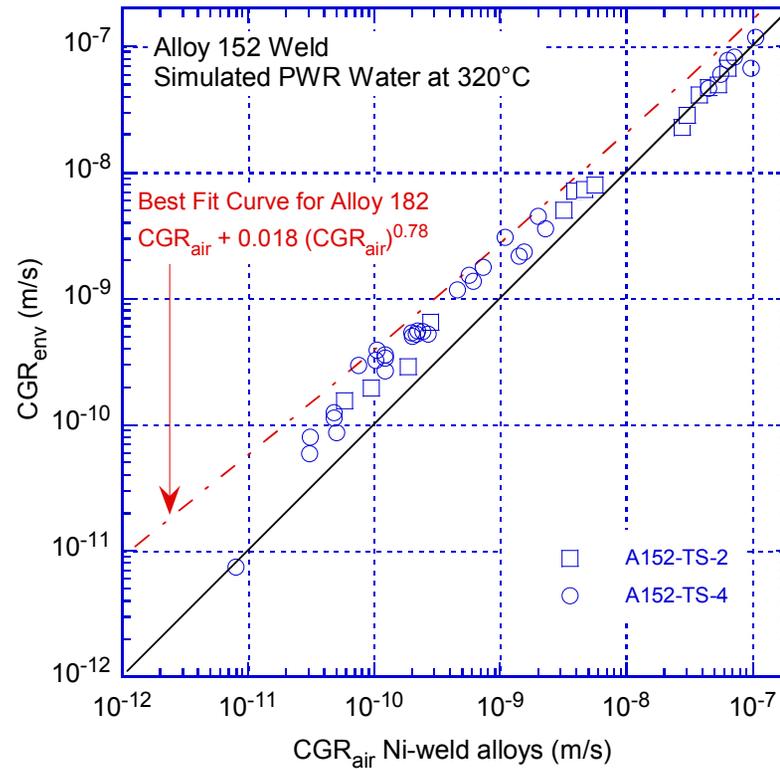

- Select conditions show environmental enhancement
- R=0.7 and rise 1000s shows no enhancement; the behavior seems to suggest a ΔK effect (and is consistent with other Alloy 690/152 observations)

SCC CGRs vs. K for Alloy 152

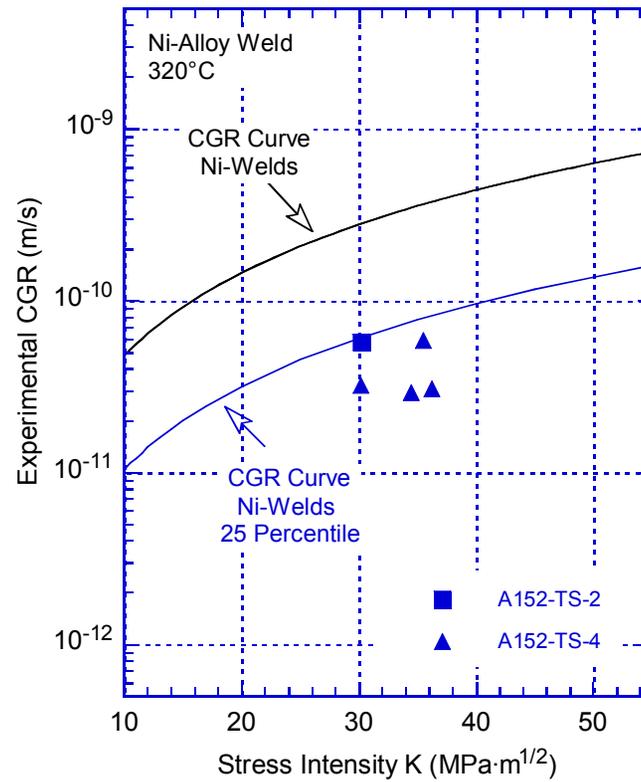

- 25th Percentile of Ni-weld Curve bounds the data

Summary of Testing Results

- Fracture surfaces were uniform for both Alloy 690 and 152 specimens; the experimental approach facilitated transitioning to SCC
- The cyclic CGRs of cold-rolled Alloy 690 show significant environmental enhancement
- As-received Alloy 690 appears to show less environmental enhancement than the cold-rolled alloy
- The environmental enhancement of cyclic CGRs is minimal for Alloy 152
- The SCC CGRs in simulated PWR water at 320°C are in the 10^{-11} m/s range for cold-rolled Alloy 690 and as-welded Alloy 152