SQN/WBN AFW PUMP TURBINE RM ND5
o-VOLUME 16

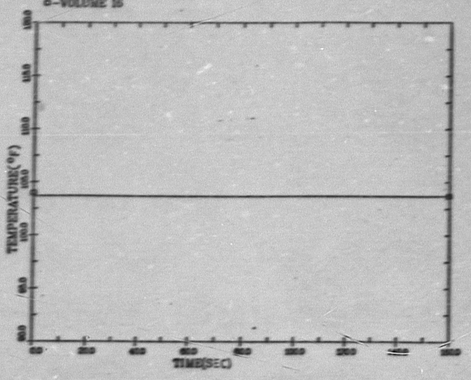

SQN/WBN AFW PUMP TURBINE RM ND5
o-VOLUME 16

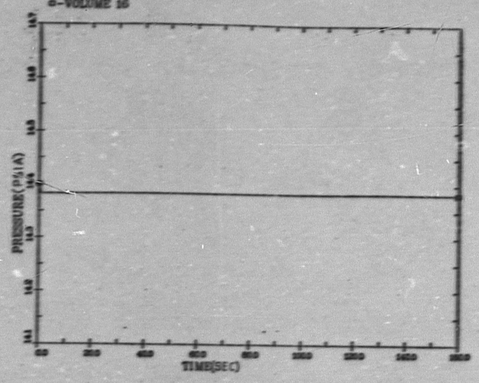

SQN/WBN AUX BOILER SYS - NODE 4 - CORRIDOR
o-VOLUME 16

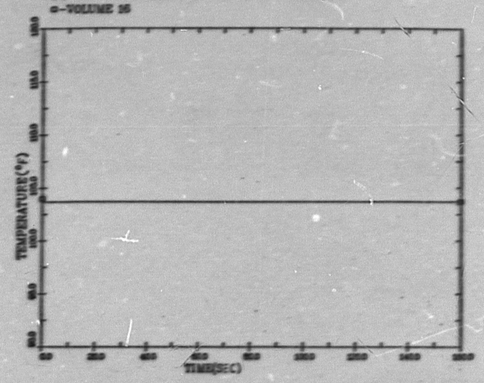

SQN/WBN AUX BOILER SYS - NODE 4 - CORRIDOR
o-VOLUME 16

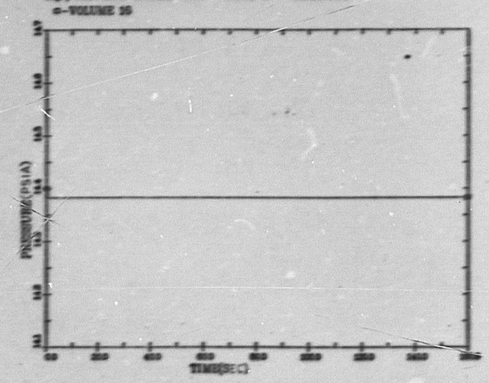

SQN/WBN RHR - NODE 2 - RHR PUMP ROOM
o-VOLUME 16

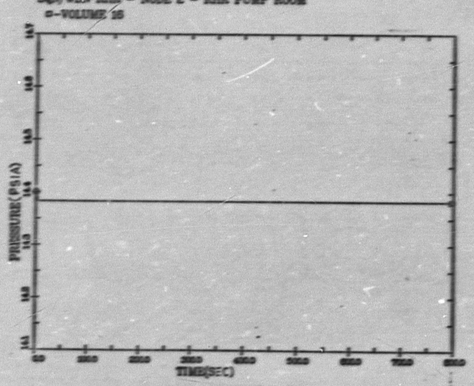

SQN/WBN 2HR - NODE 10 - RHR EXCHANGER ROOM
o-VOLUME 16

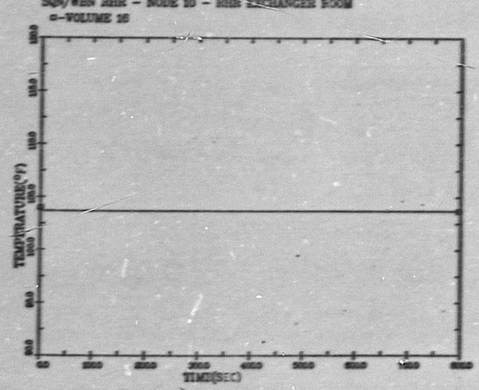

SQN/WBN CVCS - NODE 11 - EXCHANGER ROOM
o-VOLUME 16

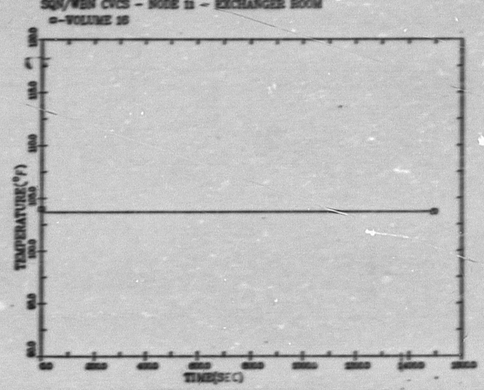

SQN/WBN CVCS - NODE 11 - EXCHANGER ROOM
o-VOLUME 16

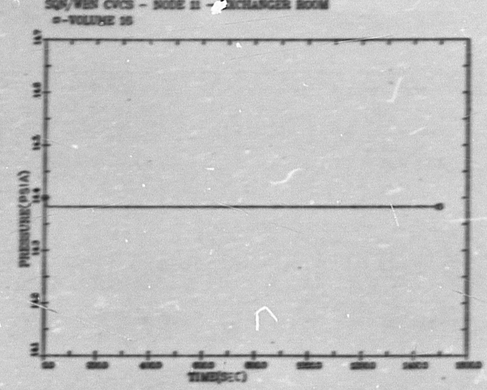

TI APERTURE CARD

COMPANION DRAWING : 47E235-84

SCALE: NTS			EXCEPT AS NOTED
AUXILIARY BUILDING UNITS 1 & 2			
ENVIRONMENTAL DATA - ENVIRONMENT - HARSH HELB PROFILES			
WATTS BAR NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN			
SUBMITTED	RECOMMENDED	APPROVED	
KNOXVILLE	9-26-83	85 M	47E235-67 R1

INSPECTED AND APPROVED FOR ISSUE