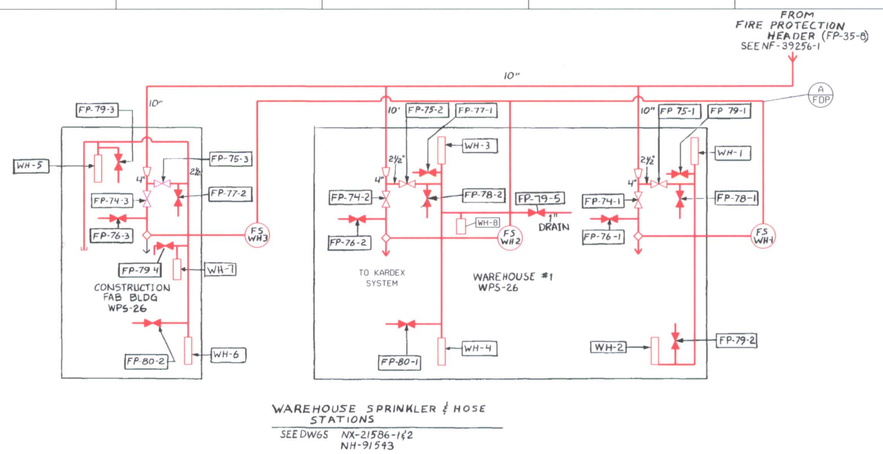

WAREHOUSE SPRINKLER & HOSE STATIONS

SEE DWGS NX-21586-1&2
NH-91593

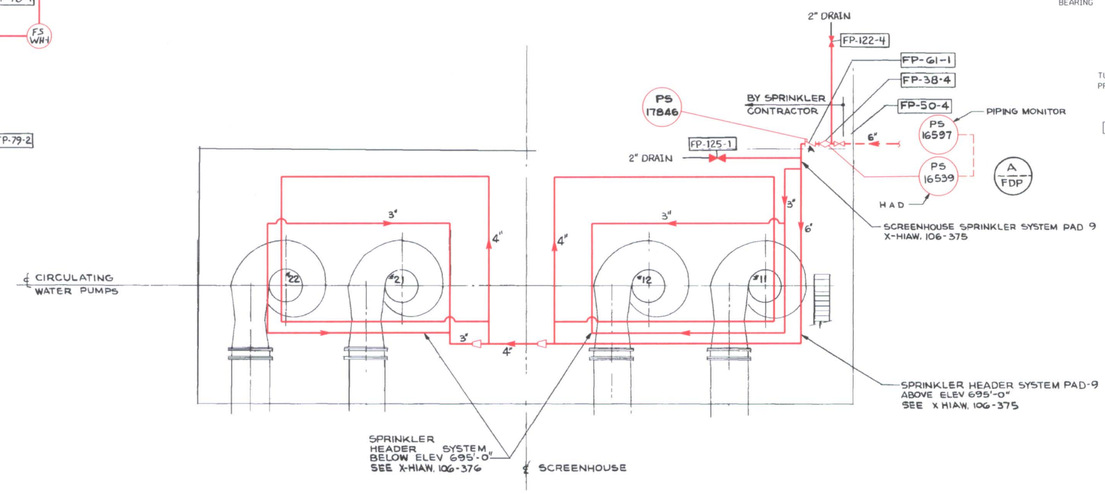

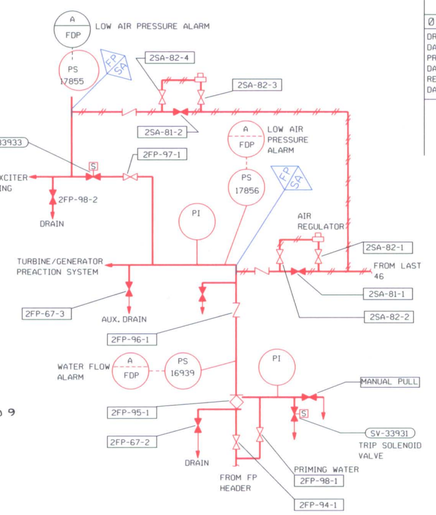

DETAIL S

TURBINE BEARING FIRE PROTECTION PREACTION SYSTEM PA-15
NX-56474-4

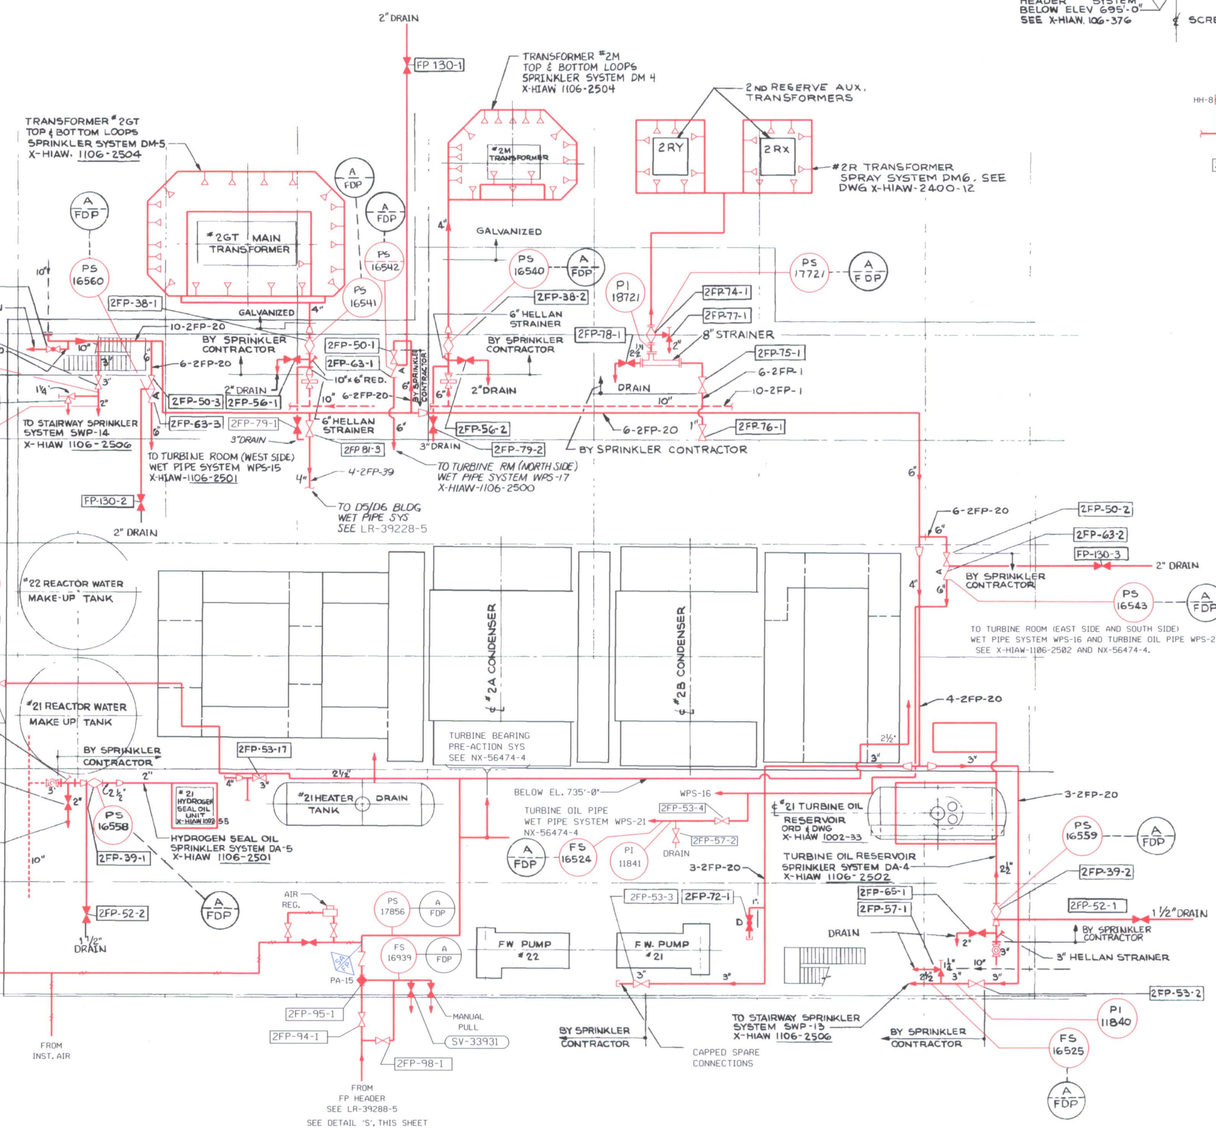

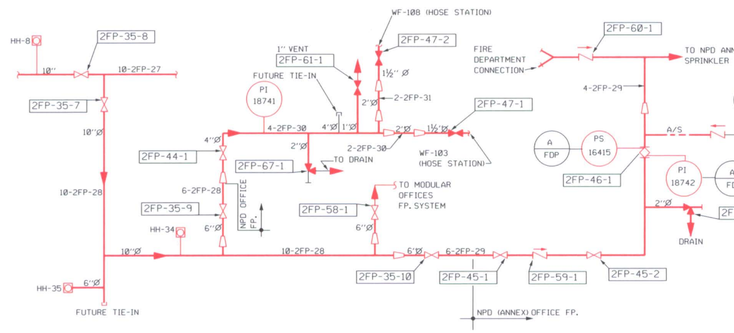

YARD AND NPD BLDGS. FP. PIPING

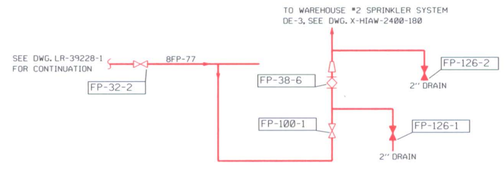

WAREHOUSE #2

LR - LEGEND

- IN SCOPE FOR LR PER 10 CFR 54.4(a)(1) 10 CFR 54.4(a)(3)
- IN SCOPE FOR LR PER 10 CFR 54.4(a)(2)
- OUT OF SCOPE
- DENOTES SYSTEM BOUNDARY BREAK

LR - SYSTEMS

FP - FIRE PROTECTION
SA - STATION & INSTRUMENT AIR

A FDP - DENOTES FIRE PROTECTION PANEL

YARD PLAN WEST DWG - NF 156066
NPD ANNEX BLDG F.P. DWG. NH-158138



KEY PLAN

NORTH

REFERNCE NF-39228-3 REV U

This map / document is a tool to assist employees in the performance of their jobs. Your personal safety is provided for by using safety practices, procedures and equipment as described in safety training programs, manuals and SPAR's.

DWN	DATE	SIGNIFICANT NO.	8630		500 400	100	1 4110	
CHECKED		GROUP	1	2	3	4	5	CL 6
PROJECT NO.								
APP'D & CERT.								
FILMED								

LICENSE RENEWAL BOUNDARY DWG
FLOW DIAGRAM
SPRINKLER FIRE PROTECTION SYSTEM
TURB. RM. 2 - SCREENHSE. UNIT 1 & 2

NORTHERN STATES POWER COMPANY
Xcel Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

SCALE NONE REV Ø

LR-39228-3

$$USERNAME$$
$$$$SYTIME$$$$$$$$$$SYDATE$$$$$$
$$$$$$$$$$DESIGNFILE$$$$$$$$

LR-39228-3.DGN KEP GENERATION CAD

D-026

LR-39228-3

REVISIONS

Ø
DRAWN BY: JLB
DATE: 4-2-07
PREPARED BY: WDR
DATE: 4-2-07
REVIEWED BY: SRM
DATE: 4-17-07

...\Flows\LR-39228-3.DGN 4/19/2007 3:35:49 PM