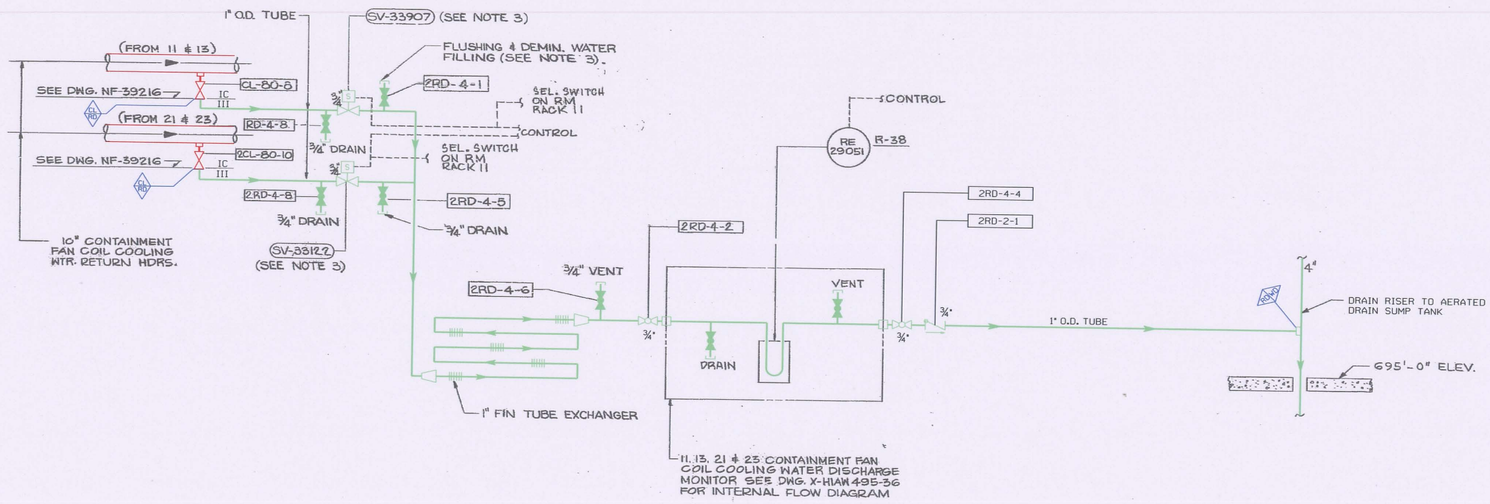

NOTES:

1. ALL PIPING TO BE QA TYPE "IC" UNLESS OTHERWISE NOTED.
2. THIS DWG. TO BE WORKED WITH: PHYSICAL PIPING DWG. NF-39797-1
3. SV-33122 & SV-33907 ARE NORMALLY-CLOSED SV; ENERGIZED IN THE OPEN POSITION AND THERE IS NO FLOW THRU DETECTOR DURING NORMAL PLANT OPERATION. DETECTOR ASSY IS TO KEPT WETTED WITH DEMINERALIZED WATER WHICH IS ADDED THROUGH FLUSHING CONNECTION.

REVISIONS

0
DRAWN BY: JLB
DATE: 3-8-07
PREPARED BY: RAB
DATE: 3-8-07
REVIEWED BY: SRM
DATE: 3-12-07

1
ENLARGED BOUNDARY FLAGS & HIGHLIGHTED 2RD-2-1
DRAWN BY: JLB
DATE: 7-31-07
PREPARED BY: WJI
DATE: 7-31-07
REVIEWED BY: SRM
DATE: 8-1-07

LR - LEGEND

- IN SCOPE FOR LR PER 10 CFR 54.4(a)(1) 10 CFR 54.4(a)(3)
- IN SCOPE FOR LR PER 10 CFR 54.4(a)(2)
- OUT OF SCOPE
- DENOTES SYSTEM BOUNDARY BREAK

LR - SYSTEMS
CL - COOLING WATER
RD - RADIATION MONITORING
WD - WASTE DISPOSAL

CHANNEL NO. R-38
INSTRUMENT NO. 29051

INTERLOCK LOGIC DIAGRAM - NF-40750

D-079

RADIATION MONITORING SYS. INSTRUMENT FLOW DIAGRAM
CHANNEL R-38 - 11, 13, 21, & 23
CONTAINMENT FAN COIL COOLING WATER DISCHARGE MONITOR
REFERENCE DWG. NE-39790-2 REV. C

SIG No.	8630						
GROUP	1	2	3	4	5	CL	6

PRAIRIE ISLAND NUCLEAR GENERATING PLANT LR-39790 SHEET 2 REV. 1

This map / document is a tool to assist employees in the performance of their jobs. Your personal safety is provided for by using safetypractices,procedures and equipment as described in safety training programs, manuals and SPAR's.

$$USERNAME$$
$$$$$$SYTIME$$$$$$$$$$$$SYDATE$$$$$$
$$$$$$$$$$DESIGNFIL$$$$$$$$$$

LR-39790-2.DGN NSP GENERATION CAD