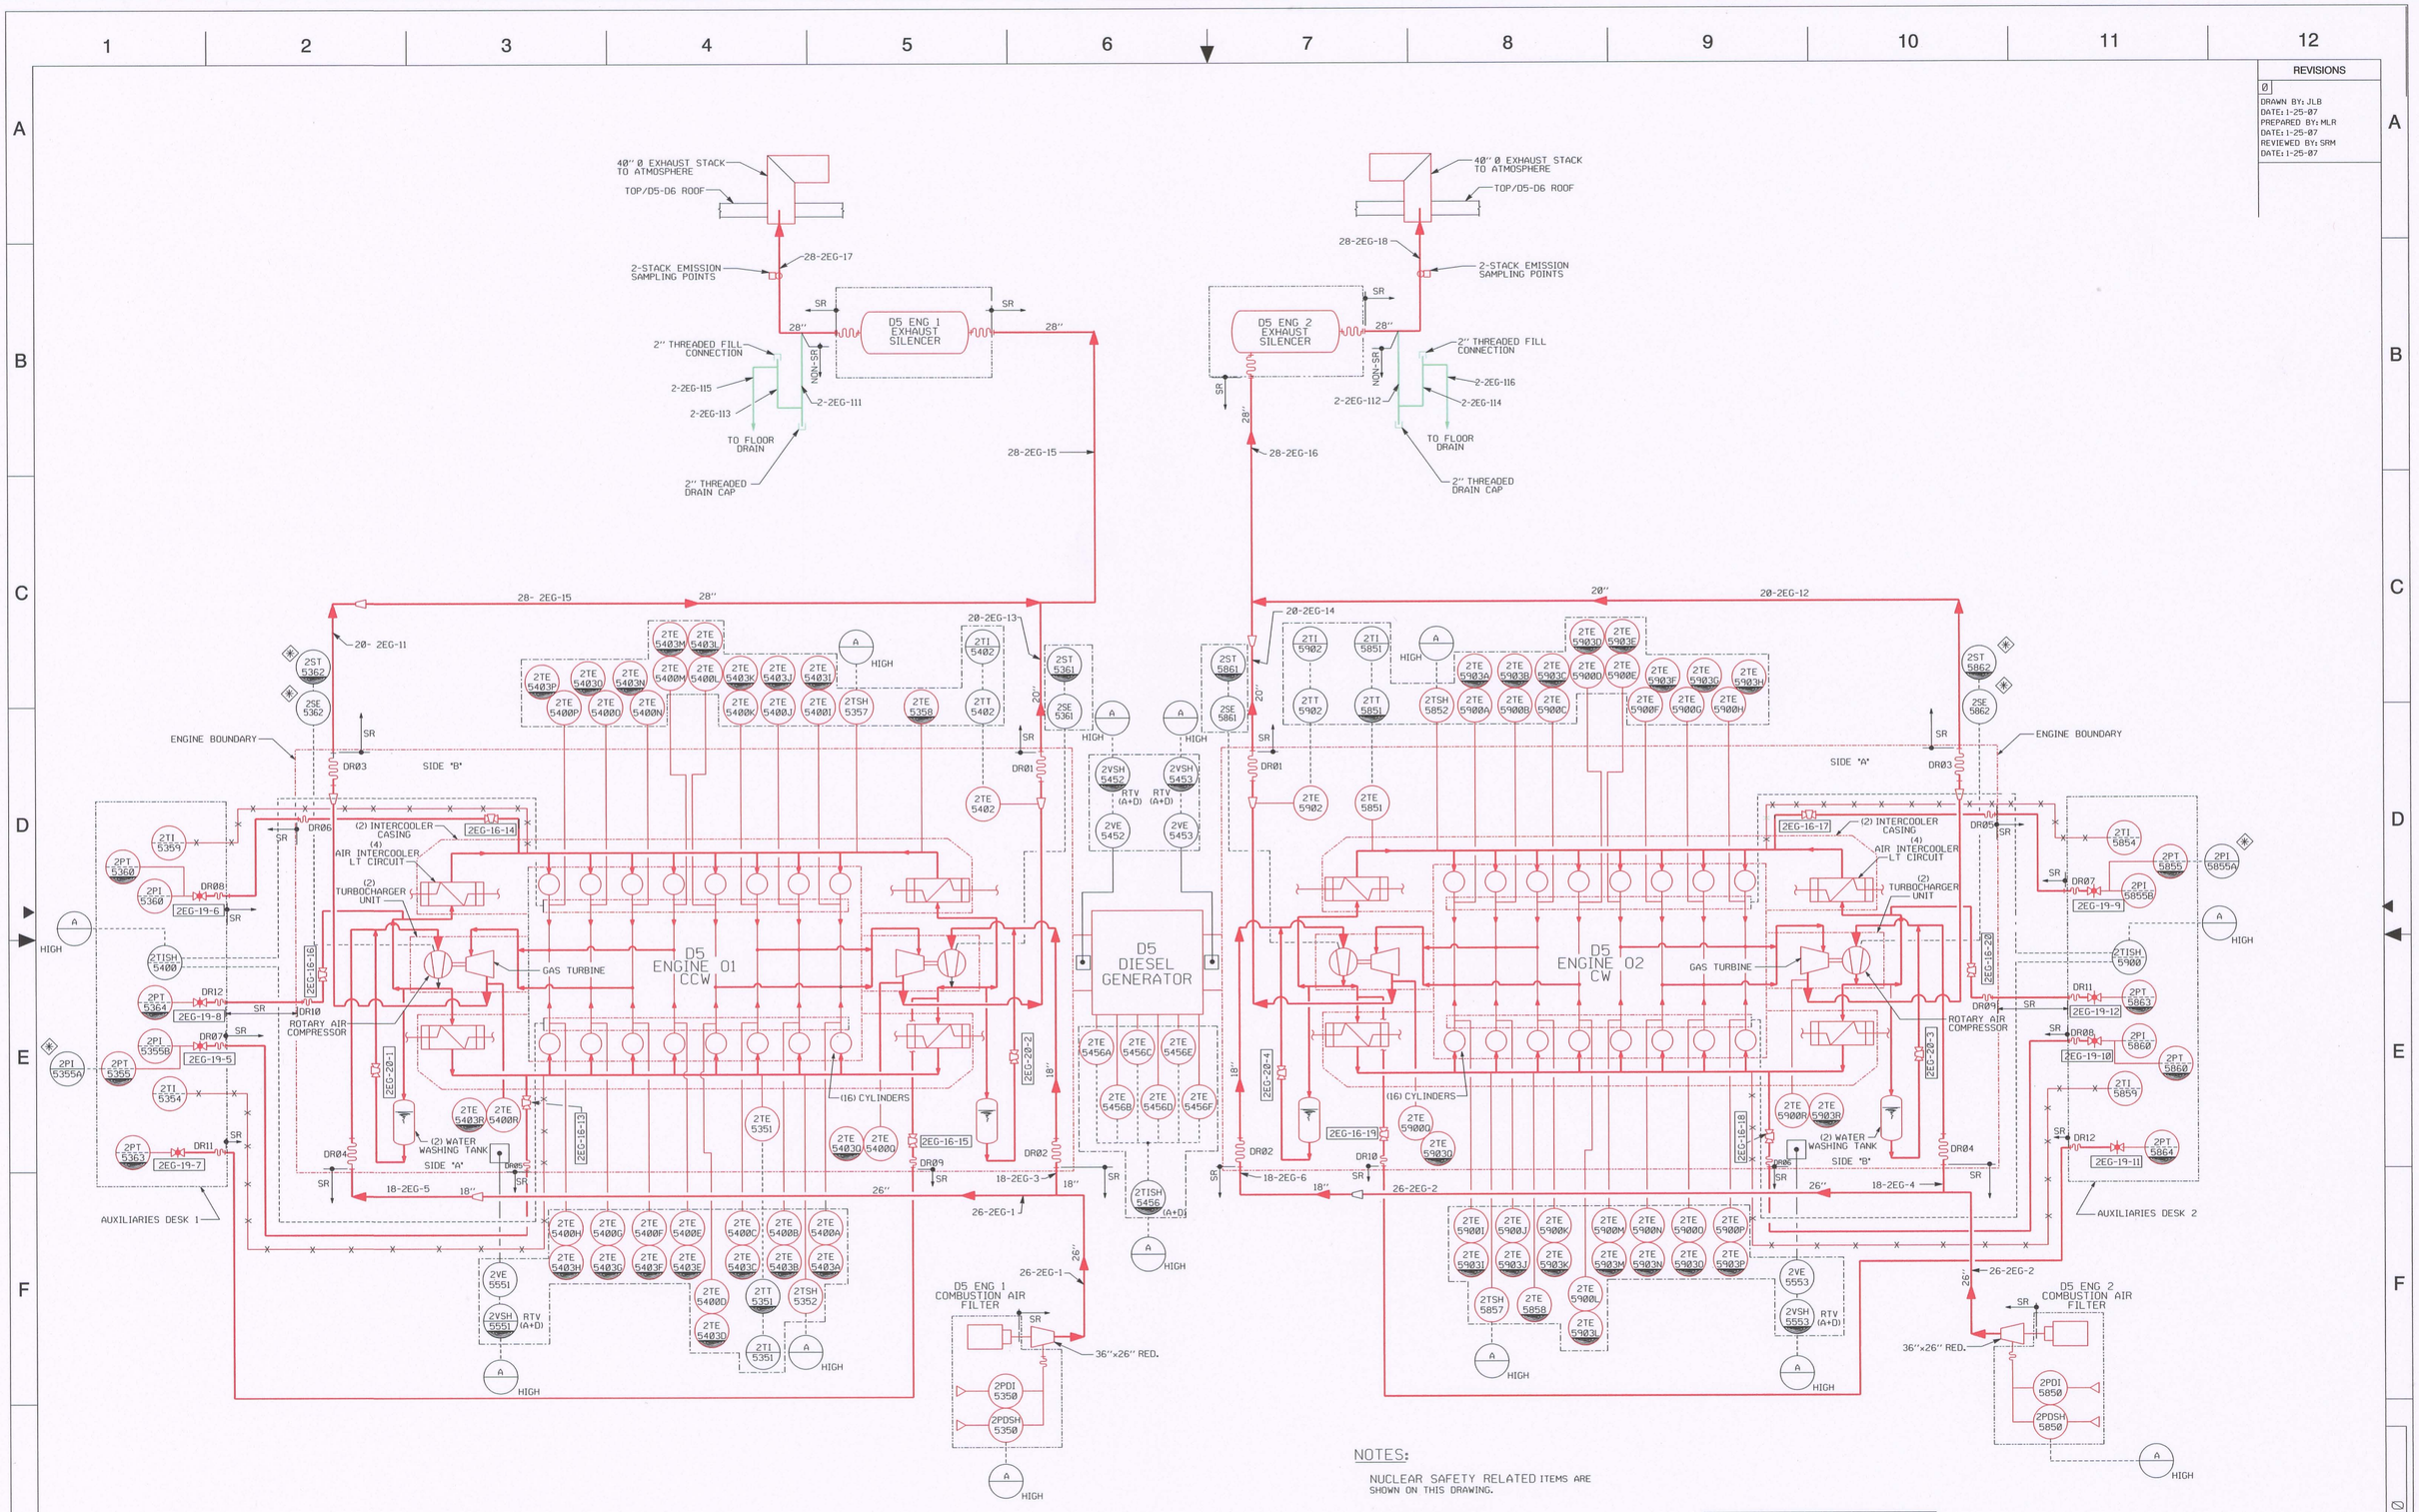

NOTES:

NUCLEAR SAFETY RELATED ITEMS ARE SHOWN ON THIS DRAWING.

REFER TO SPECS:

HIAW - 02400-66 (ERECTION)
HIAW - 02400-79 (SUPPORTS)
HIAW - 02400-80 (MATERIAL)
HIAW - 02400-81 (VALVES)

LEGEND :

- ◈ DENOTES VALVES AND INSTRUMENTS FURNISHED WITH EQUIPMENT BY SACM PER HIAW-02610. (MANUFACTURERS STANDARD).
- (A+D) DENOTES ANALOG & DIGITAL COMPUTER INPUT.
- ---------- DENOTES SACM MANUFACTURERS STANDARDS.
- SR DENOTES SAFETY RELATED ASME III
- NON-SR DENOTES NON-SAFETY RELATED ANSI B31.1
- -·-·-·- INSTRUMENTATION BOUNDED BY AND ENCLOSED BY THIS LINE REPRESENTS SACM SUPPLIED INSTRUMENTATION.

LR - LEGEND

- IN SCOPE FOR LR PER 10 CFR 54.4(a)(1) 10 CFR 54.4(a)(3)
- IN SCOPE FOR LR PER 10 CFR 54.4(a)(2)
- OUT OF SCOPE
- DENOTES SYSTEM BOUNDARY BREAK

LR - SYSTEM

DG - DIESEL GENERATOR & SUPPORT SYSTEMS

REFERENCE DWG NF-118240 REV. B

This map / document is a tool to assist employees in the performance of their jobs. Your personal safety is provided for by using safety practices, procedures and equipment as described in safety training programs, manuals and SPAR's.

DWN	DATE	SIGNIFICANT NO.	8630		4100	2	4410	1	2140
CHECKED		GROUP	1	2	3	4	5	CL	6
PROJECT NO.									
APP'D & CERT.									
FILMED									

LICENSE RENEWAL BOUNDARY DWG
FLOW DIAGRAM D5 - UNIT #2
COMBUSTION AIR INTAKE & EXHAUST

NORTHERN STATES POWER COMPANY
Xcel Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

SCALE | REV Ø
LR-118240

$$USERNAME$$
$$$$$$SYTIME$$$$$$$$$$$$SYDATE$$$$$$
$$$$$$$$$$DESIGNFIL$$$$$$$$$$

LR-118240.DGN [WSP GENERATION CAD]

D-096

LR-118240

...\Flows\LR-118240.DGN 1/26/2007 8:44:32 AM