LR-XH- 2-16A

REVISIONS
0
DRAWN BY: JLB DATE: 3-19-07 PREPARED BY: WJO DATE: 3-19-07 REVIEWED BY: SRM DATE: 3-19-07
1
ADDED (a)(3) LINES DRAWN BY: JLB DATE: 9-7-07 PREPARED BY: WJI DATE: 9-7-07 REVIEWED BY: SRM DATE: 9-14-07

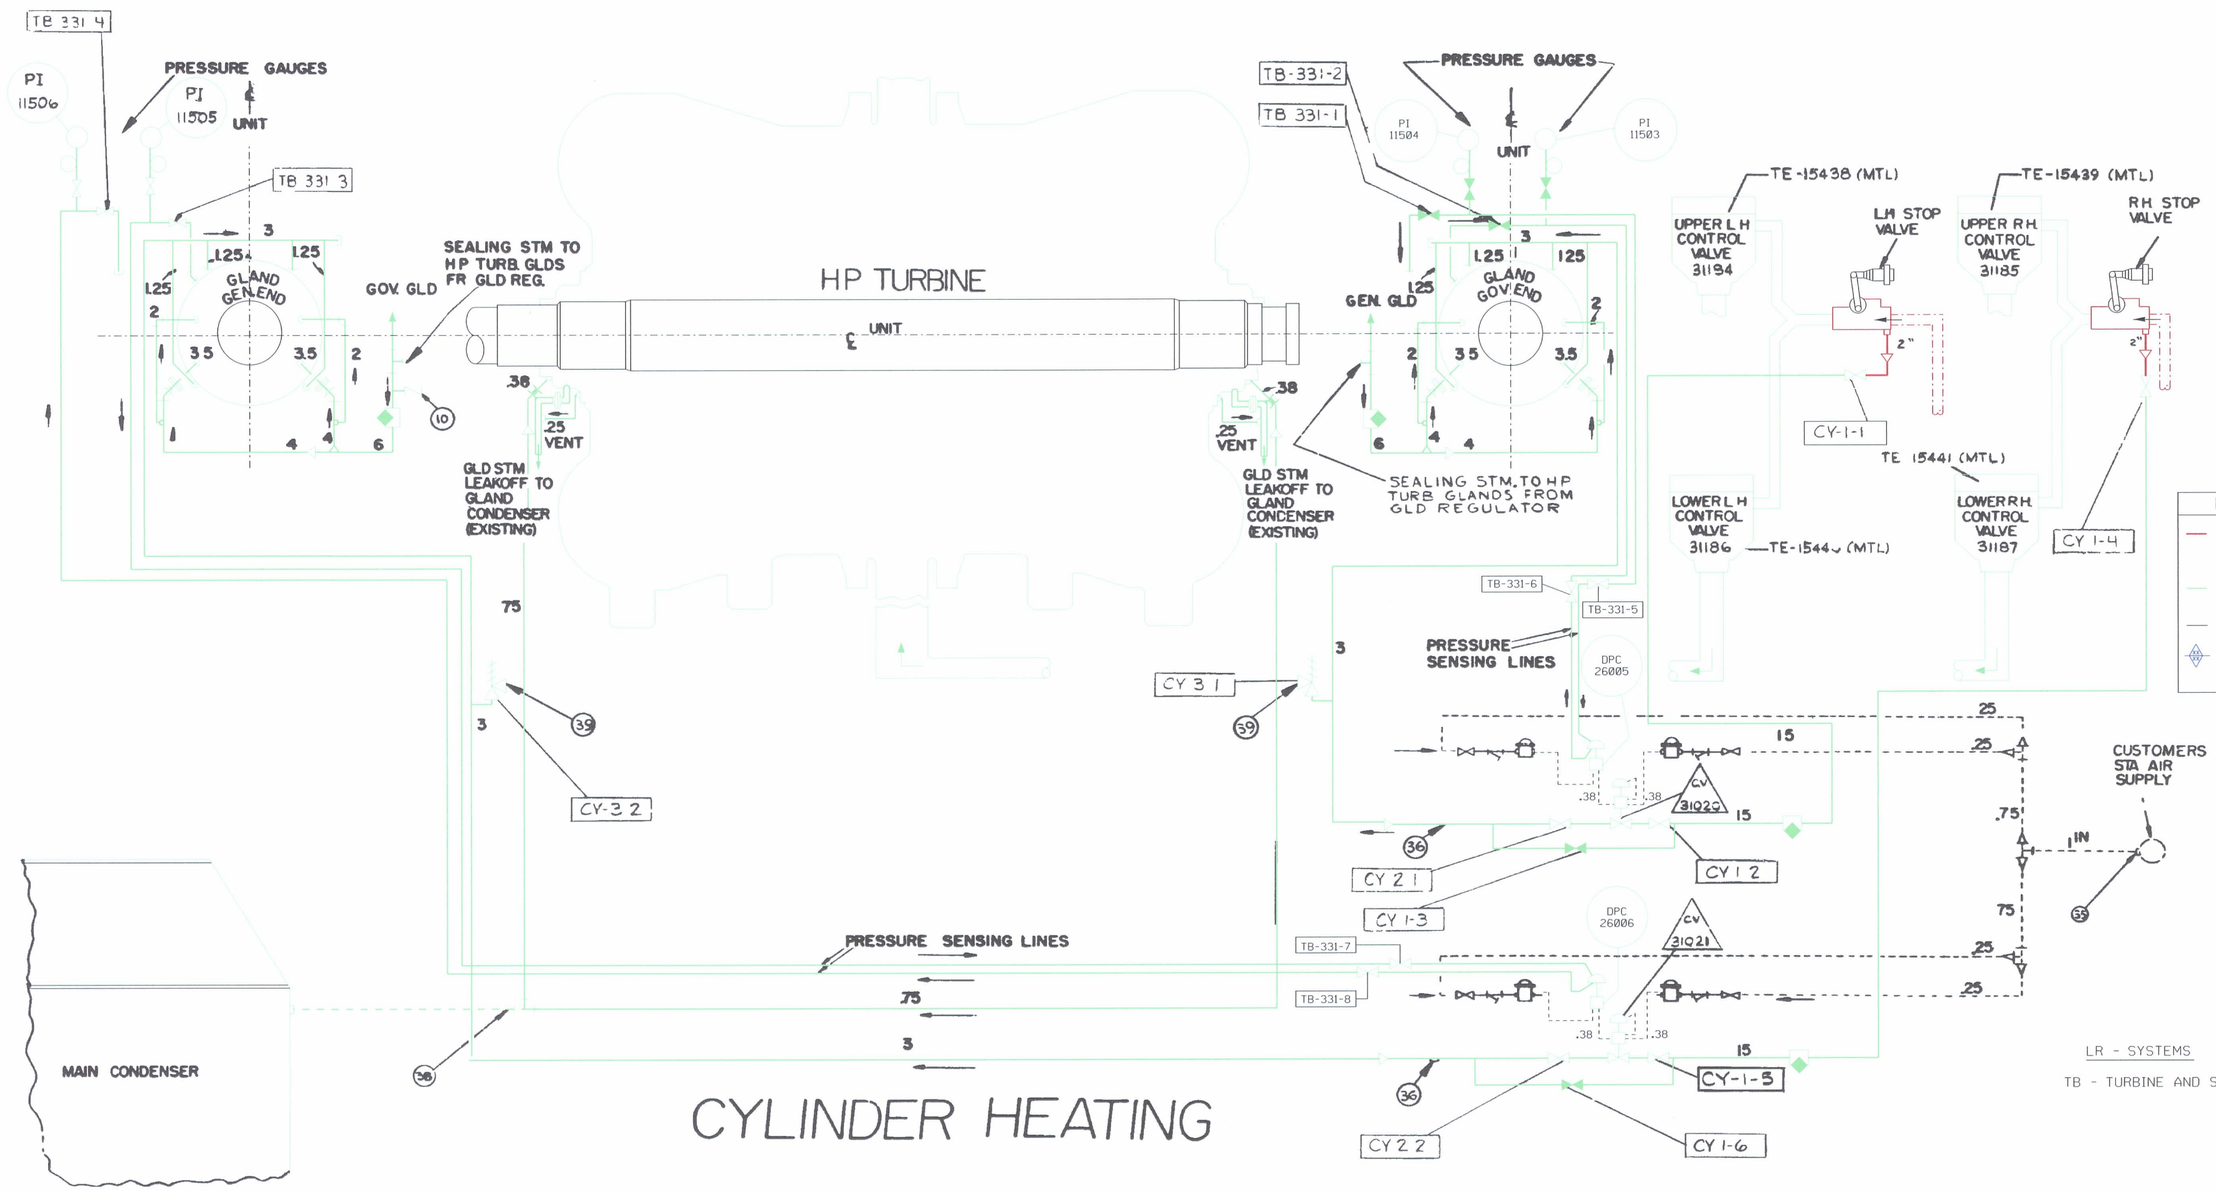

LR - LEGEND

- IN SCOPE FOR LR PER 10 CFR 54.4(a)(1) 10 CFR 54.4(a)(3)
- IN SCOPE FOR LR PER 10 CFR 54.4(a)(2)
- OUT OF SCOPE
- DENOTES SYSTEM BOUNDARY BREAK

LR - SYSTEMS

TB - TURBINE AND SUPPORT SYSTEMS

REFERENCE XH-2-16A REV. E

D-129

WESTINGHOUSE 719J856 3 OF 3

This map / document is a tool to assist employees in the performance of their jobs. Your personal safety is provided for by using safety practices, procedures and equipment as described in safety training programs, manuals and SPAR's.

DWN	DATE
CHECKED	
PROJECT NO.	
APP'D & CERT.	
FILMED	

SIGNIFICANT NO.	8630			1	M430 9071	1	
GROUP	1	2	3	4	5	CL	6

LICENSE RENEWAL BOUNDARY DWG
STEAM DRAIN AND GLAND
UNIT #1 PIPING - FLOW DIAGRAM

NORTHERN STATES POWER COMPANY
Xcel Energy
PRAIRIE ISLAND NUCLEAR GENERATING PLANT
RED WING, MINNESOTA

SCALE NONE | REV 1

LR-XH- 2-16A

LR-XH-2-16A.DGN NSP GENERATION CAD