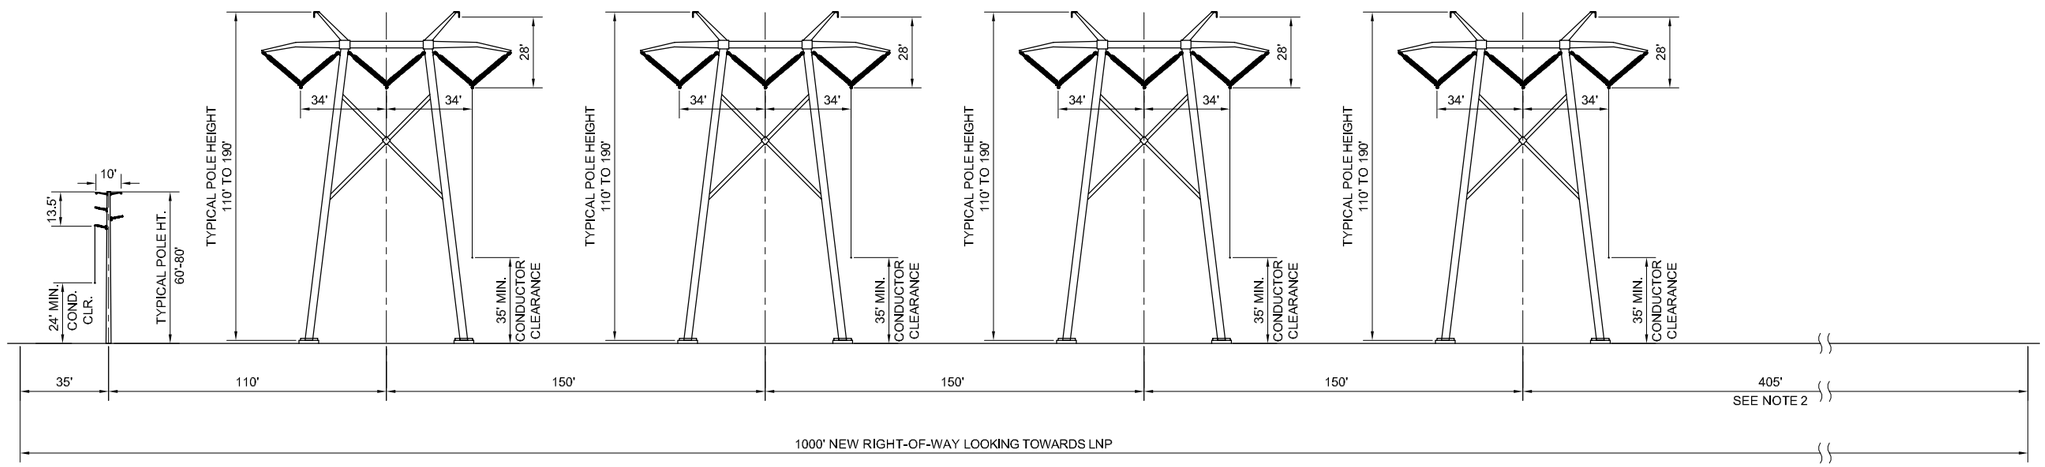

NOTE:

1. TYPICAL PIER FOUNDATION TO BE 5' TO 8' IN DIAMETER.
2. PROVISIONS FOR FUTURE TRANSMISSION LINES.

0 30 60
Feet

Progress Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 3, Environmental Report

Typical Tangent Steel H-Frame Structure on New Multi-Circuit Right-of-Way North of CR 40 with 69kV Line
FIGURE 3.7-9

Rev 0