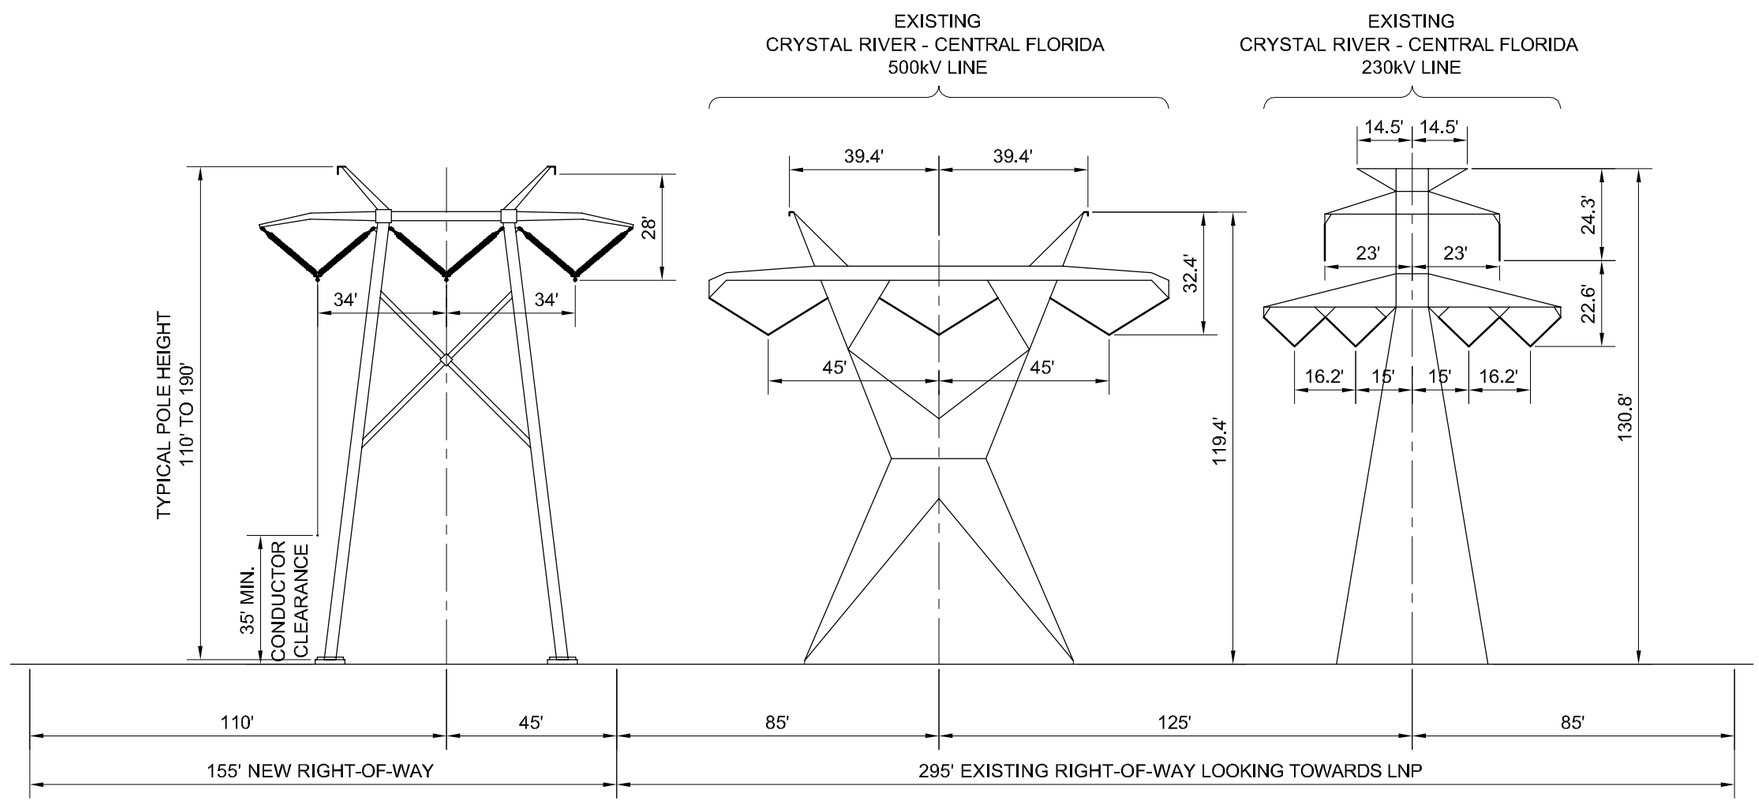

NOTE:
1. TYPICAL PIER FOUNDATION TO BE 5' TO 8' IN DIAMETER.

0 20 40
Feet

Progress Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 3, Environmental Report

Typical Tangent Steel H-Frame Structure
Parallel (Left) to Existing PEF 230/500kV Right-of-Way
FIGURE 3.7-19

Rev 0