LRM-208-3

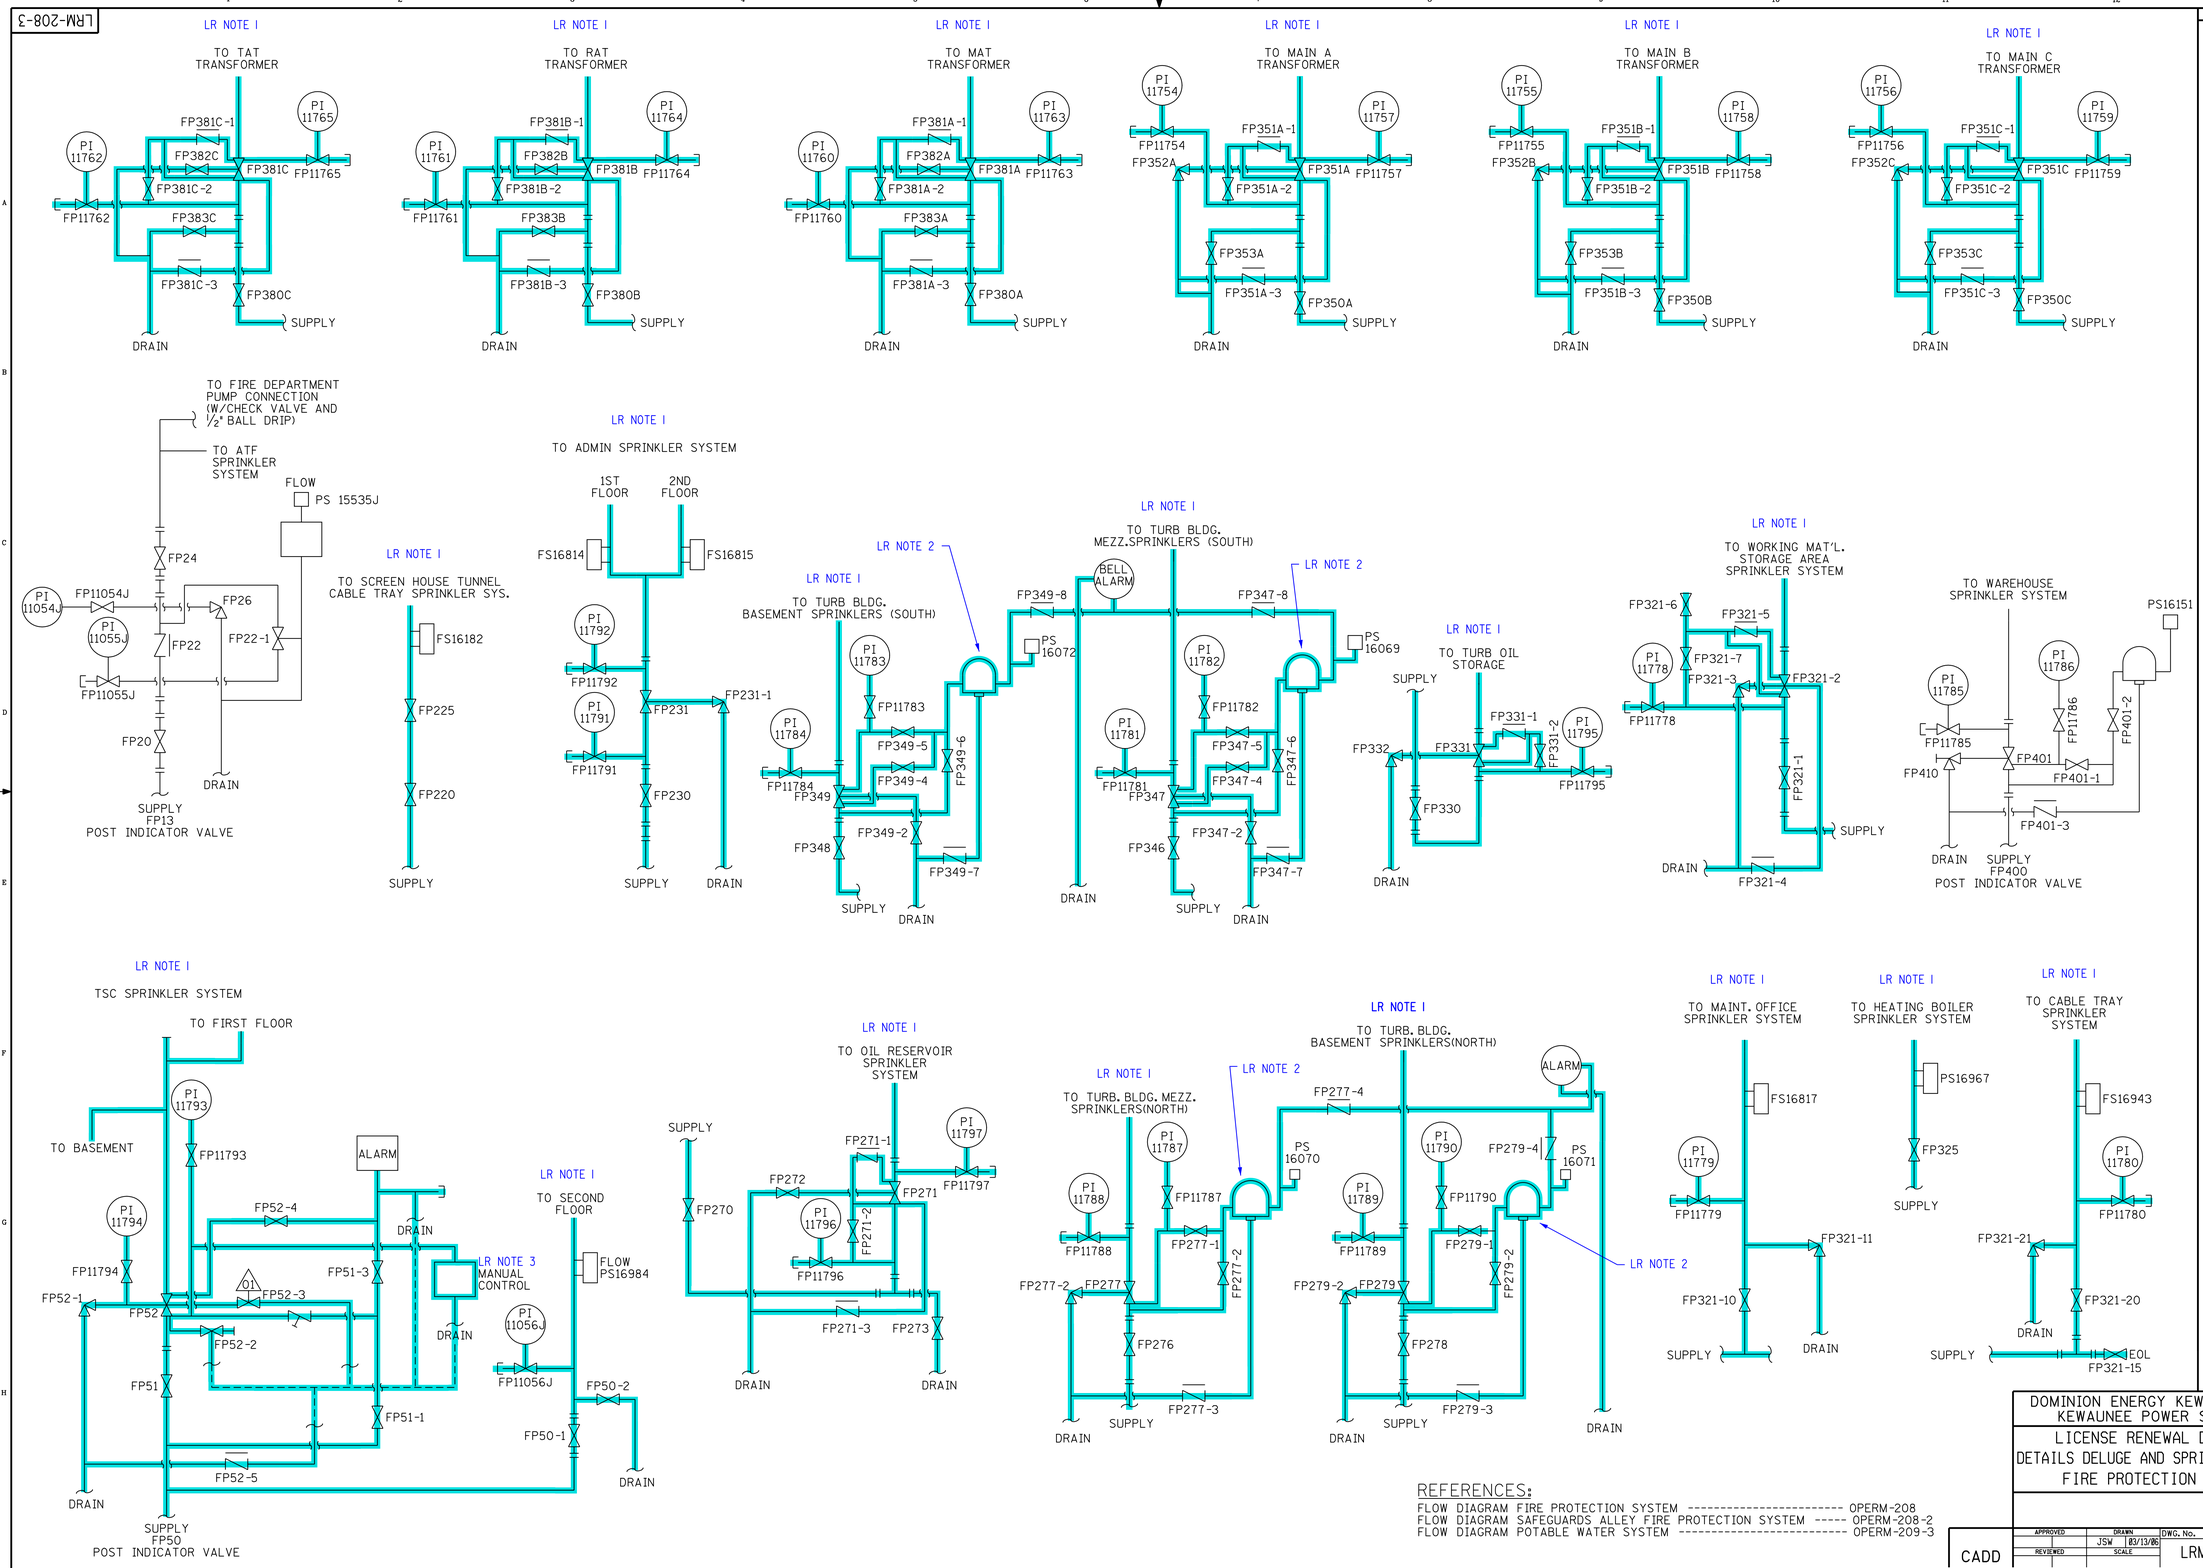

REVISION

LR NOTES:

1. PIPING, VALVES, SPRINKLERS AND NOZZLES SERVING THIS AREA ARE IN LR SCOPE BUT NOT SHOWN ON THIS DRAWING.
2. THIS COMPONENT SERVES AS A RETARDING CHAMBER.
3. THE MANUAL CONTROL STATION IS A MANUAL ACTUATION BY MANIPULATING A VALVE LEVER, AND IS INCLUDED IN THE COMPONENT GROUP VALVES.

LICENSE RENEWAL DRAWING LEGEND

Ø8/FP FIRE PROTECTION

IN SCOPE FOR LR PER 10CFR 54.4 (a)(2)

IN SCOPE FOR LR PER 10CFR 54.4 (a)(1) 10CFR 54.4 (a)(3)

REFERENCES:

FLOW DIAGRAM FIRE PROTECTION SYSTEM ---------- OPERM-208
FLOW DIAGRAM SAFEGUARDS ALLEY FIRE PROTECTION SYSTEM ----- OPERM-208-2
FLOW DIAGRAM POTABLE WATER SYSTEM ---------- OPERM-209-3

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
DETAILS DELUGE AND SPRINKLER VALVES
FIRE PROTECTION SYSTEM

CADD	APPROVED	DRAWN JSW 03/13/06	DWG. No. LRM-208-3	REV. 0
	REVIEWED	SCALE		

REFERENCED PER MASTER DRAWING OPERM-208-3 REV A

REV 'A' PER LAST UPDATE