


2-802-WB7

REVISION

- LR NOTES:
1. PIPING, VALVES, SPRINKLERS AND NOZZLES SERVING THIS AREA ARE IN LR SCOPE BUT NOT SHOWN ON THIS DRAWING.
 2. THIS COMPONENT SERVES AS A RETARDING CHAMBER.
 3. THE MANUAL CONTROL STATION IS A MANUAL ACTUATION BY MANIPULATING A VALVE LEVER, AND IS INCLUDED IN THE COMPONENT GROUP VALVES.

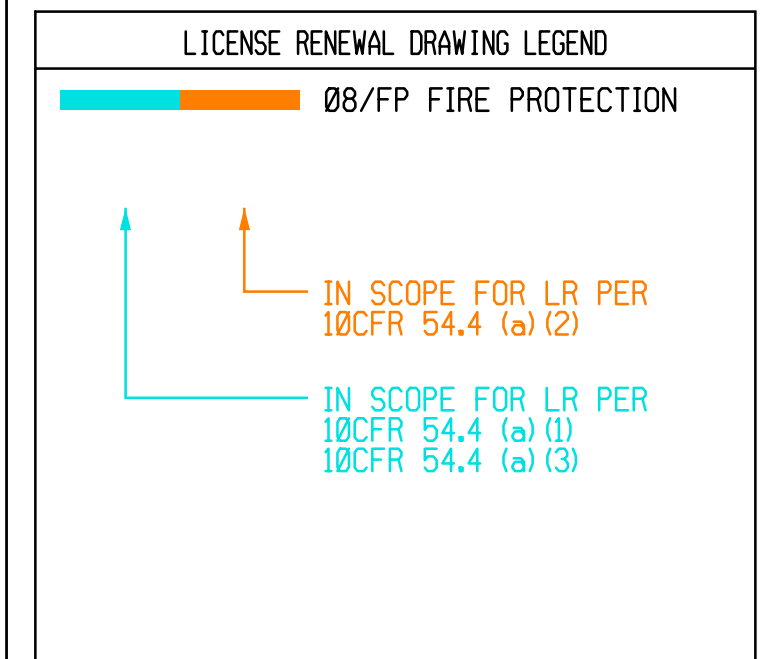

REFERENCES:
 FLOW DIAGRAM FIRE PROTECTION SYSTEM ----- OPERM-208
 FLOW DIAGRAM SAFEGUARDS ALLEY FIRE PROTECTION SYSTEM ----- OPERM-208-2
 FLOW DIAGRAM POTABLE WATER SYSTEM ----- OPERM-209-3

DOMINION ENERGY KEWAUNEE, INC.
 KEWAUNEE POWER STATION
 LICENSE RENEWAL DRAWING
 DETAILS DELUGE AND SPRINKLER VALVES
 FIRE PROTECTION SYSTEM

APPROVED	DRAWN	DATE	REV.
CADD	JSW	02/13/00	0
REVIEWED	SCALE	LRM-208-3	0

REFERENCED PER MASTER DRAWING	REV
OPERM-208-3	A

REV 'A' PER LAST UPDATE