


LR NOTES:

1. ONLY PRESSURIZED PIPING/COMPONENTS ARE INCLUDED IN SCOPE. THE REST OF THE SYSTEM COMPONENTS ARE NOT CAPABLE (GRAVITY FLOW OF DRIPPING OR LEAKING ON OR FALLING ON ANY SAFETY RELATED COMPONENT. THESE COMPONENTS ARE LOCATED IN THE NORTHERN PART OF TURBINE BUILDING BASEMENT.
2. BOUNDARY ENDS AS PIPING ENTERS TURBINE OIL STORAGE TANK ROOM, THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.

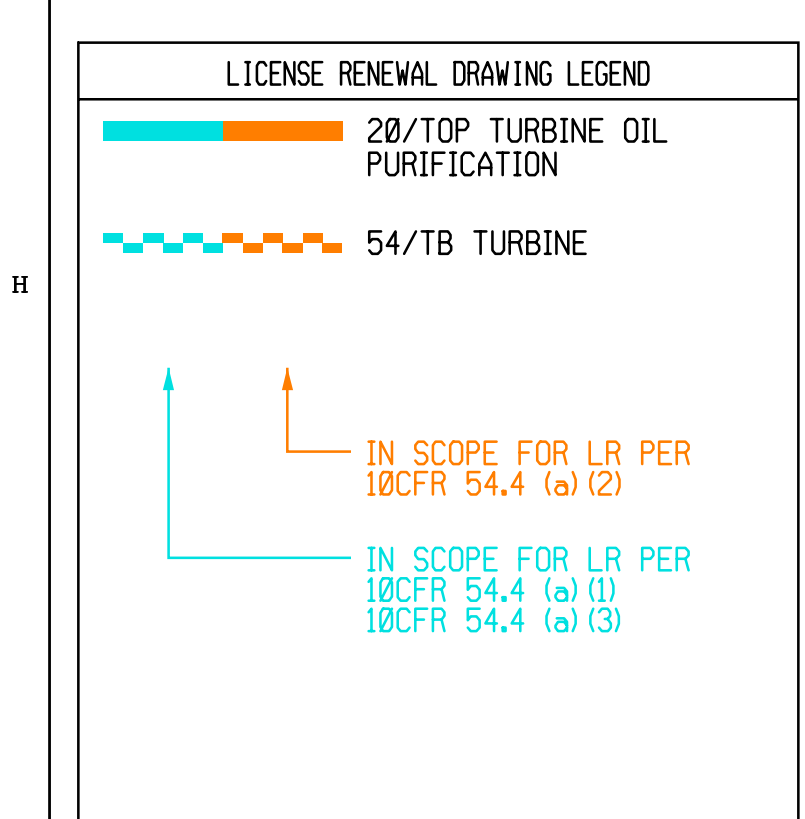

DOMINION ENERGY KEWAUNEE, INC.  
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING  
TURBINE OIL PURIFICATION

APPROVED	DRAWN	OWG. NO.	REV.
REVIEWED	SCALE	LRM-210	0

HYBRID CADD