


NOTES:

1. ALL INSTRUMENT AIR COMPONENTS PROVIDE A QA-2 BOUNDARY UNLESS NOTED. THE COMPONENTS SUPPLIED WITH INSTRUMENT AIR ALONG WITH THEIR ASSOCIATED SOLENOID VALVES MAY PERFORM A QA-1 FUNCTION.
2. FIVE DIGIT FILTER/REGULATORS NUMBERED 36014 THROUGH 36088 ARE QA 1.

- LR NOTES:
1. THERE IS A CHECK VALVE IN THE PIPING BETWEEN THE ACCUMULATOR AND VALVE IA-31659.
 2. POSITIONERS ARE CONSIDERED PART OF THE ACTUATORS WHICH ARE TREATED AS 'ACTIVE' COMPONENTS AND THEREFORE DO NOT REQUIRE AGING MANAGEMENT REVIEW.
 3. THE INSTRUMENT AIR TUBING HAS BEEN CONSERVATIVELY INCLUDED IN SCOPE UP TO THE AIR-OPERATED VALVES AND DAMPERS SHOWN ON THIS DRAWING. REFER TO THE APPLICABLE LR DRAWING FOR THE SYSTEMS IN WHICH THE VALVES AND DAMPERS ARE LOCATED, TO DETERMINE WHICH ONES ARE INCLUDED IN SCOPE.
 4. THE PANELS/CABINET (EXCLUDING THE INTERNAL COMPONENTS) ON THIS DRAWING HAVE BEEN CONSERVATIVELY INCLUDED IN LR SCOPE. THEY HAVE NOT BEEN HIGHLIGHTED BECAUSE THEY ARE BEING HANDLED AS A STRUCTURAL COMMODITY.
 5. THE MIXED BED PNEUMATIC CONTROL EQUIPMENT HAS BEEN VALVED OUT AND WILL BE REMOVED BY DCR 3484 (PHASE III).
 6. ABANDONED IN PLACE.

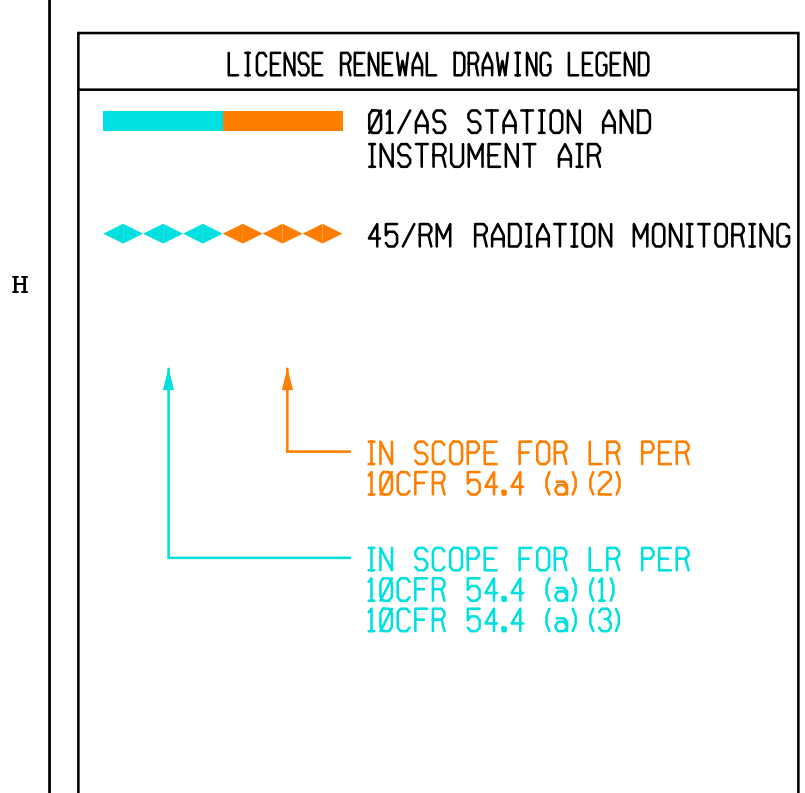

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
STATION & INSTRUMENT AIR SYSTEM

APPROVED	DRAWN	OWG. NO.	REV.
CADD	JSW	180/14/80	0
REVIEWED	SCALE	LRM-213-7	