
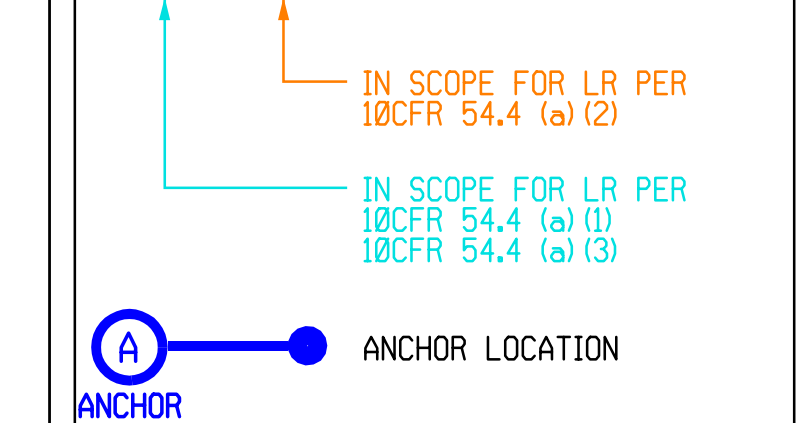


**TABLE 1
CHEMICAL INJECTION SYSTEM
CONTROL ROOM SER POINTS AND ANNUNCIATOR**

TANK	LEVEL SWITCH	LOW LEVEL SER POINT	LOW LEVEL SER POINT	CONTROL ROOM ANNUNCIATOR
AFW HYDRAZINE	I6633	4900I133	4900I151	4705J
CD HYDRAZINE	I6632	4900I132	4900I151	4705J
MORPHOLINE	I6631	4900I131	4900I151	4705J
S/G A BORIC ACID	I6748	4900I807	4900I151	4705J
S/G B BORIC ACID	I6749	4900I821	4900I151	4705J

LR NOTES:

- BOUNDARY ENDS WHERE PIPING ENTERS THE MACHINE SHOP FROM TURBINE BUILDING.
- FOR LR PURPOSES, VALVES WITH A 'CI' (CHEMICAL INJECTION) DESIGNATOR HAVE BEEN ASSIGNED TO THE SYSTEMS THEY SERVE.

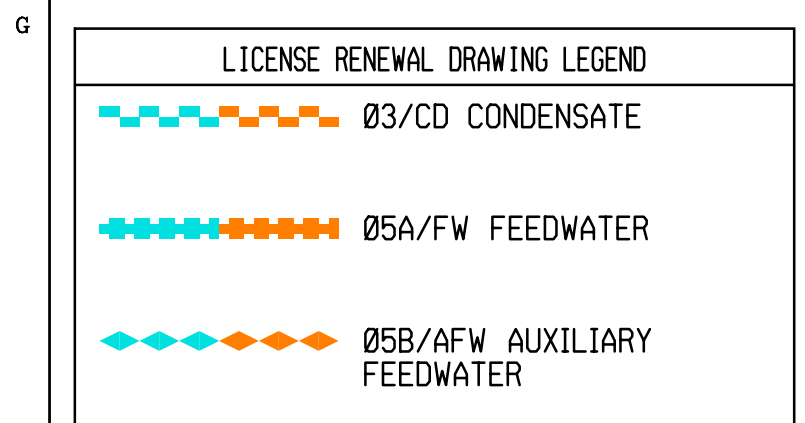

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
CHEMICAL INJECTION SYSTEM

APPROVED	DRAWN	DWG. NO.	REV.
REVIEWED	SCALE	LRM-214	0