


- LR NOTES:**
1. THE STEEL INTAKE STRUCTURE (INCLUDING THE CONNECTING 72" PIPING), DISCHARGE TUNNEL, DISCHARGE STRUCTURE AND THE 120 INCH CIRCULATING WATER DISCHARGE PIPING (FROM THE DISCHARGE TUNNEL TO THE DISCHARGE STRUCTURE) ARE INCLUDED IN THE CIVIL SCOPE OF WORK.
 2. THE COMPONENTS ARE SEPARATED FROM SAFETY RELATED COMPONENTS BY MAIN CONDENSER AND MAIN LUBE OIL RESERVOIR, (NORTH EAST SECTION OF TURBINE BUILDING BASEMENT)
 3. LINES ARE AT ATMOSPHERIC PRESSURE AND CAN NOT LEAK ON SAFETY RELATED COMPONENTS.
 4. BURIED / BELOW GRADE PIPING, NO SPATIAL CONCERN.
 5. 6" DRAIN PIPE LOCATED BEHIND THE WASTE NEUTRALIZING TANK IN THE SOUTHEAST CORNER OF THE AUX BUILDING BASEMENT, THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.
 6. DRAIN LOCATED IN CIRCULATING WATER PUMP PIT AREA BELOW ALL SAFETY RELATED COMPONENTS.
 7. THE SUPPORT FRAME AND THE COVERS ARE INCLUDED IN THE CIVIL SCOPE OF LR.

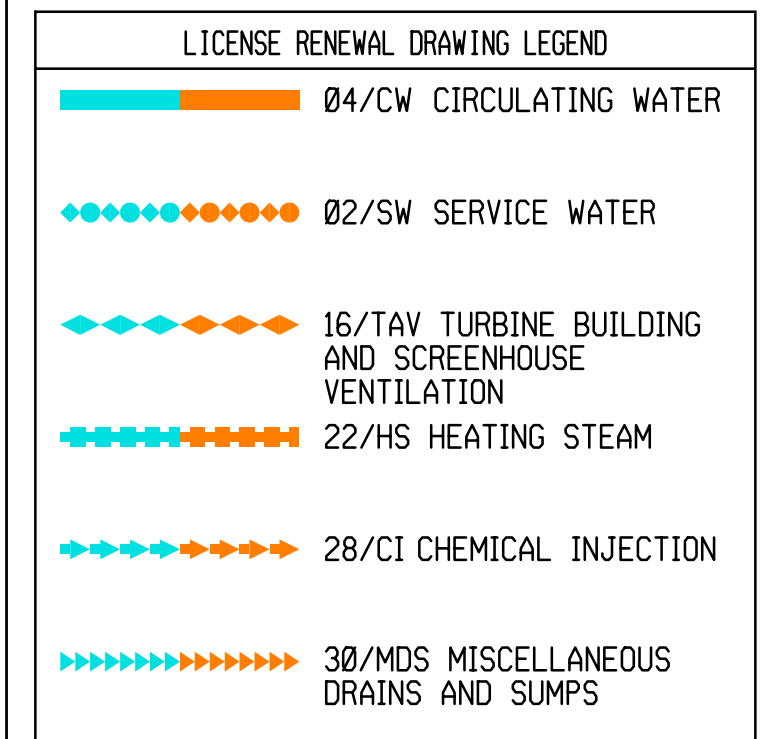

- NOTES:**
- 1) SEE M-758 SERIES FOR ADDITIONAL INSTRUMENTS ON MAJOR COMPONENTS
 - 2) ROOT VALVE NUMBERS WILL NOT BE SHOWN ON THIS DRAWING. THE OPERATION VALVE NUMBER CONTAINS THE SYSTEM DESIGNATOR FOLLOWED BY THE INSTRUMENT NUMBER (i.e., SW-11007).
 - 3) DCR 3488 INSTALLED A TWO (2) INCH VENT LINE USING THE HOT TAP PROCESS WITH A TWO INCH BALL VALVE AS THE HOT TAP ISOLATION VALVE. THIS VALVE WAS BOLTED/LOCKED IN THE OPEN POSITION AND BURIED. SINCE THE VALVE IS NOT ACCESSIBLE, IT CAN NOT CHANGE POSITION, NO VALVE NUMBER(S) ARE ASSIGNED.

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION
LICENSE RENEWAL DRAWING
CIRCULATING WATER SYSTEM

APPROVED	DRAWN	DATE	REV.
CADD	JSW	02/08/00	0
REVIEWED	SCALE	LRM-215	