


LR NOTE 3

- LR NOTES:
1. FOR LR PURPOSES THE IN SCOPE COMPONENTS DOWNSTREAM OF THE FIRST VALVE ON EACH LINE USED TO TAKE A SAMPLE ARE ASSIGNED TO SYSTEM 29 SECONDARY SAMPLING.
  2. LOCATED IN THE TURBINE BUILDING BASEMENT BELOW THE LEVEL OF ALL SAFETY RELATED COMPONENTS.
  3. EQUIPMENT LOCATED IN THE TURBINE BUILDING BASEMENT SOUTH EAST SIDE, THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.

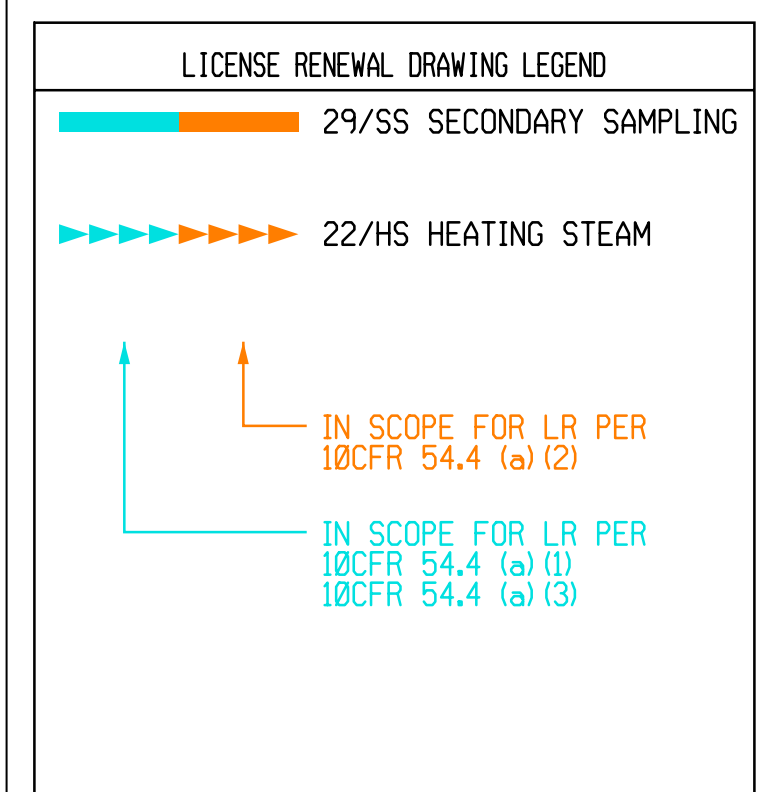

DOMINION ENERGY KEWAUNEE, INC.  
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING  
SECONDARY SAMPLING SYSTEMS

APPROVED	DRAWN	DWG. NO.	REV.
CADD	JSW	LRM-219-1	0
REVIEWED	SCALE		

REFERENCED PER MASTER DRAWING	REV
OPERM-219-1	(-)
REV *	*PER LAST UPDATE