LRM- 219-I

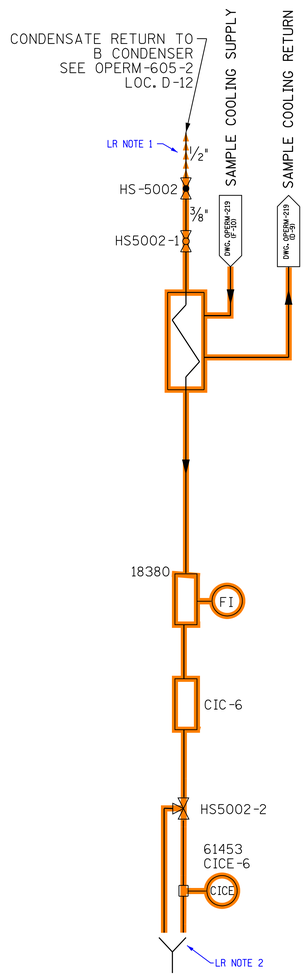

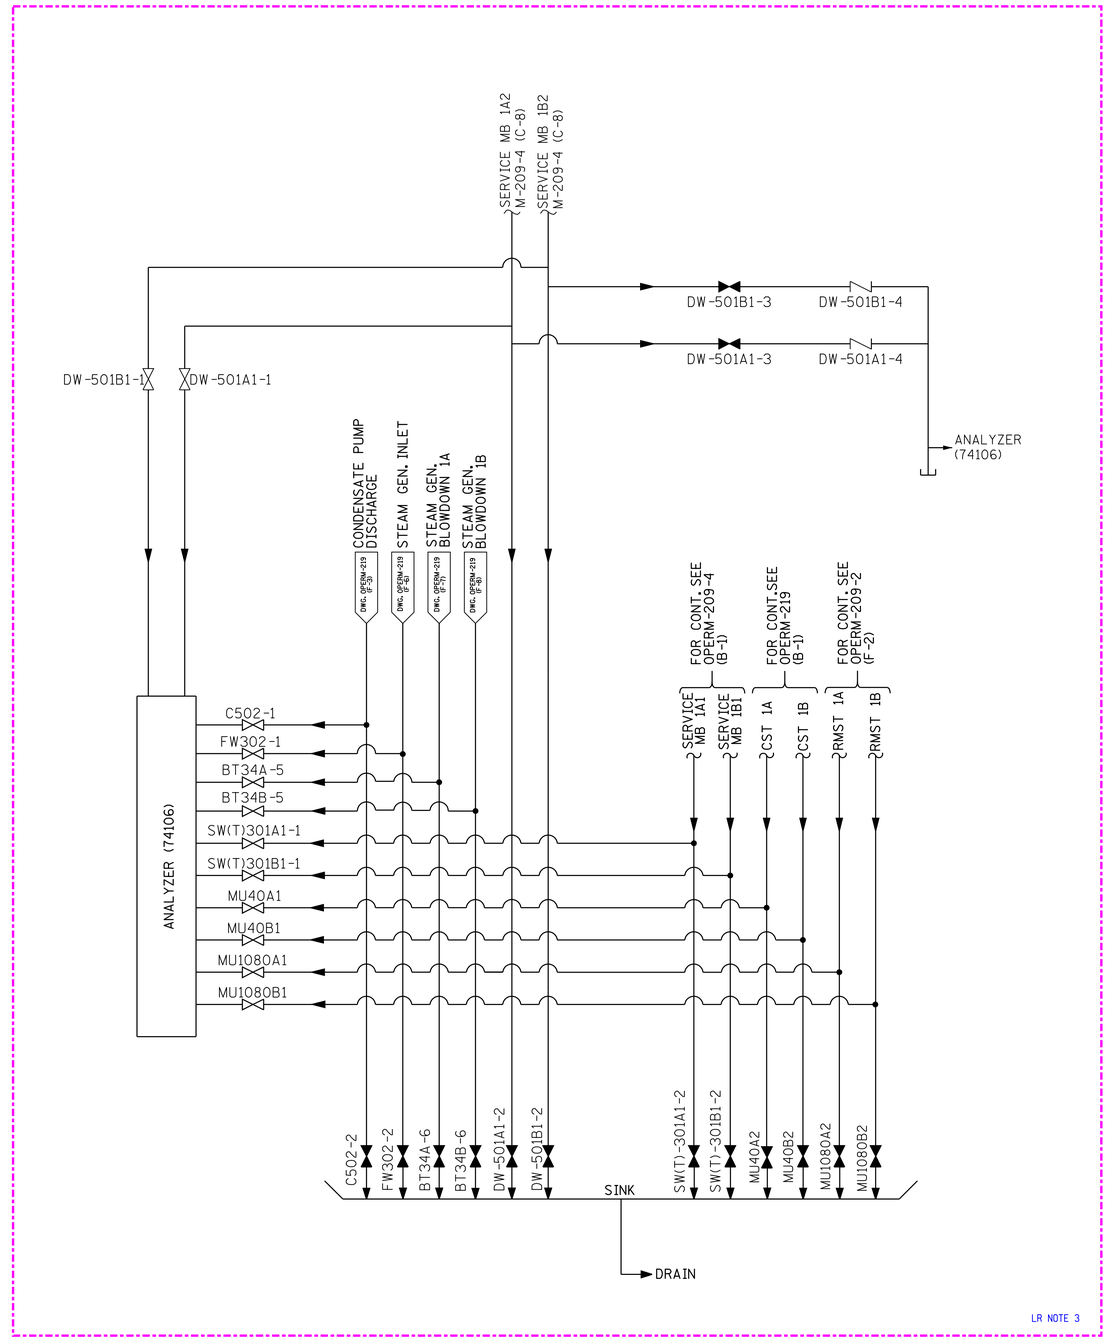

REVISION

LR NOTES:

1. FOR LR PURPOSES THE IN SCOPE COMPONENTS DOWNSTREAM OF THE FIRST VALVE ON EACH LINE USED TO TAKE A SAMPLE ARE ASSIGNED TO SYSTEM 29 SECONDARY SAMPLING.
2. LOCATED IN THE TURBINE BUILDING BASEMENT BELOW THE LEVEL OF ALL SAFETY RELATED COMPONENTS.
3. EQUIPMENT LOCATED IN THE TURBINE BUILDING BASEMENT SOUTH EAST SIDE. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.

LICENSE RENEWAL DRAWING LEGEND

29/SS SECONDARY SAMPLING

22/HS HEATING STEAM

IN SCOPE FOR LR PER 10CFR 54.4 (a)(2)

IN SCOPE FOR LR PER 10CFR 54.4 (a)(1) 10CFR 54.4 (a)(3)

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
SECONDARY SAMPLING SYSTEMS

CADD	APPROVED	DRAWN JSW 05/13/08	DWG. No.	REV.
	REVIEWED	SCALE	LRM- 219-I	0

REFERENCED PER MASTER DRAWING OPERM-219-1 REV (-)

REV * *PER LAST UPDATE