


- LR NOTES:**
1. ALL EQUIPMENT IS LOCATED ON THE SOUTH SIDE OF THE AUXILIARY BUILDING AT BASEMENT AND MEZZANINE LEVELS. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THESE AREAS.
 2. COMPONENTS ARE LOCATED SOUTH OF THE AUXILIARY BUILDING AND MOST ARE LOCATED BELOW GRADE LEVEL. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.
 3. DIESEL ENGINE AND GENERATOR ARE CONSIDERED ACTIVE COMPONENTS AND DO NOT REQUIRE AN AMR.
 4. RISER IS INCLUDED IN COMPONENT GROUP 'PIPE'.
 5. LEVEL ALARM FLOAT CHAMBER IS INCLUDED IN COMPONENT GROUP 'PIPE'.

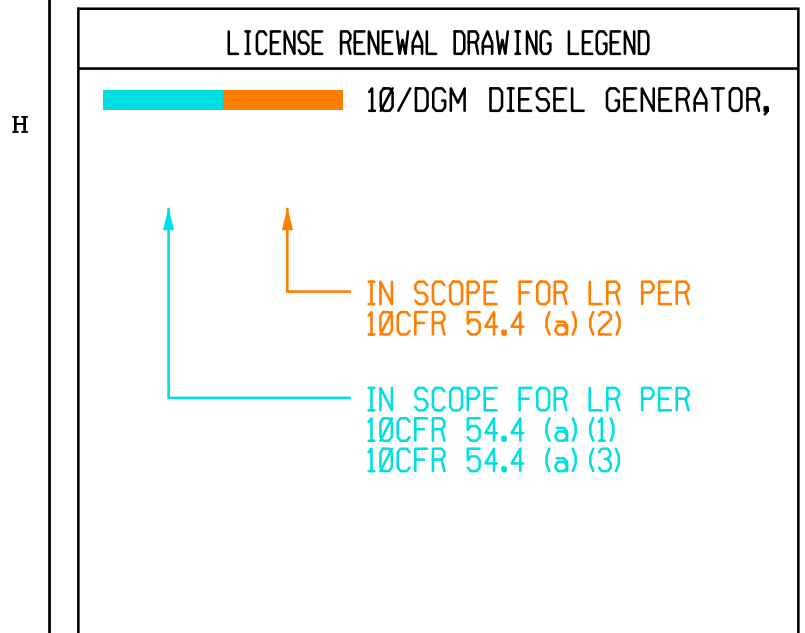

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
FUEL OIL SYSTEMS

APPROVED: JSW 11/28/00
DRAWN: JSW 11/28/00
SCALE: LRM-220
REV: 0

HYBRID CADD