


- LR NOTES:**
- BOUNDARY ENDS WHERE PIPING ENTERS FLOOR OF SGBT TANK ROOM.
  - THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.
  - PIPING LEAVES TURBINE BUILDING AND ENTERS SGBT TANK ROOM. THERE ARE NO SAFETY RELATED COMPONENTS IN THE SGBT TANK ROOM.
  - BOUNDARY ENDS WHERE PIPE EXITS THE ROOF.
  - PIPING IS IN SCOPE FOR SPATIAL WHEN IT ENTERS BUS 1 & 2 AREA.
  - THE PIPING IS LOCATED BELOW THE BASEMENT FLOOR LEVEL AND THEREFORE IS NOT A SPATIAL CONCERN.
  - LINE 7 INDICATES CUBICLE. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THIS AREA.

**LICENSE RENEWAL DRAWING LEGEND**

	07/BT STEAM GENERATOR BLOWDOWN TREATMENT
	04/CW CIRCULATING WATER
	27A/MUP MAKE-UP AND DEMINERALIZED WATER
	30/MDS MISCELLANEOUS DRAINS AND SUMPS
	32A/WD-LI LIQUID WASTE PROCESSING AND DISCHARGE
	35/CVC CHEMICAL & VOLUME CONTROL
	45/RM RADIATION MONITORING

- NOTES:**
- DRAINS TO TRENCH TERMINATE IN SUMP TANK
  - VALVES ARE SHOWN WITH SGBT SYSTEM IN ITS NORMAL OPERATING MODE. SGBT SYSTEM IS NOT OPERATING DURING NORMAL PLANT OPERATION.
  - ALL PIPING THIS SHEET IS G.A. TYPE 3, EXCEPT AS OTHERWISE NOTED.
  - ROOT VALVE NUMBERS WILL NOT BE SHOWN ON THIS DRAWING. THE OPERATION VALVE NUMBER CONTAINS THE SYSTEM DESIGNATOR FOLLOWED BY THE INSTRUMENT NUMBER (E.G., SW-11007).
  - NORMAL POSITION CLOSED PER CAP 027516
- \* GATE VALVE WITH 3/8" DIA. HOLE THRU DISC.

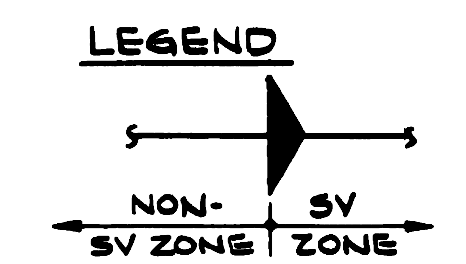

DOMINION ENERGY KEWAUNEE, INC.  
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING  
STEAM GENERATOR  
BLOWDOWN TREATMENT SYSTEM

HYBRID CADD	APPROVED	DRAWN	DWG. NO.	REV.
		JSW	18287/80	0
	REVIEWED	SCALE	LRM-368	

REFERENCED PER MASTER DRAWING: OPERM-368

REV. AK

REV. 'AK' PER LAST UPDATE