LRM-385

REVISION

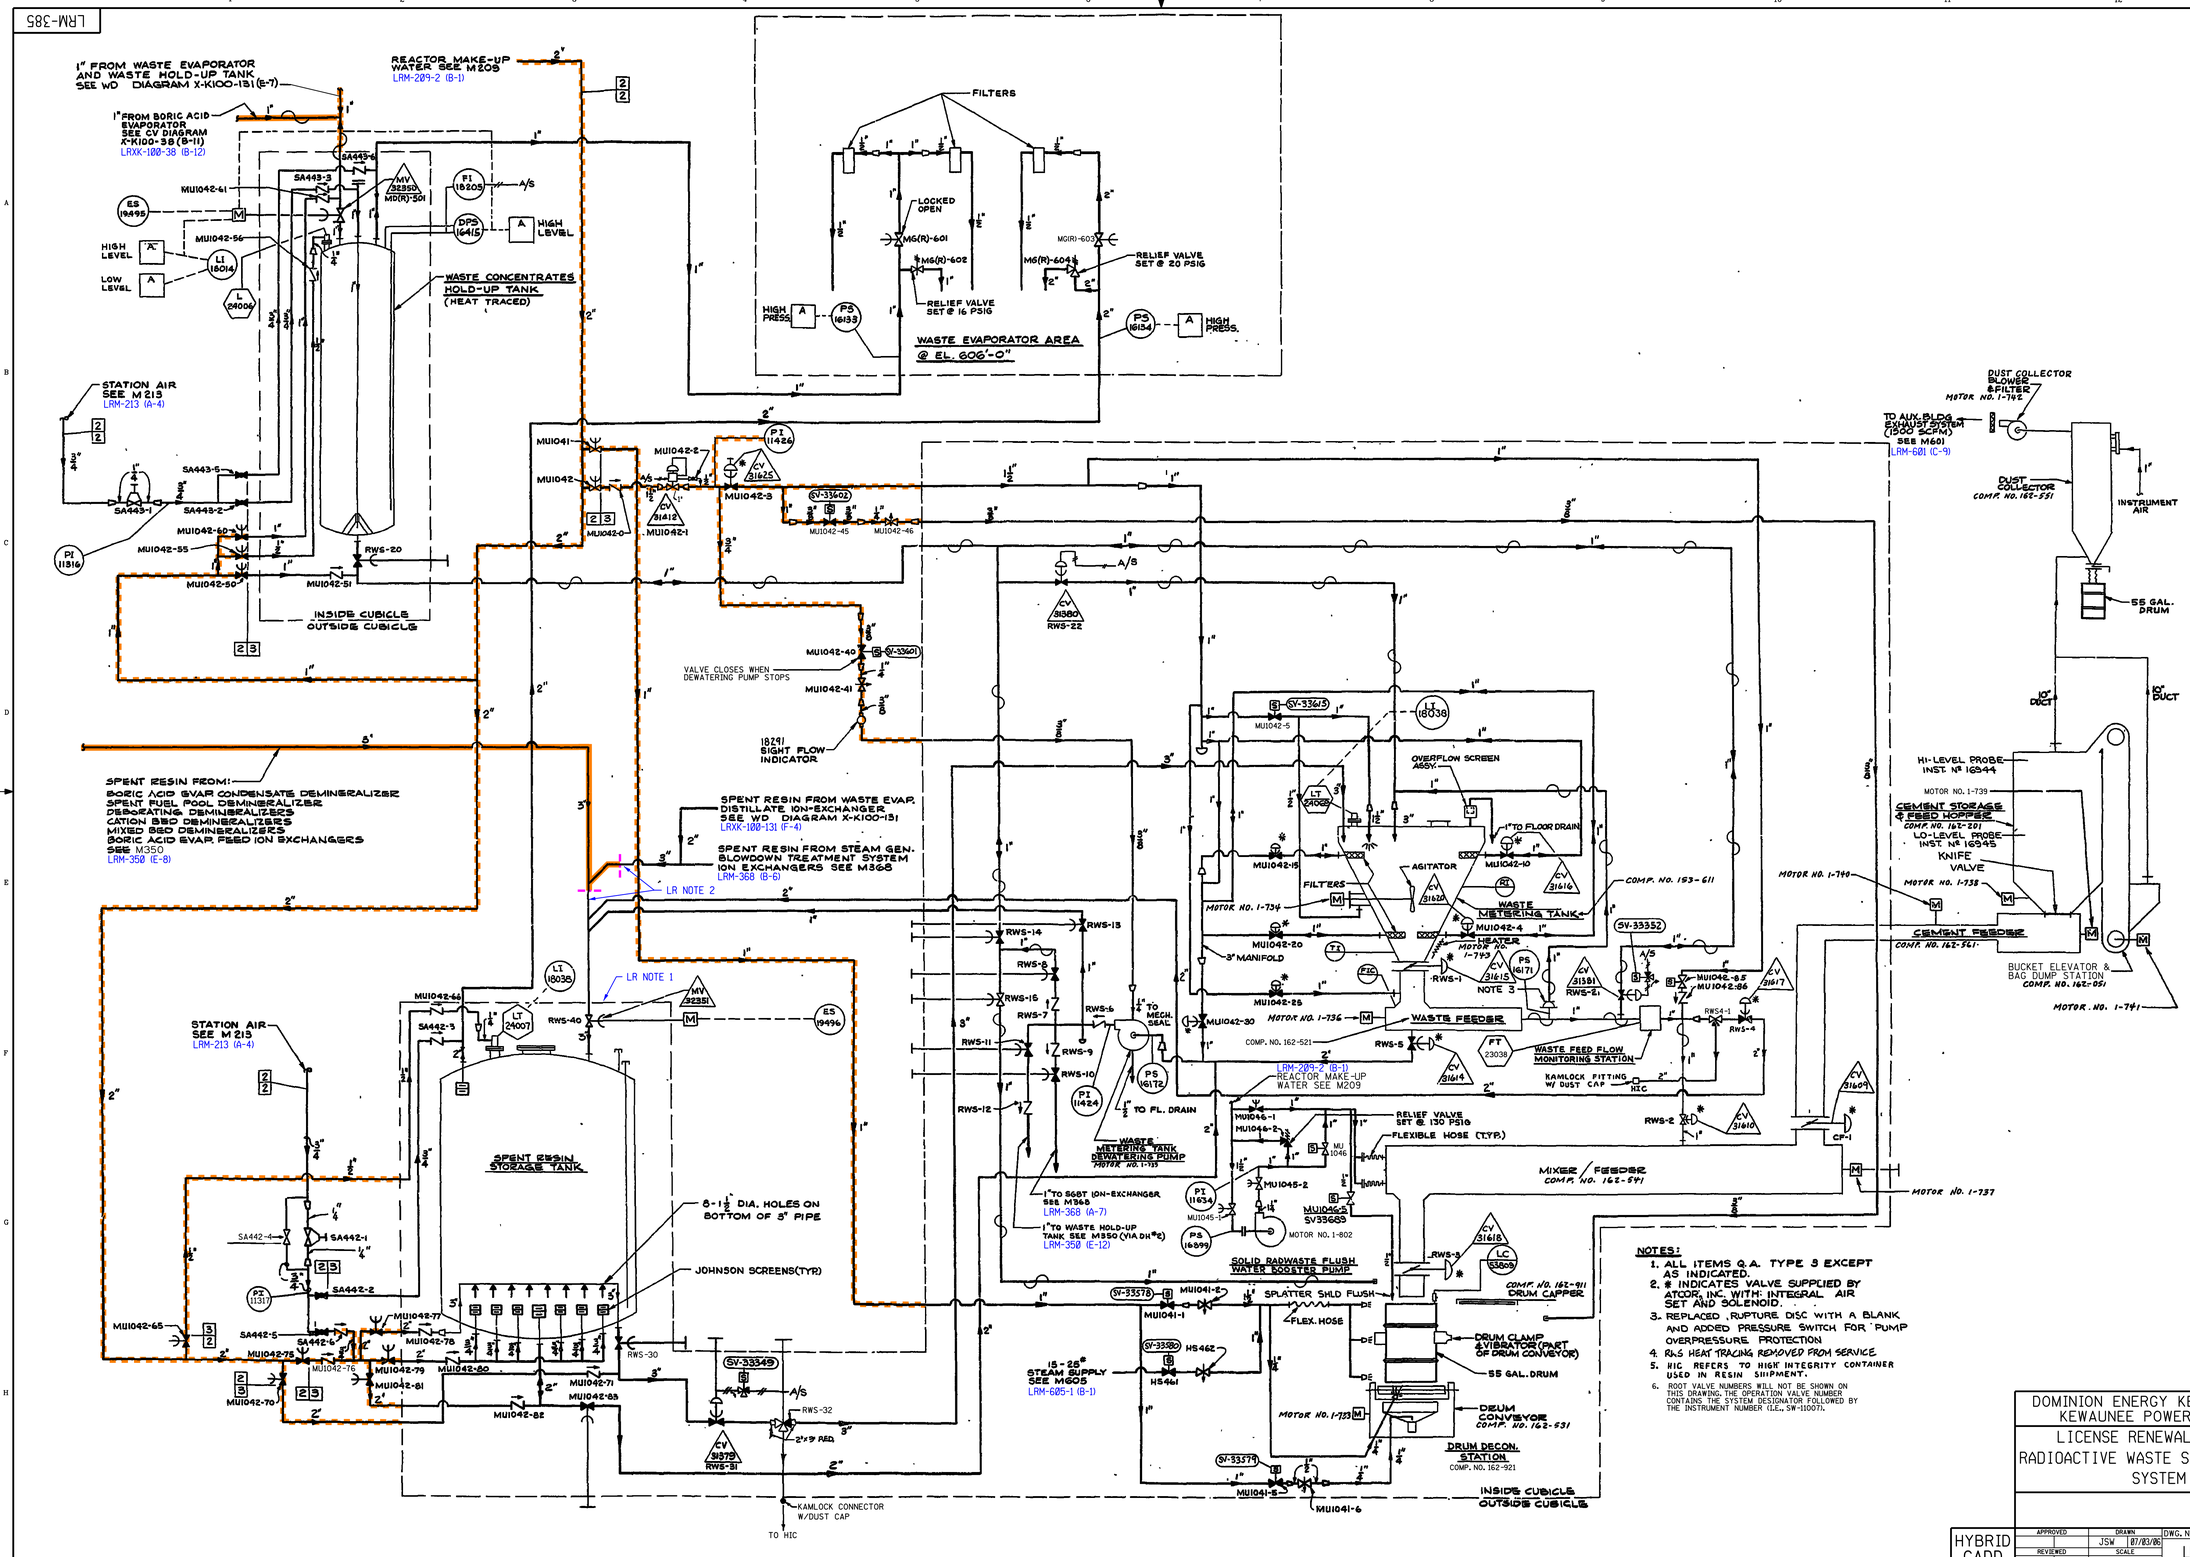

NOTES:

1. ALL ITEMS Q.A. TYPE 3 EXCEPT AS INDICATED.
2. * INDICATES VALVE SUPPLIED BY ATCOR, INC. WITH: INTEGRAL AIR SET AND SOLENOID.
3. REPLACED RUPTURE DISC WITH A BLANK AND ADDED PRESSURE SWITCH FOR PUMP OVERPRESSURE PROTECTION
4. RWS HEAT TRACING REMOVED FROM SERVICE
5. HIC REFERS TO HIGH INTEGRITY CONTAINER USED IN RESIN SHIPMENT.
6. ROOT VALVE NUMBERS WILL NOT BE SHOWN ON THIS DRAWING. THE OPERATION VALVE NUMBER CONTAINS THE SYSTEM DESIGNATOR FOLLOWED BY THE INSTRUMENT NUMBER (I.E., SW-11007).

LR NOTES:

1. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED INSIDE OF CUBICLE.
2. PIPING ENTERS SGBT ION EXCHANGER CUBICLE. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED INSIDE OF CUBICLE. SEE LRM-368 (B-8)

LICENSE RENEWAL DRAWING LEGEND

- 35/CVC CHEMICAL & VOLUME CONTROL
- 27A/MUP MAKE-UP AND DEMINERALIZED WATER
- 32A/WD-(L) LIQUID WASTE PROCESSING AND DISCHARGE
- IN SCOPE FOR LR PER 10CFR 54.4 (a) (2)
- IN SCOPE FOR LR PER 10CFR 54.4 (a) (1) 10CFR 54.4 (a) (3)

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
RADIOACTIVE WASTE SOLIDIFICATION SYSTEM

HYBRID CADD	APPROVED	DRAWN JSW 07/03/06	DWG. No.	REV.
	REVIEWED	SCALE	LRM-385	0

REFERENCED PER MASTER DRAWING OPERM-385 REV AJ

REV 'AJ' PER LAST UPDATE