LRM-504

REVISION

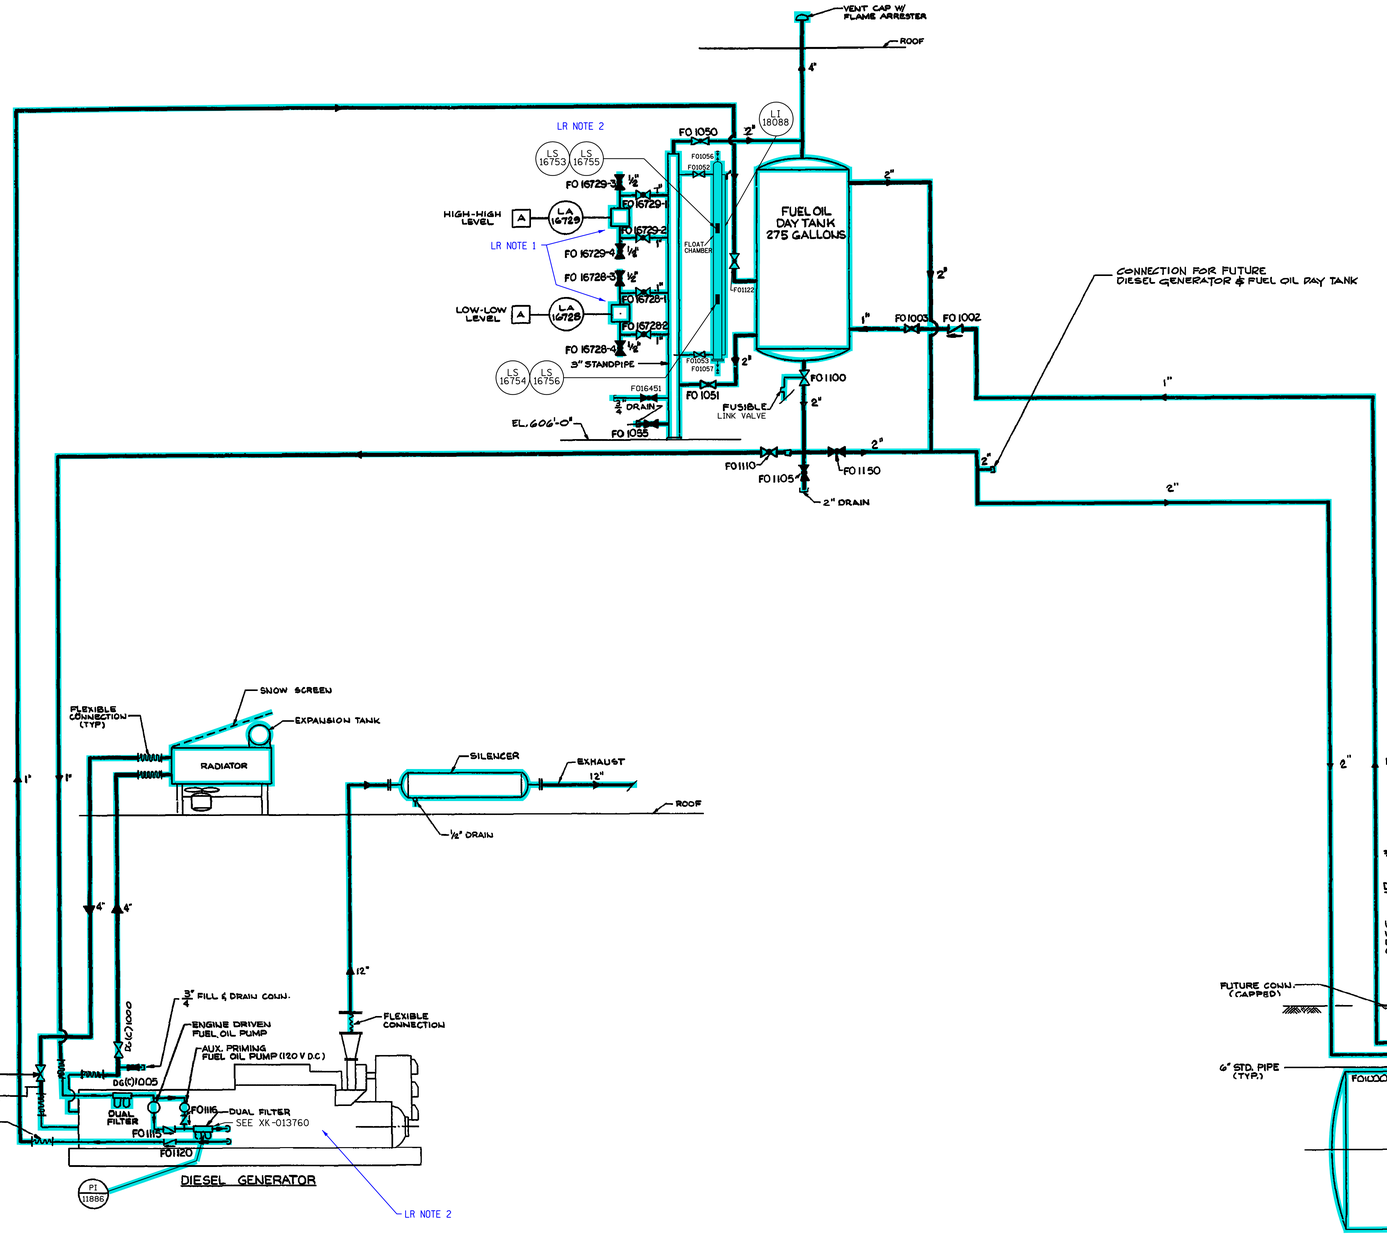

NOTE:
ALL ITEMS ARE QA TYPE 2 UNLESS OTHERWISE NOTED.

LR NOTES:

1. LEVEL ALARM FLOAT CHAMBER IS INCLUDED IN COMPONENT GROUP "PIPE".
2. DIESEL ENGINE AND GENERATOR ARE CONSIDERED ACTIVE COMPONENTS AND DO NOT REQUIRE AN AMR.

LICENSE RENEWAL DRAWING LEGEND

10/DGM DIESEL GENERATOR

IN SCOPE FOR LR PER 10CFR 54.4 (a) (2)

IN SCOPE FOR LR PER 10CFR 54.4 (a) (1) 10CFR 54.4 (a) (3)

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
T.S.C. DG, FUEL OIL EXHAUST & COOLING WATER PIPING

HYBRID CADD	APPROVED	DRAWN	DWG. No.	REV.
		JSW 11/14/06	LRM-504	0
	REVIEWED	SCALE		

REFERENCED PER MASTER DRAWING: OPERM-504 REV. S

REV "S" PER LAST UPDATE

22-JUL-2008 11:12 LRM-504.LRM