

REFERENCE:  
-W/D FAN COIL UNIT RTD ----- E-3655

NOTE:  
1. VALVE IS IN A LOCKED THROTTLED POSITION.  
2. REDUCED PRESSURE PRINCIPAL BACKFLOW PREVENTER.

ACA-17



DOMINION ENERGY KEWAUNEE, INC.  
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING  
AIR COND. COOLING WATER PIPING

HYBRID  
CADD

APPROVED	DRAWN	DWG. NO.	REV.
REVIEWED	SCALE	LRM-588	0

LR NOTES:  
1. THE POTABLE WATER PIPING IS IN LR SCOPE UNTIL IT EXITS THE CONTROLLED AREA OF THE AUXILIARY BUILDING. (SEE LRM-209-3, LR NOTE 1)

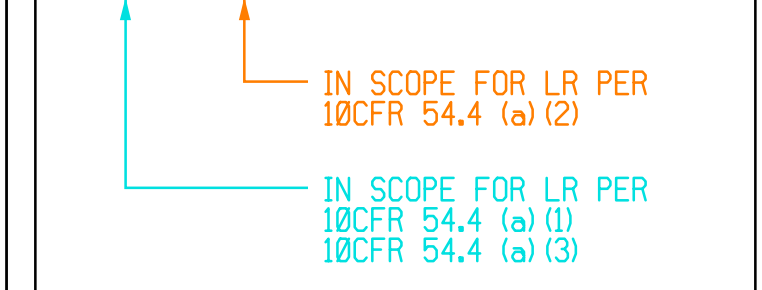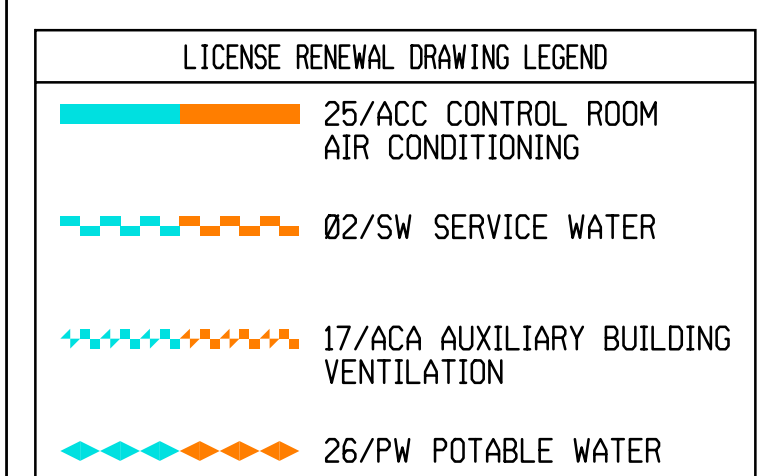

REFERENCED PER MASTER DRAWING:  
OPERM-588  
REV M  
REV "M" PER LAST UPDATE