LRM-601

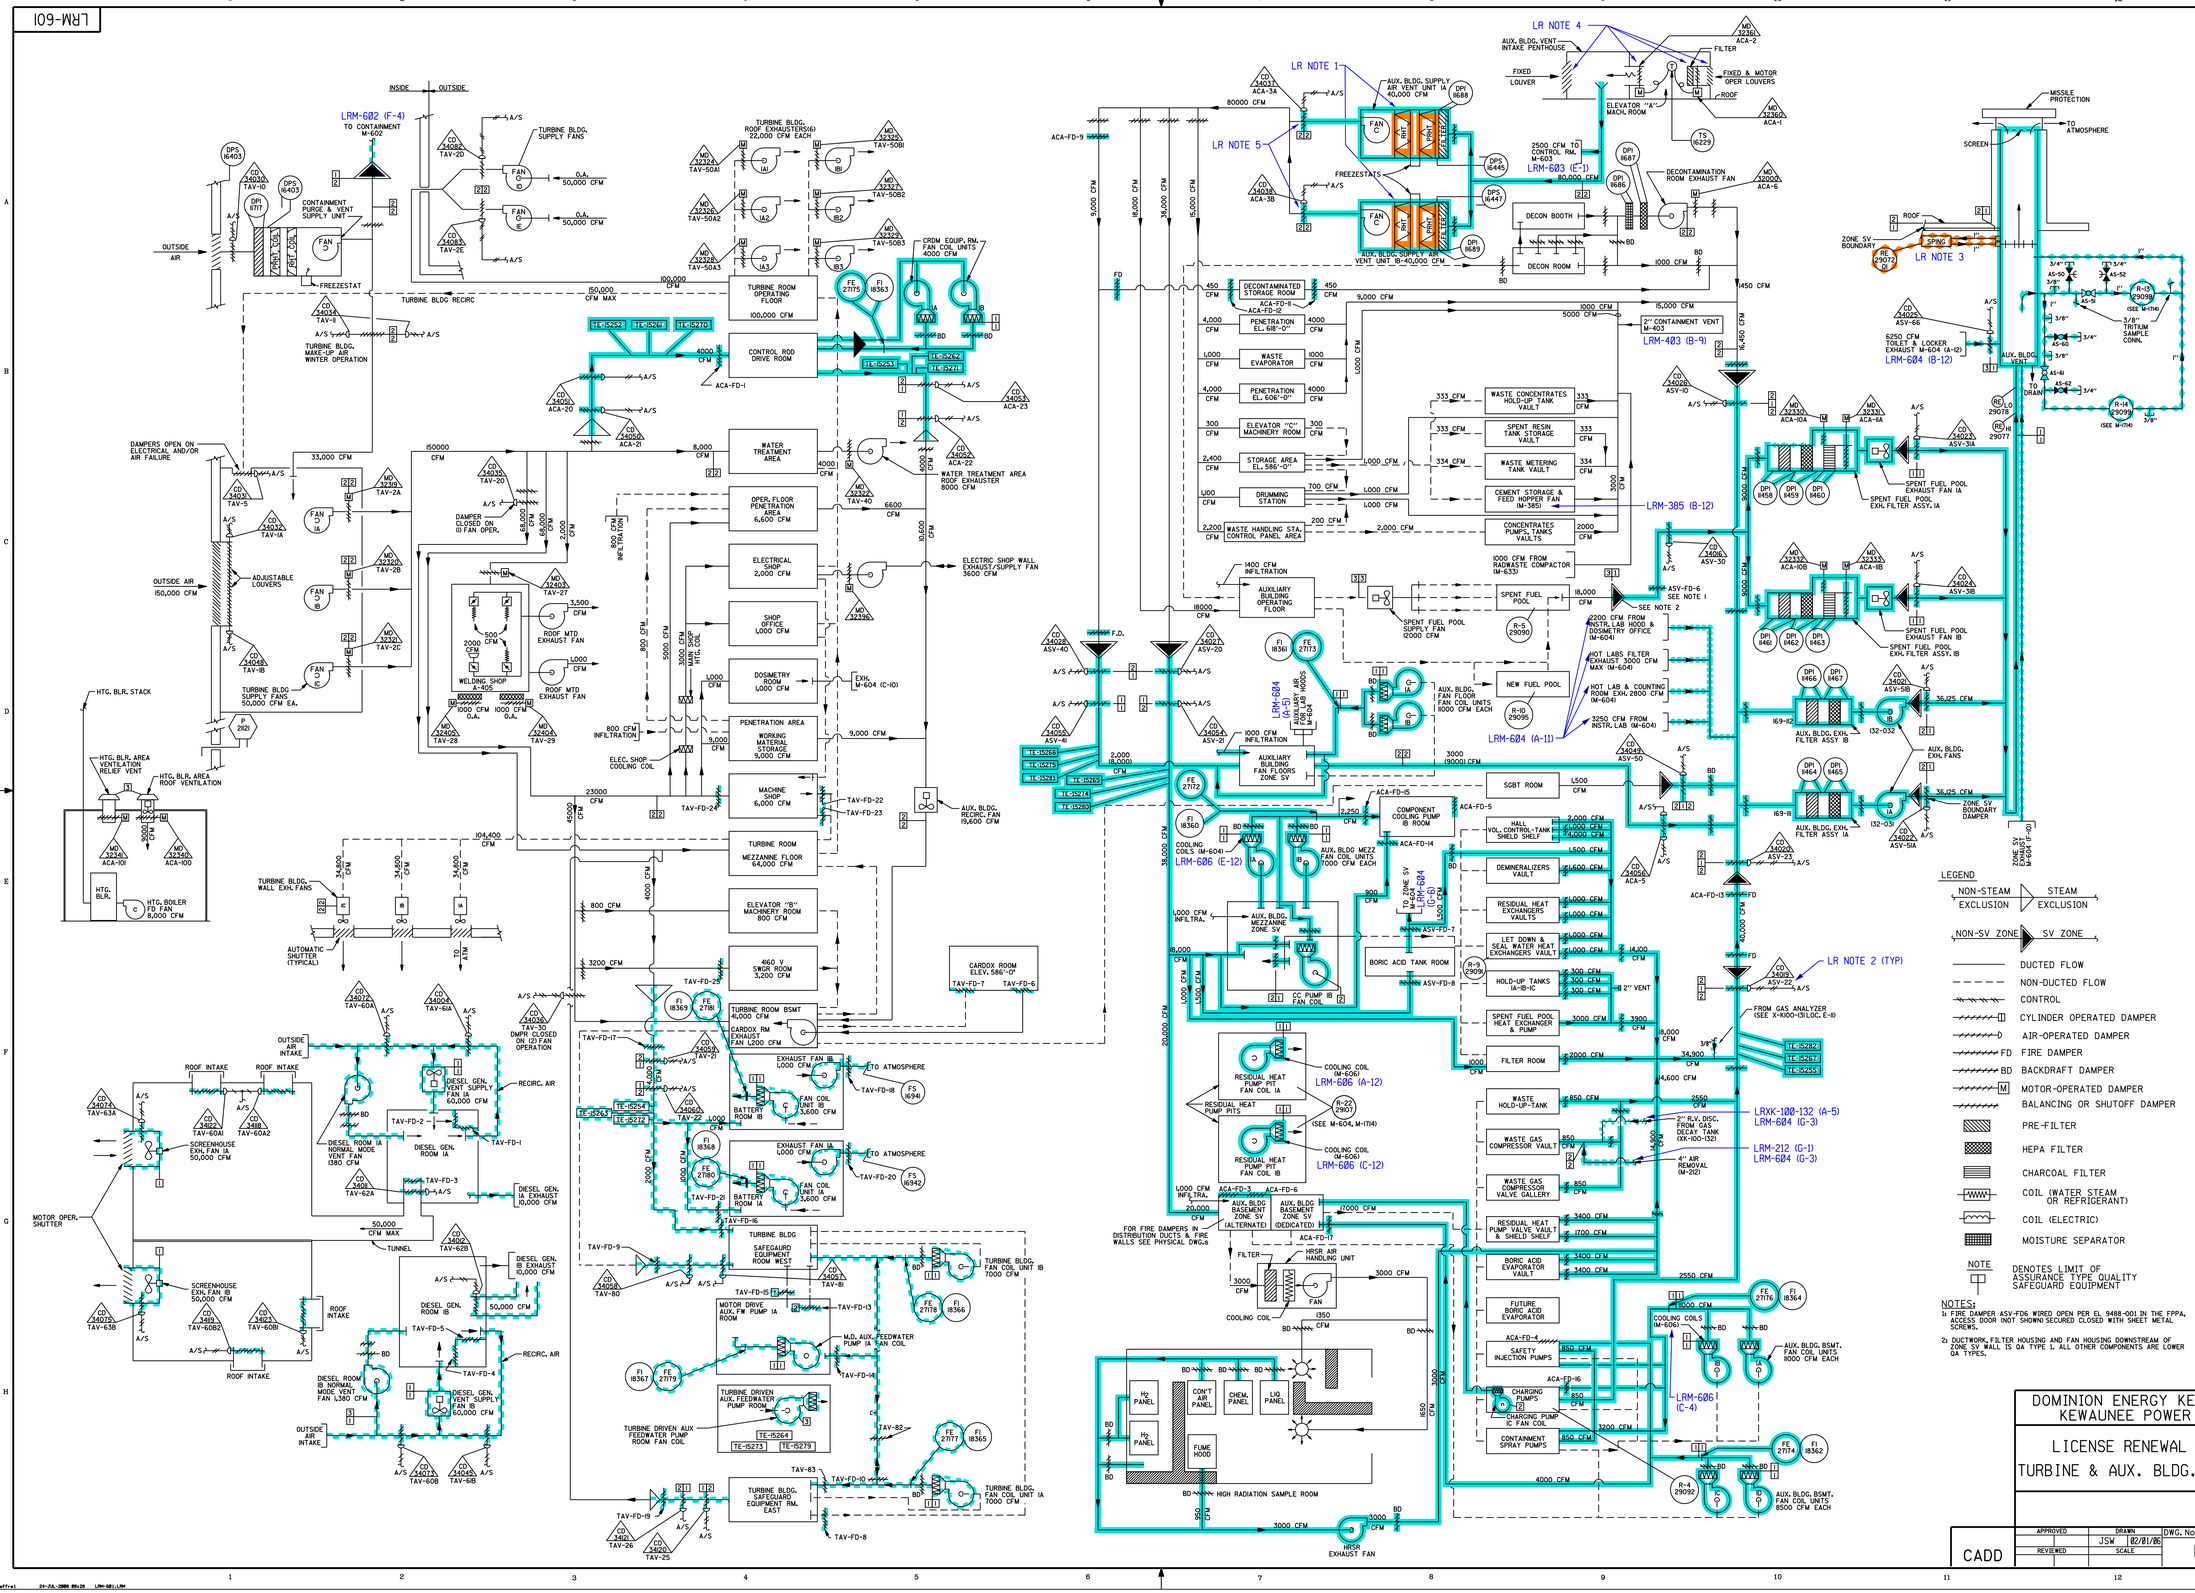

REVISION

LR NOTES:

1. IN LR SCOPE FOR HEATING STEAM PRESSURE BOUNDARY.
2. DAMPERS WITH AN "ASV" SYSTEM DESIGNATOR HAVE BEEN ASSIGNED TO THE SYSTEM IN WHICH THEY FUNCTION.
3. THE SPING-4 PROCESS MONITOR IS IN LR SCOPE. THE DETECTOR PROVIDES A PRESSURE BOUNDARY FUNCTION AND THEREFORE REQUIRES AGING MANAGEMENT REVIEW.
4. THE PENTHOUSE LOUVERS ARE COVERED IN THE EVALUATIONS FOR THE AUXILIARY BUILDING.
5. THESE DAMPERS HAVE BEEN USED TO ESTABLISH A LR BOUNDARY IN ORDER TO ENSURE A SUPPLY OF OUTSIDE AIR FROM THE AUXILIARY BUILDING VENT INTAKE PENTHOUSE TO THE CONTROL ROOM IN THE EVENT OF AN APPENDIX R FIRE. NOTE THAT PLANT PROCEDURES REQUIRE THAT THE VENTILATION IN THE AREA OF THE FIRE BE SECURED.

LICENSE RENEWAL DRAWING LEGEND

- 17/ACA AUXILIARY BUILDING VENTILATION
- 09/AR AIR REMOVAL
- 14/ASV AUXILIARY BUILDING SPECIAL VENTILATION AND STEAM EXCLUSION
- 15/AAC AUXILIARY BUILDING AIR CONDITIONING
- 16/TAV TURBINE BUILDING AND SCREENHOUSE VENTILATION
- 18/RBV REACTOR BUILDING VENTILATION - CONTAINMENT PURGE & VENTILATION
- 32B/WD-(G) GASEOUS WASTE PROCESSING AND DISCHARGE
- 45/RM RADIATION MONITORING
- IN SCOPE FOR LR PER 10CFR 54.4 (a) (2)
- IN SCOPE FOR LR PER 10CFR 54.4 (a) (1) 10CFR 54.4 (a) (3)

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
TURBINE & AUX. BLDG. VENTILATION

CADD	APPROVED	DRAWN JSW 02/01/06	DWG. No.	REV.
	REVIEWED	SCALE	LRM-601	0

REFERENCED PER MASTER DRAWING OPERM-601 REV CS

REV "CS" PER LAST UPDATE

jeffrs1 24-JUL-2008 08:20 LRM-601.LRM