


- LR NOTES:
1. PIPING ENTERS INTO THE ELEV-MECH ROOM.
 2. THERE ARE NO SAFETY RELATED COMPONENTS LOCATED IN THESE AREAS.
 3. BOUNDARY ENDS WHERE PIPING EXITS TURBINE BUILDING.
 4. PIPING ENTERS INTO ELECTRIC SHOP STORAGE.
 5. COMPONENTS LOCATED IN SE CORNER OF TURBINE BUILDING BASEMENT SEPARATED FROM SAFETY RELATED COMPONENTS BY MAJOR PLANT EQUIPMENT (CONDENSER).
 6. HEATING COILS IN LR SCOPE FOR HEATING STEAM PRESSURE BOUNDARY.

LICENSE RENEWAL DRAWING LEGEND

	22/HS HEATING STEAM
	02/SW SERVICE WATER
	17/ACA AUXILIARY BUILDING VENTILATION
	25/ACC CONTROL ROOM AIR CONDITIONING
	27/MUP MAKE-UP AND DEMINERALIZED WATER
	30/MDS MISCELLANEOUS DRAINS AND SUMPS
	32A/WD-LL LIQUID WASTE PROCESSING AND DISCHARGE
	35/CVC CHEMICAL & VOLUME CONTROL
	51/GS MISCELLANEOUS GAS

- NOTES:
1. * DENOTES ACCESSORIES & INTERCONNECTION WITH PIPING FURNISHED WITH EQUIPMENT
 2. * DENOTES INSTRUMENTS MOUNTED ON HEATING BOILER PANEL
 3. BVI (MATERIAL NO. DEARATOR AND BOILER & ASSOCIATED PIPING AND ACCESSORIES QUALITY ASSURANCE TYPE 2 UNLESS NOTED
 4. VALVES ARE SHOWN IN NORMAL POSITIONS WITH STEAM SUPPLY FROM BLEND STEAM M206.
 5. ROOT VALVE NUMBERS WILL NOT BE SHOWN ON THIS DRAWING. THE OPERATION VALVE NUMBER CONTAINS THE SYSTEM IDENTIFIER, FOLLOWED BY THE INSTRUMENT NUMBER (E.G. 51/1007).
 6. USE THIS DRAWING WITH OPERM-605-2.
 7. SEE OPERM-394 LOCATION D-8.

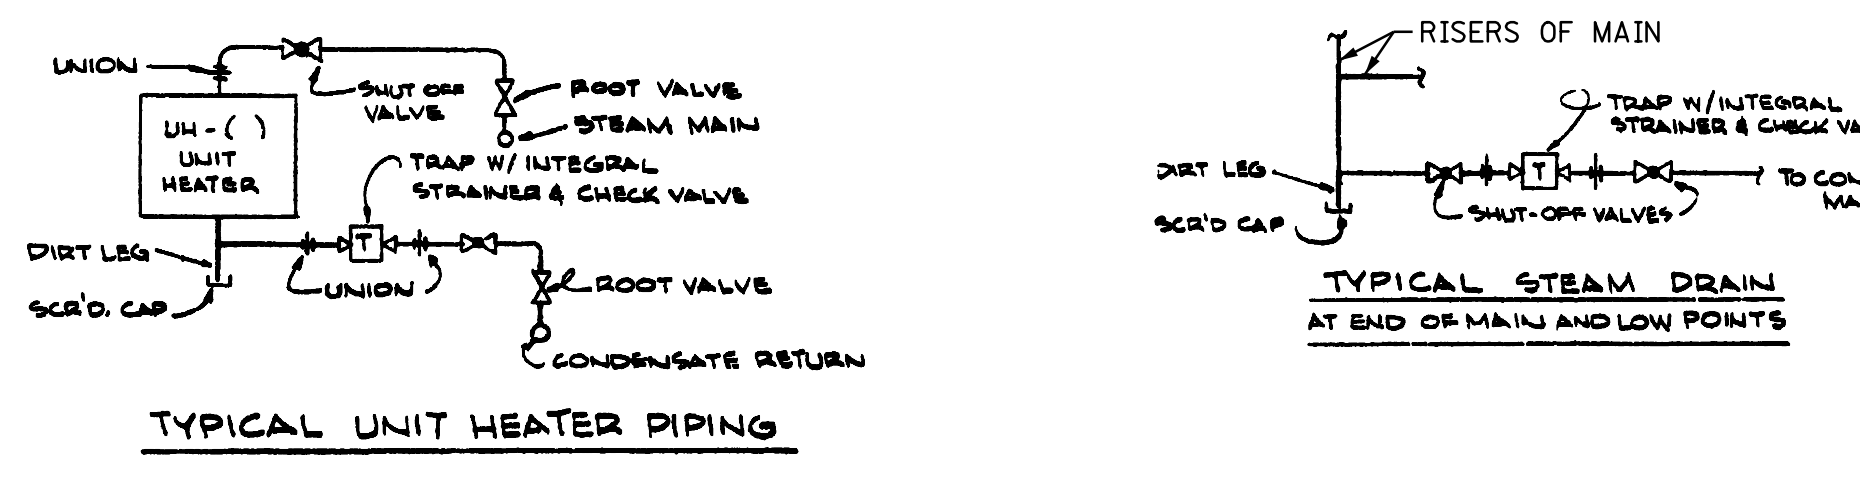

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
HEATING SYSTEM

HYBRID CADD	APPROVED	DRAWN	DATE	REV.
	REVIEWED	SCALE	LRM-605-1	0

REFERENCED PER MASTER DRAWING: OPERM-605-1

REV 'E' PER LAST UPDATE