LRXK-101-24-1

REVISION

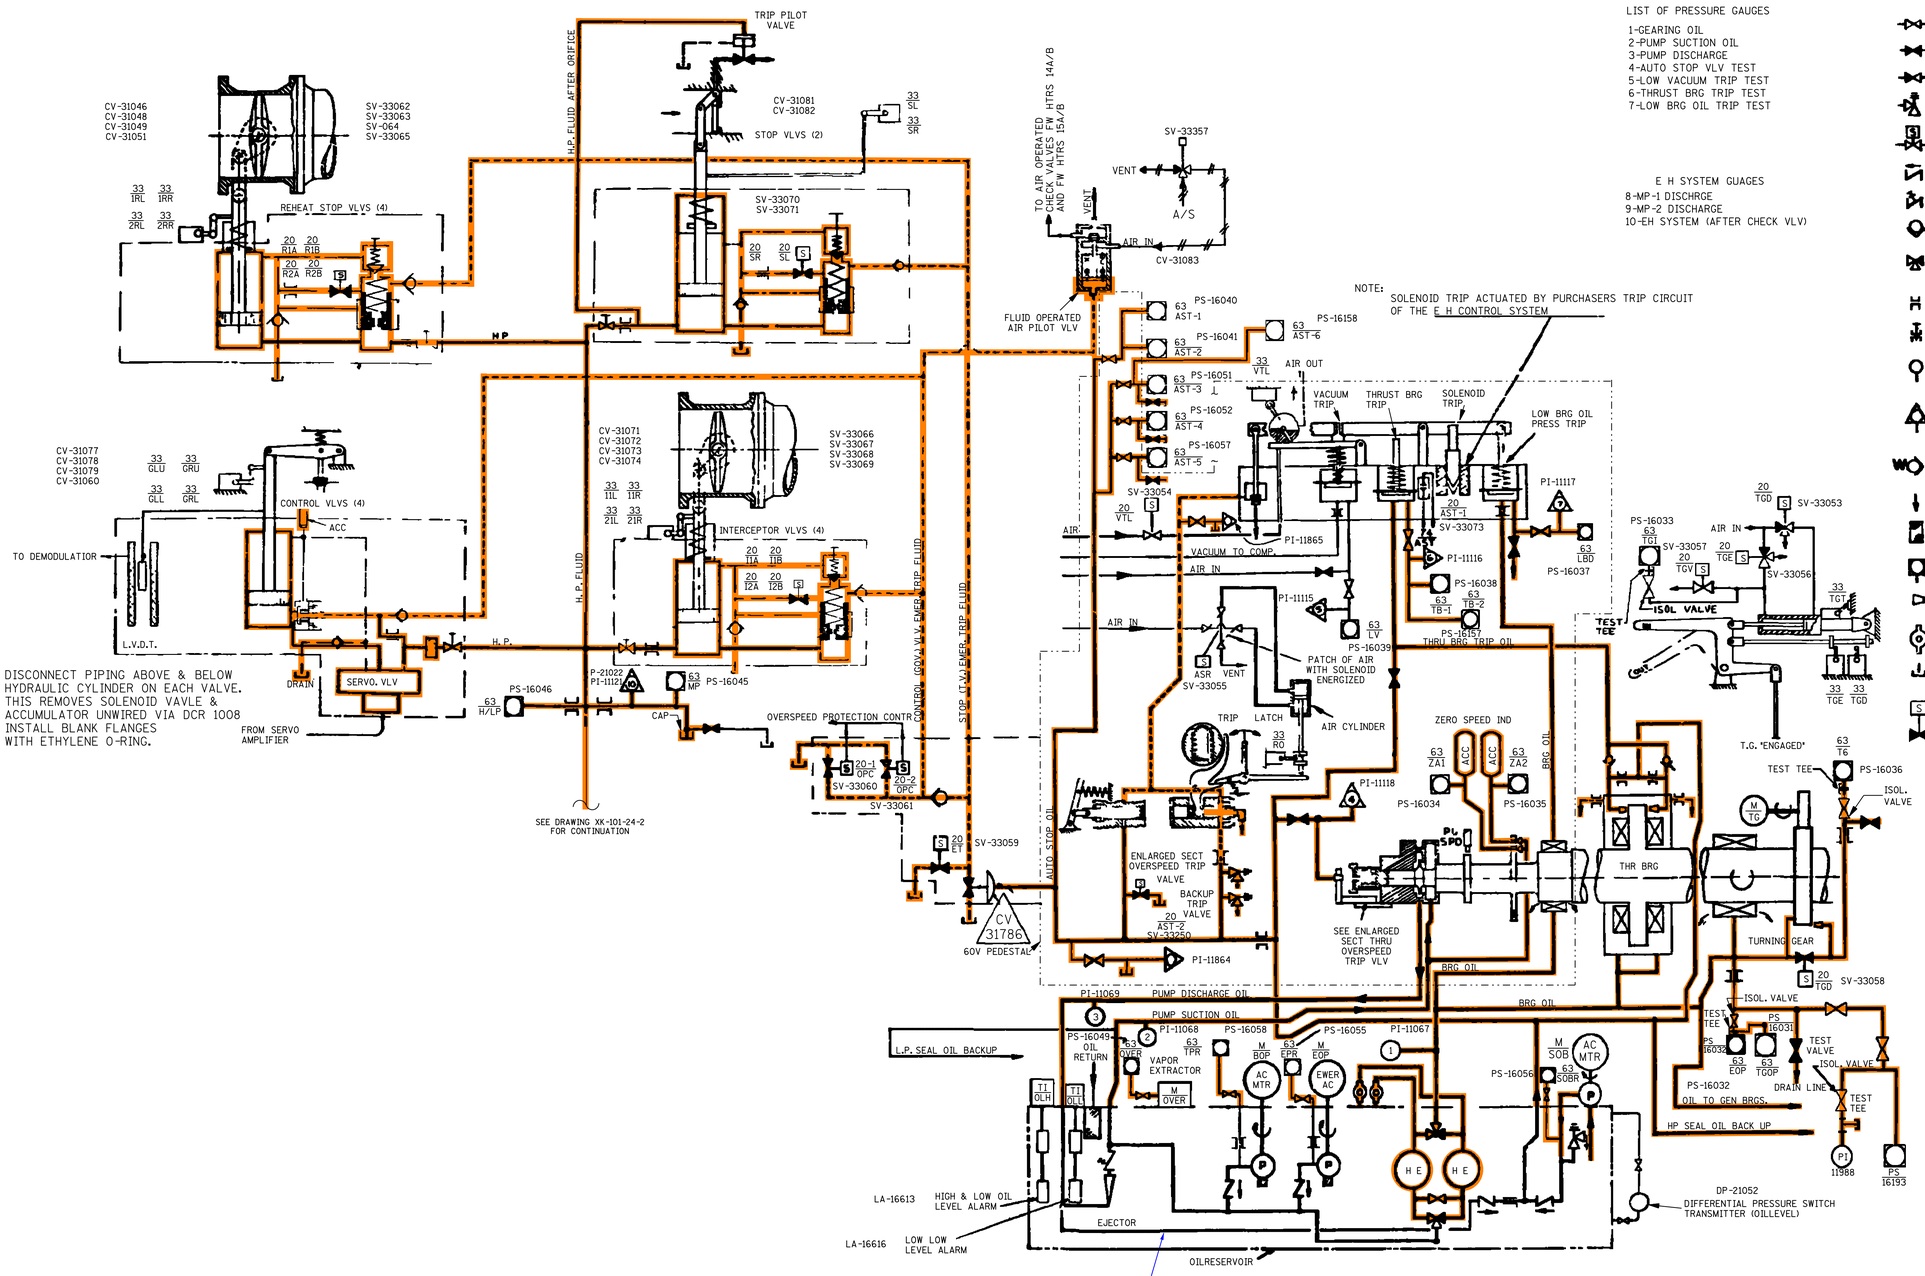

LIST OF PRESSURE GAUGES

1-GEARING OIL
2-PUMP SUCTION OIL
3-PUMP DISCHARGE
4-AUTO STOP VLV TEST
5-LOW VACUUM TRIP TEST
6-THRUST BRG TRIP TEST
7-LOW BRG OIL TRIP TEST

E H SYSTEM GUAGES

8-MP-1 DISCHRGE
9-MP-2 DISCHARGE
10-EH SYSTEM (AFTER CHECK VLV)

LEGEND

HYDR. SYMBOLS

- VALVE NORMALLY OPEN
- VALVE NORMALLY CLOSED
- VALVE NORMALLY THROTTLED
- RELIEF VALVE
- SOLENOID VALVE
- SWING CHECK VLV
- ADJUSTABLE CHECK VLV
- BALL CHECK VLV
- 3-WAY VALVE (ONE SIDE NORMALLY CLOSED)
- FIXED PRIFICE
- ADJUSTABLE PRIFICE
- GAUGE MOUNTED ON GAUGE BOARD
- GAUGE MOUNTED ON TURBINE
- SPRING LOADED LINE CHECK
- OIL DRAIN
- FILTER
- PRESSURE SWITCH
- NOZZLE
- SIGHT FLOW
- E H SYSTEM DRAIN
- S R
- SOLENOID-RELAY

LR NOTES:

1. THE COMPONENTS ARE LOCATED INSIDE THE TANK AND NOT INCLUDED IN LR SCOPE FOR SPATIAL CRITERIA.

LICENSE RENEWAL DRAWING LEGEND

54/TB TURBINE

IN SCOPE FOR LR PER 10CFR 54.4 (a)(2)

IN SCOPE FOR LR PER 10CFR 54.4 (a)(1) 10CFR 54.4 (a)(3)

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
ELECTRO - HYDRAULIC CONTROL
& LUBE SYSTEM

HYBRID CADD	APPROVED	DRAWN JSW 04/24/06	DWG. No.	REV.
	REVIEWED	SCALE	LRXK-101-24-1	0

REFERENCED PER MASTER DRAWING XK-101-24-1 REV B

REV 'B' PER LAST UPDATE