


- NOTES:**
1. DIAPHRAGM SEAL.
 2. .06" DIA. HOLE IN CLAPPER OR CUP.
 3. LOOP SEAL TO EXTEND 12" BELOW AND 12" ABOVE THE OVERFLOW NOZZLE.
 4. STEAM TRAP AND STRAINER SUPPLIED BY A.E.
 5. - QUALITY ASSURANCE CODES BY P.S. & E.
 6. HYDRAULIC END OF PUMPS SHALL BE HEAT TRACED OR SURROUNDED BY A HEATED ENCLOSURE.
 7. CANNED ROTOR PUMPS SHALL BE SURROUNDED BY A HEATED ENCLOSURE.
 8. EXTENSION REQUIRED: TO OPERATE VALVE OUTSIDE HEAT TRACING ENCLOSURE.
 9. VALVE CVC-637 LOCKED CLOSED.
- ROOT VALVE NUMBERS WILL NOT BE SHOWN ON THIS DRAWING.**
THE OPERATION VALVE NUMBER CONTAINS THE SYSTEM RESTRICTOR FOLLOWED BY THE INSTRUMENT NUMBER (I.E., SW-11001).

- LR NOTES:**
1. THE COMPONENT WITH A 'C' (CHEMICAL INJECTION SYSTEM) DESIGNATOR IN THE EQUIPMENT NUMBER HAS BEEN ASSIGNED TO 35/CVC CHEMICAL & VOLUME CONTROL SYSTEM FOR LR PURPOSES.
 2. THE DIAPHRAGM SEAL IS PART OF THE PRESSURE INDICATOR MODULE. (TYPICAL TO THIS DRAWING)
 3. PIPING BECOMES A SPATIAL CONCERN AS SOON AS IT LEAVES THE ROOM WHERE THE CAUSTIC STORAGE TANK IS LOCATED. (AUXILIARY BUILDING - SOUTH 242-ELEV.)

LICENSE RENEWAL DRAWING LEGEND

	35/CVC CHEMICAL & VOLUME CONTROL
	22/HS HEATING STEAM
	32A/WD-LJ LIQUID WASTE PROCESSING AND DISCHARGE
	33/SI SAFETY INJECTION
	27A/MUP MAKE-UP AND DEMINERALIZED WATER

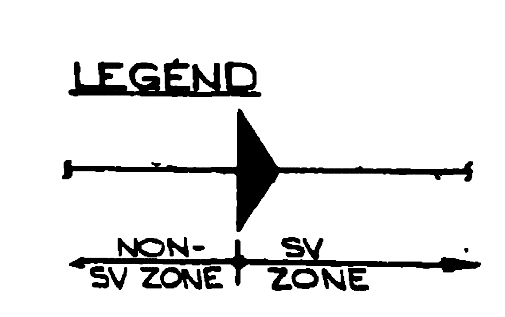

DOMINION ENERGY KEWAUNEE, INC.
KEWAUNEE POWER STATION

LICENSE RENEWAL DRAWING
CHEMICAL & VOLUME CONTROL SYS.

APPROVED	DRAWN	OWG. NO.	REV.
REVIEWED	SCALE	LRXK-100-38	0

HYBRID CADD

REFERENCED PER MASTER DRAWING	REV
OPERXK-100-38	W

REV "M" PER LAST UPDATE