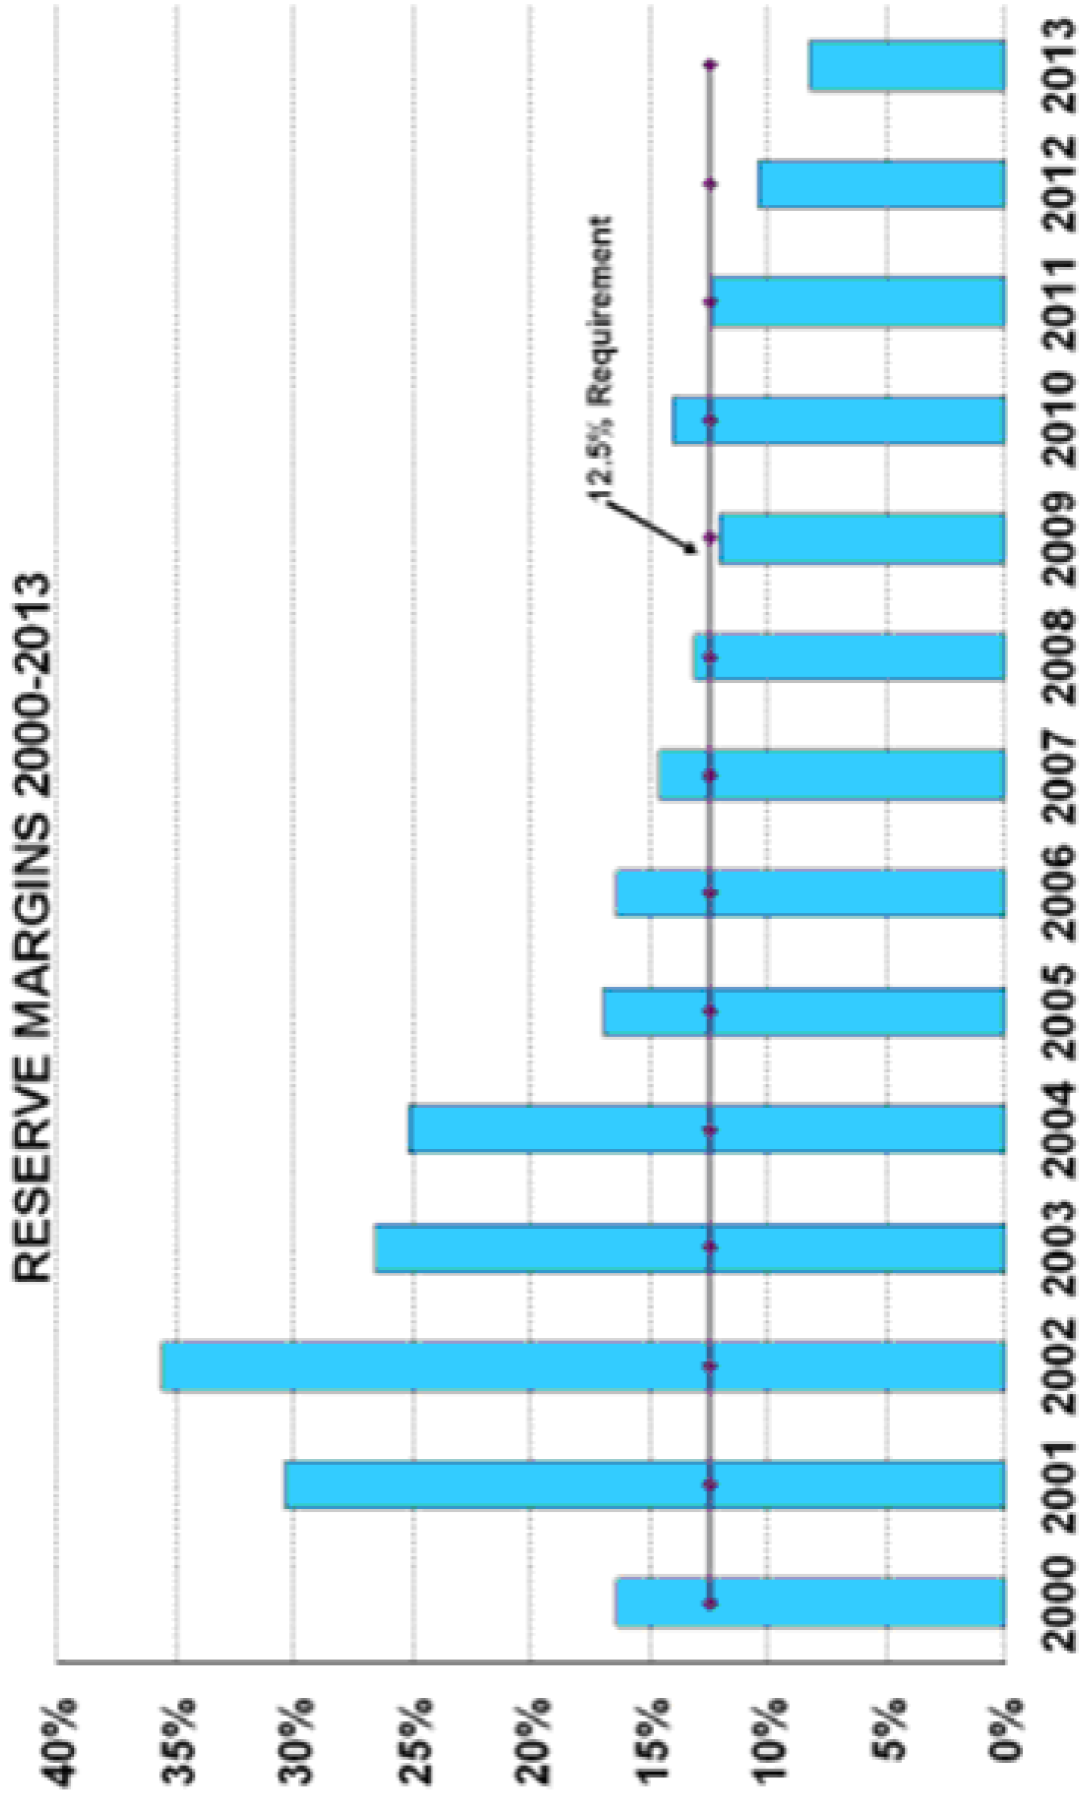

ERCOT 2007d)

Reserve Margin from 2007 Annual Constraints and Needs
FIGURE 8.4-2 Rev 0

COMANCHE PEAK NUCLEAR POWER PLANT
UNITS 3 AND 4