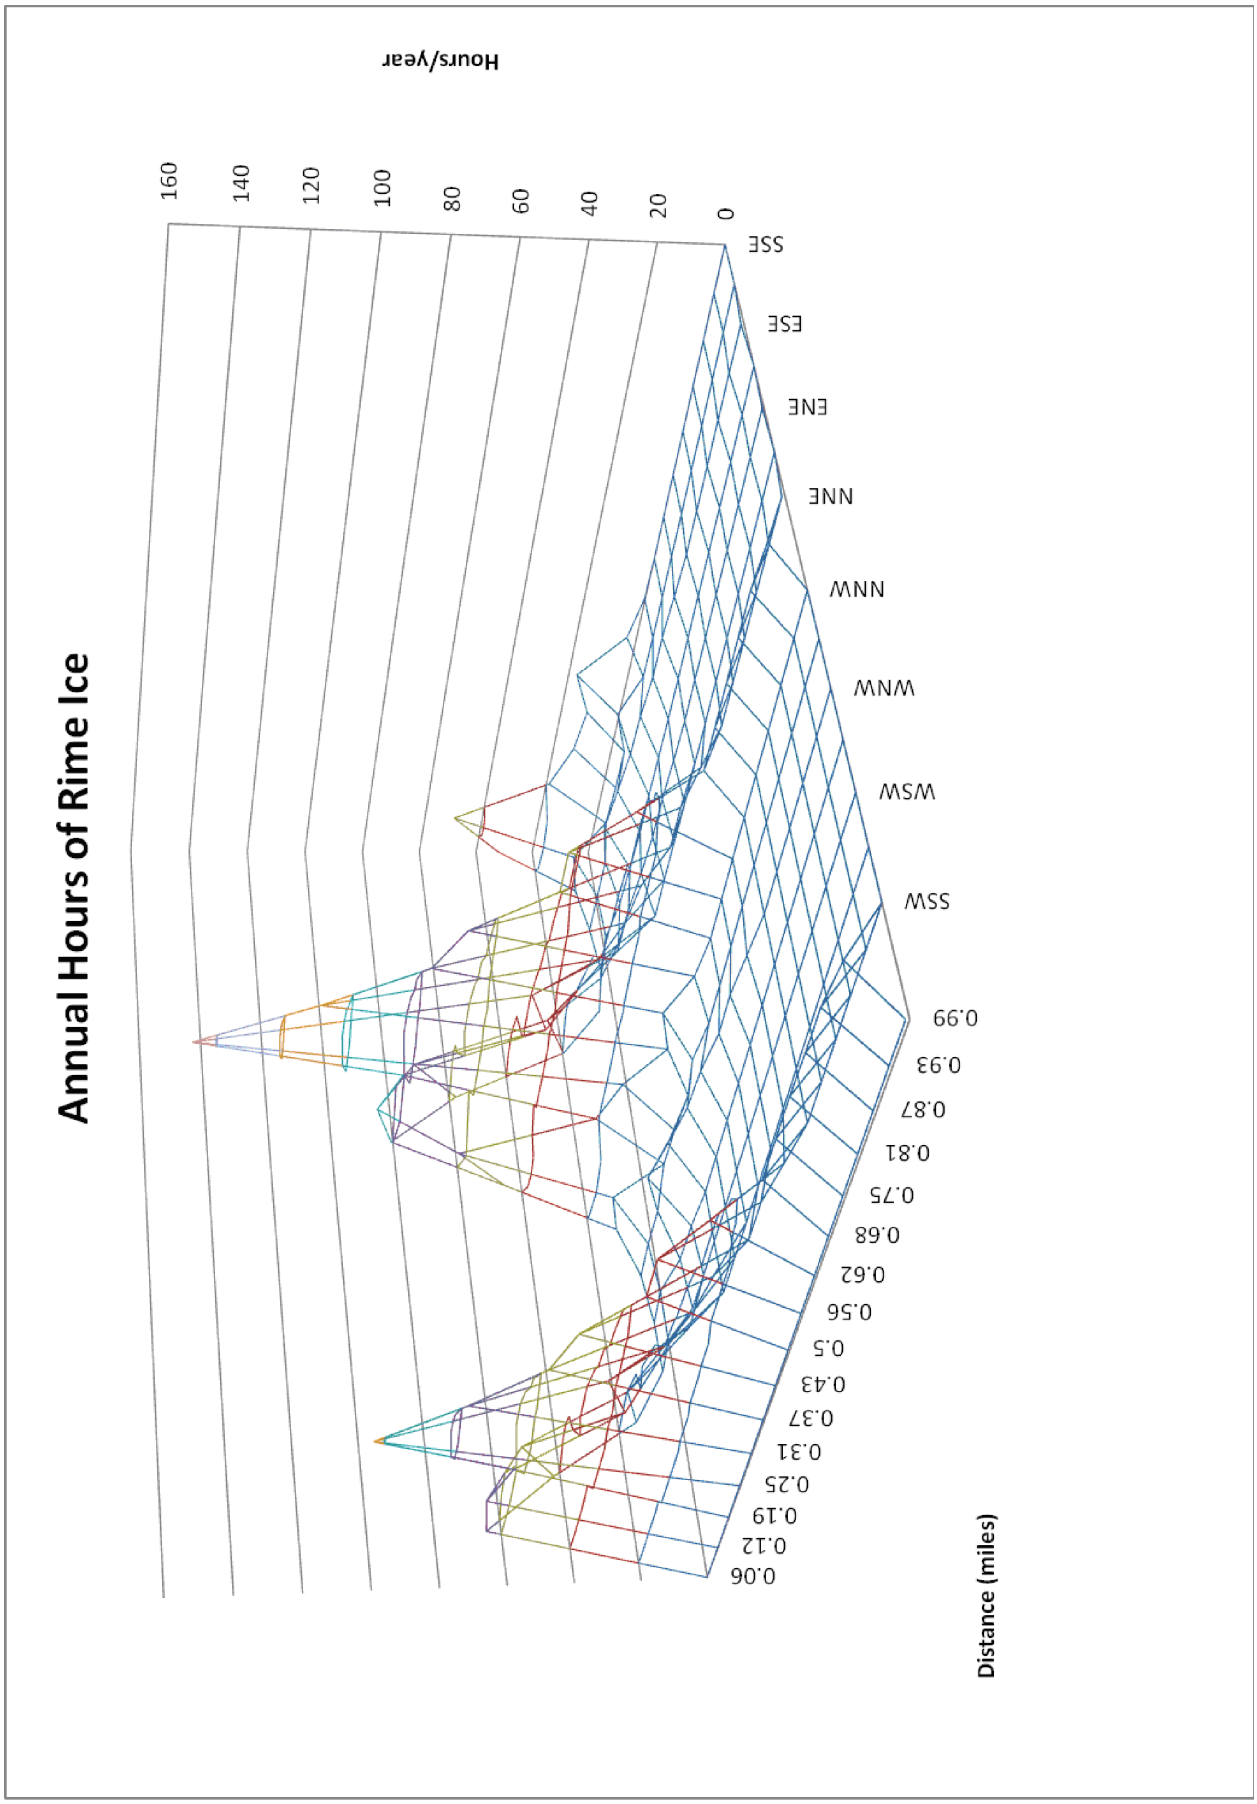

CPNPP Cooling Tower Annual Hours per Year Rime Icing
FIGURE 2.3-378 Rev 0

COMANCHE PEAK NUCLEAR POWER PLANT
UNITS 3 AND 4