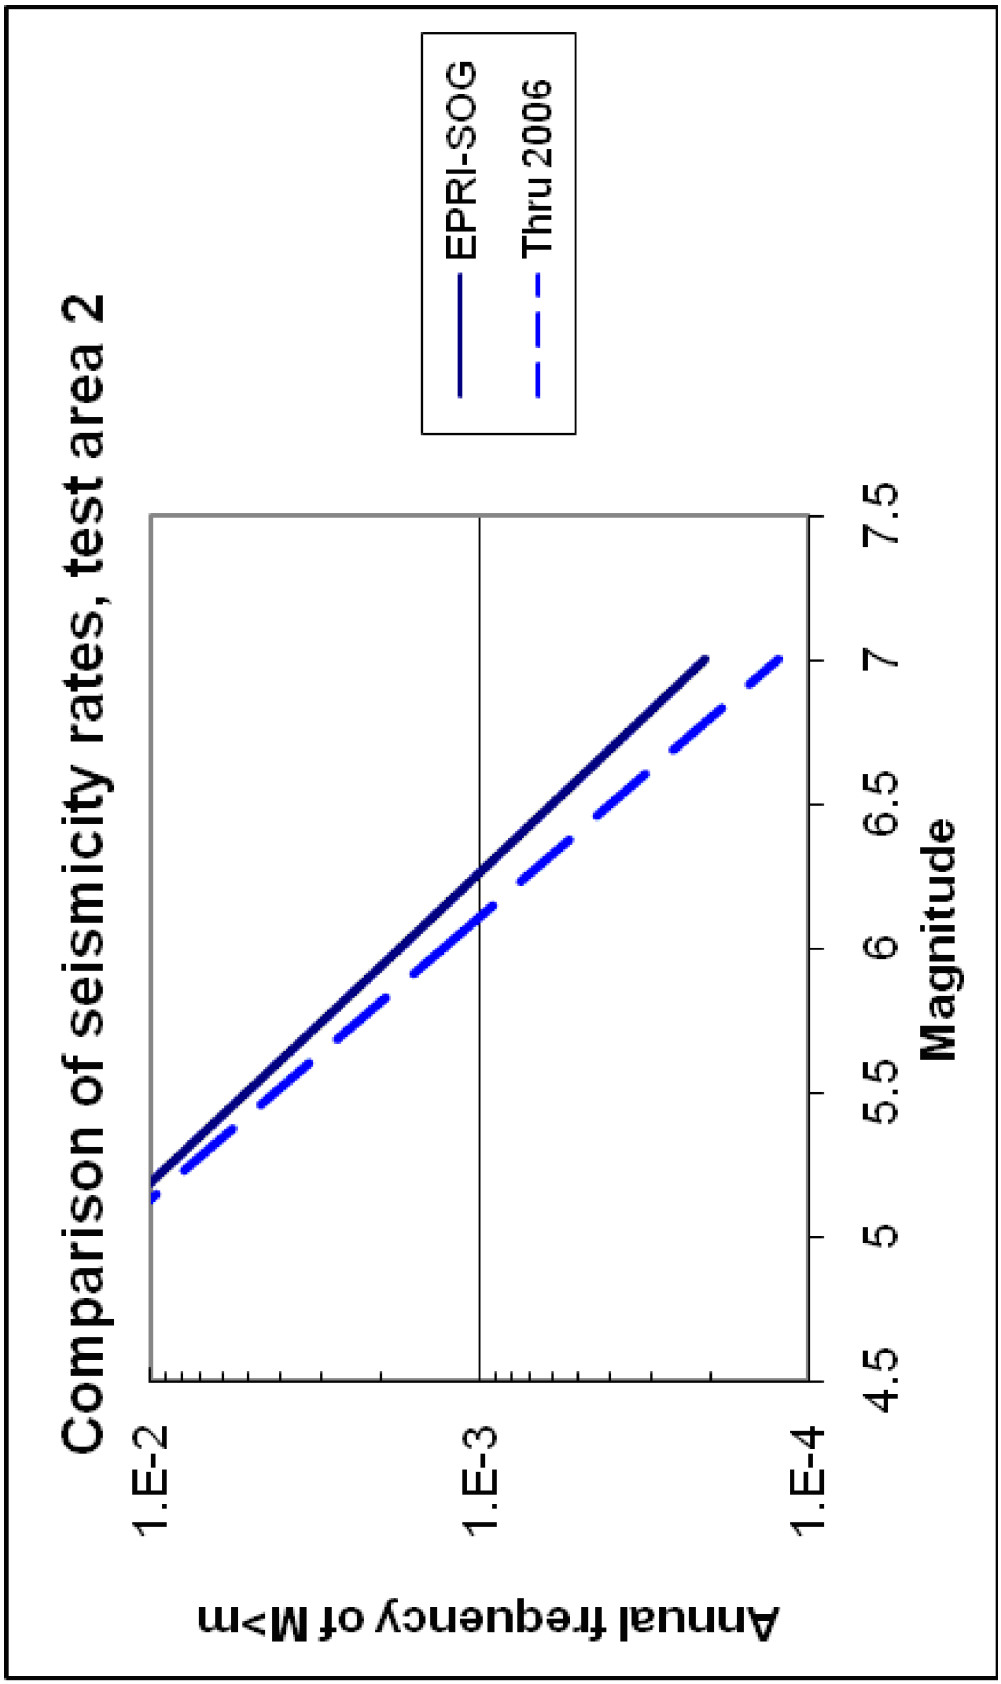

Comparison of Seismicity Rates for Test Area 2
Shown in Figure 2.5.2-209
FIGURE 2.5.2-211 Rev 0

COMANCHE PEAK NUCLEAR POWER PLANT
UNITS 3 AND 4