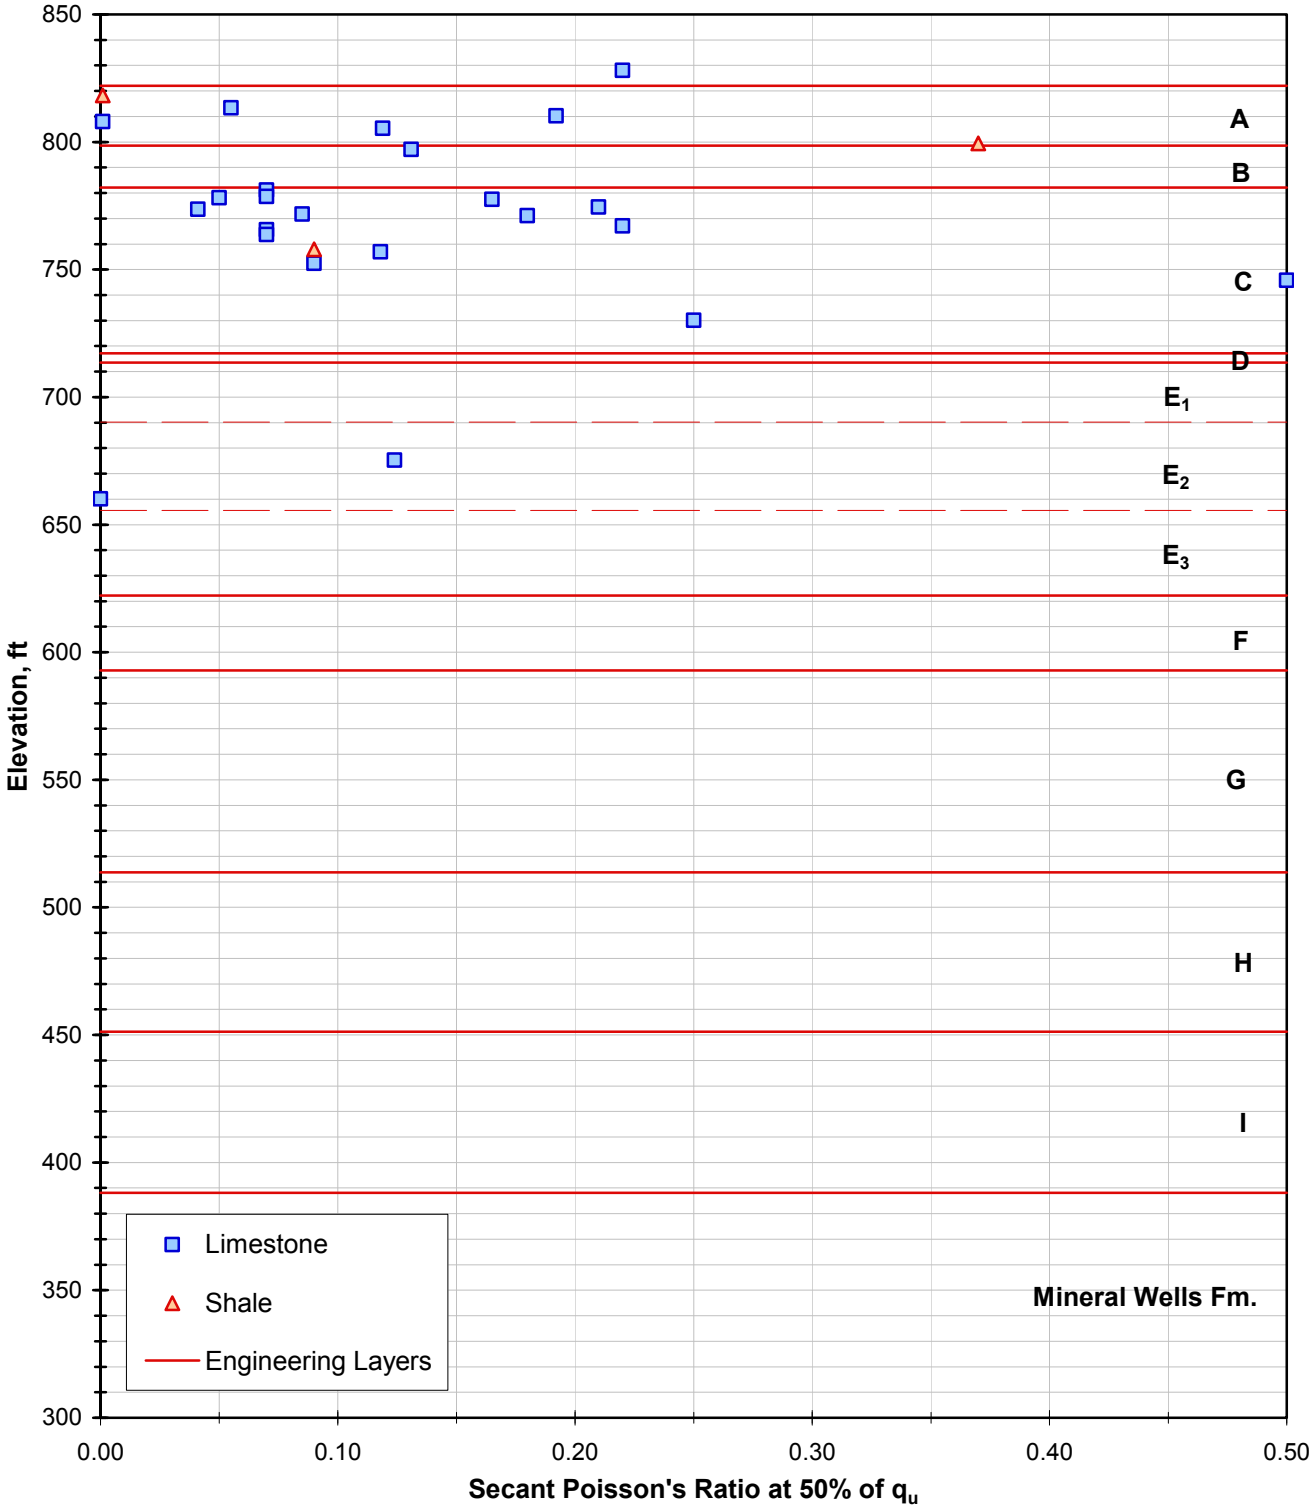

Secant Poisson's Ratio from Unconfined Compression Tests vs. Elevation
FIGURE 2.5.4-231 Rev 0

COMANCHE PEAK NUCLEAR POWER PLANT
UNITS 3 AND 4