

## PMBelCOL PEmails

---

**From:** Spink, Thomas E [tespink@tva.gov]  
**Sent:** Tuesday, August 12, 2008 5:05 PM  
**To:** Mallecia Hood; Tomeka Terry; William Burton  
**Cc:** Sterdis, Andrea Lynn; Neil Haggerty  
**Subject:** Courtesy email copy of TVA's Response to Environmental Report - LTR 34 - ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS  
**Attachments:** ER LTR 34 - Alt\_RAI#03\_Final e\_.pdf

Mallecia:

I have enclosed a pdf copy of our response to twelve RAI's related to Socioeconomics/Environmentl Justice with this email as a courtesy. As always, the official submittal has been submitted to the Document Control Desk via paper copy using Federal Express services. The paper copy should arrive on August 12, 2008.

If you have any questions, please do not hesitate to call me.

*Thomas E. Spink*

Licensing Project Manager  
Nuclear Generation Development  
1101 Market Street, LP 5A  
Chattanooga, TN 37402  
423-751-7062 Fax: (423)-751-6509

**Hearing Identifier:** Bellefonte\_COL\_Public\_EX  
**Email Number:** 972

**Mail Envelope Properties** (B648F67990B15146B8646584D20B8DD104E9FEC8)

**Subject:** Courtesy email copy of TVA's Response to Environmental Report - LTR 34 -  
ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS  
**Sent Date:** 8/12/2008 5:04:56 PM  
**Received Date:** 8/12/2008 5:10:30 PM  
**From:** Spink, Thomas E

**Created By:** tespink@tva.gov

**Recipients:**  
"Sterdis, Andrea Lynn" <alsterdis@tva.gov>  
Tracking Status: None  
"Neil Haggerty" <neilhaggerty@comcast.net>  
Tracking Status: None  
"Mallecia Hood" <Mallecia.Hood@nrc.gov>  
Tracking Status: None  
"Tomeka Terry" <Tomeka.Terry@nrc.gov>  
Tracking Status: None  
"William Burton" <William.Burton@nrc.gov>  
Tracking Status: None

**Post Office:** TVACOCXVS2.main.tva.gov

Files	Size	Date & Time
MESSAGE	601	8/12/2008 5:10:30 PM
ER LTR 34 - Alt_RAI#03_Final e_.pdf		2737901

**Options**  
**Priority:** Standard  
**Return Notification:** No  
**Reply Requested:** No  
**Sensitivity:** Normal  
**Expiration Date:**  
**Recipients Received:**



Tennessee Valley Authority, 1101 Market Street, LP 5A, Chattanooga, Tennessee 37402-2801

August 11, 2008

10 CFR 52.80

Document Control Desk  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

In the Matter of )  
Tennessee Valley Authority )

Docket Numbers 52-014 and 52-015

**BELLEFONTE COMBINED LICENSE APPLICATION – RESPONSE TO  
ENVIRONMENTAL REPORT REQUEST FOR ADDITIONAL INFORMATION –  
ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS**

Reference: Letter from Mallecia Hood (NRC) to Ashok S. Bhatnaker (TVA), Request for  
Additional Information Regarding the Environmental Review of the  
Combined License Application for Bellefonte Nuclear Plant, Units 3 and 4, dated  
July 11, 2008 [ML081840493].


This letter provides the Tennessee Valley Authority's (TVA) response to four of the Nuclear  
Regulatory Commission's (NRC) request for additional information (RAI) items included in the  
reference letter.

The enclosure to this letter provides a response to four of the NRC RAIs related to Alternative  
Sites / Alternative Plant Systems, as well as identifying any associated changes that will be made  
in a future revision of the BLN application. The status of the alternative sites / alternative plant  
systems RAIs is also provided in the enclosure.

If you should have any questions, please contact Thomas Spink at 1101 Market Street, LP5A,  
Chattanooga, Tennessee 37402-2801, by telephone at (423) 751-7062, or via email at  
tespink@tva.gov.

I declare under penalty of perjury that the foregoing is true and correct.

Executed on this 11<sup>th</sup> day of AUG, 2008.



Jack A. Bailey  
Vice President, Nuclear Generation Development

Enclosures:

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

Attachments:

- 9.2-1A. National Institute of Nuclear Investigations, Mexico, *Levelized Costs for Nuclear, Gas and Coal for Electricity, Under the Mexican Scenario, 2004.*
- 9.2-1B. The University of Chicago, *The Economic Future of Nuclear Power; A Study Conducted at The University of Chicago, August 2004.*

Document Control Desk

Page 3

August 11, 2008

cc (Enclosure and Attachments):

M. A. Hood, NRC/HQ

cc (w/o Enclosure and Attachments):

S.P. Frantz, Morgan Lewis

M.W. Gettler, FP&L

R.C. Grumbir, NuStart

P.S. Hastings, NuStart

P. Hinnenkamp, Entergy

R.H. Kitchen, PGN

M.C. Kray, NuStart

A.M. Monroe, SCE&G

C.R. Pierce, SNC

L. Reyes, NRC/RII

R.F. Smith-Kevern, DOE/HQ

G.A. Zinke, NuStart

ENCLOSURE  
RESPONSE TO ENVIRONMENTAL REPORT REQUESTS FOR ADDITIONAL INFORMATION  
ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS

**RESPONSE TO ENVIRONMENTAL REPORT  
REQUESTS FOR ADDITIONAL  
INFORMATION**

**ALTERNATIVE SITES /  
ALTERNATIVE PLANT SYSTEMS**

TVA Letter Dated: August 11, 2008

**Responses to Environmental Report Requests for Additional Information – Alternative Sites / Alternative Plant Systems**

---

This enclosure provides the status of the nine requests for additional information (RAI) related to Alternative Sites/Alternative Plant Systems and provides the BLN responses to four of these requests.

**Status of Requests for Additional Information Related to Alternative Sites and Alternative Plant Systems**

<b>RAI Number</b>	<b>Date of TVA Response</b>
• 9.2-1	This letter – see following pages.
• 9.3-1 <sup>(a)</sup>	Future – expected submittal by August 11, 2008
• 9.3-2	Future – expected submittal by August 11, 2008
• 9.3-3	July 30, 2008. (Reference 1)
• 9.3-4	July 30, 2008. (Reference 1)
• 9.3-5	This letter – see following pages.
• 9.3-6	July 30, 2008. (Reference 1)
• 9.3-7	This letter – see following pages.
• 9.3-8	This letter – see following pages.

- (a) NRC issued two requests with the same RAI Number 9.3-1, one related to Alternative Sites and Alternative Plant Systems and one related to Historic and Cultural Resources. RAI Number 9.3-1 referred to in this table is related to Alternative Sites and Alternative Plant Systems, and will be addressed in a TVA submittal expected by August 6, 2008. RAI Number 9.3-1 related to Historic and Cultural Resources was addressed in TVA's letter dated July 30, 2008 (Reference 1).

**Reference:**

1. Letter from Andrea L. Sterdis (TVA) to NRC Document Control Desk, "Bellefonte Combined License Application – Response to Environmental Report Request for Additional Information – Criteria and Basis for Comparative Ratings Among Alternative Sites," dated July 30, 2008.

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

**NRC Review of the BLN Environmental Report****NRC Environmental Category: ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS****NRC RAI NUMBER: 9.2-1**

Provide references for ER Section 9.2.3.3.

**BLN RESPONSE:**

The references for ER Subsection 9.2.3.3 are included below. Calculations of levelized costs of electricity (LCOE) generation vary widely in different studies. This is, in part, due to the fact that there are many factors that are included in LCOE calculations. The choice of factors to include in the calculations, and the weight each factor is given, affect the calculated LCOE. The apparent discrepancy between Subsections 9.2.3.3.3 and 10.4.2.1.2 is the result of the selection of studies cited and the factors those studies used in calculating the LCOE. The studies referenced in Subsection 10.4.2.1.1 (and the ER text changes below), are based on recent overseas nuclear construction experience that is more current than domestic nuclear construction experience, and likely reflects efficiencies gained from years of construction experience. The ER text has been modified, as shown below, to clarify economic comparisons between alternative generation sources, including the addition of LCOE generation costs from two recent studies (provided as Attachments 9.2-1A and 9.2-1B).

This response is PLANT-SPECIFIC.

**ASSOCIATED BLN COL APPLICATION TEXT CHANGES:**

1. Change COLA Part 3, ER Chapter 9, Subsection 9.2.3.3.3, second and third paragraphs, as follows:

Various studies (Subsection 10.4.2.1.1) show a wide range of electricity generation costs for varying power sources. The levelized cost of electricity generation calculated by these studies is based on various factors, such as choices for discount rate, construction duration, plant lifespan, capacity factor, cost of debt and equity and the split between debt and equity financing, depreciation time, tax rates, and premium for uncertainty (Subsection 10.4.2.1.2). One reason for the difference in reported generation costs between the various studies is the choice of which combinations of these factors are included in their calculations. In some instances, this results in calculated nuclear generation costs that are within the range of costs associated with natural gas and coal-fired plants. The 2005 Organization for Economic Co-operation and Development (OECD) study of projected electricity generating costs (Reference 9), reported a levelized cost of nuclear generation between \$0.021 and \$0.031/kWh at the 5 percent discount rate, while costs for coal and natural gas plants ranged from \$0.025 to \$0.050/kWh and \$0.037 to \$0.060/kWh, respectively. A 2004 National Institute of Nuclear Investigations recent study of the overall costs of generating ~~generation of~~ electricity (Reference 10) provided ~~gave~~ costs of \$0.0227/kWh ~~\$0.0266/kWh~~ for nuclear, \$0.0328/kWh for coal, and \$0.0353/kWh for natural gas at a 5 percent discount rate. A 2004 University of Chicago study (Reference 11) lists a range for nuclear generation costs of \$0.047 to \$0.071/kWh, compared to \$0.033 to \$0.041/kWh and \$0.035 to \$0.045/kWh for coal and natural gas plants, respectively. Solar ranges from \$0.09/kWh to \$0.23/kWh, and wind from \$0.03/kWh to \$0.05/kWh, although as discussed in Subsection 9.2.2.1, the wind generation capability within the overall TVA region is low, and there is not



TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

enough wind to generate output equal to that generated by, ~~there is no area within the TVA range capable of enough wind to equal the generation of~~ the BLN project. To support timely decision making, TVA updates such information as there are changes in market conditions or technological costs. Considering the above information, a range of \$0.036 to \$0.083/kWh has been selected as a reasonable and conservative estimate of the levelized cost of generation for the BLN project, as discussed in Subsection 10.4.2.1.2.

The project costs associated with electricity generation at BLN are anticipated to fall within the range that makes it economically competitive with other forms of electricity generation. ~~all other forms of generation are greater than that of the BLN project. Therefore, any combination of wind and/or solar facilities, and a coal-fired facility is not economically preferable to the BLN project, and should not be considered further.~~

2. Change COLA Part 3, ER Chapter 9, Subsection 9.2.5, by adding References 9, 10, and 11, as follows:

9. Nuclear Energy Agency, Organization for Economic Co-operation and Development (OECD), and International Energy Agency, Projected Costs of Generating Electricity; 2005 Update, Website, <http://213.253.134.43/oecd/pdfs/browseit/6605011E.PDF>, accessed June 5, 2007 (Note: electronic version cannot be printed, Paper version is available for purchase)
10. National Institute of Nuclear Investigations, Mexico, Palacios & others, "Levelized Costs for Nuclear, Gas and Coal for Electricity, Under the Mexican Scenario," 2004.
11. The University of Chicago, The Economic Future of Nuclear Power; A Study Conducted at The University of Chicago, August, available on U.S. Department of Energy website at <http://nuclear.energy.gov/np2010/reports/NuclIndustryStudy-Summary.pdf>, accessed June 5, 2007.

#### ATTACHMENTS:

The following documents are provided as Attachment 9.2-1A and 9.2-1B to this enclosure:

- 9.2-1A. National Institute of Nuclear Investigations, Mexico, *Levelized Costs for Nuclear, Gas and Coal for Electricity, Under the Mexican Scenario*, 2004.
- 9.2-1B. The University of Chicago, *The Economic Future of Nuclear Power, A Study Conducted at The University of Chicago*, August 2004.

(Note: Reference 9 cannot be printed directly from the NEA/OECD website, but is available in full-text format for viewing at the website provided in the reference citation.)

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

**NRC Review of the BLN Environmental Report**

**NRC Environmental Category: ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS**

**NRC RAI NUMBER: 9.3-5**

Provide description of current land-use zoning, urban and industrial development controls and policies at all 4 alternative sites.

**BLN RESPONSE:**

TVA has determined, through communications with local government administrators and the applicable industrial park property managers, that there are no regional zoning or other developmental controls or use restrictions that would prevent the construction of a nuclear reactor plant within the current property boundaries for each of the four alternative sites. However, for the Hartsville site, it was determined that the zoning of the property outside the former Hartsville site boundaries would not allow construction of a nuclear plant, and may require rezoning if it was determined necessary to expand beyond the current property boundaries. However, it is noted that as an agency of the Federal government, TVA is not bounded by State or local zoning or other local land restrictions or policies, and as such, it is not anticipated that the off-site property zoning restrictions would prevent nuclear plant construction on or adjacent to any of these alternative sites.

This response is SITE-SPECIFIC.

**ASSOCIATED BLN COL APPLICATION TEXT CHANGES:**

None.

**ATTACHMENTS:**

None.

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

**NRC Review of the BLN Environmental Report****NRC Environmental Category: ALTERNATIVES SITES / ALTERNATIVE PLANT SYSTEMS****NRC RAI NUMBER: 9.3-7**

Describe the type of land coverage (e.g., industrial/developed, wetlands, forested, flood plain) and the approximate acreage of each land category for the Hartsville, Phipps Bend, and Yellow Creek alternative sites.

**BLN RESPONSE:**

At the request of the NRC, TVA evaluated existing land uses at the Bellefonte site as well as the alternative sites (Table 1). Classified satellite imagery from 2001 was used in conjunction with a geographic information system to make the determinations. The data are the National Land Cover Dataset (NLCD) available from the Multi-Resolution Land Cover Consortium (MRLC). MRLC is a consortium of nine federal agencies (USGS, EPA, USFS, NOAA, NASA, BLM, NPS, NRCS, and USFWS) with the goal of creating land cover data for the entire United States. More information on the NLCD can be found at the following Internet address: <http://www.mrlc.gov/about.php>. It is important to note that wetlands are particularly difficult to classify accurately based on satellite imagery. Therefore, the wetlands acreage listed in Table 1 may differ slightly from those determined via the National Wetlands Inventory database.

**Table 1.****Land Use/Land Cover for Alternative Candidate Sites.**

<b>Land Use (acres)</b>	<b>Hartsville</b>	<b>Phipps Bend</b>	<b>Yellow Creek</b>
Water	65	34	31
Developed, Open Space	124	16	48
Developed, Low Intensity	30	105	18
Developed, Medium Intensity	24	103	8
Developed, High Intensity	95	35	2
Barren	25	0	0
Deciduous Forest	886	303	300
Evergreen Forest	33	2	248
Mixed Forest	47	7	111
Scrub/Shrub	0	2	0
Grassland	179	595	117
Cultivated Crops	393	42	258
Woody Wetlands	32	42	8
<b>Total</b>	<b>1932</b>	<b>1285</b>	<b>1149</b>

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

Class Descriptions

**Open Water** - All areas of open water, generally with less than 25 percent cover of vegetation or soil.

**Developed, Open Space** - Includes areas with a mixture of some constructed materials, but mostly vegetation in the form of lawn grasses. Impervious surfaces account for less than 20 percent of total cover. These areas most commonly include large-lot, single-family housing units, parks, golf courses, and vegetation planted in developed settings for recreation, erosion control, or aesthetic purposes

**Developed, Low Intensity** - Includes areas with a mixture of constructed materials and vegetation. Impervious surfaces account for 20 to 49 percent of total cover. These areas most commonly include single-family housing units.

**Developed, Medium Intensity** - Includes areas with a mixture of constructed materials and vegetation. Impervious surfaces account for 50 to 79 percent of the total cover. These areas most commonly include single-family housing units.

**Developed, High Intensity** - Includes highly developed areas where people reside or work in high numbers. Examples include apartment complexes, row houses, and commercial/industrial buildings. Impervious surfaces account for 80 to 100 percent of the total cover.

**Barren Land (Rock/Sand/Clay)** - Barren areas of bedrock, desert pavement, scarps, talus, slides, volcanic material, glacial debris, sand dunes, strip mines, gravel pits, and other accumulations of earthen material. Generally, vegetation accounts for less than 15 percent of total cover.

**Deciduous Forest** - Areas dominated by trees generally greater than 5 meters tall, and greater than 20 percent of total vegetation cover. More than 75 percent of the tree species shed foliage simultaneously in response to seasonal change.

**Evergreen Forest** - Areas dominated by trees generally greater than 5 meters tall, and greater than 20 percent of total vegetation cover. More than 75 percent of the tree species maintain their leaves all year. Canopy is never without green foliage.

**Mixed Forest** - Areas dominated by trees generally greater than 5 meters tall, and greater than 20 percent of total vegetation cover. Neither deciduous nor evergreen species are greater than 75 percent of total tree cover.

**Shrub/Scrub** - Areas dominated by shrubs; less than 5 meters tall with shrub canopy typically greater than 20 percent of total vegetation. This class includes true shrubs, young trees in an early successional stage, or trees stunted from environmental conditions.

**Grassland** - Areas dominated by graminoid or herbaceous vegetation, generally greater than 80 percent of total vegetation. These areas are not subject to intensive management such as tilling, but can be utilized for grazing.

**Cultivated Crops** - Areas used for the production of annual crops, such as corn, soybeans, vegetables, tobacco, and cotton, and also perennial woody crops such as orchards and vineyards. Crop vegetation accounts for greater than 20 percent of total vegetation. This class also includes all land being actively tilled.

**Woody Wetlands** - Areas where forest or shrub land vegetation accounts for greater than 20 percent of vegetative cover and the soil or substrate is periodically saturated with or covered with water.

This response is PLANT-SPECIFIC.

Enclosure

Page 7 of 8

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

**ASSOCIATED BLN COL APPLICATION TEXT CHANGES:**

None.

**ATTACHMENTS:**

None.

TVA Letter Dated: August 11, 2008

Responses to Environmental Report Requests for Additional Information – Alternative Sites /  
Alternative Plant Systems

---

**NRC Review of the BLN Environmental Report**

**NRC Environmental Category: ALTERNATIVE SITES / ALTERNATIVE PLANT SYSTEMS**

**NRC RAI NUMBER: 9.3-8**

Are there any land-use or development restrictions that would take effect on the Hartsville site once the planned prison construction is complete?

**BLN RESPONSE:**

Based on communications with representatives of the Greater Nashville Regional Council and the Four Lake Regional Industrial Authority, TVA confirmed that sufficient land was purchased to provide the necessary buffer around the planned Trousdale Correctional Center, such that there are no additional land-use or development restrictions placed on the remainder of the former Hartsville site due to the planned penitentiary. Furthermore, the presence of the prison imposes no additional restrictions, zoning, or other special conditions beyond the boundaries of the prison site.

This response is SITE-SPECIFIC.

**ASSOCIATED BLN COL APPLICATION TEXT CHANGES:**

None.

**ATTACHMENTS:**

None.

ATTACHMENT 9.2-1A  
NATIONAL INSTITUTE OF NUCLEAR INVESTIGATIONS, MEXICO  
LEVELIZED COSTS FOR NUCLEAR, GAS AND COAL FOR ELECTRICITY,  
UNDER THE MEXICAN SCENARIO  
2004

**National Institute of Nuclear Investigations  
Mexico**

***Levelized Costs for Nuclear, Gas and Coal for  
Electricity, Under the Mexican Scenario***

**2004**

## **Levelized costs for nuclear, gas and coal for Electricity, under the Mexican scenario.**

Javier C. Palacios, Gustavo Alonso, Ramón Ramírez, Armando Gómez, Javier Ortiz, Luis C. Longoria.

Instituto Nacional de Investigaciones Nucleares  
México

palacios@nuclear.inin.mx, galonso@nuclear.inin.mx .

### **ABSTRACT**

In the case of new nuclear power stations, it is necessary to pay special attention to the financial strategy that will be applied, time of construction, investment cost, and the discount and return rate. The levelized cost quantifies the unitary cost of the electricity (the kWh) generated during the lifetime of the nuclear power plant; and allows the immediate comparison with the cost of other alternative technologies.

The present paper shows levelized cost for different nuclear technologies and it provides comparison among them as well as with gas and coal electricity plants. For the calculations we applied our own methodology to evaluate the levelized cost considering investment, fuel and operation and maintenance costs, making assumptions for the Mexican market, and taking into account the gas prices projections.

The study also shows comparisons using different discount rates (5% and 10%), and some comparisons between our results and an OECD 1998 study. The results are in good agreement and shows that nuclear option is cost competitive in Mexico on the basis of levelized costs.

### **1- The Mexican Scenario**

The globalization and liberalization processes that are taking place in the most advanced economic systems are establishing new behavior rules in the energy systems and, in particular, in the electricity market. The energy policy continues being defined by the smallest cost, considering the limits established by the environmental norms and regulations. However, the experiences registered in pioneer countries in the liberalization of the electric market have granted a great relevance to other objectives, among those that highlight the guarantee and supply quality and the stability of the production costs, and they have been the cause of important modifications in the current strategic valuation of the different energy sources, especially the nuclear.

The operation of the nuclear power stations has been improving until reaching marks of excellence that transforms them into a valuable asset for the electric systems. This technology has incorporated improvements coming from developments in other areas (computer science, materials) and a very solid infrastructure of legislation. Several countries have been developed new programs and designs in order to increase the nuclear capacity of the current operating nuclear power stations. Enlarging the useful life of the plants from 40 to 60 years and increasing their generation capacity from 100% to 105% (this is the case of Mexico) and in some cases up to 120%.

Currently, Mexico has one nuclear power plant located in Laguna Verde, in the state of Veracruz Mexico, starting comercial operation in 1990. This NPP has 2 BWR units with a combined capacity of 1365 MWe. This power represents 3.08% as of March 2004 of the total installed capacity in the country [1]. The Mexican government through Comisión Federal de Electricidad (CFE; Electricity Commission), is the utility owning and operating the nuclear power reactor. This power plant produced in the first three months of 2004 5.23% of the total electricity in the country. Figure 1 shows the distribution of the electricity production in Mexico as of March 2004.

Although in the past the nuclear option was no competitive in Mexico, at present this situation is changing, due to different factors. One of them is the high price of fossile fuel in Mexico mainly



natural gas. Other factor is that the construction time for a nuclear plant in the world has been significantly reduced to the range of three to five years.

Currently, the growth of the Mexican electricity demand requires the addition of electrical generation and more base load capacity in the near future. The recent power generation capacity in Mexico has been based on combined cycle natural gas plants. However, the volatility of the natural gas prices makes necessary to reconsider the viability of these plants as an option to increase the electrical capacity.

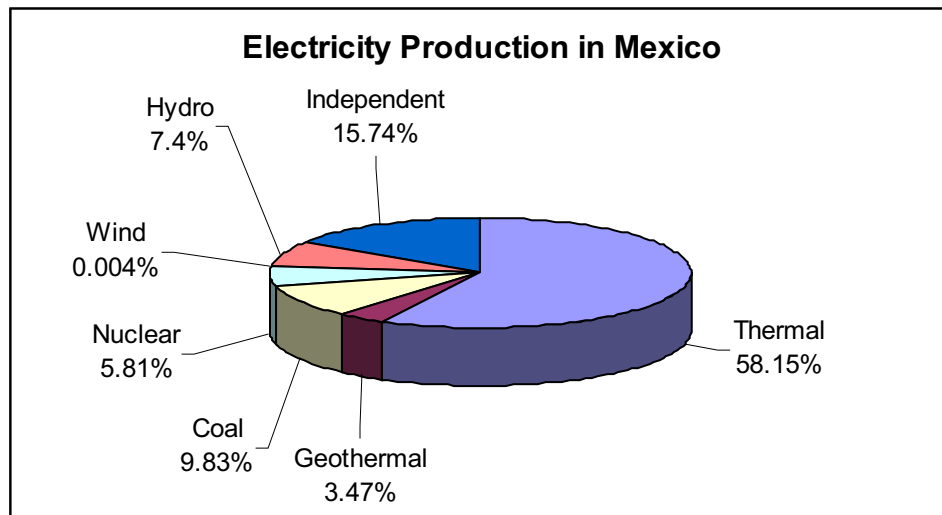


Figure 1. Distribution of the total electricity generation per source in Mexico (March 2004). The plants that use hydrocarbons as fuel are included.

## 2. Levelized Cost

When calculating the costs of electricity generation it is necessary to keep in mind the structure of the investment and their financing costs, and the fuel costs. In the case of the nuclear power stations, it is necessary to pay special attention to the financial strategy that will be applied, time of construction and investment cost, and that it includes the remuneration of the capital. These factors can be kept implicitly in mind in the applicable discount rate for the lifetime of the facility. The levelized cost of the production unit quantifies the unitary cost of the product (the kWh) generated during the facility lifetime; and allows the immediate comparison with the cost of other alternative technologies.

Generally speaking, we can say that the costs of the kWh consist of fixed costs that are generated due to the investment to build the nuclear power plant and variable costs that are proportional to the produced energy. In this study we make use of the methodology of standard calculation of levelized cost and for that we considered the following costs corresponding to:

- Investment
- Fuel
- Operation and Maintenance

The previous costs were used to obtain the levelized costs of electric generation using coal, gas and nuclear energy. We use the two most recent studies to compare the obtained levelized costs. The first of them was carried out in 1998 and it was elaborated by the OECD [2], which projected the generation costs for the period 2005-2010. The second study was elaborated by the Finnish

government in 2002 [3] to compare the electricity generation costs by means of gas, coal and nuclear.

### 3. Fuels for Electricity Generation in Mexico

Recently in Mexico, as in other countries, the cost of natural gas has been very unstable, the more recently prices reported by NYMEX (June 2004) are very high compared with the prices of the past year [4], and this situation should make that the Mexico's government try to find other cheaper way to produce electricity to cover the demand.

The desirable criteria for a fuel for base-load electricity generation in highly populated and industrialized nations may be represented by:

- It should be relatively cheap, giving low cost power.
- Unless it can be supplied from a source very close to the power station it should ideally be a concentrated source of energy, which can therefore be economically transported and readily stockpiled.
- It should have regard to the scarcity of the resource; alternative valued applications (such as burning directly, or chemical feedstock).
- Wastes should be manageable, so that they produce a minimum of pollution and environmental disturbance, including long-term global warming effect.
- It must be safe both in routine operation and regarding possible accident scenarios.

Of the main fuels available for base-load electricity generation in Mexico (natural gas, coal, diesel, oil and uranium), uranium fits mostly those criteria in a better shape than the others resources. National energy strategies will vary according to the natural resources of each country, the economics of importing fuels (or electricity), the grade of industrialization and the security of their supply.

In Table I it is shown the approximated costs distribution in US dollars to obtain 1 kg of  $\text{UO}_2$  (Uranium dioxide) as fuel in nuclear reactors. With the costs of Table I and considering that the calorific content of one kilogram of enriched uranium dioxide is 3400 GJ, the total cost of nuclear fuel is near to 0.27 US\$/GJ.

<b>Table I. Approximated Costs to Obtain 1 kg of <math>\text{UO}_2</math> [6]</b>	
$\text{U}_3\text{O}_8$	US \$200
Conversión	US \$38
Enrichment	US \$452
Fabrication	US \$240
Total	US \$930

Taking into account the following equivalencies:

1 tonne oil equivalent (toe) = 42 GJ and

1 tonne coal equivalent (tce) = 29.3 GJ

To obtain the calorific content of one kg of enriched uranium dioxide it is needed 80.95 toe and 16.04 tce.

The estimations of the prices of natural gas have a lot of variations. Table II shows a comparison between the cost of natural gas (from different sources and years), the cost of coal, diesel, oil and the cost of enriched uranium dioxide.

<b>Table II. Comparisons of Fuel Costs</b>	
<b>Fuel</b>	<b>Cost US\$/GJ</b>
Natural gas (DOE)	4.21
Natural gas (NYMEX- September 2003)	4.54
Natural gas (NYMEX-June 2004)	5.91
Coal (DOE)	1.61
Diesel* (DOE)	7.79
Oil (DOE)	6.83
Enriched uranium dioxide	0.27

\* Average prices that were reported by DOE in May 2004 [5]

The capital cost of peak-load equipment such as gas turbines is about half that of base-load coal-fired plant, and in addition it can be installed much more quickly. However, the fuel cost is relatively high compared with coal in a base-load station, per unit of power generated. Modern combined cycle gas turbine facilities, which have substantially greater efficiencies than that of coal-fired plants, reduce the difference.

#### 4. Costs Comparison between New Reactors and Coal and Gas Plants.

With the third generation of nuclear reactors, and all their innovative characteristics, it is necessary to study the economical advantages or disadvantages of these new designs of nuclear power plants, and compare with the conventional plants in Mexico (coal, diesel, oil and natural gas).

There are several reactors of generation III. The main designs and some characteristics of each one of them are shown in Table III.

<b>Table III. Main Characteristics of the New Nuclear Reactor Designs</b>					
<b>Name</b>	<b>Operating Life</b>	<b>Capacity factor</b>	<b>Electrical Power (MWe)</b>	<b>Thermal efficiency (%)</b>	<b>Overnight capital cost (US\$/kWe)</b>
ABWR	40	0.87	1356	33	1300
AP600	40	0.80	600	33	1400
EPR	40	0.91	1600	36	1241
ACR	40	0.85	1400	33	1000

Where the complete name of the reactors and the suppliers are as follows:

ABWR: Advanced Boiling Water Reactor (GE-Hitachi-Toshiba).  
 AP600: Advanced Pressurized Reactor 600 (Westinghouse).  
 EPR: European Pressurized Reactor (Framatome ANP).  
 ACR: Advanced CANDU Reactor (AECL)

Table IV shows the main characteristics of the coal and natural gas plants.

Table IV. Main Characteristics of Gas and Coal Plants					
Kind of plant	Operating Life	Capacity factor	Electrical Power (MWe)	Thermal efficiency (%)	Overnight capital cost (US\$/kWe)
GAS	25	0.80	400	55	500
COAL	40	0.80	700	40	1000
DIESEL*	25	0.65	37.4	47.61	1030
OIL*	30	0.67	700	37.56	636

\* Data available for Mexico [1].

To find the real cost contribution of the investment or capital cost to the kWh cost, (affected by discount rate and construction schedule), it is necessary to apply a methodology that considers the “present value factor” and a “capital recuperation factor”. The total cost of inversion is calculated by the following equation:

$$CI = CU \left[ \frac{1}{GNA} \right] \left[ \frac{frc(i, n)}{(1+i)} \right] [fvp(i, w)] \quad (1)$$

Where:

*GNA*: is the average total generation per year;

*CU*: is the direct investment cost in dollars per MWe installed.

*frc*: is the capital recuperation factor which depends on the discount rate (*i*), and the economic life of the plant (*n*), defined as follows:

$$frc = \frac{i(1+i)^n}{(1+i)^n - 1} \quad (2)$$

*fvp*: is the present value factor that is a function of the discount rate (*i*), the construction period in years (*N*) and the construction schedule (*W<sub>k</sub>*), defined as;

$$fvp(i, W) = \sum_{k=1}^N W_k (i+1)^{N-(k-1)} \quad (3)$$

Using this methodology the total investment cost of the plants described in Table III and Table IV can be seen in Table V considering a discount rate of 8% and a construction schedule given in Table VI.

Table V. Contribution of investment cost to MWh cost	
Type of plant	Investment cost US\$/MWh
ABWR	17.03
AP600	19.22
EPR	16.18
ACR	12.92
GAS	7.69
COAL	16.09
DIESEL	21.30
OIL	12.75

From Table V it can be seen the cost difference between natural gas plants and nuclear plants, it is around the half of the investment cost of a natural gas plant compared with nuclear plants.

<b>Table VI. Construction Schedule for Nuclear, Gas and Coal Plants</b>		
<b>Type of Plant</b>	<b>Construction years</b>	<b>Capital flow per year (%)</b>
ABWR	4	5.4, 20.5, 59.62, 14.6
AP600	3	11.7, 45.3, 43.0
EPR	5	5.4, 6.3, 45.4, 35.4, 7.6
ACR	3	11.7, 45.3, 43.0
GAS	2	73.8, 26.2
COAL	4	1.4, 41.8, 43.7, 13.1
DIESEL	2	44.6, 55.4
OIL	4	1.7, 25.5, 55.3, 17.5

In section 3 we discussed the impact of the fuel prices in the total energy generation cost. The fuel cost in US\$/MWh for nuclear, coal and natural gas plants can be calculated as a first approximation by the following equation:

$$CI_{FUEL} = \frac{COM}{efic} FC \quad (4)$$

Where:

*COM*: is the fuel price in US\$/GJ;

*FC*: is a conversion Factor ( $FC = 3.6 \text{ US$/GJ} / \text{US$/MWh}$ )

*efic*: is the efficiency of the plant

In Table VII it is shown the contribution of fuel cost to the total cost for the different plants using the approximation given by equation (4)

<b>Table VII. Contribution of Fuel Costs to MWh cost</b>	
<b>Fuel</b>	<b>Cost in US\$/MWh</b>
Nuclear (0.27 US\$/GJ)	2.94
Gas 1 (4.21 US\$/GJ)	27.55
Gas 2 (4.54 US\$/GJ)	29.71
Gas 3 (5.91 US\$/GJ)	38.61
Coal (1.61 US\$/GJ)	14.49
Diesel (7.79 US\$/GJ)	58.9
Oil (6.83 US\$/GJ)	65.46

Finally for a total generation cost it is necessary to consider the operation and maintenance costs (O&M). The costs of O&M used in this paper were the standard costs for Mexico. Table VIII shows these costs.

<b>Table VIII. Contribution of O&amp;M Costs to MWh cost</b>	
<b>Kind of Plant</b>	<b>Cost in US\$/MWh</b>
Nuclear	8.19
Gas	3.26
Coal	6.64
Diesel	12.51
Oil	2.84

In Figure 2 we present the total energy generation cost for all the scenarios considered in this paper.

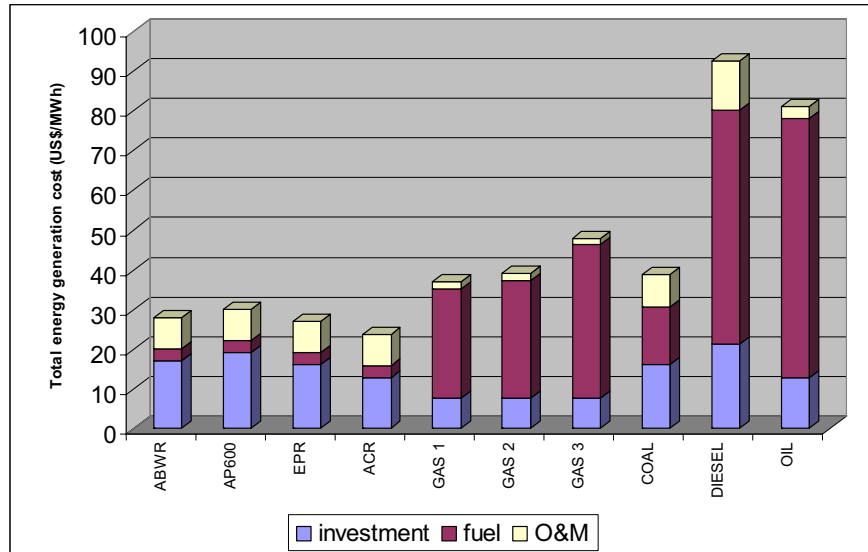


Figure 2. Total energy cost for Nuclear, Gas and Coal Plants

As was discussed in section 3, the variation in the total cost of electricity generation of the different plants as a function of the variation of fuel price is more drastic in the case of gas, and coal fuel compared with uranium. As an example, we can see from figure 3 that if the fuel prices increase 100%, this would result in a 16.21% increase in the cost of nuclear generation, 55.44% in the case of coal generation and 79.01% for natural gas.

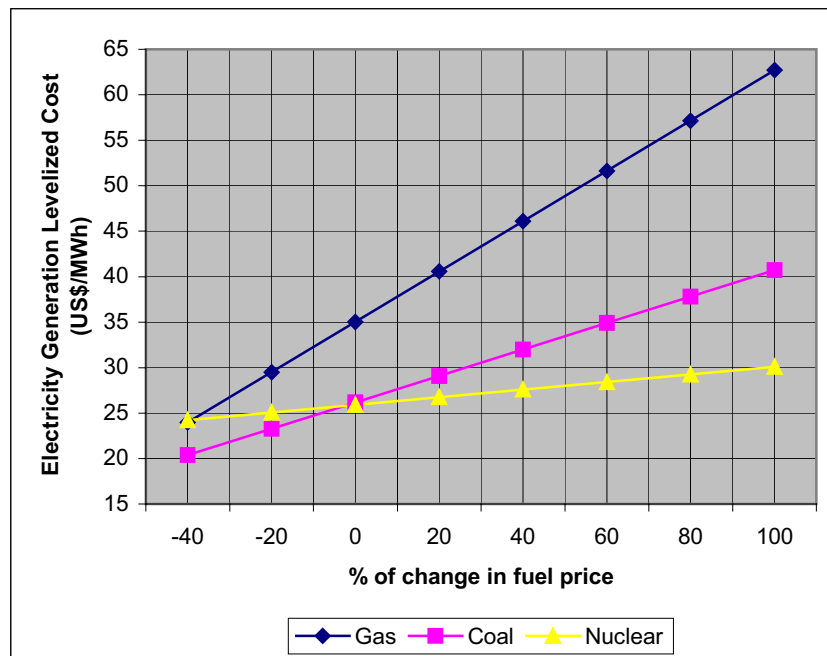


Figure 3. Variation in the total cost of electricity generation as a function of the variation of fuel price

Finally in figure 5 we show the results for the levelized cost of electricity generation at different discount rates.

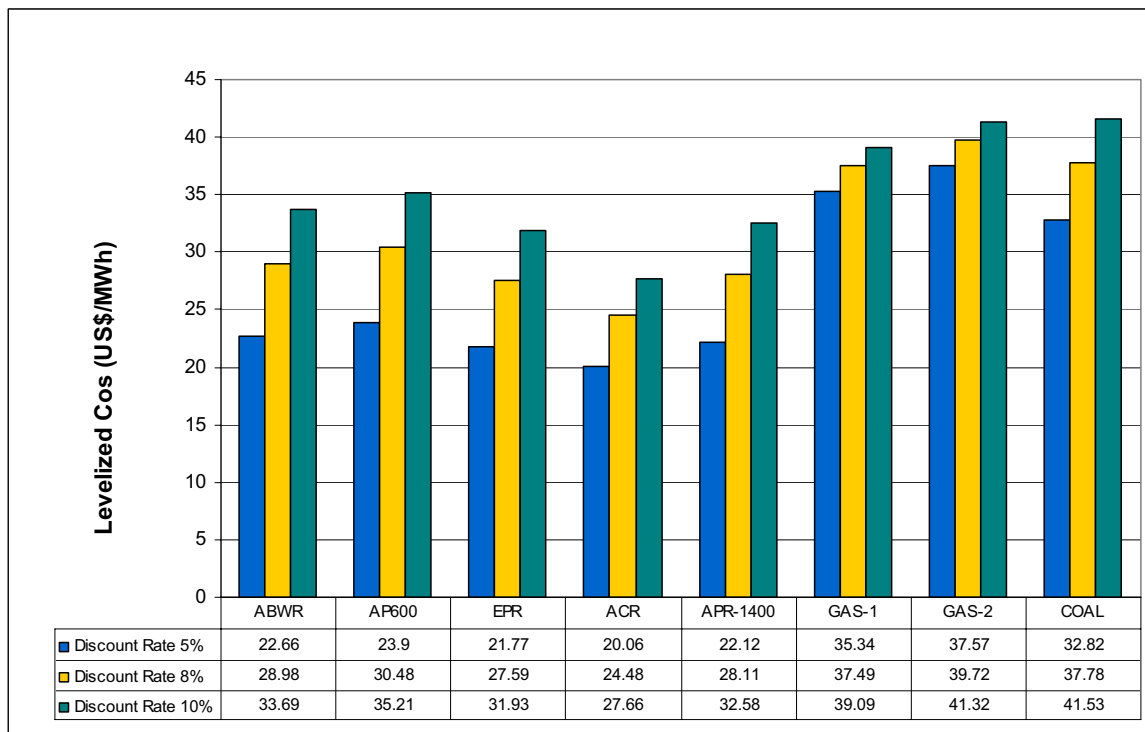


Figure 4. Levelized cost at different discount rates for electricity generation.

### 5. Comparison between ININ results and OCDE and Finish studies.

As we mentioned in section 2 we use two recent studies to compare the obtained levelized costs. The first of them was carried out in 1998 and it was elaborated by the OECD [2], which projected the generation costs for the period 2005-2010. The second study was elaborated by the Finnish government in 2002 [3] to compare the electricity generation costs by means of gas, coal and nuclear.

For comparison purposes we use a discount rate of 5%. From the results obtained in this study and those reported by the OECD and Finland, we can observe the reduction of the levelized cost since the OCDE results. Also we can see that in the three studies it is demonstrated that the most economic option in generation for levelized cost is the nuclear one. The results of the comparison are shown in figure 5.

### 6. Final Discussion

The investment cost of the nuclear power stations could seem relatively high, but they can be redeemed in a reasonable time due to their variable costs (especially that of fuel) is reduced and is not vulnerable in front of fluctuations of the market. With these characteristics, the nuclear power stations are good to produce load-base electricity, it means, working the 24 hours of every day of the year.

The social acceptability is today the biggest obstacle for the use of the nuclear power stations. This phenomenon is the result of the non well understanding of a relatively complicated technology and the fear to some unlikely risks, among others factors

From the levelized cost methodology, and taking into account the volatility of gas prices, the nuclear option could be a good choice to be considered for Mexico in the near future.

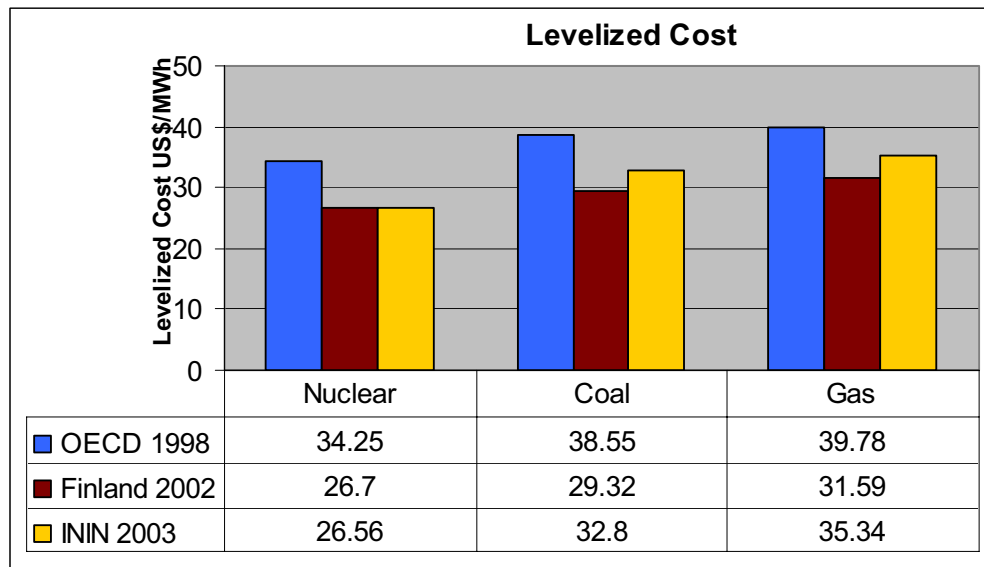


Figure 5. Comparison for electricity generation total levelized cost.

## 7 References.

- [1] Comisión Federal de Electricidad (CFE- Mexico), <http://www.cfe.gob.mx/www2/home.asp> (2004)
- [2] Results from the OECD report on international projections of electricity generation costs, Proceedings of IJGPC 98: International Joint Power Generation Conference and Exhibition, 24-26 August 1998, Baltimore, MD.
- [3] Finlandia. Foro de la Industria Nuclear Española, Mayo 2002.
- [4] WTRG Economics, Analysis, planning, forecast and data services for energy producers and consumers. <http://www.wtrg.com/> (2004).
- [5] DOE/EIA-04884(2004), "International Energy Outlook 2004", April 2004.
- [6] World Nuclear Association, The economics of Nuclear Power, October 2003 <http://www.world-nuclear.org/info/inf02.htm>



ATTACHMENT 9.2-1B  
THE UNIVERSITY OF CHICAGO  
THE ECONOMIC FUTURE OF NUCLEAR POWER;  
A STUDY CONDUCTED AT THE UNIVERSITY OF CHICAGO  
AUGUST 2004

**The University of Chicago**

***The Economic Future of Nuclear Power,  
A Study Conducted at The University of Chicago***

**August 2004**

# THE ECONOMIC FUTURE OF NUCLEAR POWER



**A Study Conducted at The University of Chicago**

**August 2004**



**Disclaimer**

Neither the United States Government nor any agency thereof, nor The University of Chicago, nor any of their employees or officers, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. The views and opinions of document authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, Argonne National Laboratory, or the institutional opinions of The University of Chicago.

**THE ECONOMIC FUTURE OF NUCLEAR POWER**

**A Study Conducted at The University of Chicago**

**August 2004**



### **STUDY PARTICIPANTS**

George S. Tolley, Professor Emeritus at The University of Chicago, and Donald W. Jones, Vice President of RCF Economic and Financial Consulting, Inc., directed the study.

The study was carried out in cooperation with the Department of Economics, the Graduate School of Business, and the Harris School of Public Policy of The University of Chicago. Graduate students and advanced undergraduate students coauthored the study as follows:

<b>Name</b>	<b>Topic</b>	<b>Affiliation</b>
Martin Castellano	Nonproliferation	Harris School of Public Policy
William Clune	Nuclear Waste Disposal Nuclear Fuel Cycle Nuclear Regulation	Harris School of Public Policy
Philo Davidson	Future Electricity Capacity	Economics
Kant Desai	Nuclear Technologies Hydrogen, Gas, and Coal Technologies Environmental Policies	Harris School of Public Policy
Amelia Foo	Hydrogen	Economics
Adrian Kats	Energy Security	Economics
Minghao Liao	Levelized Costs of Electricity	Harris School of Public Policy
Emil Iantchev	Energy Security	Economics
Nathan Ilten	International Comparisons	Economics
Wei Li	Financing Issues	Graduate School of Business
Mark Nielson	Financing Issues	Economics
Ashwin Rode Harris	Fuel Prices	School of Public Policy
James Taylor	Nuclear Technologies Hydrogen	Harris School of Public Policy
Walter Theseira	Electricity Futures	Harris School of Public Policy
Stephanie Waldhoff	Environmental Policies	Harris School of Public Policy
Daniel Weitzenfeld	Learning by Doing	Economics
Jie Zheng	Financing Issues Nuclear Scenarios: 2015	Graduate School of Business



## TABLE OF CONTENTS

PREFACE.....	vii
DOE NUCLEAR POWER 2010 PROGRAM.....	viii
ACKNOWLEDGEMENTS.....	ix
ABSTRACT.....	x
EXECUTIVE SUMMARY.....	xi
SUMMARY.....	S-1

### TABLES

Table 1:	Shares of Total U.S. Electricity Generation, by Type of Generation, 2003 .....	S-1
Table 2:	Summary Worksheet for Busbar Cost Comparisons, \$ per MWh, with Capital Costs in \$ per kW, 2003 Prices .....	S-2
Table 3:	Organization for Economic Co-operation and Development (OECD) Busbar Costs, 75 Percent Capacity Factor, 40-Year Plant Life, \$ per MWh, 2003 Prices.....	S-4
Table 4:	Conditions Associated with Alternative Learning Rates .....	S-6
Table 5:	Parameter Values for No-Policy Nuclear LCOE Calculations .....	S-7
Table 6:	First-Plant LCOEs for Three Reactor Costs, 5- and 7-Year Construction Periods, \$ per MWh, 2003 Prices .....	S-8
Table 7:	Effects of Capacity Factor, Construction Period, and Plant Life on First-Plant Nuclear LCOE for Three Reactor Costs, \$ per MWh, 2003 Prices.....	S-8
Table 8:	LCOEs for Pulverized Coal and Gas Turbine Combined Cycle Plants, \$ per MWh, 2003 Prices .....	S-9
Table 9:	Cost Characteristics of Fossil-Fired Electricity Generation.....	S-10
Table 10:	Natural Gas Price Projections .....	S-11
Table 11:	Nuclear LCOEs with Loan Guarantees, \$ per MWh, 2003 Prices.....	S-13
Table 12:	Nuclear LCOEs with Accelerated Depreciation Allowances, \$ per MWh, 2003 Prices.....	S-13
Table 13:	Nuclear LCOEs with Investment Tax Credits, \$ per MWh, 2003 Prices .....	S-13
Table 14:	Nuclear LCOEs with Production Tax Credits, \$18 per MWh, 8-Year Duration, \$ per MWh, 2003 Prices .....	S-14
Table 15:	Effects of Combined \$18 per MWh 8-Year Production Tax Credits and 20 Percent Investment Tax Credits on Nuclear Plants' LCOEs, \$ per MWh, 2003 Prices.....	S-14
Table 16:	LCOEs for the Fifth Nuclear Plant, with No Policy Assistance, 7-Year Construction Time, 10 Percent Interest Rate on Debt, and 15 Percent Rate on Equity, \$ per MWh, 2003 Prices.....	S-15
Table 17:	LCOEs for the Fifth Nuclear Plant, with No Policy Assistance, 5-Year Construction Time, 7 Percent Interest Rate on Debt, and 12 Percent Rate on Equity, \$ per MWh, 2003 Prices.....	S-15



TABLES(contd.)

Table 18:	Fossil LCOEs with and without Greenhouse Policies, \$ per MWh, 2003 Prices.....	..S-16
Table A-1:	Plant and Market Model Summary .....	..S-18
Table A-2:	Summary of New Reactor Designs .....	..S-20
Table A-3:	Components of Front-End Nuclear Fuel Costs, \$ per kg U, 2003 Prices .....	..S-21
Table A-4:	Disposal Costs, \$ per MWh, 2003 Prices.....	..S-21

## **PREFACE**

In 2003, the U.S. Department of Energy (DOE), acting through Argonne National Laboratory (ANL), requested a study of the economic factors affecting the future of nuclear power in the United States. The study was carried out at The University of Chicago.

The present report gives the results of the study. Intended to be a white paper, it is a systematic review of the economics of nuclear power that can serve as a reference for future studies. It does not take a position on policy subjects. Rather, it reviews and evaluates alternative sources of information bearing on the nuclear power industry, and presents scenarios encompassing a reasonable range of future possibilities.

Part I considers factors affecting the competitiveness of nuclear power. Topics include (1) levelized costs, (2) comparisons with international nuclear costs, (3) capital costs, (4) effects of learning by doing, and (5) financing issues.

Part II analyzes gas-fired and coal-fired technologies as the major baseload competitors to nuclear generation. Topics include technologies that could reduce the costs of gas- and coal-fired electricity, future fuel price changes, and the potential economic impact of greenhouse gas control policies and technology.

Part III analyzes several federal financial policy alternatives designed to make nuclear power competitive in the next decade and beyond.

The Appendix provides comprehensive background information underpinning the body of the study. Previous nuclear energy studies were less comprehensive. The demand for new electricity generating capacity in the United States is estimated. A major concern is the viability of new nuclear plants as a way to meet growing electrical demand during the next decade. The study focuses on baseload electrical capacity. Appendices A1 through A9 address the major factors that affect the desirability and the viability of nuclear power. Conclusions include the following:

- Waste disposal issues remain to be settled.
- U.S. policy regarding nonproliferation goals will affect future fuel cycle decisions.
- Regulatory simplification shows promise of reducing plant construction times.
- A transition from oil-based to hydrogen-based transportation could, in the longer run, increase the demand for nuclear power as a non-polluting way to produce hydrogen.
- If gas imports increase, nuclear power could substitute for gas and contribute to energy security.

### **DOE NUCLEAR POWER 2010 PROGRAM**<sup>\*</sup>

In FY 2003, the U.S. Department of Energy (DOE) initiated a University of Chicago study on the economic viability of new nuclear power plants in the United States. This report describes the results of that study. According to DOE's Fiscal Year 2005 Budget Report, "the information obtained from this study is used to focus the program's activities on issues of the greatest impact" (DOE 2004, p. 397).

The Nuclear Power 2010 program is a joint government-industry cost-shared effort involved with identifying sites for new nuclear power plants, developing advanced nuclear plant technologies, evaluating the business case for building new nuclear power plants, and demonstrating untested regulatory processes. These efforts are designed to pave the way for an industry decision by the end of 2005 to order a new nuclear power plant. The regulatory tasks include demonstration of the Early Site Permit (ESP) and combined Construction and Operating License (COL) processes to reduce licensing uncertainties and minimize attendant financial risks to the licensee.

The Nuclear Power 2010 program continues to evaluate the economic and business case for building new nuclear power plants. This evaluation includes identification of the economic conditions under which power generation companies would add new nuclear capacity. In July 2002, DOE published a draft report, "Business Case for New Nuclear Power Plants in the United States," which provided recommendations for federal government assistance. DOE continues to develop and evaluate strategies to mitigate specific financial risks associated with deployment of new nuclear power plants identified in that report.

Recently, DOE solicited proposals from teams led by power generation companies to initiate new nuclear plant licensing demonstration projects. Under a cost-sharing arrangement, power companies will conduct studies, analyses, and other activities necessary to select an advanced reactor technology and prepare a site-specific, technology-specific COL application. DOE has already received responses from several utility consortia.

DOE has also initiated a technology assessment of nuclear power plant construction, which is being conducted in cooperation with the power generation companies. That study has assessed schedules and construction methods for the nuclear power plant designs most likely to be built in the near term.

---

<sup>\*</sup>Source: U.S. Department of Energy (DOE). (2004). "FY 2005 DOE Budget Request, Energy and Water Development Appropriations," Vol. 3, Nuclear Energy, pp. 395-398. <http://www.mbe.doe.gov/budget/05budget/content/es/nuclear.pdf>.

### **ACKNOWLEDGEMENTS**

Many persons have made generous and valuable contributions to this study. Deserving special mention are Donald Joyce and Stephen Goldberg of ANL, who gave help throughout. In addition, William Magwood, Thomas Miller and Kenneth Chuck Wade of DOE provided very timely and useful assistance. Other contributors include Stephen Aumeier, Phillip Finck, Stephen Berry, Prashant Bharadwaj, Gale Boyd, Chaim Braun, Kim Cawley, Matthew Crozat, Hermann Grunder, Richard Hornbeck, Dale Knutson, Jane Mahoney, Ella Revzin, Thomas Rosenbaum, Allen Sanderson, Luc van den Durpel, Mark Grenchik, and Latif Yacout. Their assistance is gratefully acknowledged.

**ABSTRACT**

Developments in the U.S. economy that will affect the nuclear power industry in coming years include the emergence of new nuclear technologies, waste disposal issues, proliferation concerns, the streamlining of nuclear regulation, a possible transition to a hydrogen economy, policies toward national energy security, and environmental policy. These developments will affect both the competitiveness of nuclear power and appropriate nuclear energy policies. A financial model developed in this study projects that, in the absence of federal financial policies aimed at the nuclear industry, the first new nuclear plants coming on line will have a levelized cost of electricity (LCOE, i.e., the price required to cover operating and capital costs) that ranges from \$47 to \$71 per megawatt-hour (MWh). This price range exceeds projections of \$33 to \$41 for coal-fired plants and \$35 to \$45 for gas-fired plants. After engineering costs are paid and construction of the first few nuclear plants has been completed, there is a good prospect that lower nuclear LCOEs can be achieved and that these lower costs would allow nuclear energy to be competitive in the marketplace. Federal financial policies that could help make early nuclear plants more competitive include loan guarantees, accelerated depreciation, investment tax credits, and production tax credits. In the long term, the competitiveness of nuclear power could be further enhanced by rising concerns about greenhouse gas emissions from fossil-fuel power generation.

## **EXECUTIVE SUMMARY**

### **Context**

Developments in the U.S. economy that will affect the nuclear industry in the future include the emergence of new nuclear technologies, decisions about nuclear fuel disposition, proliferation concerns, regulatory reform, a potential transition to a hydrogen economy, national energy security policies, and environmental policies. A successful transition from oil-based to hydrogen-based transportation could, in the long run, increase the demand for nuclear energy as a nonpolluting way to produce hydrogen.

The U.S. Department of Energy (DOE) currently supports research on designs for advanced nuclear power plants that can produce hydrogen as well as increase the sustainability and proliferation-resistance of nuclear energy and help lower nuclear energy costs. DOE also supports the certification of new nuclear reactor designs and the early site permitting process that will help make the licensing of new nuclear plants more predictable. Such predictability promises to lower financial risk by reducing the time required to construct and license new plants.

This study analyzes the economic competitiveness of nuclear, gas-fired, and coal-fired electricity.

### **Summary of Economic Findings**

#### **Economics of Deploying Plants during the Next Decade**

- Capital cost is the single most important factor determining the economic competitiveness of nuclear energy.
- First-of-a-kind engineering (FOAKE) costs for new nuclear designs could increase capital costs by 35 percent, adversely affecting nuclear energy's competitiveness.
- The risk premium paid to bond and equity holders for financing new nuclear plants is an influential factor in the economic competitiveness of nuclear energy. A 3 percent risk premium on bonds and equity is estimated to be appropriate for the first few new plants.
- Without federal financial policy assistance, new nuclear plants coming on line in the next decade are projected to have a levelized cost of electricity (LCOE) of \$47 to \$71 per megawatt-hour (MWh). This study provides a full range of LCOEs for first nuclear plants for alternative construction periods, plant lives, capacity factors, and overnight cost estimates. LCOEs for coal- and gas-fired electricity are estimated to be \$33 to \$41 per MWh and \$35 to \$45 per MWh, respectively.

- With assistance in the form of loan guarantees, accelerated depreciation, investment tax credits, and production tax credits, new nuclear plants could become more competitive, with LCOEs reaching \$32 to \$50 per MWh.

Economics of Deploying the Next Series of Nuclear Plants

- With the benefit of the experience from the first few plants, LCOEs are expected to fall to the range of \$31 to \$46 per MWh; no continued financial assistance is required at this level.

Future Greenhouse Gas Policies

- If stringent greenhouse policies are implemented and advances in carbon capture and sequestration prove less effective than hoped, coal-fired electricity's LCOE could rise as high as \$91 per MWh and gas-fired electricity's LCOE could rise as high as \$68 per MWh. These LCOEs would fully assure the competitiveness of nuclear energy.

## **SUMMARY**

### **Background**

The focus of this study is baseload electricity as supplied by nuclear, coal-fired, and gas-fired technologies. Baseload power is power that a utility generates continuously, year round, in anticipation of the minimum customer demand that will occur, regardless of daily and seasonal fluctuations. Nuclear energy, coal, and gas are the major baseload fuel alternatives. Renewables are not considered since they are used minimally to meet baseload demand. While hydroelectric facilities supply baseload generation in some parts of the United States, the major opportunities for hydroelectric projects have already been taken. Table 1 presents the shares of generation furnished by various technologies in the United States. This study synthesizes the current understanding of the factors affecting the economic viability of nuclear power and estimates its viability under a range of future scenarios.

**Table 1: Shares of Total U.S. Electricity Generation, by Type of Generation, 2003<sup>a</sup>**

<b>Energy Source</b>	<b>Net Generation, Percent</b>
Coal	50.1
Nuclear	20.2
Natural Gas	17.9
Hydroelectric	6.6
Petroleum	2.5
Non-hydro Renewables	2.3
Other Sources	0.4
<b>Total</b>	<b>100</b>

<sup>a</sup>Identical to Table A1-1.

### **Part One: Economic Competitiveness of Nuclear Energy**

This study first develops a pre-tax levelized cost of electricity (LCOE) model and uses it to calculate LCOEs for nuclear, coal, and gas generation based on values from recent plant models and data developed for use in those models. The LCOE is the price at the busbar needed to cover operating costs plus annualized capital costs. Table 2 summarizes these results.



**Table 2: Summary Worksheet for Busbar Cost Comparisons, \$ per MWh, with Capital Costs in \$ per kW, 2003 Prices<sup>a</sup>**

Technology	Sandia Model GenSim		SAIC Model Power Choice			Scully Capital Report			EIA – AEO 2004	
	r=10%	r=15%	Debt r = 8%; Disc r = 8%	Debt r =10%; Disc r = 8%	Debt r =10%; Disc r = 10%	r = 8%	r = 10%	r = 10%	Debt r =10%; Eq = 15%; Disc r = 10%	Debt r =8%; Eq = 10%; Disc r = 10%
Nuclear (capital cost)	51 (1,853)	83 (1,853)								
Legacy Nuclear (capital cost)			65 (2,000)	70 (2,000)	77 (2,000)					
EIA Reference Case, New Nuclear (capital cost)									63 to 68  (1,752 to 1,928)	
EIA Advanced Technology Case, New Nuclear (capital cost)									43 to 53  (1,080 to 1,555)	
ABWR (capital cost)			53 (1,600)	50 (1,600)	55 (1,600)					
AP 1000 (capital cost)			49 (1,365)	46 (1,365)	51 (1,365)	36 (1,247)	40 (1,247)	44 (1,455)		
Pebble Bed Modular Reactor (PBMR) (capital cost)			40  (1,365)	41  (1,365)	45  (1,365)					
Gas Turbine Modular Helium Reactor (GT-MHR) (capital cost)			39  (1,126)	39  (1,126)	43  (1,126)					
Advanced Fast Reactor (AFR) (capital cost)			57  (1,126)	57  (1,126)	64  (1,126)					
Coal (capital cost)	37 (1,094)	48 (1,094)	43 (1,350)	44 (1,350)	49 (1,350)					38 (1,169)
Gas Turbine Combined Cycle (capital cost)	35  (472)	40  (472)	38  (590)	38  (590)	40  (590)					41  (466)
Gas Combustion Turbine (capital cost)	56  (571)	68  (571)								
Solar-Photovoltaic	202	308								
Solar-Thermal	158	235								
Wind	55	77								

<sup>a</sup>Identical to Table 1-1.

To illuminate the reasons for the ranges of LCOEs estimated in prior studies, this study calculates LCOEs using the cost and performance assumptions used in three plant models identified in Appendix A2 (Table A2-1) and in the National Energy Modeling System (NEMS), as reported in the Energy Information Administration's (EIA's) *Annual Energy Outlook*. The Sandia model, GenSim, does not specify a particular nuclear technology; rather, it adopts EIA's specifications from the 2003 *Annual Energy Outlook* (AEO 2003). At a base capital cost of \$1,853 per kW, increasing the discount rate from 10 to 15 percent raises the GenSim busbar nuclear cost from \$51 to \$83 per megawatt-hour (MWh). GenSim's estimates for competitors to nuclear are: \$37 to \$48 per MWh for coal, \$35 to \$40 per MWh for gas turbine combined cycle, and \$56 to \$68 per MWh for gas combustion turbines. The SAIC model, Power Choice, considers several nuclear technologies; cost estimates range from \$39 per MWh for the Gas Turbine Modular Helium Reactor (GT-MHR) to \$77 per MWh for existing nuclear technology. Coal-fired costs are on a par with the Pebble Bed Modular Reactor (PBMR) costs, at \$43 to \$49 per MWh. Gas turbine combined cycle costs are in the range of \$35 to \$48 per MWh. The Scully model compares alternative financing plans for a technology that broadly corresponds to the AP1000. The busbar cost range is \$36 to \$44 per MWh. The reference case in EIA's recent *Annual Energy Outlook* (AEO 2004) considers future construction of historical designs. Its assumptions regarding capital costs and interest rates result in a nuclear busbar cost of \$63 to \$68 per MWh, which is higher than most other studies. However, its cost for coal generation is \$38 per MWh. Its advanced technology case lowers capital costs, partly to reflect learning effects in construction, which produces LCOEs of \$43 to \$53 per MWh.

### **Worldwide Cost Estimates**

This study compares U.S. nuclear busbar costs with those in other countries that use electricity generated from nuclear energy, coal, and gas. U.S. nuclear busbar costs are estimated to be somewhat below the middle of the worldwide range for countries not reprocessing spent fuel, i.e., \$36 to \$65 per MWh. LCOEs of new nuclear plants in the United States compare favorably to prospective costs for new nuclear plants in France. Table 3 reports the nuclear busbar costs for various countries; separate estimates are provided for fuel cycles that dispose of spent fuel directly and those that reprocess spent fuel.

**Table 3: Organization for Economic Co-operation and Development (OECD) Busbar Costs, 75 Percent Capacity Factor, 40-Year Plant Life, \$ per MWh, 2003 Prices<sup>a</sup>**

Plant Type	Country	Discount Rate (To Derive Net Present Value)	
		8 Percent	10 Percent
		\$ per MWh	
Nuclear, Spent Fuel Disposal	Finland, new SWR 1000	36	42
	Canada	39 to 45	48 to 53
	China	44	54
	United States	45	53
	Russia	45	55
	Romania	49	59
	Korea	49	59
	India	52	64
	Turkey	53	64
	Finland	58	68
	Spain	65	78
Nuclear with Reprocessing	China	39 to 50	47 to 61
	France	50	60
	Japan	83	97
Gas Turbine Combined Cycle	OECD average	30 to 66	38 to 65
Advanced Gas Turbine Combined Cycle	United States	26	27
Pulverized Coal Combustion	OECD average	36 to 74	43 to 84
Coal Circulating Fluidized Bed	Canada	56	63
Coal Integrated Gasification Combined Cycle (IGCC)	OECD average	36 to 66	42 to 74

<sup>a</sup> From Tables 2-5 and 2-6.

### Overnight Capital Cost Estimates

Capital costs, the single most important cost component for nuclear power, are analyzed in detail. For the Advanced Boiling Water Reactor (ABWR), already built in Asia, and the AP1000, a smaller scale version of which has been certified by the U.S. Nuclear Regulatory Commission (NRC), overnight capital costs, or undiscounted capital outlays, account for over a third of LCOE; interest costs on the overnight costs account for another quarter of the LCOE. Overnight cost estimates from different sources have ranged from less than \$1,000 per kilowatt (kW) to as much as \$2,300 per kW. This study examines the reasons for the differences in these estimates, with the aim of estimating a narrower plausible range.

One reason that early plants are more expensive is the impact of first-of-a-kind engineering (FOAKE) costs. Several hundred million dollars may be expended to complete the engineering design specifications for Generation III or III+ reactors. Such costs are incurred for early nuclear plants built of any type. Although building a reactor of a particular design in one country may enable transfer of part of the engineering that will be used in another country, some partial FOAKE costs may still be incurred for the first construction in any given country.

FOAKE costs are a fixed cost of a particular reactor design. How a vendor allocates FOAKE costs across all the reactors it sells can affect the overnight cost of early reactors considerably. A vendor may be concerned about its ability to sell multiple reactors and therefore want to recover all FOAKE costs on its first plant. FOAKE costs could raise the overnight cost of the first plant by 35 percent.

This study uses the Advanced Boiling Water Reactor (ABWR), the CANDU ACR-700, the AP1000, and the Framatome SWR 1000 as reasonable candidates for deployment in the United States by 2015.

- An overnight cost of \$1,200 per kW is assumed for a generic class of mature designs.
- An overnight cost of \$1,500 per kW is assumed for a generic class of designs that require payment of FOAKE costs.
- An overnight cost of \$1,800 per kW is assumed for a generic class of more advanced designs that also require FOAKE costs.

Consideration of the four reactor types contributes to the choice of \$1,200, \$1,500, and \$1,800 per kW for overnight costs, a range consistent with estimates identified in EIA's 2004 advanced technology case. (See AEO 2004.)

### **Learning by Doing**

The study finds that reductions in capital costs between a first new nuclear plant and some <sup>n</sup><sup>th</sup> plant of the same design can be critically important to eventual commercial viability. In building the early units of a new reactor design, engineers and construction workers learn how to build the plants more efficiently with each plant they build. A case can be made that the nuclear industry will start with very little learning from previous experience when the first new nuclear construction occurs in the United States. The paucity of new nuclear construction over the past twenty years in the United States, together with the entry of new technologies and a new regulatory system, has eliminated much of the applicable U.S. experience. On the other hand, participation in overseas construction may have given some U.S. engineers experience that is transferable to construction in the United States.

This study uses a range of 3 to 10 percent for future learning rates in the U.S. nuclear construction industry, where learning rate is the percent reduction in cost resulting from doubling the number of plants built. Table 4 summarizes the conditions associated with different learning rates.

**Table 4: Conditions Associated with Alternative Learning Rates<sup>a</sup>**

<b>Learning Rate (Percent for Doubling Plants Built)</b>	<b>Pace of Reactor Orders</b>	<b>Number of Reactors Built at a Single Site</b>	<b>Construction Market</b>	<b>Reactor Design Standardization</b>	<b>Regulation Impacts</b>
3	Spread apart 1 year or more	Capacity saturated; no multiple units	Not highly competitive; can retain savings from learning	Not highly standardized	Some construction delays
5	Somewhat more continuous construction	Somewhat greater demand for new capacity; multiple units still uncommon	More competitive; most cost reductions from learning passed on to buyers	Narrower array of designs	Delays uncommon
10	Continuous construction	High capacity demand growth; multiple units common	Highly competitive; all cost reductions passed on	Several designs; sufficient orders for each to achieve standardization learning effects	Construction time reduced and delays largely eliminated

<sup>a</sup>Identical to Table 4-6.

### **The Financial Model**

This study employs a financial model for businesses that is based on the following equation:

$$\text{PRESENT VALUE OF EQUITY INVESTMENT DURING THE CONSTRUCTION PERIOD} \\ = \text{PRESENT VALUE OF NET REVENUE EARNED BY EQUITY OVER THE LIFE OF THE PLANT}$$

where

$$\text{NET REVENUE} = \text{EARNINGS FROM LCOE REVENUE BEFORE INTEREST AND TAXES (EBIT)} - \\ \text{INTEREST EXPENSE} - \text{TAX EXPENSE} + \text{DEPRECIATION} - \text{REPAYMENT OF DEBT}$$

Because risk is a major consideration for investors, its treatment in the financial model is an important factor in deriving the required net revenue. The perceived risk of investments in new nuclear facilities contributes to the risk premium on new nuclear construction. Principal

sources of risk are the possibilities that construction delays will escalate costs and that new plants will exceed original cost estimates for other reasons. This study uses guidelines from the corporate finance literature, previous nuclear studies, and opinions of investment analysts to specify likely relationships between project risk and risk premiums for corporate bonds and equity capital. Risks associated with building a new nuclear plant are estimated to raise the required rate of return on equity to 15 percent, compared to 12 percent for other types of facilities, and debt cost to rise to 10 percent from 7 percent.

Table 5 specifies the parameter values for LCOE calculations under the assumption that no financial policies benefiting nuclear power are in effect. In using the financial model to study sensitivities, overnight costs of \$1,200, \$1,500, and \$1,800 per kW are used. Table 6 summarizes the "no-policy" LCOEs for the three nuclear capital costs, each under 5-year and 7-year anticipated construction times. These construction times are expected values perceived by investors, based on both previous nuclear construction experience and new information. This study assumes investors will conservatively expect a 7-year construction period for the first few new plants. If actual construction times prove to be 5 years, investors will revise their expectations downward accordingly for subsequent plants.

**Table 5: Parameter Values for No-Policy Nuclear LCOE Calculations<sup>a</sup>**

Item	Parameter Value
Overnight Capital Cost	\$1,200 per kW   \$1,500 per kW   \$1,800 per kW
Plant Life	40 years
Construction Time	7 years
Plant Size	1,000 MW
Capacity Factor	85 percent
Hours per Year	8,760 hours
Cost of Debt	10 percent
Cost of Equity	15 percent
Debt Term	15 years
Depreciation Term	15 years
Depreciation Schedule	MACRS <sup>b</sup>
Debt Finance	50 percent
Equity Finance	50 percent
Tax Rate	38 percent
Nuclear Fuel Cost	\$4.35 per MWh
Nuclear Fixed O&M Cost	\$60 per kW
Nuclear Variable O&M Cost	\$2.10 per MWh
Nuclear Incremental Capital Expense	\$210 per kW per year
Nuclear Decommissioning Cost	\$350 million
Nuclear Waste Fee	\$1 per MWh

<sup>a</sup>Identical to Table 5-1.

<sup>b</sup>Modified Accelerated Cost Recovery System.

**Table 6: First-Plant LCOEs for Three Reactor Costs, 5- and 7-Year Construction Periods, \$ per MWh, 2003 Prices<sup>a</sup>**

<b>Construction Period</b>	<b>Mature Design FOAKE Costs Paid, \$1,200 per kW Overnight Cost</b>	<b>New Design FOAKE Costs Not Yet Paid, \$1,500 per kW Overnight Cost</b>	<b>Advanced New Design FOAKE Costs Not Yet Paid, \$1,800 per kW Overnight Cost</b>
5 years	47	54	62
7 years	53	62	71

<sup>a</sup>Identical to Table 5-3.

Table 7 presents a full range of LCOEs for first nuclear plants, for alternative construction periods, plant lives, and capacity factors and for each of the three overnight costs specified in Table 5. The table shows the relative importance of the various characteristics for generation cost. Overnight capital cost is clearly most important, but the two-year difference in construction period is nearly as important. If investors were convinced of the likelihood of a 5-year construction period, they would estimate the generation cost of the \$1,800 per kW plant to equal that of the \$1,500 per kW plant built in 7 years; similarly, the \$1,500 per kW plant anticipated to be built in 5 years would have a generation cost nearly that of the \$1,200 per kW plant anticipated to be built in 7 years. Capacity factor also exerts a significant influence on generation cost. However, the effect of longer plant life is relatively minor because these benefits occur in the distant future and are discounted.

**Table 7: Effects of Capacity Factor, Construction Period, and Plant Life on First-Plant Nuclear LCOE for Three Reactor Costs, \$ per MWh, 2003 Prices<sup>a</sup>**

Capacity Factor, Percent	Overnight Cost					
	\$1,200 per kW		\$1,500 per kW		\$1,800 per kW	
5-year construction period						
85	Plant Life		Plant Life		Plant Life	
	40 years	60 years	40 years	60 years	40 years	60 years
	47	47	54	53	62	61
90	44	43	51	50	58	58
95	42	41	49	48	56	55
7-year construction period						
85	Plant Life		Plant Life		Plant Life	
	40 years	60 years	40 years	60 years	40 years	60 years
	53	53	62	61	71	70
90	50	49	58	58	67	66
95	47	47	56	55	64	63

<sup>a</sup>Identical to Table 5-6.

Table 8 presents LCOEs for coal and gas alternatives. Given the capital cost range, the LCOE of new nuclear plants in the absence of federal financial policies is from \$53 to \$71 per MWh with a 7-year construction time. The range is from \$47 to \$62 per MWh with a 5-year construction time. Costs remain above the range of competitiveness with coal and gas generation, which have LCOEs ranging from \$33 to \$45 per MWh. For the \$1,500 and \$1,800 per kW plants, FOAKE costs of roughly \$300 per kW are assumed to be paid off with the first plant, which lowers the LCOE for the second plants by 13 to 15 percent.

**Table 8: LCOEs for Pulverized Coal and Gas Turbine Combined Cycle Plants, \$ per MWh, 2003 Prices<sup>a</sup>**

Coal	33 to 41
Gas	35 to 45

<sup>a</sup>From Tables 5-4 and 5-5.

## **Part Two: Outlook for Nuclear Energy's Competitors**

### **Gas and Coal Technologies**

This study examines the near-term prospects for improvements in gas- and coal-fired electricity generation that would affect their costs relative to nuclear power. Table 9 summarizes the cost estimates, construction times, and thermal efficiencies of fossil-fired electricity generation. Some modest thermal efficiency improvements are foreseen in the near term for gas technologies, but similar improvements for coal technologies appear to be farther in the future. The most common combustion technology used in coal plants recently built in the United States is pulverized coal combustion. Fluidized bed combustion is a cleaner alternative, and the thermal efficiency of most fluidized beds used for power generation is similar to that of pulverized coal. However, the cost competitiveness of fluidized bed combustion remains a question. Integrated coal gasification combined cycle, while attractive from the perspective of thermal efficiency and emissions, is likely to be too expensive to enter the U.S. market in the near term. More advanced coal-fired technologies are still in early R&D stages.

Since fuel costs are generally two-thirds of the levelized cost of gas-generated power, a 5 percentage point increase in efficiency in gas turbine combined cycle plants could decrease the cost of gas-generated electricity by approximately 8 percent.



**Table 9: Cost Characteristics of Fossil-Fired Electricity Generation<sup>a</sup>**

	<b>Pulverized Coal Combustion</b>	<b>Coal, Circulating Fluidized Bed</b>	<b>Coal, Integrated Gasification Combined Cycle</b>	<b>Gas Turbine Combined Cycle</b>
Capital Cost (\$ per kW)	1,189	1,200	1,338	590
Fuel Cost (\$ per MWh)	11.26	12.04	9.44	23.60
Total Operations and Maintenance Cost (O&M) (\$ per MWh)	7.73	5.87	5.19	2.60
Construction time (years)	4	4	4	3
Current Thermal Efficiency (percent)	30 to 35	30 to 35	40 to 45	55 to 60
R&D Thermal Efficiency Targets (percent)	45	45	60	65

<sup>a</sup> Identical to Table 6-6.

### **Fuel Prices**

This study examines forecasts for three fuels: coal, natural gas, and uranium.

#### *Coal and Gas*

Coal supplies worldwide are expected to be sufficiently price elastic that even a doubling of demand would not increase price appreciably. Previous forecasts generally agree that coal production will increase 35 to 50 percent over the next 25 years. Forecasts for the U.S. coal price to utilities uniformly predict a decline of about 10 percent.

Forecasts for natural gas prices are mixed (see Table 10). EIA's forecasts have changed sharply as prices experienced during the base years of 2000 to 2003 have fluctuated considerably. Expressed in 2003 prices, the Lower 48 wellhead price rose from \$3.93 per 1000 cu. ft. in 2000 to \$4.24 in 2001, then fell to \$3.02 in 2002. The 2003 price of \$5.01 was the highest in recent years. EIA's 2003 forecast for 2020, in 2003 prices, was \$3.75, but its 2004 forecast for the same date is \$4.34. The 2002 price of \$3.02 was below both 2020 forecasts, but the 2003 price of \$5.01 was well above both. As Table 10 shows, EIA's 2004 forecast for 2020 was for an 11 percent increase over 2000 prices, equivalent to a 40 percent increase over 2002 prices but a 13 percent decrease from 2003 prices.

**Table 10: Natural Gas Price Projections<sup>a</sup>**

<b>Year</b>	<b>2000<sup>b</sup></b>	<b>2005</b>	<b>2010</b>	<b>2015</b>	<b>2020</b>
NEMS <sup>c</sup> , Lower 48 U.S. Wellhead Price, AEO 2003	100 <sup>d</sup>	75	86	93	96
NEMS <sup>c</sup> , Lower 48 U.S. Wellhead Price, AEO 2004	100 <sup>d</sup>	92	88	109	111

<sup>a</sup>Abridged version of Table 7-2, Year 2000=100.

<sup>b</sup>Year 2000=100.

<sup>c</sup>National Energy Modeling System (NEMS).

<sup>d</sup>\$3.93 per 1,000 cu. ft.

Sensitivity analyses for gas-fired LCOEs use three alternative time paths for natural gas prices. One is an average of the 2001 and 2002 gas price, which results in forecasts for 2010 to 2015 of \$3.39 per MMBtu, assumed constant over the plant life. Another uses the 2003 gas price forecast for 2010 to 2015 of \$4.30, also assumed constant over the plant life. The third uses EIA's 2004 forecast of gas prices from 2015 through the end of the plant life, which begins at \$4.25 in 2015, peaks at \$4.51 in 2021, falls to \$4.48 by 2025, and remains at that level for the remainder of the plant life. All prices are in 2003 dollars.

### *Uranium*

The supply elasticity of uranium is estimated by several sources to be between 2.3 and 3.3, which should be sufficiently large to keep uranium prices down in the range of \$15 per pound over the next several years. Since fuel cost accounts for only about 10 percent of total nuclear generation cost, variation in uranium prices will have only a limited effect on the overall cost of nuclear generation of electricity.

### **Environmental Policies**

As opposed to technology advances and possible fuel price decreases that could reduce coal- and gas-fired costs, environmental considerations could raise the cost of these sources because they emit air pollutants. This study assesses potential cost increases from more stringent environmental compliance for coal- and gas-generated electricity.

- Despite global climate concerns, carbon remains an important but largely uncontrolled emission that could be subject to future controls through carbon capture and sequestration.
- Although the technologies of carbon capture, transport, injection, and sequestration are not yet commercialized, estimates of current and future costs are available.

Assuming 100 km transportation by pipeline, this study reports the following costs per MWh generated:

- \$36 to \$65 per MWh for pulverized coal, including an energy penalty of 16 to 34 percent
- \$17 to \$29 per MWh for gas turbine combined cycle, including an energy penalty of 10 to 16 percent
- \$20 to \$44 per MWh for integrated gasification combined cycle, including an energy penalty of 6 to 21 percent
- An alternative measurement of the future costs of carbon control can be obtained by examining permit markets. In particular, prices generated through permit market trading can be interpreted as the approximate future cost of reducing present emissions. This study uses a carbon price range of \$50 to \$250 per ton to construct upper and lower bounds of the electricity cost impact. For coal-fired electricity, the cost impact is likely to be between \$15 and \$75 per MWh; for gas-fired electricity, the cost impact is likely to be between \$10 and \$50 per MWh. These estimates are subject to significant uncertainty, particularly because of uncertainty about the overall amount of carbon that will be controlled.

### **Part Three: Nuclear Energy in the Years Ahead**

#### **Nuclear Energy Scenarios: 2015**

The year 2015 is chosen as a reasonable year for the first new nuclear plants to come on line, allowing for time lags required for design certification, site selection and planning, licensing, and construction. This study considers the effects of several possible federal policies targeting the first plants.

##### *Individual Federal Financial Policies Considered for the First Plants*

- According to this study's financial model, a loan guarantee of 50 percent of construction loan costs would reduce the nuclear LCOE for the lowest-cost reactor from \$53 to \$49 per MWh (see Table 11).
- Accelerated depreciation would reduce the LCOE for the lowest-cost reactor to \$47 per MWh (see Table 12).
- An investment tax credit of 20 percent, refundable so as to be applicable as an offset to a utility's non-nuclear activities, would reduce the nuclear LCOE to \$44 per MWh for the lowest-cost reactor (see Table 13).

- A production tax credit of \$18 per MWh for the first 8 years (as proposed in 2004 legislation) would reduce the LCOE of the lowest-cost reactor to \$38 per MWh, which is within the required competitive range (see Table 14).

This study uses a 7-year construction schedule because the financial community is likely to assume that duration for the first plants constructed, for financial planning purposes. If shorter construction times are proven with early experience, the construction period used for financial planning would be reduced accordingly for subsequent plants.

**Table 11: Nuclear LCOEs with Loan Guarantees, \$ per MWh, 2003 Prices<sup>a</sup>**

<b>Loan Guarantee Policy</b>	<b>Mature Design \$1,200 per kW</b>	<b>New Design \$1,500 per kW</b>	<b>Advanced New Design \$1,800 per kW</b>
0 (no policy)	53	62	71
25 percent of loan	50	58	67
50 percent of loan	49	57	65

<sup>a</sup>From Table 9-3.

**Table 12: Nuclear LCOEs with Accelerated Depreciation Allowances, \$ per MWh, 2003 Prices<sup>a</sup>**

<b>Depreciation Policy</b>	<b>Mature Design \$1,200 per kW</b>	<b>New Design \$1,500 per kW</b>	<b>Advanced New Design \$1,800 per kW</b>
15 years (no policy)	53	62	71
7 years	50	58	67
Expensing (1 year)	47	54	62

<sup>a</sup>From Table 9-4.

**Table 13: Nuclear LCOEs with Investment Tax Credits, \$ per MWh, 2003 Prices<sup>a</sup>**

<b>Tax Credit Policy</b>	<b>Mature Design \$1,200 per kW</b>	<b>New Design \$1,500 per kW</b>	<b>Advanced New Design \$1,800 per kW</b>
0 percent (no policy)	53	62	71
10 percent	47	55	63
20 percent	44	51	58

<sup>a</sup>From Table 9-5.

**Table 14: Nuclear LCOEs with Production Tax Credits, \$18 per MWh, 8-Year Duration, \$ per MWh, 2003 Prices**

<b>Tax Credit Policy</b>	<b>Mature Design \$1,200 per kW</b>	<b>New Design \$1,500 per kW</b>	<b>Advanced New Design \$1,800 per kW</b>
0 (no policy)	53	62	71
\$18 per MWh, 8-year duration	38	47	56

<sup>a</sup>From Table 9-6.*Combination of Federal Financial Policies and Streamlined Licensing*

While the most of the individual financial policies considered in this study appear to be insufficient to enable nuclear power to enter the marketplace competitively, the financial model indicates that a combination of policies at reasonable levels could do so. As shown in Table 15, an \$18 per MWh production tax credit for 8 years together with a 20 percent investment tax credit could bring the LCOE of the lower-cost reactors (\$1,200 and \$1,500 per kW) within the competitive range with a 7-year anticipated construction time. This policy package would bring the LCOE of the \$1,800 per kW reactor close to the anticipated competitive range with the 7-year construction time and well within it with a 5-year construction period.

**Table 15: Effects of Combined \$18 per MWh 8-Year Production Tax Credits and 20 Percent Investment Tax Credits on Nuclear Plants' LCOEs, \$ per MWh, 2003 Prices**

<b>Mature Design \$1,200 per kW</b>		<b>New Design \$1,500 per kW</b>		<b>Advanced New Design \$1,800 per kW</b>	
<b>Construction Time</b>		<b>Construction Time</b>		<b>Construction Time</b>	
<b>5 years</b>	<b>7 years</b>	<b>5 years</b>	<b>7 years</b>	<b>5 years</b>	<b>7 years</b>
<b>No policies:</b>					
47	53	54	62	62	71
<b>With combination of policies:</b>					
26	31	31	38	37	46

<sup>a</sup>Identical to Table 9-7.*N<sup>th</sup> Plants and Nuclear Competitiveness*

Under aggressive assumptions regarding learning by doing, the LCOE for the fifth plant, when most learning has been achieved, is \$44 per MWh for the lowest-cost nuclear reactor, assuming that for the first plant the business community anticipates a construction period of 7 years and uses a 3 percent risk premium on debt and equity interest rates (see Table 16).

**Table 16: LCOEs for the Fifth Nuclear Plant, with No Policy Assistance, 7-Year Construction Time, 10 Percent Interest Rate on Debt, and 15 Percent Rate on Equity \$ per MWh, 2003 Prices<sup>a</sup>**

Learning Rate (Percent for Doubling Plants Built)	Initial Overnight Cost, \$ per kW	
	1,200 and 1,500	1,800
3	50	58
5	48	56
10	44	52

<sup>a</sup>From Table 9-8.

This study goes on to report LCOEs for the fifth plant assuming that, with favorable regulatory experience, the business community comes to expect a 5-year construction period and more favorable risks, comparable to gas and coal. Under these conditions, the fifth-plant LCOEs for nuclear reactors reach the required range of competitiveness. The two lower-cost nuclear reactors have LCOEs of about \$35 per MWh even under the most pessimistic learning rate (see Table 17). If the reduced risk encourages a higher ratio of debt to equity in financing, LCOEs would be further reduced: by nearly 3 percent with 60 percent debt instead of 50 percent or by 8.5 percent with 70 percent debt instead of 50 percent.

This study found that, even under pessimistic learning assumptions, nuclear power could become self-sufficient in the market after cessation of initial policy assistance if overnight costs were \$1,200 or \$1,500 per kW and a 5-year construction schedule was maintained. Depending on where fossil LCOEs emerge within the ranges calculated here, the \$1,800 per kW nuclear plant could become self-sufficient as well.

**Table 17: LCOEs for the Fifth Nuclear Plant, with No Policy Assistance, 5-Year Construction Time, 7 Percent Interest Rate on Debt, and 12 Percent Rate on Equity \$ per MWh, 2003 Prices<sup>a</sup>**

Learning Rate (Percent for Doubling Plants Built)	Initial Overnight Cost, \$ per kW	
	1,200 and 1,500	1,800
3	35	40
5	34	39
10	32	36

<sup>a</sup>From Table 9-11.

*Robustness of Conclusions*

The results of this study are sensitive to assumptions about overnight costs and plant construction times, but are not very sensitive to assumptions about plant life and capacity factors.

*Environmental Policies for Fossil Generation*

Stringent measures to control greenhouse gases would raise costs for both gas- and coal-fired plants, making nuclear energy easily competitive in the market place, as shown in Table 18.

**Table 18: Fossil LCOEs with and without Greenhouse Policies,  
\$ per MWh, 2003 Prices<sup>a</sup>**

	<b>Under Current Environmental Policies</b>	<b>Under Greenhouse Policy</b>
Coal-Fired	33 to 41	83 to 91
Gas-Fired	35 to 45	58 to 68

<sup>a</sup>Identical to Table 9-12.

**2025 and Beyond**

The long gestation periods involved in nuclear energy research and the long lags entailed in gearing up the nuclear industry to construct new power plants make it prudent to look several decades ahead when making decisions about nuclear energy policy.

*Nuclear Energy Technology.* The importance of cost reductions from first-of-a-kind-engineering (FOAKE) costs and learning by doing beyond FOAKE has been documented in this study. If presently available Generation III technologies are deployed for several years beginning in 2015, as contemplated in this study, significant cost reductions from their replication could extend to 2025 and beyond. Research and development on Generation III and IV designs is expected to allow commercialization of lower-cost reactors in later years.

*Global Warming.* The longer the time horizon, the more likely the United States will place an increased priority on global warming, leading to an urgent need to replace coal- and gas-fired electricity generation. In view of the time it takes to gear up the nuclear industry, the prospect of this need is one of the reasons for national concern with maintaining a nuclear energy capability. If environmental policies greatly restrict carbon emissions in the period after 2025, fossil-fired LCOEs could increase by 50 to 100 percent over current levels. Nuclear power would then acquire an unquestioned cost advantage over its gas and coal competitors.

*Hydrogen.* The widespread introduction of hydrogen-powered vehicles to replace gasoline-powered vehicles would greatly increase the demand for energy to produce hydrogen. Some impacts could occur by 2015, but this study is conservative and does not consider those

impacts when projecting demand for nuclear energy in the 2015 timeframe. If the expressed national commitment to developing a commercially viable hydrogen vehicle proves successful, nuclear power could become a major producer of this transportation fuel. A full analysis of the implications of increased demand for hydrogen is beyond the scope of this study.

Despite the many uncertainties in the future beyond 2025, the findings in this study suggest the likelihood of an increased demand for nuclear energy beyond 2025.

## **APPENDIX**

### **Background**

#### **Purpose and Organization of Study**

This study aims to synthesize what is known about the factors affecting the economic viability of nuclear power and to estimate its viability under a range of future scenarios. The focus is on generating baseload electricity—nuclear, coal-fired, and gas-fired technologies. Renewables are not considered because they are rarely used to meet baseload demand. While hydroelectric facilities supply baseload generation to some parts of the United States, the major opportunities for hydroelectric projects have already been taken.

#### **Electricity Futures**

This study uses two principal types of models to investigate electricity futures:

- *Plant models* calculate the cost of electricity generation from a specific type of power plant. Costs are calculated on a levelized basis (LCOE), combining operating and capital costs to arrive at a cost per megawatt-hour (MWh), that must be recouped in the price of electricity. Costs are calculated at the busbar level in order to focus on electricity generation costs and abstract from locally varying distribution costs.
- *Market models* forecast the demand for electricity and the mix of electricity generating capacity that will come online to meet future levels of expected demand. Aggregate demand and supply functions are estimated and brought together to simulate market behavior, often at the regional level.

Table A-1 summarizes the characteristics of the various plant and market models that are reviewed in this study. The table distinguishes the plant types, forecast horizons, treatments of environmental costs, and nuclear power data sources that have been used.



**Table A-1: Plant and Market Model Summary<sup>a</sup>**

<b>Model Identification</b>	<b>Plant Type</b>	<b>Forecast Horizon</b>	<b>Treatment of Environmental Costs</b>	<b>Source of Nuclear Power Data</b>
<b>Plant Models</b>				
<b>Scully Capital-DOE (Nuclear Energy)</b>	Nuclear (AP1000)	Up to 2010	No	Vendor, 2002
<b>Electricity Generation Cost Simulation Model (GenSim)/Sandia</b>	Wide spectrum of energy sources	Current year	Has capability	Energy Information Administration (EIA) and Platt's (McGraw-Hill) Database, 2003
<b>MIT Study</b>	Nuclear, coal, gas	Up to 2050	Carbon tax	EIA, 2003
<b>Market Models</b>				
<b>National Energy Modeling System (NEMS)-EIA</b>	Wide spectrum of energy sources	20 years from present	No	EIA, 2003
NEMS-Electric Power Research Institute (EPRI)	Nuclear, coal, gas	Up to 2050	Carbon tax	Vendors, 2002
All Modular Industry Growth Assessment Modeling System (AMIGA)/ Pew Charitable Trust	Wide spectrum of energy sources	Up to 2035	Yes	Argonne National Laboratory, Vendors, 2001
Integrated Planning Model (IPM)/Environmental Protection Agency (EPA)	Nuclear, coal, gas	20 years from present	Yes	EIA
<b>Hybrid Models</b>				
<b>Science Applications International Corporation (SAIC) Power Choice Model</b>	Nuclear, coal, gas	80 years from present	Carbon tax	DOE and Vendors, 2001

<sup>a</sup>Identical to Table A2-1.

Within each model category, different underlying numerical assumptions cause the principal differences in electricity cost projections. The most significant of these are differences in capital costs and interest rates for nuclear capacity, capital costs for coal generation, and fuel costs for gas generation. The market models are sufficiently complex that reasons for differences in their projections frequently are difficult to pinpoint. Plant models are better suited for studying the economic viability of nuclear energy. However, while the plant model structures are straightforward, documentation of underlying data is not always sufficient to allow detailed economic analysis. Four of the plant models, identified in bold font in Table A-1, are used for comparison purposes later in this study: the Scully model, GenSim, NEMS, and SAIC's Power Choice model.

### **Need for New Generating Capacity in the United States**

This study analyzes future electricity demand and compares it with existing capacity to estimate a future time range when construction of added capacity must start. Projections by EIA and the North American Electric Reliability Council (NERC) are compared with projections based on historical relationships between electricity demand growth and gross domestic product (GDP) growth. The historical relationships estimated for this study imply electricity demand growth rates that are roughly one percentage point higher than EIA's forecasts and a half percentage point above NERC's forecasts. From a national perspective, even with an annual growth rate in electricity demand of 2.7 percent, which is above the EIA and NERC forecasts, new capacity will not be needed before 2011. On a regional basis, new capacity may be required as early as 2006. (See Appendix A3, "Need for New Generating Capacity in the United States.")

### **Major Issues Affecting the Nuclear Power Industry in the U.S. Economy**

#### **Technologies for New Nuclear Facilities**

The nuclear reactors currently in use in the United States, denoted as Generation II, were deployed in the 1970s and 1980s. They include boiling water reactors and pressurized water reactors. Advanced modular reactor designs are denoted as Generation III. Some have passive safety features, and all have been developed to be more cost competitive. Generation III designs include the ABWR design and the pressurized water reactor, both of which use passive safety systems; they also include the AP600/AP1000 and the light-water-cooled heavy-water-moderated CANDU ACR-700. The nuclear industry has continued to develop yet more innovative Generation III+ designs. Generation III+ designs may have lower generating costs than Generation III designs, but the U.S. Nuclear Regulatory Commission (NRC) has not yet certified them, and their cost estimates have greater uncertainty. DOE is developing Generation IV nuclear energy systems that use even more advanced designs intended to further reduce life cycle costs.

Table A-2 summarizes the characteristics and NRC certification status of the reactor designs reviewed in this study.

**Table A-2: Summary of New Reactor Designs<sup>a</sup>**

<b>Design</b>	<b>Supplier</b>	<b>Size and Type</b>	<b>U.S. Deployment Prospects and Overseas Deployment</b>	<b>NRC Certification Status</b>
<b>ABWR</b>	General Electric	1,350 MW BWR	Operating in Japan, under construction in Taiwan.	Certified in 1996.
<b>AP1000</b>	Westinghouse	1,090 MW PWR	Additional design work to be done before plant ready for construction.	Design certification expected September 2005.
<b>SWR 1000</b>	Framatome Advanced Nuclear Power (ANP)	1,013 MW BWR	Under consideration for construction in Finland, designed to meet European requirements.	Submission of materials for pre-application review to begin in mid-2004. Pre-application review completion expected 2005.
<b>CANDU ACR-700</b>	Atomic Energy Company, Limited (AECL) Technologies Inc., U.S. subsidiary of AECL	753 MW HWR	Deployed outside Canada in Argentina, Romania, South Korea, China, and India.	Pre-application review scheduled to be completed by NRC, June 2004.
<b>AP600</b>	Westinghouse	610 MW PWR	Additional design work to be done before plant ready for construction.	Design is certified, but actual construction will be superseded by AP1000.
<b>Simplified Boiling Water Reactor (ESBWR)</b>	General Electric	1,380 MW BWR	Commercialization plan not likely to support deployment by 2010.	Pre-application review completion expected in early 2004. Application for design certification to be submitted mid-2005.
<b>PBMR</b>	British Nuclear Fuels (BNFL)	110 MW Modular pebble bed	No plan beyond completion of South African project.	Pre-application review closed September 2002 with departure of Exelon.
<b>GT-MHR</b>	General Atomics	288 MW Prismatic graphite	Licensed for construction in Russia.	Design certification application would begin by end of 2005.
<b>International Reactor Innovative and Secure (IRIS) Project</b>	Westinghouse	100 to 300 MW PWR	Plans to deploy between 2012 and 2015.	Design certification review to begin 2006.
<b>European Pressurized Water Reactor (EPR)</b>	Framatome-ANP	1,545 to 1,750 MW PWR	No decision on U.S. market.	Ordered for deployment in Finland.
<b>System 80+</b>	Westinghouse	1,300 MW PWR	Plants built in Korea. Design not planned to be marketed in United States.	Certified May 1997.
<b>Advanced Fast Reactor; Power Reactor Innovative Small Module (AFR; PRISM)</b>	General Electric, Argonne National Laboratory	300 to 600 MW, sodium-cooled	Began certification in the 1990s.	No action taken.

<sup>a</sup>Identical to Table A4-2.

### Nuclear Fuel Cycle and Nuclear Waste Disposal

This study analyzes the economic costs of nuclear power contributed by the nuclear fuel cycle. It also considers two options for spent fuel disposition: (1) on-site storage followed by centralized disposal and (2) on-site storage and reprocessing, followed by centralized disposal. Recycle of mixed-oxide fuel was not considered. The front-end costs of nuclear fuel are relevant regardless of which disposition alternative is used. As shown in Table A-3, these costs amount to \$3.50 to \$5.50 per MWh or 5 to 12 percent of the cost of nuclear power generation. In the United States, the direct method of spent fuel disposal has been used to date, without reprocessing of spent fuel. The costs of disposal consist of on-site storage costs while awaiting permanent storage, plus a charge levied to pay for eventual permanent storage or disposal at a centralized site. The back-end costs are about \$1.10 per MWh, as shown in Table A-4, which is about 2 percent of the overall LCOE. Plausible differences in fuel cycle costs are not a major factor in the economic competitiveness of nuclear power.

**Table A-3: Components of Front-End Nuclear Fuel Costs, \$ per kg U, 2003 Prices<sup>a</sup>**

Process Step	Direct Outlays	Interest Cost	Total Cost
Ore Purchase	222 to 353	94 to 150	316 to 503
Conversion	40 to 94	15 to 35	55 to 129
Enrichment (per kg SWU)	606 to 951	197 to 306	804 to 1,259
Fabrication	193 to 250	54 to 69	246 to 319
<b>Total</b>			<b>1,420 to 2,209</b>
<b>\$ per MWh</b>			<b>3.56 to 5.53</b>

<sup>a</sup>Abridged version of Table A5-1.

**Table A-4: Disposal Costs, \$ per MWh, 2003 Prices<sup>a</sup>**

Fuel Cycle Component	No Reprocessing
Temporary on-site storage	0.09
Permanent disposal at Yucca Mountain	1.00
Total	1.09

<sup>a</sup>Identical to Table A5-2.

### Nuclear Regulation

Federal Regulation 10 CFR Part 52 was adopted in the 1990s. It provides for combined construction and operation permitting and is aimed at streamlining the permitting process. The combined Part 52 license is designed to allow investors to resolve many historically important uncertainties before committing large amounts of money to a nuclear facility. This study analyzes the economic advantages that such regulatory streamlining can provide, both directly by

reducing construction delays, and indirectly by reducing the risk premium necessary to compensate investors for possible delays or cancellations due to regulatory difficulties. For example, as more new nuclear plants are built well beyond 2015, this study finds that mature designs already in operation could generate energy that could be competitive with gas-fired electricity, if the nuclear licensing period could be reduced to five years (see Table 17 above).

### **Nonproliferation Goals**

This study reviews international arrangements aimed at preventing nuclear proliferation. Some countries have chosen direct disposal of spent nuclear fuel, while others have chosen recycling of spent fuel. In the United States, policy decisions regarding direct disposal versus recycling must be reviewed when DOE considers a second repository. By statute, DOE must report to Congress on or after January 1, 2007, but not later than January 1, 2010, on the need for a second repository. (See Sec. 161(b), P.L. Law 97-425.) The uranium extraction (UREX) process was developed as a variant of plutonium-uranium extraction (PUREX). DOE is currently conducting R&D on further recycling technologies, including pyrometallurgical processing. In the future, an innovative fuel cycle that strongly resists nuclear proliferation, such as pyrometallurgical processing, will be pursued. The President recently announced a policy to cap the deployment of new reprocessing technologies outside a select group of countries. Nevertheless, the future economic viability of nuclear power does not depend on decisions about direct disposal versus reprocessing. As Appendix A6 shows, differences in the cost of nuclear waste handling between these two alternatives is too small to materially affect the economic viability of nuclear power.

### **Hydrogen**

This study reviews the prospects of hydrogen as a transportation fuel that would reduce U. S. dependence on foreign oil and could have potentially large environmental benefits. Mass production costs need to be reduced by roughly one-half to two-thirds to achieve widespread adoption of hydrogen vehicles. The environmental benefits of hydrogen would be tempered to the extent that fossil fuels, with their attendant carbon emissions, were used to produce the hydrogen. Carbon emissions from oil would then simply be replaced by emissions from fossil-fuel power generation or steam methane reforming. Nuclear energy, on the other hand, would provide a pollution-free input to hydrogen production. A hydrogen economy, accompanied by more stringent control of carbon emissions, could greatly expand the demand for nuclear power.

### **Energy Security**

This study considers the energy security benefits of nuclear power as a potential source of hydrogen to replace oil in the transportation sector and more generally as a substitute for gas-generated electricity. Energy security has been analyzed primarily in connection with oil and the political instability of the Middle East. A direct link to electricity is limited by the small amount of electricity produced using oil. However, nuclear energy could help ease oil security concerns if hydrogen is cogenerated for transportation. Currently, the United States imports about 4 percent of its natural gas consumption in the form of liquefied natural gas (LNG), but that percentage could grow if many new gas-fired electricity generating plants are built and if North

American gas production expands only sluggishly. As international trade in LNG becomes more extensive and the United States imports increase, this energy security linkage could become more important, if nuclear electricity substitutes directly for gas-generated electricity.

This study considers potential supply and demand shocks from environmental, national security, and other risks affecting choices among electricity generation technologies. Maintaining some nuclear capacity now could avoid a costly and lengthy adjustment of gearing up a nuclear industry that might otherwise be in a run-down condition. This study uses a decision-making model to develop a numerical example of a portfolio of fossil and nuclear electrical generating capacity. In this example, 25 percent of new capacity would be nuclear. Further research is needed to refine this analysis.

