

7.9S Data Communication Systems

7.9S.1 Description

This section addresses both the essential (safety-related) and non-essential (nonsafety-related) data communication functions, as specified in RG 1.206, that are part of or support the instrumentation and control (I&C) systems described in Sections 7.2 through 7.8. This includes data communication between systems and between divisions within a system. Communication within a system is an integral part of that system.

The Data Communication Functions (DCF) of the Reactor Trip and Isolation System (RTIS), Neutron Monitoring System (NMS), and ESF Logic and Control System (ELCS) are required to support the safety-related functions of these systems. The DCFs of these systems are an integral part of these systems.

The majority of the non-essential data communications are performed through a plant-wide distributed data network defined as the Plant Data Network (PDN). The PDN provides the distribution of process and other data required to support the nonsafety-related operational functions.

Figure 7.9S-1 provides an overview of the ABWR data communication configuration.

7.9S.2 Data Communication Functions (DCF) of the SSLC Systems

7.9S.2.1 Safety-Related Functions

The DCFs associated with the Safety System Logic and Control (SSLC) systems perform data collection and data distribution using ~~independent distributed data acquisition and control networks~~ both local and remote data acquisition and control units connected by dedicated data links and/or networks for each of the following systems, segments, and divisions:

- RTIS (4 divisions)
- NMS (4 divisions)
- ELCS (4 divisions), including the safety-related Main Control Room panel displays

7.9S.2.2 Nonsafety-Related Functions

The safety-related digital systems described here also provide the following nonsafety-related communication functions:

- Provide alarm and status data from safety-related plant sensors and the SSLC systems to the nonsafety-related Plant Information and Control System (PICS) for Main Control Room (MCR) indication and computer logging through isolated gateway interfaces and the PDN.
- Provide selected safety-related plant process data to the nonsafety-related control systems through isolated gateway interfaces. The interconnection of Class 1E

communication to non-Class 1E devices is done using fiber optic cable. The fiber optic cable provides the necessary electrical isolation. Communication to nonsafety-related systems are controlled by the safety device to assure no communication task will interfere with the safety system performing intended functions.

- Provide for the communication of the LPRM and APRM calibration data from the nonsafety-related core monitor function of PCIS to the NMS. Plant personnel action to manually accept the data transfer to the operational safety side is required for such data to be accepted. ~~The nonsafety-related system can request certain LPRM performance data. NMS provides the data only when it has no impact on the performance of safety functions.~~
- ~~Provide selected LPRM calibration data from individual LPRMs to the core monitor provided that NMS determines that collection and transmission of this data does not impact the APRM operability or performance of the NMS safety functions.~~

7.9S.2.3 Communications Within a Division

~~The safety-related data communication is based on high-speed networks that use a reflective memory type network communication design, employing redundant, counter-rotating, fiber optic based rings. Each processing node on a network has associated with it, a reflective memory network communication module that holds the current data values of signals from processors on the same network. A processor writes its current data values to its own reflective memory communication module and reads current data values from other processors on the network.~~

~~The data from each processor's reflective memory communication module is written (transmitted) to the other reflective memory communication modules on the same network on a fixed deterministic frequency. This assures that sensor data and control data are guaranteed network access without interference from other network traffic. Data communication between the reflective memory communication modules is done over dual, fiber optic based rings, using a counter rotation transmission. This assures that data continues to be written to the reflective memory communication modules on the network even in the event that both of the communication paths fail at the same location. These features assure that the data communication is highly reliable (fault-tolerant) and deterministic.~~

The safety-related data communication is based on serial, point-to-point data transmission. The transmission is purely unidirectional without acknowledgment from the other side. The transmitting and receiving devices are optically isolated from each other. The integrity of the links and the data transmitted is monitored by the receiver. The data transmission cycle time is fixed and the communication is deterministic. Self diagnostics are used to monitor the proper operation of data links.

Use of a system or segment data communication ~~network~~function to communicate command and control signals to final actuators varies by each system or segment. ELCS provides control signals to remote input/output devices through its data communication ~~network~~links. RTIS inputs and control outputs are directly connected to

field devices, ~~thereby bypassing its data communication network~~. NMS provides no control signals to final actuators, but does provide direct connected trip data to RTIS ~~over direct point-to-point communication interfaces.~~

Safety-related data communication is used by RTIS and NMS to transmit safety related display information to the ELCS.

The ELCS utilizes a deterministic network within each division to support main control room safety related displays and maintenance and test functions.

~~Input and output signals between field devices as well as data from intermediate system functions are made available to other processors on the divisional networks. The networks provide both local and remote communication capabilities. In some cases, such as Turbine Building sensor inputs to the RTIS, the sensor signals are connected directly to input modules located in the same chassis as the system logic processors, thereby bypassing the communication network.~~

7.9S.2.4 Communications Between Divisions

~~Limited~~ For RTIS and ELCS, limited communication between divisions is necessary. For example, individual divisional input trip determinations must be shared between divisions in order to support two-out-of-four voting for divisional trip outputs. To support this, there are a limited set of dedicated data communication links from each division to each of the other three divisions. The links provide a qualified and isolated, point-to-point, single direction communication path between divisions so as to preserve divisional independence.

~~In other cases, such as the Startup Range Neutron Monitor (SRNM) and Power Range Neutron Monitor (PRNM) in the NMS, the data acquisition and primary signal processing including two out of four voting is performed internal to the NMS prior to providing data and calculational results to the RTIS. The data communication from the NMS to the RTIS is done through a point to point communication paths (one for each division) totally independent of the normal interdivisional communication functions. The NMS does not rely on data communication between divisions.~~

7.9S.2.5 Design-Basis Information

The safety-related DCFs have the following safety design basis:

- Provide for the transmittal of data between input/output (I/O) devices, (locally and remotely) and controllers. This allows process information, equipment status information, and operator input to be made available to controllers for the processing of safety-related control functions, and making the controller output information available to I/O devices for distribution to final actuators and operator interfaces.
- Provide for the transmittal of data between divisions or from safety-related systems to nonsafety-related systems through qualified isolation devices such as fiber optic-~~base~~ communication.

- Provide data communication that is predictable and verifiable (deterministic) and that does not compromise the functionality of either the transmitting or receiving system.

7.9S.2.5.1 Quality of Components and Modules

Applicable quality assurance provisions of 10 CFR 50 Appendix B, IEEE-603 and IEEE-7-4.3.2 are applied to the SSLC systems, of which the DCFs are integral parts.

7.9S.2.5.2 Software Quality

Development of software for the safety system functions within the SSLC systems, including their DCFs, conforms to the guidance of IEEE-7-4.3.2 and Branch Technical Position BTP- HICB-14 as discussed in Appendix 7B to this chapter.

7.9S.2.5.3 Protocol Support of Performance Requirements

The real-time performance of SSLC systems, including their DCFs, in meeting the requirements for safety system trip and initiation response conforms to BTP-HICB-21. Each ~~controller~~communication interface operates independently and asynchronously with respect to other ~~controllers~~communication interfaces. Maximum time delay from input to output is deterministic, based on the control logic and communication ~~network~~ design. Data rates (bandwidth) are constant as the communication modules provide the same data elements to each destination at the prescribed frequency ~~through reflective memory. The ability for systems to read the memory is independent of the timing of the writing function.~~ Timing signals are not exchanged between divisions of independent equipment or between controllers within a division. Timing requirements of IEEE-603 are also met.

7.9S.2.5.4 Reliability

~~The fault tolerant network architecture and extensive self testing by the processors of the SSLC system~~The simplicity of the communication design, combined with self diagnostics make the DCFs of the SSLC highly reliable. The two-out-of-four logic prevents any single error from causing or preventing an actuation of functions.

~~The dual counter rotating fiber optic ring structure allows communication to continue in the event of any single failure.~~ Errors are detected by self-check logic diagnostic tests including verifying checksums and verifying values are within allowable range. Upon error detection, the alternate ring data is used. (i.e. checksum, parity check, or reception of a keep-alive signal). Should data not be available, the logic takes predetermined action based on the specific data involved.

7.9S.2.5.5 External Access Control

There are no unprotected electronic paths by which unauthorized personnel can change plant software or display erroneous status information to the operators. Interfaces external to the plant are through ~~firewalls~~security protected interfaces that allow communication between the nonsafety PDN to the offsite Emergency Operations Facility (EOF). Although the EOF Workstation contains login protection (passwords or

other protective measures), the data access control resides in the site ~~firewalls~~security protected interfaces and data servers.

The SSLC DCFs are additionally protected by gateways to the nonsafety PDN that only allow one-way data transfer from the safety to nonsafety network. The SSLC networks have no direct external electronic paths.

7.9S.2.5.6 Single Failure Criterion

The DCFs of the SSLC systems satisfy the requirements of the single-failure criterion through conformance to IEEE-603, IEEE-379 and Regulatory Guide 1.53. ~~There are four independent safety-related communication networks in each of the three independent safety-related systems for ELCS, RTIF and NMS. Each communication network corresponds to a division within each system. Communication between divisions preserves divisional independence such that a failure in one division does not affect other divisions.~~

7.9S.2.5.7 Independence

The DCFs of the SSLC systems satisfy the requirements for independence through conformance to Clauses 4.6 and 4.7 of IEEE-279, IEEE-384, IEEE-603, and Regulatory Guide 1.75. Divisions are physically separated and electrically isolated from each other. Divisions have separate power sources. Transmission of logic signals between divisions is through qualified isolation devices.

NMS ~~and RTIF~~ can receive calibration data from nonsafety-related maintenance support systems. On a divisional level, a division must be manually placed in inop and manually verified and accepted before such data is allowed in the portion of the device performing the safety function. Only limited data in a strict format will be accepted by the safety device.

To meet the requirements of IEEE-384 and Regulatory Guide 1.75, the protective covering of the fiber optic-based cables are flame retardant. The cables are passed through physical, safety class barriers, where necessary, for separation of Class 1E circuits and equipment from other Class 1E equipment or from non-Class 1E equipment. The DCF equipment is kept physically separate to minimize the effects of design basis events. During operations, the functionality of the DCFs of SSLC, NMS and ~~RTIF~~RTIS is independent of nonsafety systems.

7.9S.2.5.8 Protection System Failure Modes

The RTIS and NMS systems are designed to fail into a safe state upon loss of communications. ELCS fails as-is during communication failure, that is, system controllers continue to operate based on the last command.

7.9S.2.5.9 Testing and Surveillance

The safety-related DCFs are integral functions of the SSLC systems. SSLC ~~self~~ testing features and surveillances encompass those related to the DCFs. ~~Self test~~SSLC testing and surveillance is covered in 7.1.2.1.6.

7.9S.2.5.10 Bypass and Inoperable Status Indications

The safety-related DCFs are integral functions of the SSLC systems. SSLC bypass and inoperable status indications encompass those related to the DCFs that provide information for compliance with RG 1.47.

7.9S.2.5.11 Isolation Protection

Fiber optic-based isolation devices are expected to have less difficulty than previous isolation devices in complying with all qualification requirements due to their small size, low mass, and simple electronic interfaces. The basic materials and components, except for the fiber optic cable itself, are the same as those used in existing, qualified isolation devices. A major advantage of fiber optics is that signals can be transmitted long distances and around curves through the isolating medium; thus, the physical, safety-class barrier required for separation of Class 1E devices may be provided by just the cable length if the protective covering and any fill materials of the cable are made properly flame-retardant. For short distances, the fiber optic cable can be fed through a standard safety class structure.

7.9S.2.5.12 Diversity and Defense-in-Depth

Diversity and defense-in-depth is covered in Appendix 7C. FMEA is discussed in Appendix 15B.

7.9S.2.5.13 Seismic Hazards

All of the equipment implementing the DCFs of the SSLC is located in Seismic Category I structures and meets RG 1.100 and IEEE 344.

Fiber optic isolation devices are expected to have less difficulty than previous isolation devices in complying with all qualification requirements due to their small size, low mass, and simple electronic interfaces. The basic materials and components, except for the fiber optic cable itself, are the same as those used in existing, qualified isolation devices.

7.9S.2.6 Analysis

7.9S.2.6.1 General Requirements Conformance

The ELCS, RTIS and NMS each have safety-related data communication functions for data collection and data distribution. Each system provides four independent ~~data-acquisition-and-control networks~~ **communication functions** to serve the four divisions of plant protection and safety systems and safety-related display systems. These communication ~~networks~~ **functions** are classified as safety-related since they are considered integral parts of the safety-related systems that they serve.

7.9S.2.6.2 Specific Regulatory Requirements Conformance

The safety-related DCFs are integral functions of the SSLC systems. Conformance to specific regulatory requirements related to the DCFs is addressed in the sections related to the SSLC systems.

7.9S.3 Plant Data Network (PDN)

7.9S.3.1 Plant Data Network (PDN) Functions

The PDN provides a plant wide, highly reliable, high speed data communication network for plant control, monitoring, and other related operational needs.

The PDN is nonsafety-related and supports the collection and distribution of data for multiple systems using a layered network design. A control layer is designated for systems and information that directly impact plant operation. The PDN has other communication layers that support other selected nonsafety-related functions.

The control network supports data communication between:

- Process I/O units, controllers, engineering workstations
- Network monitoring, historical data storage units, control building workstations
- Main control room panel displays and workstations that support the operator interfaces
- Printers
- Safety-related network gateways that support the one-way acquisition of data from the safety systems for plant data historian recording and for use on nonsafety displays.

The PDN supports data communication to workstations for the Technical Support Center (TSC), the Emergency Operations Facility (EOF) and other external data users (e.g., engineering offices). ~~Outside~~External connectivity is limited and only provided from the network through ~~managed firewalls~~a security protected interface.

The PDN is designed around a fully redundant, fiber-optic based backbone. The backbone is defined as the cabling between the core switches and between the core and zone switches. The PDN provides sufficient throughput capacity to support all of the data communication needs including the PICS needs to acquire, process and store data at the required scan and processing rates from available data sources, as well as support displays.

7.9S.3.1.1 PDN System Interfaces

The PDN ~~control network~~ interfaces with the controllers, gateways, communication interface modules, engineering workstations, main control panel workstations and printers through zone switches. The ~~control network~~PDN also interfaces with the ELCS and ~~RTI~~RTIS through isolated gateways that only allow one-way data transfer from the ELCS and ~~RTI~~RTIS to the PDN. The isolation method is through the use of fiber optic-based communication that does not have the capability of receiving communications from the transmitting source. Interface to the NMS is explained in 7.9S.2.2.

~~An external modem access is allowed to the nonsafety-related Core Monitoring program. This modem is not normally in use and not physically connected. It is only used under strict procedural control for specific limited time periods to support required maintenance. Multiple security levels are employed to prevent unauthorized access or use.~~

The PDN also interfaces with the TSC and EOF through a security protected interface ~~and firewalls.~~ for example a firewall.

7.9S.3.1.2 PDN Classification

The PDN is classified as nonsafety-related. The PDN is essential to power generation through its data communication support of operation and the power generation systems control and monitoring functions performed by other equipment.

7.9S.3.1.3 PDN Power Sources

Two separate Non-Class 1E feeds from the Non-Class 1E 120 Vital AC (VAC) or 125 VDC systems power the PDN. This redundancy allows the PDN to operate such that any single failure in the system power supplies will not cause the loss of data communications to the interfacing systems or equipment.

The power sources automatically switch over upon failure of one power source or power supply module.

7.9S.3.1.4 PDN Equipment

PDN hardware includes core switches, zone switches, ~~firewalls~~ security devices, mounting cabinets, patch panels, fiber-optic cables and associated junction boxes and cable supports.

7.9S.3.1.5 PDN Testability

Network monitoring is an integral part of the PDN and provides the capability to continuously monitor network operation and performance. Network monitoring workstations allows system management, test, and control of the PDN functions.

7.9S.3.1.6 PDN Environmental Considerations

The PDN is designed to operate in the normal plant environment where it is located. Its support function serves power generation purposes only. It is not required for safety purposes and is not required to operate after a design basis accident.

7.9S.3.1.7 PDN Operational Considerations

No operator actions are required since the system is capable of self-starting following power interruptions, or any other single failure, including any single switch failure. After repairs or replacements are performed, PDN equipment automatically re-initializes to normal status when power is restored.

7.9S.3.1.8 PDN Operator Information

The self-test provisions of the PDN are desired to alert the operator to system anomalies via alarms. Problems ~~significant enough to cause system channel failures~~ are alarmed ~~separately from those that allow continued operation~~. The system is designed such that no control output or alarm is inadvertently activated during system initialization or shutdown.

7.9S.3.2 PDN Design Basis Information

The PDN has no safety design basis.

General Design Functions

The PDN provides a plant wide distributed data communication networks to support the plant control and monitoring (nonsafety-related) systems. The PDN includes the active electrical components and connectivity (such as switches and cabling), between the components defined by other plant systems. The PDN also includes the associated communication software required to support its function of providing plant-wide data for distributed control and monitoring.

The PDN is the means by which process data is distributed to the various nonsafety-related plant control and information systems requiring data and to the main control room for processing and display.

(1) System Interface

The PDN control network interfaces with nonsafety-related controllers, gateways, communication interface modules, engineering workstations, main control panel workstations, and printers through zone switches.

(2) Classification

The PDN, of itself, is neither a power generation system nor a protection system. It is a data communication network utilized for transmission of data for power generation (nonsafety-related) systems. It is classified as nonsafety-related.

(3) Power Sources

The PDN receives its power from two separate non-Class 1E distribution panels from the non-Class 1E 120 VAC UPS and 125 VDC. This redundancy allows the PDN to supply dual logic functions such that any single failure in the system power supplies will not cause the loss of the validated outputs to the interfacing actuators and to the monitors and displays.

(4) Equipment

The PDN hardware is comprised of fiber optic-based or direct connection cabling, switches, ~~firewalls~~ security devices and gateway devices. These interface with the PICS control devices and gateways.

(5) Diagnostics and Testability

The PDN contains built in, continuously running, self-diagnostic capabilities to sense and correct or block data and device errors. Faults or problems are logged and alarmed ~~based on their importance~~.

(6) Environmental Considerations

The PDN is not required for safety purposes, nor is it required to operate after the design basis accident. Its support function serves power generation purposes only and it is designed to operate in the normal plant environment.

(7) Operational Considerations

The PDN automatically initiates for both cold and warm starts. No operator actions are required in that the PDN is capable of self-starting following power interruptions, or any other single failure, including any single processor failure. After repairs or replacements are performed, the PDN automatically re-initializes to normal status when power is restored to any unit and automatically resets any alarms.

(8) Operator Information

The self-test provisions are designed to alert the operator to system anomalies via interfaces with the PICS. The circuitry is designed such that no communication is inadvertently activated during network initialization or shutdown. For such events, control outputs change to predetermined fail-safe outputs.

The PDN has the following nonsafety-related design bases:

Transmits data between controllers.

Allows for process and equipment status information and operator input to be available to controllers for the processing of nonsafety-related control functions.

Provides for the receipt of data from the safety-related DCFs through isolated gateway interfaces to nonsafety-related workstations, controllers and historians for the purposes of display and alarm to operators, transient analysis and sequence-of- events recording and nonsafety-related control functions.

Provides for the transmission of data to interfaces with the Technical Support Center (TSC) and Emergency Operations Facility (EOF).

7.9S.3.3 Analysis

7.9S.3.3.1 General Requirements Conformance

The PDN constitutes neither a power generation system nor a protection system, by itself. It is a support function utilized for the transmission of data for power generation (nonsafety-related) systems and their associated sensors, actuators and interconnections. The PDN equipment is classified as nonsafety-related and does not interface with any engineered safeguard or safety-related system except for the reception of isolated signals for alarm, display or nonsafety-related control purposes except those discussed in 7.9S.2.1.2. The PDN supports power generation systems. As such, it meets the same functional requirements imposed on those systems. Although not required to meet the single-failure criterion, the PDN equipment is redundant and receives its power from redundant, highly reliable power sources such that no single failure will cause its basic function to fail.

The PDN equipment and software is also diverse from those implementing the safety-related DCFs of the SSLC systems (different hardware and/or software) to minimize the effect of common-mode failures as discussed in IEEE-4.3.2-7.4.3.2, Criteria for Digital Computers in Safety Systems of Nuclear Power Generating Stations.

7.9S.3.4 Specific Regulatory Requirements Conformance

Table 7.1-2 identifies the nonsafety-related control systems and the associated codes and standards applied in accordance with Section 7.9 of the Standard Review Plan. It provides specific enhancement for control systems in their conformance with GDCs 13 and 19.

Legend:

APR – Auto Power Regulator
 ATLM – Auto. Thermal Limit Monitor
 CI – Communications Interface
 DPU – Digital Processing Unit
 DTF – Digital Trip Function
 ELCS – ESF Logic & Control System
 EOF – Emergency Operations Facility
 ESF – Engineered Safety Functions
 GW – Gateway
 I/O – Plant Input & Output Units
 LT – Level Transmitter
 LV – Level Control Valve
 MCC – Motor Control Centers
 MCP – Main Control Panel
 MRBM – Multichannel Rod Block
 MTP – Maintenance & Test Panel
 NMS – Neutron Monitoring System
 NBS – Nuclear Boiler System
 OLU – Output Logic Unit
 PDN – Plant Data Network
 PICS – Plant Information & Control Sys.
 PRNM – Power Range Neutron Monitor
 RCIS – Rod Control & Info. Sys.
 RDLC – Remote Digital Logic Controller
 RFC – Recirculation Flow Control
 RPS – Reactor Protection System
 RTIS – Reactor Trip & Isolation Sys.
 RWM – Rod Worth Minimizer
 SLF – Safety Logic Functions
 SPTM – Suppression Pool Temp. Monit.
 SRNM – Startup Range Neutron Monitor
 TLF – Trip Logic Function
 TSC – Technical Support Center

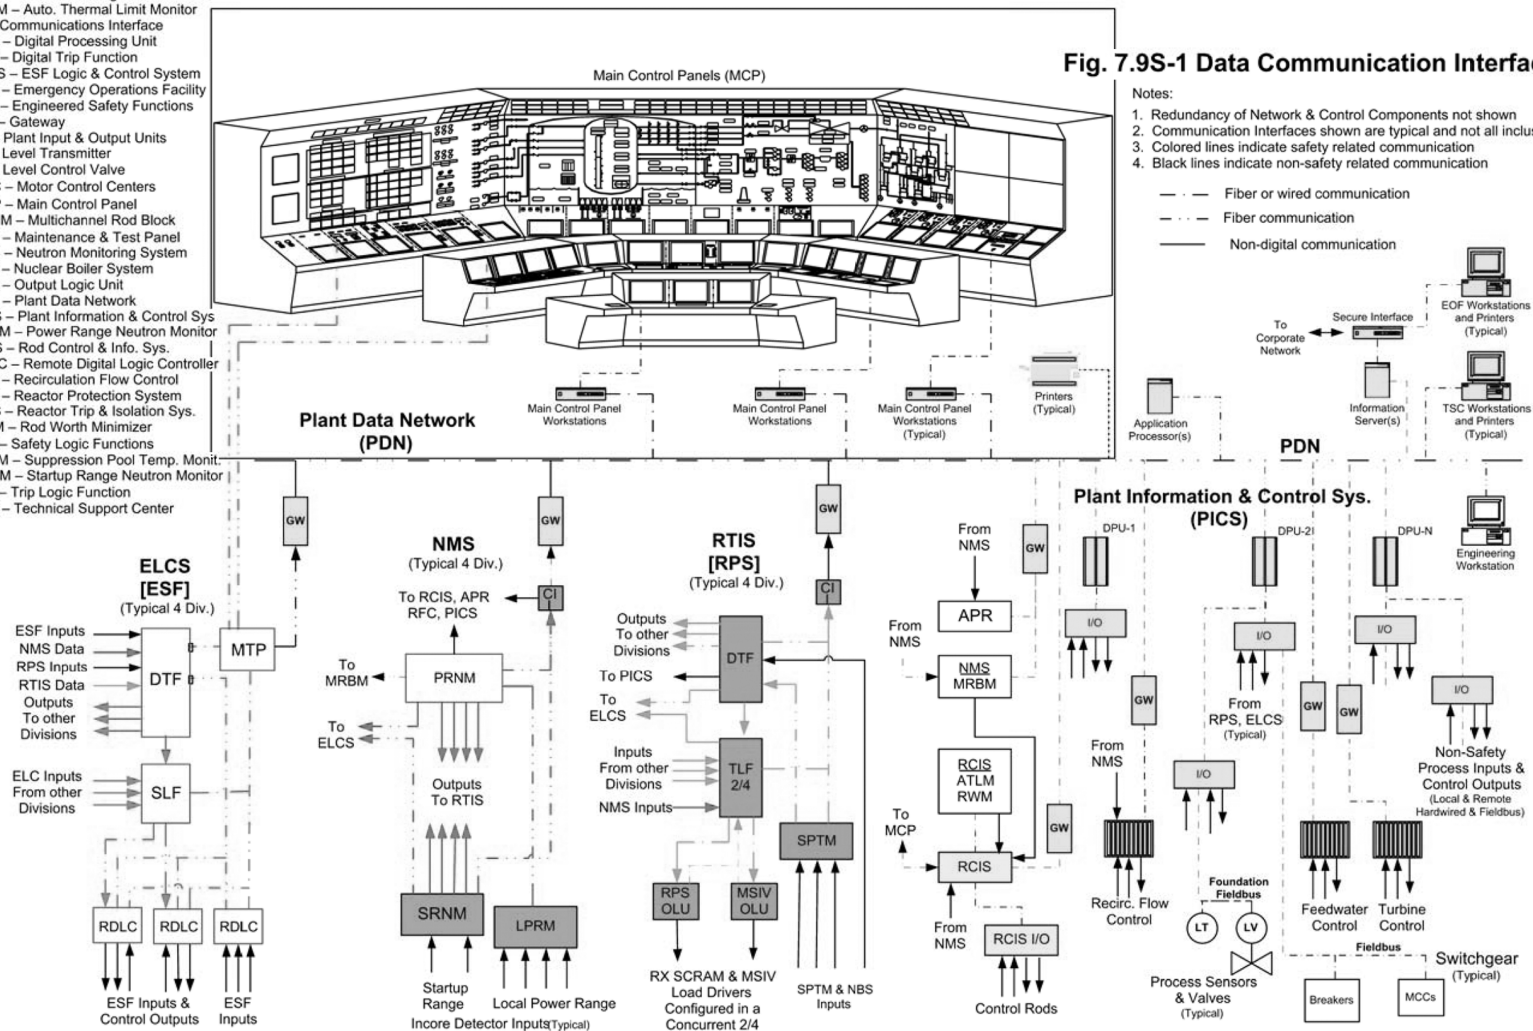


Fig. 7.9S-1 Data Communication Interfaces

Notes:

1. Redundancy of Network & Control Components not shown
2. Communication Interfaces shown are typical and not all inclusive
3. Colored lines indicate safety related communication
4. Black lines indicate non-safety related communication

— — — Fiber or wired communication
 - - - Fiber communication
 — — — Non-digital communication

Figure 7.9S-1 Data Communication Interfaces